



February, 19 2010

TRANSMITTAL LETTER

TO: Rick Jones
 City of Dover, NH

DATE: March 1, 2010
 FROM: _____
 PROJECT: _____
 PROJECT #: _____

We are sending you: Enclosed/Attached Under Separate Cover

- | | | |
|---|--|--|
| <input type="checkbox"/> Shop Drawings | <input type="checkbox"/> Product Data Sheets | <input type="checkbox"/> Copy of Letter |
| <input type="checkbox"/> Plans | <input type="checkbox"/> Copy of Letter | <input checked="" type="checkbox"/> Submittals |
| <input type="checkbox"/> Specifications | <input type="checkbox"/> Samples | <input type="checkbox"/> Operations & Maint. Manuals |
| <input type="checkbox"/> Damper Schedules | <input type="checkbox"/> Room Schedules | <input type="checkbox"/> Device Schedules |
| <input type="checkbox"/> Valve Schedules | <input type="checkbox"/> Door Schedules | <input type="checkbox"/> _____ |

This material/information is being sent:

- | | | |
|---|---|--|
| <input type="checkbox"/> per your request. | <input type="checkbox"/> for your record purposes | <input type="checkbox"/> for correction & resubmittal. |
| <input checked="" type="checkbox"/> for your review and approval. | <input type="checkbox"/> approved as submitted. | <input type="checkbox"/> for issue to subcontractors. |
| <input type="checkbox"/> for your review and comment. | <input type="checkbox"/> approved as noted. | <input type="checkbox"/> _____ |
| <input type="checkbox"/> _____ | <input type="checkbox"/> _____ | <input type="checkbox"/> _____ |
| <input type="checkbox"/> _____ | <input type="checkbox"/> _____ | <input type="checkbox"/> _____ |

Information Sent	# of Copies	Date Above Action Required By	Comments
1. Ice Arena:	1		
2. Chiller			
3. Dehumidifier			
4. Infrared			
5. Aluma Zorb			
6.			

Message/Comments:

sent via email

Delivered by: Aaron Alibrio

Date: 2/19/10

Received by:

Date:

We are pleased to submit on the following:

Rink Chiller

One (1) Carrier model 30HXC246RA-6--TA Water Cooled Screw Chiller, 460v/3ph, including:

- Microprocessor controls
- Dual independent refrigerant circuits
- Standard factory charge R134a refrigerant
- Standard pass cooler
- Suction service valves
- Across the line starter
- Factory brine option for chilled water temperatures to 15-deg. F.
- Head insulation kit
- Vibration isolation mounting pads
- Condenser water temperature thermisters with wells
- Factory start-up and first year warranty labor
- 2nd – 5th Year extended compressor parts warranty

Refrigerant Monitor

One (1) Genesis International Inc. Sherlock 402 Refrigerant Gas Monitoring System, including:

- Sherlock 402 Control Module
- Sherlock 82-0101 R-134a CMOS Room Sensor
- Sherlock 88-0150 R-134a CMOS Vent Line Sensor
- Sherlock 88-0233 Combo Strobe/Horn

Date:	Supersedes:	30HXC076-271 WATER-COOLED LIQUID CHILLER	30HXC	Rev: -8SB
JOB NAME:		LOCATION:		
BUYER:	BUYER P.O. #	CARRIER #		
UNIT NUMBER:		MODEL NUMBER:		
PERFORMANCE DATA CERTIFIED BY:			DATE:	

DESCRIPTION

Packaged water-cooled liquid chillers are factory wired, piped, and charged with HFC-134a.

FEATURES

Cooler is mechanically cleanable shell-and-tube type with removable heads. It is tested and stamped in accordance with ASME Code for a refrigerant working side pressure of 235 psig (1620 kPa) and a minimum water side pressure of 300 psig (2068 kPa) (250 psig [1720 kPa] in Canada).

Compressor is semi-hermetic twin screw design with refrigerant gas cooled motor and integral oil filter and discharge gas muffler.

Complete thermal and electrical protection is provided.

Water-cooled condenser is mechanically cleanable shell-and-tube type with removable heads and is tested and stamped in accordance with ASME Code for a refrigerant working side pressure of 235 psig

(1620 kPa) and a minimum water side pressure of 300 psig (2068 kPa) (250 psig [1720 kPa]) in Canada).

Each refrigerant circuit includes oil separator, high side pressure relief device, liquid and discharge line shutoff valve, filter drier, moisture indicating sight glass, expansion valve.

Microprocessor control includes keypad, system status (including temperatures, pressures and % loading) and the alarm conditions.

Automatic circuit lead/lag.

Capacity control based on leaving chilled water temperature with return water temperature sensing.

7-day time scheduling of pump(s) and chiller.

30 Series Chillers Performance Summary

Project Name: Untitled
 Company Name: Carrier Northeast

2/1/2010
 2:31:06 PM

	Untitled
Location	
Buyer P.O.	
Date	2/1/2010
Version 2.92	
Unit Size	30HXC246***6***
Capacity, Tons	141.2
Compressor Input Power, kw	158.0
Unit Input Power, kw	158.0
Capacity control steps	8
Minimum Capacity, %	13.0
Input kw/Ton	1.119
Unit EER	10.73
Refrigerant	R134a
Cooler Data	
Fluid Type	Ethylene glycol
Fluid concentration, %	35.0
Fluid Entering Temperature, °F	20.1
Fluid Leaving Temperature, °F	15.0
Fluid Flow Rate, gpm	750.0
Fluid Pressure Drop, ft wg	35.7
Fluid Velocity, ft/s	7.1
Fouling Factor, (hr-sqft-F)/Btu	0.0001
Foul. Fact. Temp. Adj., °F	.35
Saturated Suction Temp., °F	
Circuit A	9.7
Circuit B	10.5
Outside Surface Area, sqft	465.9
Condenser Data	
Fluid Type	Fresh Water
Fluid Entering Temperature, °F	75.0
Fluid Leaving Temperature, °F	85.0
Fluid Flow Rate, gpm	439.1
Fluid Pressure Drop, ft wg	8.2
Fluid Velocity, ft/s	3.7
Fouling Factor, (hr-sqft-F)/Btu	0.00025
Foul. Fact. Temp. Adj., °F	.46
Saturated Discharge Temp., °F	
Circuit A	86.1
Circuit B	87.6
Outside Surface Area, sqft	547.7
Factory Options	
Flow Control Type	EXV
Chiller Electrical Data	
Nameplate Voltage, volts	460
Elec. Power Frequency, hertz	60
Power supply to control circuit, volts	115
Power supply to control circuit,	1
Minimum circuit amps	303
MOCP, amps	400
Max Instant. Current Flow (ICF), amps	859

30 Series Chillers Performance Summary

Project Name: Untitled
Company Name: Carrier Northeast

2/1/2010
2:31:06 PM

Control circuit fuse amps	15
Factory Installed Options	
Suction Service Valve	No
Evaporator Passes	Standard
Condenser Passes	Standard
Start option	Across the line
Minimum load control	None
Control transformer	None
ARI Rating	Outside the scope of ARI Standard 550/590-2003.

Dimensions (cont)








30HXC206-271

NOTES:

- Operating weight includes weight of water and refrigerant.
- Denotes center of gravity.
- Dimensions are in inches (mm).
- Recommended service clearance around machine is 36 in. (914.4 mm).
- Victaulic nozzles are standard on all models. Flow switch factory installed in cooler outlet victaulic nozzle.

UNIT	OPERATING WEIGHT - lb (kg)	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)						
		A	1	2	3	4	5	6
30HXC206	10581 (4799)	33.88 (860)	948 (430)	2406 (1091)	1243 (564)	1201 (545)	3133 (1421)	1650 (748)
30HXC246	10989 (4976)	34.38 (873)	985 (447)	2515 (1141)	1306 (592)	1154 (523)	3276 (1486)	1733 (786)
30HXC261	10992 (4986)	34.38 (873)	985 (447)	2520 (1143)	1311 (595)	1154 (523)	3283 (1489)	1739 (789)
30HXC271	11029 (5003)	34.38 (873)	985 (447)	2529 (1147)	1318 (598)	1154 (523)	3294 (1494)	1749 (793)

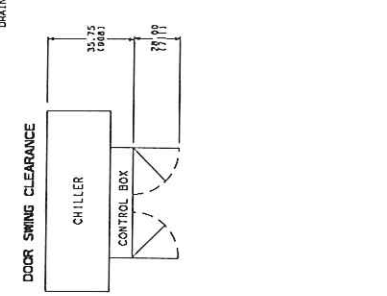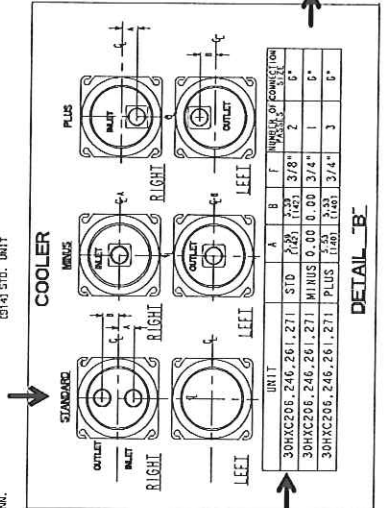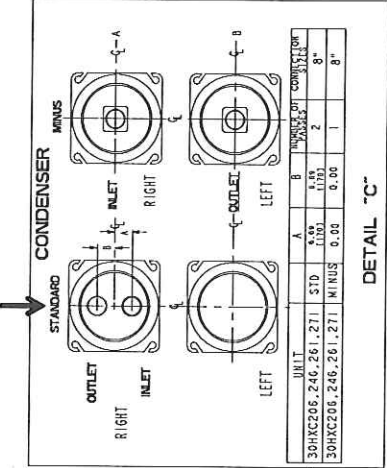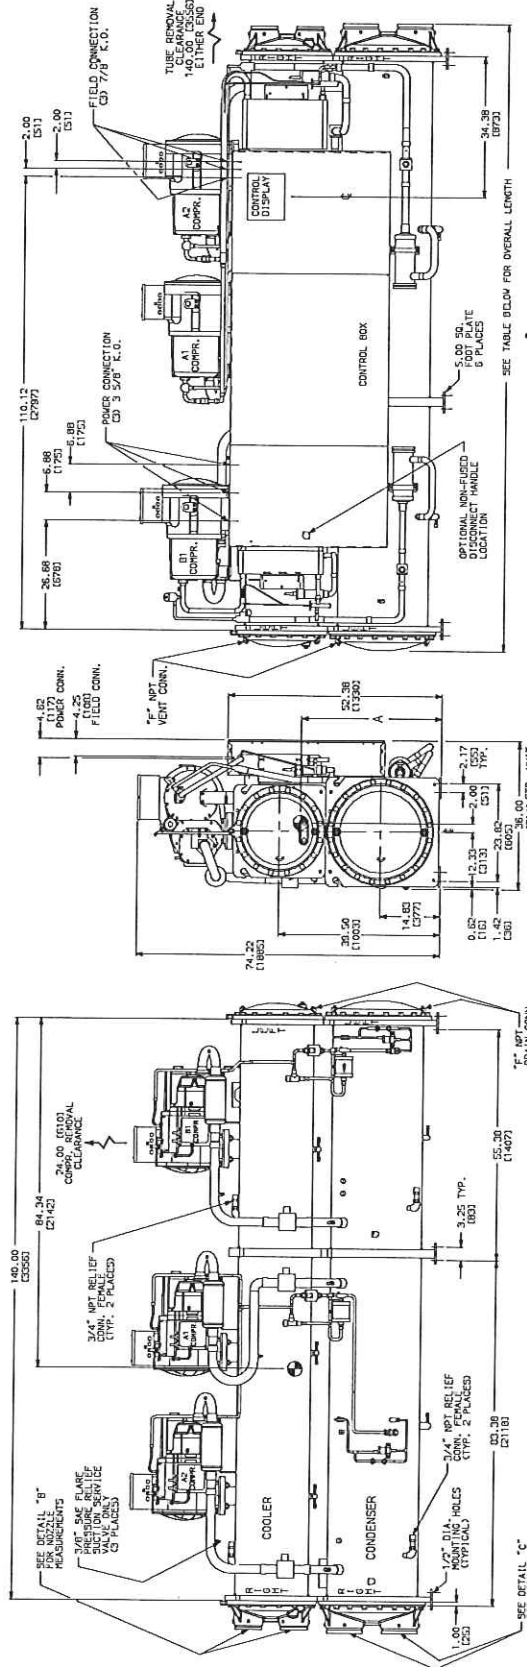

COOLER	CONDENSER	OVERALL LENGTH
STANDARD COOLER	STANDARD CONDENSER	138.35
STANDARD COOLER	MINUS ONE PASS CONDENSER	160.00
PLUS ONE PASS COOLER	STANDARD CONDENSER	160.00
PLUS ONE PASS COOLER	MINUS ONE PASS CONDENSER	160.00
MINUS ONE PASS COOLER	STANDARD CONDENSER	160.00
MINUS ONE PASS COOLER	MINUS ONE PASS CONDENSER	160.00

Electrical data (cont)



ELECTRICAL DATA, 30HXC UNITS (cont)

UNIT 30HXC	UNIT VOLTAGE			POWER SUPPLY QTY. REQD.	NO. POWER SUPPLY CONDUCTORS	UNIT VOLTAGE						CONTROL CIRCUIT			
	V-Hz (3 Ph)	Supplied				MCA	MOCP	ICF		Rec Fuse Size		V-Hz (Single Ph)	Supplied		MCA and MOCP
		Min	Max					XL	WD	XL	WD		Min	Max	
171	230-60	207	253	1	6	428.4	600	—	604.5	—	500	115-60	104	127	15
	208/230-60	187	253	1	6	476.0	700	—	623.6	—	600	115-60	104	127	15
	460-60	414	506	1	3	215.0	300	771.1	302.1	250	250	115-60	104	127	15
	575-60	518	633	1	3	171.8	250	616.8	241.8	200	200	115-60	104	127	15
	380-60	342	418	1	3	260.2	350	861.2	343.2	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	266.6	350	961.8	375.8	300	300	230-50	198	254	15
230-50	207	253	1	6	440.4	600	—	606.8	—	500	230-50	207	254	15	
186	230-60	207	253	1	6	462.3	600	—	638.5	—	600	115-60	104	127	15
	208/230-60	187	253	1	6	513.7	700	—	661.3	—	600	115-60	104	127	15
	460-60	414	506	1	3	232.0	300	788.1	319.1	300	300	115-60	104	127	15
	575-60	518	633	1	3	185.4	250	630.4	255.4	225	225	115-60	104	127	15
	380-60	342	418	1	3	280.8	400	881.8	363.8	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	289.4	400	984.6	398.6	350	350	230-50	198	254	15
230-50	207	253	1	6	478.1	600	—	644.5	—	600	230-50	207	254	15	
206	230-60	207	253	1	6	524.5	700	—	700.7	—	600	115-60	104	127	15
	208/230-60	187	253	1	6	582.8	800	—	730.4	—	700	115-60	104	127	15
	460-60	414	506	1	3	263.2	350	819.3	350.3	300	300	115-60	104	127	15
	575-60	518	633	1	3	210.4	250	655.4	280.4	250	250	115-60	104	127	15
	380-60	342	418	1	3	318.6	400	919.6	401.6	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	326.8	450	1022.0	436.0	400	400	230-50	198	254	15
230-50	207	253	1	6	539.8	700	—	706.2	—	600	230-50	207	254	15	
246	230-60	207	253	1	6	604.1	800	—	780.3	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	671.3	800	—	818.9	—	800	115-60	104	127	15
	460-60	414	506	1	3	303.2	400	859.3	390.3	350	350	115-60	104	127	15
	575-60	518	633	1	3	242.3	300	687.3	312.3	300	300	115-60	104	127	15
	380-60	342	418	1	3	367.0	450	968.0	450.0	400	400	230-60	207	254	15
	380/415-50	342	440	1	3	377.6	500	1072.8	466.8	450	450	230-50	198	254	15
230-50	207	253	1	6	623.8	800	—	790.2	—	700	230-50	207	254	15	
261	230-60	207	253	1	6	633.8	800	—	810.0	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	704.3	800	—	851.9	—	800	115-60	104	127	15
	460-60	414	506	1	3	318.1	400	874.2	405.2	350	350	115-60	104	127	15
	575-60	518	633	1	3	254.2	300	699.2	324.2	300	300	115-60	104	127	15
	380-60	342	418	1	6	385.0	500	986.0	468.0	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	395.2	500	1090.4	504.4	450	450	230-50	198	254	15
230-50	207	253	1	6	652.9	800	—	819.3	—	800	230-50	207	254	15	
271	230-60	207	253	1	6	667.8	800	—	843.9	—	800	115-60	104	127	15
	208/230-60	187	253	1	6	742.0	800	—	889.6	—	800	115-60	104	127	15
	460-60	414	506	1	3	335.1	400	891.2	422.2	400	400	115-60	104	127	15
	575-60	518	633	1	3	267.8	350	712.8	337.8	300	300	115-60	104	127	15
	380-60	342	418	1	6	405.6	500	1006.6	488.6	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	418.0	500	1113.2	527.2	500	500	230-50	198	254	15
230-50	207	253	1	6	690.6	800	—	857.0	—	800	230-50	207	254	15	

LEGEND

- ICF — Maximum Instantaneous Current Flow during start-up (the point in the starting sequence where the sum of the LRA for the start-up compressor, plus the total RLA for all running compressors is at a maximum)
- LRA — Locked Rotor Amps
- MCA — Minimum Circuit Ampacity (for wire sizing)
- MOCP — Maximum Overcurrent Protection
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

- Maximum incoming wire size for each terminal block is 500 kcmil.
- Maximum allowable phase imbalance is: voltage, 2%; amps, 5%.
- Use copper conductors only.
- The MOCP is calculated as follows:

MOCP = (2.25) (largest RLA) + the sum of the other RLAs. Size the fuse one size down from the result. The RLAs are listed on the nameplate.

The recommended fuse size in amps (RFA) is calculated as follows:

RFA = (1.50) (largest RLA) + the sum of the other RLAs. Size the fuse one size up from the result. The RLAs are listed on the nameplate.

NOTES:

- Each main power source must be supplied from a field-supplied fused electrical service with a (factory-installed or field-installed) disconnect located in sight from the unit.
- Control circuit power must be supplied from a separate source through a field-supplied disconnect (except for 380/415-50 units). An accessory control transformer may be used to provide control circuit power from the main unit power supply.






Product Data

30HXA, HXC076-271 Condenserless and Water-Cooled Liquid Chillers 50/60 Hz

75 to 265 Tons (264 to 931 kW)

Comfort Link™

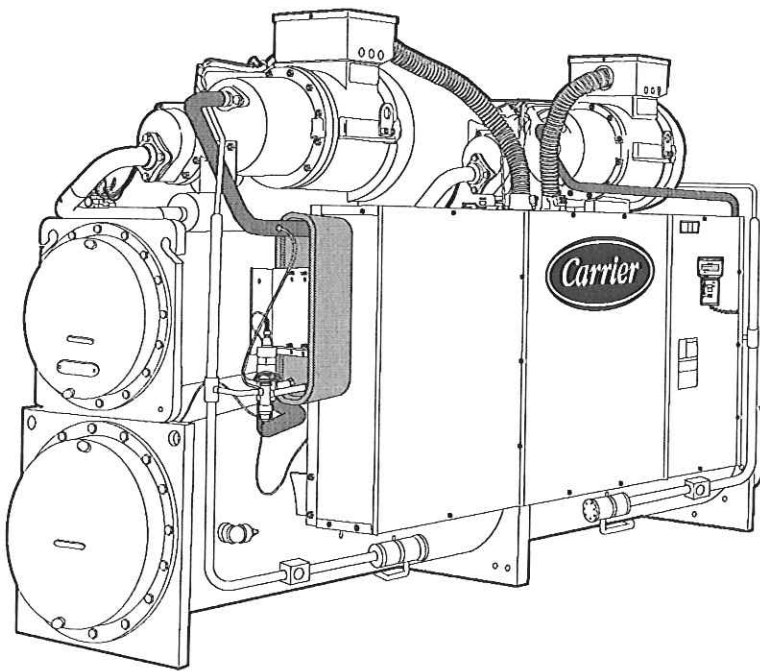

**ASHRAE
90.1
COMPLIANT**

Water-cooled and condenserless chillers designed from the ground up to meet the needs of today and tomorrow:

- Unit fits through a standard door with no disassembly required
- Chlorine-free HFC-134a refrigerant
- Dual independent refrigerant circuits
- Smooth compression using twin screw compressors
- ARI certified efficiencies to 0.53 kW/ton

Features/Benefits

Quality design and construction make the 30HXC (Water-Cooled) and 30HXA (Condenserless) units the preferred choice

Easy installation

The 30HX chiller has a compact design that fits through a standard door opening and requires minimal indoor space. The 30HX chiller is delivered as a complete package for easy installation. There are no extra controls, clocks, starters, or other items to install.

The 30HX unit also provides a single location electrical power entrance (using the accessory field-installed control power transformer) and quick, easy piping (using victaulic-type clamp-on couplings).

The 30HX 208/230-v, 230-v, 460-v and 575-v units are designed in accordance with UL (Underwriters' Laboratory, U.S.A.) and UL, Canada (Underwriters' Laboratory, Canada) standards to minimize electrical inspection time.



A quick start-up is assured once installation is complete, since each 30HX unit is manufactured at an ISO 9001:2000 listed manufacturing facility to guarantee quality. In addition, all 30HXC units are tested under load at the factory to provide reliable start-up.

NOTE: Units shipped with optional nitrogen charge are tested for proper operation of the electrical components but are not run-tested at the factory.

Easy operation

The 30HX units have a quiet, low-vibration design featuring screw compressors.

Efficiency levels of the 30HX units meet or exceed energy efficiency requirements of ASHRAE (American Society of Heating, Refrigeration and

Air Conditioning Engineers) 90.1-2001 and CSA (Canadian Standards Association) for both full-load and part-load operation, thus saving on operating costs through lower electrical costs. All 30HX units are also rated in accordance with ARI (Air Conditioning and Refrigeration Institute, U.S.A.) standards. The 60 Hz 30HXC units are ARI certified.

The 30HX controls are fully automatic. The leaving-fluid temperature is directly controlled to within .5° F (.3° C), and the entering-fluid temperature is continuously monitored to detect load and flow changes.


Dual, independent refrigerant circuits provide reliable, dependable cooling, and the 30HX units use medium-pressure HFC-134a refrigerant to

minimize stress on the compressors and ensure a long life.


From a service standpoint, the 30HX units offer the following features:

- Use of HFC-134a refrigerant, which has no planned phase-out in its future
- Mechanically cleanable cooler and condenser (30HXC units)
- Twin-screw compressors, which require no routine service or maintenance
- Easily accessed service information includes suction and discharge pressure and temperature using standard Navigator™ display module
- All parts are available through Totaline parts stores.


DUAL INDEPENDENT REFRIGERANT CIRCUITS

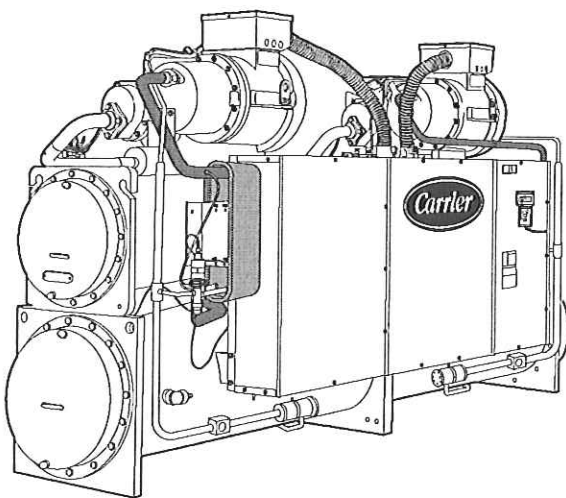


TWIN-SCREW COMPRESSOR DESIGN

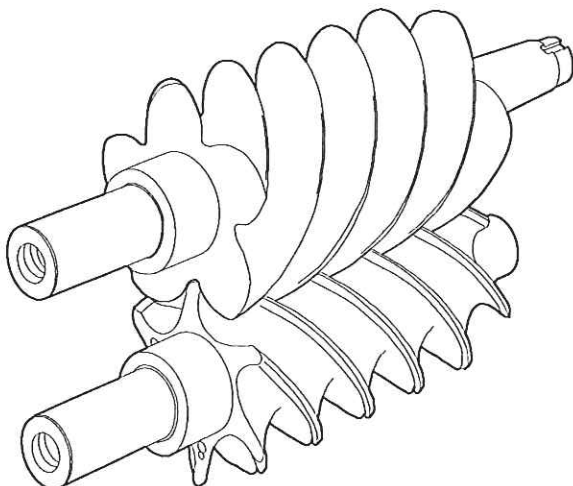

NAVIGATOR IN DISPLAY MODE

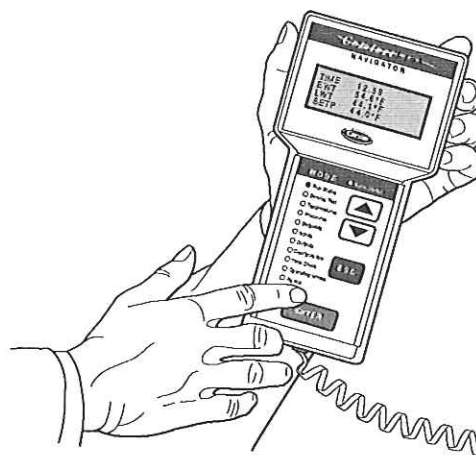

FITS THROUGH STANDARD DOORWAY

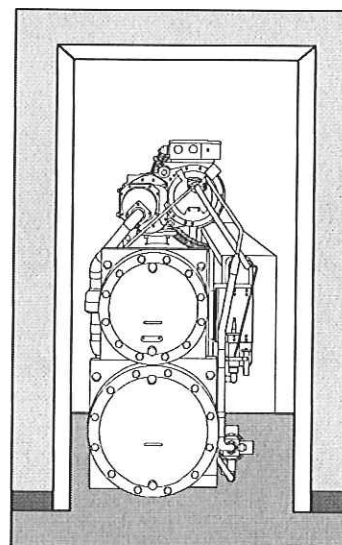

ARI* capacity ratings



30HXC WATER-COOLED CHILLER ARI RATINGS (60 Hz ONLY)

UNIT SIZE 30HXC	CAPACITY		INPUT POWER (kW)	COOLER FLOW		COOLER PRESSURE DROP		CONDENSER FLOW		CONDENSER PRESSURE DROP		FULL-LOAD EFFICIENCY (kW/Ton)	IPLV† (kW/Ton)
	Tons	Output kW		GPM	L/s	Ft of Water	kPa	GPM	L/S	Ft of Water	kPa		
076	75.4	265.2	53.7	181.0	11.4	12.6	37.7	226.2	14.3	8.0	23.9	0.712	0.512
086	83.1	292.3	60.4	199.4	12.6	15.1	44.9	249.3	15.7	9.6	28.6	0.727	0.523
096	94.0	330.5	67.0	225.5	14.2	14.9	44.6	281.9	17.8	9.9	29.4	0.713	0.513
106	104.3	366.8	75.3	250.3	15.8	13.4	40.1	312.9	19.7	12.0	35.7	0.722	0.521
116	113.6	399.4	79.9	272.6	17.2	11.7	34.9	340.7	21.5	15.3	45.5	0.703	0.509
126	123.0	432.6	86.8	295.2	18.6	13.5	40.3	369.0	23.3	17.7	52.7	0.706	0.509
136	136.5	479.9	97.0	327.5	20.7	12.8	38.3	409.4	25.8	16.7	49.9	0.711	0.527
146	145.9	513.2	105.1	350.2	22.1	14.5	43.3	437.8	27.6	19.0	56.5	0.720	0.533
161	156.5	550.6	111.7	375.7	23.7	12.0	35.7	469.6	29.6	19.4	57.9	0.714	0.520
171	165.9	585.3	118.2	398.1	25.1	13.3	39.6	497.6	31.4	15.9	47.4	0.712	0.538
186	177.2	623.1	126.7	426.2	26.8	12.1	36.2	531.6	33.5	18.0	53.7	0.715	0.562
206	211.6	744.0	146.4	507.7	32.0	12.8	38.2	634.7	40.0	19.0	56.7	0.692	0.510
246	248.6	874.1	172.4	596.5	37.6	14.1	42.1	745.7	47.0	20.1	59.9	0.693	0.522
261	257.2	904.6	180.5	617.3	38.9	15.0	44.8	771.6	48.7	21.4	63.9	0.702	0.523
271	267.4	940.3	189.5	641.7	40.5	16.1	48.0	802.1	50.6	23.0	68.7	0.709	0.525

LEGEND

IPLV — Integrated Part-Load Value

*Air Conditioning and Refrigeration Institute (U.S.A.).

†IPLV shown is the lower of Sequence A or Sequence B unloading.

NOTES:

- Rated (60 Hz only) in accordance with ARI Standard 550/590-98 at standard rating conditions.
- Standard rating conditions are as follows:
Cooler Conditions:
Leaving Water Temperature: 44 F (6.7 C)
Flow: 2.4 gpm per ton (0.043 L/s per kW)
Condenser Conditions:
Entering Water temperature: 85 F (29.4 C)
Flow: 3.0 gpm per ton (0.054 L/s per kW)
Fouling Factor (Cooler):
0.00010 hr x sq ft x F per Btuh (0.000018 m² x K per W)
Fouling Factor (Condenser):
0.00025 hr x sq ft x F per Btuh (0.000044 m² x K per W)

- IPLV is a single number part-load efficiency value calculated from the system full-load efficiency values and corrected for a typical building air-conditioning application.
- All data in this table is rated (60 Hz only) in accordance with ARI Standard 550/590-98 as represented in the ECOLOGIC™ Chiller Selection Program (E-Cat) version 2.80.
- Contact Carrier for custom ratings.



Rated in accordance with
ARI Standard 550/590-98.

60 Hz only





ENGLISH (cont)

UNIT SIZE 30HX	161	171	186	206	246	261	271
UNIT OPERATING WEIGHT (lb)							
Water-Cooled (HXC)	7452	7660	7854	10,581	10,969	10,992	11,029
Condenserless (HXA)	5752	5777	5946	7,485	7,621	7,621	7,621
COMPRESSORS	Semi-Hermetic, Twin Screw						
Quantity	2	2	2	3	3	3	3
Nominal Capacity per Compressor (tons)	80/56	66/80	80/80	66/39/80	80/56/80	80/66/80	80/80/80
Economizer	Yes	Yes	Yes	Yes	Yes	Yes	Yes
No. Capacity Steps							
Standard	6	6	6	8	8	8	8
Optional (maximum)	8	8	8	11	11	11	11
Minimum Step Capacity (%)							
Standard	20	20	20	13	13	13	13
Optional	10	10	10	7	7	7	7
REFRIGERANT							
Charge* (lb) Circuit A/Circuit B	157/110	119/140	135/135	R-134a 220/135	220/135	220/135	220/135
COOLER TYPE	Shell and Tube with Enhanced Copper Tubes						
Part No. 10HX400-	601	611	621	631	632	632	632
Net Fluid Volume (gal)	28.5	28.5	33.4	43.1	47.2	47.2	47.2
Maximum Refrigerant Pressure (psig)	220	220	220	220	220	220	220
Maximum Water-Side Pressure (psig)	300	300	300	300	300	300	300
Water Connections							
Inlet and Outlet (in.) (Standard Pass)	5	5	5	6	6	6	6
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220
Standard Number of Passes	2	2	2	2	2	2	2
30HXA OIL SEPARATOR							
Part No. 09RX400-	215	214	214	213	213	213	213
Maximum Refrigerant Pressure (psig)	320	320	320	320	320	320	320
Refrigerant Connections (in.)							
Discharge Circuit A/B	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8
Liquid Circuit A/B	1 3/8/1 3/8	1 3/8/1 3/8	1 3/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8
Relief Valve							
Connection (in. SAE Flare)	5/8	5/8	5/8	5/8	5/8	5/8	5/8
Flow Capacity (lb air/min)	21.6	21.6	21.6	21.6	21.6	21.6	21.6
Relief Setting (psig)	320	320	320	320	320	320	320
CONDENSER (HXC)	Shell and Tube with Enhanced Copper Tubes						
Part No. 09RX400-	261	262	262	263	264	264	264
Net Fluid Volume (gal)	30.6	37.6	37.6	47.6	55.1	55.1	55.1
Maximum Refrigerant Pressure (psig)	220	220	220	220	220	220	220
Maximum Water-Side Pressure (psig)	300	300	300	300	300	300	300
Water Connections (in.)							
Inlet and Outlet (Standard Pass)	6	6	6	8	8	8	8
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220
Standard Number of Passes	2	2	2	2	2	2	2
DISCHARGE LINE†							
Relief Valve							
Connection (in. SAE Flare)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Flow Capacity (lb air/min)	6.3	6.3	6.3	6.3	6.3	6.3	6.3
Setting (psig)	350	350	350	350	350	350	350

LEGEND

NPTF — National Pipe Thread Female
 SAE — Society of Automotive Engineers

*Charges listed are for 30HXC units. The 30HXA units are shipped with a holding charge only. To determine the refrigerant charge requirements for 30HXA units see the System Refrigerant Charge for Start-Up table in the Application Data on page 28.

†Only on units with factory-installed suction service valves.

Application data



Unit location

Unit should be level (particularly in its major lengthwise dimension) to assure proper oil return.

The unit should be located indoors in an area of temperature greater than 50 F (10 C).

Good acoustic design practice should be followed, i.e., unit should not be located adjacent to sound-sensitive areas unless appropriate consideration has been made.

Cooler fluid temperature

1. *Maximum* leaving water (fluid) temperature (LWT) is 60 F (21 C). Unit can start and pull down with up to 95 F (35 C) entering water (fluid) temperature due to MOP (maximum operating pressure) feature of the expansion valve. For sustained operation, it is recommended that entering fluid temperature not exceed 70 F (21.1 C).
2. *Minimum* LWT is 40 F (4.4 C) for standard units. The brine option is required for operation with leaving fluid temperatures in the range of 39 to 12 F (4 to -9 C). For ratings below 40 F (4.4 C) LWT, contact your local Carrier representative.
3. *Minimum* entering water (fluid) temperature (EWT) is 45 F (7.2 C). *Maximum* EWT is 70 F (21.1 C).

Leaving-fluid temperature reset

The accessory reset sensor can be applied to the chiller to provide reset of in LWT constant fluid flow systems. Reset reduces compressor power usage at part load when design LWT is not necessary. Humidity control should be considered, since higher coil temperatures resulting from reset will reduce latent heat capacity. Three reset applications are offered:

From return-fluid temperature — Increases LWT set point as return (or entering) fluid temperature decreases (indicating load decrease). Reset from return fluid may be used in any application where return fluid provides accurate load indication. Limitation of return-fluid reset is that the LWT may only be reset to value of design return-fluid temperature. No additional hardware is required.

From outdoor-air temperature — Increases LWT as outdoor ambient temperature decreases (indicating load decrease). This reset should be applied only where outdoor ambient temperature is an accurate indication of load. A field-supplied thermistor is required.

From occupied space temperature — Increases LWT as space temperature decreases (indicating load decrease). This reset should be applied only where space temperature is an accurate indication of load. A field-supplied thermistor is required.

Temperature can also be reset using a 4 to 20 mA signal from the control system. This type of reset requires the Energy Management Module Accessory.

Condenser fluid temperature

1. *Maximum* leaving condenser fluid temperature is 105 F (40.5 C) on all 30HXC units.

2. *Standard* 30HXC units will start at entering condenser fluid temperatures above 55 F (12.8 C). In general, however, continuous machine operation with entering condenser fluid temperatures below 70 F (21.1 C) is not recommended. When the entering condenser fluid temperature is expected to drop below 70 F (21.1 C), it is recommended that some form of condenser flow control be used to optimize performance. Tower pump, bypass valves, or flow regulating valves may be controlled by a 4 to 20 mA output from the 30HXC control (60-second open to close time recommended for actuator).

Cooler and water-cooled condenser temperature rise

Ratings and performance data in this publication are for a cooling temperature rise of 10° F (5.6° C). Units may be operated at a different temperature rise, provided flow limits are not exceeded and corrections to capacity, etc., are made. For minimum flow rates, see the Minimum Flow Rates table. High flow rate is limited by pressure drop that can be tolerated.

Minimum cooler flow — Flow (maximum cooler temperature rise) is shown in the Minimum Flow Rates table. Minimum flow rate must be maintained to prevent fouling. When gpm (L/s) required is lower (or rise is higher), follow recommendations below:

1. Multiple smaller chillers can be applied in series, each providing a portion of the design temperature rise.
2. Chilled fluid can be recirculated to raise flow rate. However, mixed temperature entering cooler must be maintained at a minimum of at least 5° F (2.8° C) above the leaving chilled fluid temperature.
3. Special plus one-pass cooler can be used. Contact your Carrier representative for further information.

Maximum cooler flow (> 5 gpm/ton or < 5° F rise [> 0.09 L/s · kW or < 2.7° C rise]) — Maximum flow results in practical maximum pressure drop through cooler. Special minus-one-pass cooler can be used to reduce pressure drop. Contact your Carrier representative.

Return fluid can bypass the cooler to keep pressure drop through cooler within acceptable limits. This permits a higher ΔT with lower fluid flow through cooler and mixing after the cooler. Contact your Carrier representative if pressure drop appears excessive.

Variable cooler flow rates — These variable rates may be applied to standard 30HX series chillers. However, the unit will attempt to maintain a constant leaving chilled-fluid temperature. In such cases, minimum fluid loop volume must be in excess of 3 gal per ton (3.2 L per kW) and flow rate must change in steps of less than 10% per minute. Apply 6 gal per ton (6.5 L per kW) fluid loop volume minimum if flow rate changes more rapidly.

Minimum water-cooled condenser flow — This value (maximum rise) is shown in Minimum Flow Rates table. Ensure leaving-fluid temperature does not exceed 105 F (40.5 C).

Application data (cont)




MINIMUM FLOW RATES

DEVICE	UNIT SIZE 30HX	COOLER		MIN. FLOW RATE*		COOLER TEMP DIFFERENCE	
		No. of Passes	Type	GPM	L/s	F	C
COOLER	076	2	Minus 1	136.0	8.6	13	7.4
		3	Standard	90.0	5.7	20	11.1
		4	Plus 1	68.0	4.3	27	14.8
	086	2	Minus 1	149.0	9.4	13	7.4
		3	Standard	100.0	6.3	20	11.1
		4	Plus 1	75.0	4.7	27	14.8
	096	2	Minus 1	169.0	10.7	13	7.4
		3	Standard	113.0	7.1	20	11.1
		4	Plus 1	85.0	5.3	27	14.8
	106	2	Minus 1	188.0	11.8	13	7.4
		3	Standard	125.0	7.9	20	11.1
		4	Plus 1	94.0	5.9	27	14.8
	116	1	Minus 1	272.0	17.2	10	5.6
		2	Standard	136.0	8.6	20	11.1
		3	Plus 1	91.0	5.7	30	16.7
	126	1	Minus 1	295.0	18.6	10	5.6
		2	Standard	147.0	9.3	20	11.1
		3	Plus 1	98.0	6.2	30	16.7
	136	1	Minus 1	327.0	20.7	10	5.6
		2	Standard	164.0	10.3	20	11.1
		3	Plus 1	109.0	6.9	30	16.7
	146	1	Minus 1	350.0	22.1	10	5.6
		2	Standard	175.0	11.0	20	11.1
		3	Plus 1	117.0	7.4	30	16.7
	161	1	Minus 1	376.0	23.7	10	5.6
		2	Standard	188.0	11.9	20	11.1
		3	Plus 1	125.0	7.9	30	16.7
171	1	Minus 1	399.0	25.2	10	5.6	
	2	Standard	199.0	12.6	20	11.1	
	3	Plus 1	133.0	8.4	30	16.7	
186	1	Minus 1	426.0	26.9	10	5.6	
	2	Standard	213.0	13.4	20	11.1	
	3	Plus 1	142.0	9.0	30	16.7	
206	1	Minus 1	508.0	32.1	10	5.6	
	2	Standard	254.0	16.0	20	11.1	
	3	Plus 1	169.0	10.7	30	16.7	
246	1	Minus 1	597.0	37.7	10	5.6	
	2	Standard	309.0	18.8	20	11.1	
	3	Plus 1	199.0	12.6	30	16.7	
261	1	Minus 1	618.0	39.0	10	5.6	
	2	Standard	309.0	19.5	20	11.1	
	3	Plus 1	206.0	13.0	30	16.7	
271	1	Minus 1	642.0	40.5	10	5.6	
	2	Standard	321.0	20.3	20	11.1	
	3	Plus 1	214.0	13.5	30	16.7	
CONDENSER	076,086	2	—	105	6.6	—	—
	096,106	2	—	135	8.5	—	—
	116,126	2	—	170	10.7	—	—
	136,146	2	—	195	12.3	—	—
	161	2	—	235	14.8	—	—
	171,186	2	—	255	16.1	—	—
	206	2	—	273	17.2	—	—
	246	2	—	333	21.0	—	—
	261	2	—	333	21.0	—	—
271	2	—	333	21.0	—	—	

*Based on 20 F (11.1 C) temperature difference at ARI conditions.

NOTES:

- The 30HX units will start with loop temperatures up to 95 F (35 C).
- Minimum flow rate shown is based on ARI Ratings and is for reference only. 20 F (11.1 C) is the maximum cooler temperature differential that will determine actual minimum flow rate.
- To obtain proper temperature control, loop fluid volume must be at least 3 gal/ton (3.23 L/kW) of chiller nominal capacity for air conditioning and at least 6 gal/ton (6.5 L/kW) for process applications.

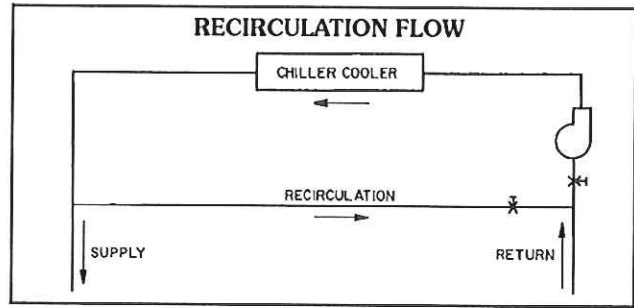

Oversizing chillers

Oversizing chillers by more than 15% at design conditions must be avoided as the system operating efficiency will be adversely affected (resulting in greater and/or excessive electrical demand and cycling of compressors). When future expansion of equipment is anticipated, install a single chiller to meet present load requirements, and install a second chiller to meet the additional load demand.

It is also recommended that the installation of 2 smaller chillers be considered where operation at minimum load is critical. The operation of 2 small chillers at higher loading is preferred to operating a single chiller at or near its minimum recommended value.

The minimum load control accessory should not be used as a means to allow oversizing chillers. Minimum load control should be given consideration where substantial operating time is anticipated below the minimum unloading step.

Parallel chillers

Where chiller capacities greater than can be supplied by a single 30HX chiller are required, or where stand-by capability is desired, chillers may be installed in parallel. Units may be of the same or different sizes. However, cooler and condenser flow rates must be balanced to ensure proper flow to each chiller. The standard 30HX ComfortLink™ control can be configured to provide lead/lag control for two chillers. The accessory Chillervisor™ System Manager III control may be used for proper leaving chilled fluid temperature control and to ensure proper staging sequence of up to 8 chillers. Refer to the accessory Chillervisor System Manager III installation instructions for further details.

Series chillers

Chillers in series may be used for capacities greater than those supplied by a single 30HX chiller. Using the Minus-One-Pass Cooler Head option, fluid pressure drop across the cooler can be held to reasonable levels. The leaving fluid temperature sensors need not be relocated. However, the cooler minimum entering fluid temperature limitations should be considered for the chillers located downstream of other chillers. The standard 30HX control can control two 30HX chillers in series. Condensers should be piped in parallel to maximize capacity and efficiency. This should also minimize condenser pressure drop and saturated condensing temperatures. However, if condensers are piped in series, ensure that the leaving fluid temperature does not exceed 105 F (40.5 C).

Energy management

Demand limiting and load shedding are popular techniques used to reduce peak electric demands typically experienced during hot summer days when air conditioning loads are highest. When utility electricity demands exceed a certain level, electrical loads are turned off to keep the peak demands below a prescribed maximum limit. Compressor unloading reduces electrical demand while allowing the chiller to operate under part-load capacity and to maintain partial chilled fluid cooling.

Electrical demand can be limited through demand limit input to chiller control which unloads the chiller to a predetermined percentage of the load. One stage of unloading can be initiated by a remote signal to significantly reduce the chiller power consumption. This power reduction applies to the full load power at nominal conditions. The demand limit control should not be cycled less than 10 minutes on and 5 minutes off.

Duty cycling

Duty cycling will cycle an electrical load at regular intervals, regardless of electrical demand. This reduces the electrical demand by "fooling" demand measuring devices. Duty cycling of the entire compressor is **NOT** recommended since motor windings and bearings will be damaged by constant cycling.

Wye-delta start

Wye-delta start is standard on 30HX 208/230-v, 60-Hz units and 230-v, 50-Hz units and optional on all other 30HX units. This feature is not always required on 30HX units due to the use of multiple compressors that allow small electrical load increments, but is available if required. Maximum instantaneous current flow (see ICF in Electrical Data tables on pages 59-62) should be used in determining need.

Vibration isolation

External vibration isolators are available as field-installed accessories.


Strainers

A strainer with a minimum screen size of 20 mesh must be installed in both the cooler and condenser fluid lines, within 10 ft (3 m) of the inlets to both the cooler and condenser. For 30HXA units, this requirement applies only to the cooler.

Chilled fluid loop volume

The chilled fluid loop volume in circulation must equal or exceed 3 gal per nominal ton of cooling (3.2 L per kW) for temperature stability and accuracy in normal air conditioning applications. For example, a 30HXC096 with a nominal capacity of 94.0 tons would require 282 gal (1067.4 L) in circulation in the system loop.

For process jobs where accuracy is vital, or for operation at ambient temperatures below 32 F (0° C) with low unit loading conditions, there should be from 6 to 10 gal per ton (6.5 to 10.8 L per kW). To achieve this volume, it is often necessary to install a tank in the loop. Tank should be baffled to ensure there is no stratification, and that water (or brine) entering the tank is adequately mixed with liquid in the tank. See Tank Installation drawing.

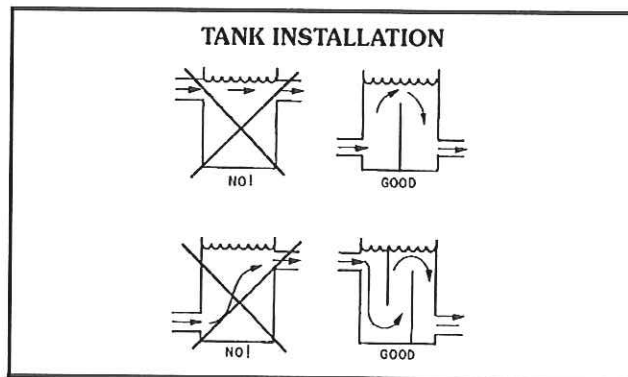

Fouling factor

The factor used to calculate tabulated ratings for the cooler is 0.00010 ft² · hr · F/Btu (0.000018 m² · K/W), and for the condenser is 0.00025 ft² · hr · F/Btu (0.00044 m² · K/W). As fouling factor is increased, unit capacity decreases and compressor power increases. To determine selections at other fouling factors, use the chiller program in the electronic catalog.

Cooler and water-cooled condenser freeze protection

If chiller refrigerant or fluid lines are in an area where ambient conditions fall below 32 F (0° C), it is recommended that an antifreeze solution be added to protect the unit and fluid piping to a temperature 12° F (6.7° C) below the lowest anticipated temperature. For corrections to performance, refer to the chiller program in the electronic catalog.

Use only antifreeze solutions approved for heat exchanger duty. Use of automotive antifreezes is not recommended because of the fouling that can occur once their relatively short-lived inhibitors break down.

If the system will not be used during freezing weather conditions and the chiller and fluid piping are not protected with an antifreeze solution, it is recommended that the chiller and outdoor piping be drained.

Refer to Cooler Fluid Temperature section, page 21, for leaving fluid temperature for brine units. When leaving chilled fluid temperatures will be lower than 40 F (4.4 C), an appropriate antifreeze solution must be used in the cooler. In addition, the following special installation instructions will apply:

1. In addition to the factory-mounted chilled water flow switch, a field-supplied condenser water flow switch must be installed.
2. The chiller must control both the chilled water pump and the condenser pump. The cooler pump must operate for a minimum of 10 minutes after the chiller has shut down and the condenser pump must operate for a minimum of 30 minutes after the chiller has shut down. In the event of a loss of condenser water flow, the flow of chilled fluid to the evaporator must be stopped or the isolation valve must be closed. This is necessary to reduce the possibility of condenser freeze-up.

Application data (cont)



3. Condenser head pressure control valves must not reduce condenser flow below 0.75 gallons per ton (0.4 L/s per kW) or the lowest detectable flow level of the condenser water flow switch. For further information, refer to the 30HX Installation Instructions or contact your Carrier representative.

30HXA remote condenser requirements

1. Do not manifold independent refrigerant circuits into a single condenser circuit.
2. Ensure each refrigerant circuit has its own head pressure control.
3. Condensing pressure control must be provided on condensers used with 30HXA to maintain a minimum 75 F (24 C) saturated discharge temperature at light loads.
4. Condenser must provide 15° F (8.3° C) subcooling, a maximum of 40° F (22.2° C) difference between saturated condensing temperature and outdoor ambient temperature (to prevent overload at high ambient temperatures), and a minimum of 20° F (11.1° C) difference (to assure subcooling).
5. Minimum saturated discharge temperature (SDT) is 90 F (32.2 C). Maximum SDT is 135 F (57.2 C) at full load.
6. Condenser should not be located more than 15 ft (4.6 m) below chiller to maintain subcooling.
7. Design discharge and liquid piping according to Carrier System Design Manual. Piping must be sized for HFC-134a. Refer to the ASHRAE Refrigeration Handbook for R-134a sizing tables. Also see 30HX Installation instructions and the Typical 30HXA Refrigerant Piping to Remote Condenser diagrams on page 29.
8. Maximum interconnecting refrigerant line length is 200 ft (61 m) actual.
9. Liquid line solenoid valves are required.
10. If accessory sound enclosure is installed, run lines along the floor so the sound enclosure can be notched to clear lines.

Refrigerant pipe sizing for 30HXA with Carrier 09D condenser combinations — For refrigerant pipe sizing of the 30HXA follow these directions:


Discharge line:

1. For applications at conditions of 40 F (4.4 C) or higher, use the Refrigerant Line Sizes for 30HXA Chiller/09DK Condenser Combinations tables on pages 25 and 26.
For applications using brine, other condensers, or LWT below 40 F (4.4 C), size lines using the ASHRAE Refrigeration Handbook, or other suitable design guide.
2. Install horizontal lines level or pitched slightly toward the base of discharge riser and the condenser (in the direction of flow).
3. If chiller is below the condenser, loop the discharge line to at least one inch (25.4 mm) above the top of condenser.

4. A double discharge riser (as shown in Refrigerant Line Sizes, Double Discharge Riser Pipe Sizes table on page 26) is required if any of the following conditions exist:
 - a. Unit is equipped with minimum load control.
 - b. Chiller is located below condenser.
 - c. Discharge line size is in shaded area in Refrigerant Line Sizes, Recommended Refrigerant Pipe Sizes table on page 25.
5. Minimize line length and restrictions to minimize pressure drop and refrigerant charge.
6. If accessory sound enclosure is applied, run lines along the floor so sound enclosure may be notched to clear lines.
7. Lines should not be buried underground.

Liquid line:

1. For applications at conditions of 40 F (4.4 C) or higher LWT, use the Refrigerant Line Sizes for 30HXA Chiller/09DK Condenser Combinations tables on pages 25 and 26.
For applications using brine, other condensers, or LWT below 40 F (4.4 C), size lines using the ASHRAE Refrigeration Handbook, or other suitable design guide.
2. If chiller is above condenser, maximum vertical separation is 15 ft (4.6 m).
3. Minimize line length and restrictions to minimize pressure drop and refrigerant charge.
4. Field-supplied liquid line solenoid valves are required. The solenoid valves must be located close to the chiller.
5. If sound enclosure is applied, run lines along floor so sound enclosure may be notched to clear lines.
6. In-line receivers are NOT recommended due to their negative effect on system subcooling. Where the use of a receiver is desired for service purposes, the receiver should be piped in parallel with the main liquid line and equipped with shut-off valves to isolate it during unit operation. See sketch below.
7. Filter driers (field supplied) are required.

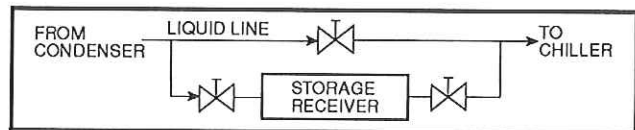

Relief valve vent lines

1. Vent per local code requirements.
2. Each chiller has a minimum of 4 refrigerant relief valves: 2 on the cooler, 2 on the condenser (30HXC) or oil separator (30HXA). Units with factory-installed suction service valves also have one relief valve on each compressor discharge line. See Dimensions section on pages 11-18 for specific locations.
3. If sound enclosure is applied, run lines along floor so sound enclosure may be notched to clear lines.

Controls



The standard microprocessor-based control in the 30HX units provides the following functions:

- leaving fluid temperature control (using both entering and leaving fluid sensors)
- 7-day time sequence of both pump and chiller
- temperature reset from return fluid (standard) or from outdoor ambient (accessory), occupied space temperature (accessory), 4 to 20 mA signal (accessory), or via the optional Carrier Comfort Network (CCN)
- automatic compressor lead-lag switching based on compressor accumulated run times and number of cycles
- automatic temperature range across the cooler adjustment
- fully automatic control of the chiller components


A 4-line, 20-character per line display is used to accomplish the following (see figure below):

- set schedules and set points
- identify operating mode
- display current temperatures and pressures being used by the control for internal calculations
- identify abnormal (alarm or alert) conditions

Sequence of operation

The control has a 44 F (6.2 C) leaving fluid temperature (LWT) set point as shipped from the factory. If temperature reset or demand limiting is in effect, this set point may change.

Start-up — The chiller will start when the circulating pump is energized. (If the flow switch is applied, the chiller starts after the flow has been proven.) The compressor starts unloaded.

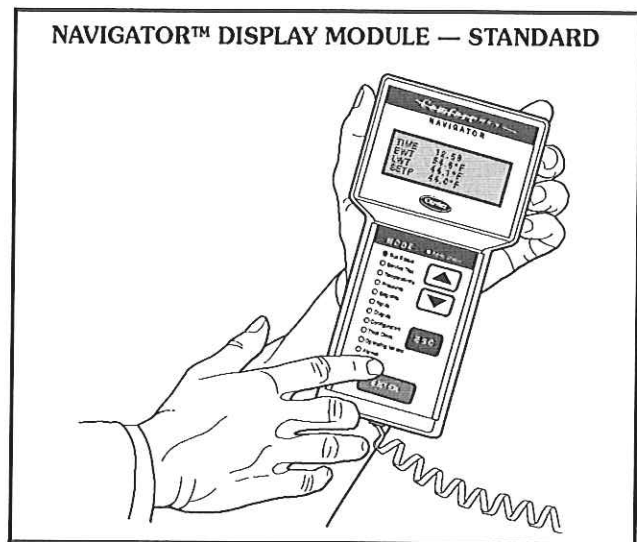

NOTE: Which compressor starts first is determined by the automatic lead/lag feature.

If the entering fluid temperature is 85 F (29 C) or higher, the maximum operating pressure (MOP) feature limits the suction pressure to keep the chiller on line.

Normal operation — The entering fluid temperature sensor monitors changes in entering fluid temperature to anticipate changes in the cooling load. Based on leaving fluid temperature, the control adds or subtracts capacity to maintain a constant leaving fluid temperature.

Dual chiller control — The Dual Chiller Routine is available for the control of two units supplying chilled fluid on a common loop.

In parallel flow applications, an additional leaving fluid temperature thermistor must be installed and connected to the lead chiller.

Transition to off — The chiller unloads once the “time-to-stop” signal has been given. This signal can be either internal or external.

Safeties — The 30HX control as shipped from the factory automatically deenergizes any active compressor that experiences any of the following:

- electrical overload
- thermal overload protection
- high pressure
- low oil pressure
- loss of refrigerant charge
- loss of phase protection
- reverse rotation (control prevents compressor start)
- current imbalance
- ground current
- low chilled fluid temperature

Additional information

Detailed information on controls and operation is available in the Controls, Start-Up, Operation and Troubleshooting guide included with each unit. Packaged Service Training programs are also available. Contact your Carrier representative for more information.

SHERLOCK 402 Refrigerant Gas Monitoring System



ETL Listed
Conforms To UL Std. 3111-1
Certified To CAN/CSA
C22.2 Std. No. 1010.1



Monitoring Panel

The *Sherlock 402* Control Module is a hard wired, electronic control panel that is capable of monitoring the analog output signal of up to eight *Sherlock* Refrigerant Gas Sensors or seven *Sherlock* Refrigerant Gas Sensors and one *Sherlock* Oxygen Depletion Sensors and two digital dry-contact switches. The Control Module will activate four Form C SPDT relay contacts based upon the programmed alarm setpoints of each sensor. The relays are referred to as K1A, K1B for the first alarm level and K2A, K2B for the second alarm level. There is optional zone isolation alarm relay (A-H) for each Sensor. The Control Module can be located in the area to be monitored, or in a separate location, typically outside of the monitored room.

Monitoring Points

Each monitoring point consists of an analog signal generating sensor connected to the control module via discrete, three conductor cable. Each sensor can be mounted up to 800 feet (longer run with special cable) away in locations where leaked refrigerant is likely to concentrate.

The gas sensors are available in three varieties:

- Ceramic Metal Oxide Semiconductor (CMOS) or Solid State Sensor
- Non-Dispersive, Pyro-Electric Infrared Sensor.
- Oxygen Depletion Electro-chemical Sensor.

Alarm Level Settings

The *Sherlock 402* allows you to set a unique Level 1 Alarm Setpoint and Level 2 Alarm Setpoint for each individual sensor. When an Alarm Setpoint is exceeded, corresponding alarm relays are activated. Each Alarm Setpoint has a programmable Alarm Delay, 1 to 120 minutes. Sensor readings are required to exceed an Alarm Setpoint for the programmed amount of time before the control activates the corresponding alarm relay contacts. For example, if the Alarm Setpoint is 200 and the Alarm Delay is five minutes, the control will enter an alarm condition only if the sensor detects a level of 200 or higher for more than five minutes.

Alarm Indication

All alarms are logged to indicate which sensor went in and out of any of the two alarm levels, the time and date of the alarm. The alarm log stores the last 32 alarms. When a sensor is in alarm, an alarm LED for this sensor on the front panel will turn to red color, the on-board beeper will be beeping and the display will show the activated alarm level.

Alarm Relay Contacts

The *Sherlock 402* provides two fused SPDT (Single Pole Double Throw) relay outputs for each alarm level that switch positions in the event of an alarm condition. Level 1 Alarm activates K1A and K1B relays. Level 2 Alarm activates K2A and K2B relays. Level 2 alarm on each individual sensor can be disabled. One alarm relay on each level (K1B/K2B) can be silenced (returned to non-alarm state) when the SILENT button on the front panel is pushed. The other alarm relay will remain active until the alarm condition is cleared. The *Sherlock 402* can be programmed so that the alarm is cleared automatically when the air is cleared below the alarm setpoint (UNLATCHED). The relays can also be programmed so the alarm is latched "ON" until the alarm is manually reset. The K1/K2 alarm level can be configured so the relays are "Energized to Alarm" (where the C-NC contacts open on alarm) or "De-Energized to Alarm" (where the relay is energized during normal operations and the C-NC contacts close on alarm). Optional zone isolation alarm relay(A-H) for each sensor can be programmed to activate by level 1 or level 1&2 alarm.

Sensor Failure Monitoring

The *Sherlock 402* constantly monitors the wiring to the sensors. Should any of the activated sensor wires be cut or disconnected, "OPEN" will appear on the SHERLOCK display, the K1A and K1B relays will be activated and the condition is logged.

Setback Alarm Settings

In some locations the sensor may be expected to function in two different environments. For example, the sensor may have to perform in still air (i.e. with the exhaust fan off) and in moving air (i.e. with the exhaust fan on), or the sensor may be used in a location where changes in air quality, perhaps caused by the use of propane powered floor buffers, elevates the sensor readings. The *Sherlock 402* provides a feature called SETBACK to accommodate alternate environments under which the sensor would operate. SETBACK provides a second ALARM SETPOINT and a second ALARM DELAY enabling the sensor to perform in this second environment. The *Sherlock 402* switches to the second set of parameters when a dry contact (i.e. air flow, sail switch or timer) closes or on a daily time schedule.

Each sensor can be programmed with one of five SETBACK options:

- 1) No SETBACK
- 2) SETBACK triggered by setback input 1 and the Setback Clock
- 3) SETBACK triggered by setback input 2 only

Each sensor can be programmed with only one SETBACK option; however, different sensors may be programmed to follow different options.

SHERLOCK 402 Refrigerant Gas Monitoring System



ETL Listed
Conforms To UL Std. 3111-1
Certified To CAN/CSA
C22.2 Std. No. 1010.1

MODEL #	NEMA/IP RATING	ELECTRICAL CATEGORY	POLLUTION PROTECTION
402	1	II	2
402-4	4X/IP67	II	3
402-PM	1	II	2

NEMA 1 Compliant Enclosure - This enclosure is intended for indoor use only primarily to provide a degree of protection against contact with the enclosed equipment. The enclosure is not designed to provide protection from water or to be placed in a hazardous environment. Mount only in Pollution Level 2 environments, i.e. environmentally controlled offices, control rooms, or environmentally controlled machine rooms.

DIMENSIONS 12"H x 9.25"W x 5.25"D Nema 1

NEMA 4X Compliant Enclosure - This enclosure is intended for either indoor or outdoor use, 0 to 50 °C, to provide a degree of protection against corrosion, windblown dust and rain, splashing water, and hose directed water.

DIMENSIONS 14"H x 12"D x 7"D Nema 4X

NEMA 1 Panel Mount Option - The control and display assemblies must be suitably mounted in an enclosure. The Faceplate may be surface mounted onto a Nema 1 enclosure. The IO Board Assembly must be mounted within an enclosure providing at least Nema 1 protection.

DIMENSIONS 10.2"H x 8.5" W x 2"D PM Faceplate
10.6"H x 8.5"W x 3"D PM Backplate

POWER 90 to 250VAC, 50/60 Hz, 1.0 Amps

INPUTS Four (4) **SHERLOCK** sensor *Cmos or IR*

or

Three (3) **SHERLOCK** sensor *Cmos or IR*

One Oxygen Depletion Sensor

Two dry contacts -- Setback 1 / Setback 2

OUTPUTS Four SPDT, 1 Form C relays 250VAC, 3.15Amp Slo-Blo fuse

Optional Zone Isolation Relays - Four SPDT, 1 Form C relays 250VAC,
3.15Amp Slo-Blo fuse

OPERATING TEMPERATURE 45°F - 99°F

OPERATING HUMIDITY 30% - 90% RH, non- condensing

ALARMS Two Alarm Levels, two SPDT Relays per level.
One Silenceable when in alarm
Optional One (1) Zone Isolation alarm relay per each sensor.

DISPLAY 2 lines by 20 characters Alphanumeric LCD with back light
Alarm Indication LED -- indicates active alarm

KEYPAD 5 tactile key switches: *Scroll up, Scroll down, Select/Change, Exit,*
Alarm Silence/Clear

ALARM INDICATORS

LCD DISPLAY Name, description, and current reading of alarming sensor

BUZZER Piezo-electric, 90db @10ft, silenceable

STATUS LED Four on front panel of control. Indicates alarm status of
each sensor

STROBE LIGHT (Optional) Mounted on top of the housing, activates during
any alarm condition.

Horn-Strobe

Audible and Visual signal to alert the user in alarm condition. Makes any alarm visible during an emergency.

- Patented Self-contained, 8ohm 15 watt Indoor/Outdoor Armored Speaker.
- Can be mounted within a mechanical machinery room for Mechanical Code alarm requirements
- The full featured armored speaker consists of a light weight rust proof aluminum die-cast housing and a dual-action plunger switch for tamper supervision for a normally closed loop.
- Can be connected to most security or energy management systems.
- The armored speaker DOES NOT require additional metal boxes, tamper switches, special tools, or training to install and operate.
- Comes completely assembled and ready for installation.
- Operates on 5 to 14VDC.
- Easy installation and mounting.
- Clear dome lens. Available in BLUE (Standard), RED and AMBER.
- High-powered "U" shaped Xenon bulb flash is visible for miles.
- High-Impact plastic case is moisture and corrosion-resistant.
- Flash rate is approx. 60 to 100 flashes per minute, depending upon the operating voltage.



Specifications

ENCLOSURE RATING:	Indoor/Outdoor 5.8 in X 8.1 in X 4.8 in
POWER:	12V DC, 865mA
STARTING VOLTAGE:	9.6V DC
OPERATING VOLTAGE:	9.6V to 14.4V DC
SOUND OUTPUT:	105dB(A) @ 10 FT
FLASHING RATE:	20 - 100 flashes/min (Voltage Dependant)
OPERATING ENVIRONMENT:	
Temperature:	14 TO 140 °F (-10 TO 60 °C)
Humidity:	0 TO 95% RH Non-condensing
LENS COLOR:	BLUE

Features

Aluminum diaphragm
Rust free Beige color aluminum die-cast housing
8 ohm
Dual-action tamper switch using reed switch
Up-front screw terminals for easier field wiring
Mounts directly to the wall or to a 4 5/16" square back box



Controls Start-Up, Operation Service, and Troubleshooting

SAFETY CONSIDERATIONS

Installing, starting up, and servicing this equipment can be hazardous due to system pressures, electrical components, and equipment location (roof, elevated structures, etc.). Only trained, qualified installers and service mechanics should install, start up, and service this equipment.

When working on this equipment, observe precautions in the literature, and on tags, stickers, and labels attached to the equipment, and any other safety precautions that apply. Follow all safety codes. Wear safety glasses and work gloves. Use care in handling, rigging, and setting this equipment, and in handling all electrical components.

▲ WARNING

Electrical shock can cause personal injury and death. Shut off all power to this equipment during installation and service. There may be more than one disconnect switch. Tag all disconnect locations to alert others not to restore power until work is completed.

▲ CAUTION

This unit uses a microprocessor-based electronic control system. Do not use jumpers or other tools to short out components, or to bypass or otherwise depart from recommended procedures. Any short-to-ground of the control board or accompanying wiring may destroy the electronic modules or electrical components.

▲ WARNING

To prevent potential damage to heat exchanger tubes always run fluid through heat exchangers when adding or removing refrigerant charge. Use appropriate brine solutions in cooler and condenser fluid loops to prevent the freezing of heat exchangers when the equipment is exposed to temperatures below 32 F (0° C).

DO NOT VENT refrigerant relief valves within a building. Outlet from relief valves must be vented outdoors in accordance with the latest edition of ANSI/ASHRAE (American National Standards Institute/American Society of Heating, Refrigeration and Air Conditioning Engineers) 15 (Safety Code for Mechanical Refrigeration). The accumulation of refrigerant in an enclosed space can displace oxygen and cause asphyxiation. Provide adequate ventilation in enclosed or low overhead areas. Inhalation of high concentrations of vapor is harmful and may cause heart irregularities, unconsciousness or death. Misuse can be fatal. Vapor is heavier than air and reduces the amount of oxygen available for breathing. Product causes eye and skin irritation. Decomposition products are hazardous.

▲ WARNING

DO NOT attempt to unbrazed factory joints when servicing this equipment. Compressor oil is flammable and there is no way to detect how much oil may be in any of the refrigerant lines. Cut lines with a tubing cutter as required when performing service. Use a pan to catch any oil that may come out of the lines and as a gage for how much oil to add to system. DO NOT re-use compressor oil. Do NOT leave refrigerant system open to air any longer than necessary. Seal circuits being serviced and charge with dry nitrogen to prevent oil contamination when timely repairs cannot be completed.

CONTENTS

	Page
SAFETY CONSIDERATIONS	1
GENERAL	2,3
MAJOR SYSTEM COMPONENTS	3,4
Main Base Board (MBB)	3
Screw Compressor Board (SCB)	3
Electronic Expansion Valve (EXV) Board	3
<i>ComfortLink</i> Compressor Protection (CCP) Board	3
Energy Management Module (EMM)	3
Enable/Off/Remote Connect Switch	3
Emergency On/Off Switch	3
Board Addresses	3
Control Module Communication	3
Carrier Comfort Network (CCN) Interface	3
OPERATION DATA	4-40
Electronic Expansion Valve (EXV)	4
• EXV OPERATION	
• ECONOMIZER OPERATION	
Oil Pumps	5
Motor Cooling	5
Back Pressure Valve (30GXN,R and 30HXA only)	5
Sensors	5
<i>ComfortLink</i> Compressor Protection (CCP) Board	7
• OUTPUTS	
• INPUTS	
Wye-Delta vs Across-the-Line (XL) Starting Option	8
Capacity Control	8
• MINUTES LEFT FOR START	
• MINUTES OFF TIME	
• LOADING SEQUENCE	
• CLOSE CONTROL	
• LEAD/LAG DETERMINATION	
• CAPACITY SEQUENCE DETERMINATION	
• MINIMUM LOAD VALVE	
• CAPACITY CONTROL OVERRIDES	

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

CONTENTS (cont)

	Page
Head Pressure Control	11
• GENERAL	
• AIR-COOLED UNITS (30GXN,R)	
• WATER-COOLED UNITS (30HXC)	
• CONDENSERLESS UNITS (30HXA)	
• 09DK AIR-COOLED CONDENSERS	
• 09AZ AIR-COOLED CONDENSERS	
• OPERATION SEQUENCE	
• VARIABLE SPEED FAN CONTROL	
• ADJUSTING PID ROUTINES	
Control Methods	17
• SWITCH	
• 7-DAY SCHEDULE	
• OCCUPANCY	
• CCN	
Cooling Setpoint Select	17
Ice Mode	17
Cooler and Condenser (30HXC)	
Pump Control	17
• COOLER PUMP CONTROL	
• CONDENSER PUMP CONTROL	
Flow Sensor	18
Cooler Heater Control	18
Oil Heater Control	18
Navigator Display Module Usage	18
Service Test	19
Configuring and Operating Dual Chiller Control	19
Alarms/Alerts	36
Run Hours and Starts	36
Temperature Reset	36
Demand Limit	38
• DEMAND LIMIT (2-Stage Switch Controlled)	
• EXTERNALLY POWERED DEMAND LIMIT	
• DEMAND LIMIT (CCN Loadshed Controlled)	
Cooling Set Point (4 to 20 mA)	39
TROUBLESHOOTING	41-51
Checking Display Codes	41
Unit Shutoff	41
Complete Unit Stoppage	41
Single Circuit Stoppage	41
Restart Procedure	41
• POWER FAILURE EXTERNAL TO THE UNIT	
Alarms and Alerts	41
Compressor Alarm/Alert Circuit	42
EXV Troubleshooting Procedure	50
• INSPECTING/OPENING ELECTRONIC EXPANSION VALVES	
• BRAZED-PLATE ECONOMIZERS	
SERVICE	52-71
Servicing Coolers and Condensers	52
• TUBE PLUGGING	
• RETUBING	
• TIGHTENING COOLER/CONDENSER HEAD BOLTS	
Inspecting/Cleaning Heat Exchangers	52
• COOLERS	
• CONDENSERS (30HX Only)	
Water Treatment	53
Condenser Coils (30GXN,R Only)	53
• COIL CLEANING	
• CLEANING E-COATED COILS	
Condenser Fans (30GXN,R Only)	54
Refrigerant Charging/Adding Charge	55
Oil Charging/Low Oil Recharging	56
Oil Filter Maintenance	57
• REPLACING THE EXTERNAL OIL FILTER	
• REPLACING THE INTERNAL OIL FILTER	
Compressor Changeout Sequence	57
• BURNOUT CLEAN-UP PROCEDURE	
Moisture-Liquid Indicator	59
Filter Drier	59
Liquid Line Service Valve	59
Thermistors	59
• LOCATION	
• THERMISTOR REPLACEMENT	
Pressure Transducers	65
• TROUBLESHOOTING	
• FLOW SENSOR	
Safety Devices	68
• COMPRESSOR PROTECTION	
• OIL SEPARATOR HEATERS (30GX)	
• COOLER PROTECTION	
Relief Devices	68
• PRESSURE RELIEF VALVES	
Control Modules	68
• MAIN BASE BOARD (MBB), SCREW COMPRESSOR BOARD (SCB), EXPANSION VALVE BOARD (EXV), ENERGY MANAGEMENT MODULE (EMM), COMFORTLINK™ COMPRESSOR PROTECTION BOARD (CCP), AND THE NAVIGATOR	
• RED LED	
• GREEN LED	
• YELLOW LED	
Carrier Comfort Network (CCN) Interface	69
Replacing Defective Processor Module	69
Winter Shutdown Preparation	70
Maintenance	70
PRE-START-UP PROCEDURE	71
System Check	71
START-UP AND OPERATION	71,72
Actual Start-up	71
Operating Sequence	71
FIELD WIRING	72-74
APPENDIX A	
(Compressor Must Trip Amps)	75-84
APPENDIX B	
(Capacity Loading Sequence)	85-89
APPENDIX C (Available Accessories)	90,91
APPENDIX D (Building Interface)	92-94
APPENDIX E (Cooler and Condenser Pressure Drop)	95-100
APPENDIX F	
(Typical System Components)	101-112
APPENDIX G (CCN Configuration)	113-125
APPENDIX H (30GXN,R Duplex Combinations) ..	126
APPENDIX I (Motormaster® V Operation Instructions)	127-129
APPENDIX J (Maintenance Log)	130
START-UP CHECKLIST (For 30GX,HX Liquid Chiller)	CL-1 to CL-10
GENERAL	
<p>IMPORTANT: These units use refrigerant R-134a. Compressor oil used with R-134a is Castrol Icematic SW-220, Carrier Specification #PP47-32.</p>	
<p>This publication contains Controls Start-Up, Service, Operation and Troubleshooting data for the 30GXN,R080-528 and 30HXA,C076-271 screw chillers.</p> <p>Circuits are identified as circuits A and B, and compressors are identified as A1 or A2 in circuit A, and B1 or B2 in circuit B. Refer to Appendix H for Duplex unit combinations.</p> <p>The 30GXN,GXR,HX Series chillers feature microprocessor-based electronic controls and electronic expansion valves (EXV) in each refrigeration circuit.</p>	

The control system cycles compressor loaders and/or compressors to maintain the selected leaving fluid temperature set point. The system automatically positions the EXV to maintain the specified discharge gas superheat temperature in the circuit. The system also has capabilities to control a condenser water valve to maintain suitable discharge pressure for the 30HXC unit. Safeties are continuously monitored to prevent the unit from operating under unsafe conditions. A scheduling function can be programmed by the user to control the unit's occupied and unoccupied schedules. The control also operates a test function and a manual control function that allows the operator to check output signals and ensure components are operable.

MAJOR SYSTEM COMPONENTS

Main Base Board (MBB) — This board contains the majority of the control system operating software and controls the operation of the machine. It has 11 input channels and 11 output channels.

The MBB continuously monitors input/output channel information received from all the modules and controls all output signals for all output channels. The processor module also controls the EXV driver module, commanding it to open or close each EXV in order to maintain the proper cooler level. Information is transmitted between the MBB; *ComfortLink*[™] Compressor Protection (CCP) boards, the EXV driver module, the Screw Compressor Board (SCB), the Energy Management Module (EMM) and the Navigator modules through a 3-wire communications bus called the Local Equipment Network (LEN). The remote enhanced display is connected to the MBB through a 3-wire communications bus, but uses a different communication bus called the Carrier Comfort Network (CCN). The CCN bus is also used to communicate to other CCN devices when the unit is installed in a network application.

Screw Compressor Board (SCB) — The SCB has 8 inputs along with 2 analog and 5 discrete outputs. The SCB module communicates the status of the inputs with the MBB and operates the oil heater (30GXN,R only), cooler heater (30GXN,R only) and oil pump outputs.

Electronic Expansion Valve (EXV) Board — The EXV board has 4 inputs and 2 outputs. It receives signals from the MBB and operates the electronic expansion devices. The electronic expansion valve board also sends the MBB the status of its 4 input channels.

ComfortLink Compressor Protection (CCP) Board — The CCP board monitors the high-pressure switch status, running current and motor temperature for each compressor. Each CCP board controls up to 2 compressors. The CCP board also controls the motor cooling solenoid, oil solenoid and contactor outputs. A pre-punched configuration header for each compressor determines the must trip amps setting. Each CCP board sends the MBB each compressor's motor temperature, relay status and running current as a percentage of the must trip amps value. The CCP board also communicates any alarm conditions as the feedback value.

Energy Management Module (EMM) — The EMM is available as a factory-installed option or as a field-installed accessory. The EMM receives 4 to 20 mA inputs for the temperature reset, cooling set point reset and demand limit functions. The EMM also receives the switch inputs for the field-installed 2-stage demand limit and ice done functions. The EMM communicates the status of all inputs with the MBB, and the MBB adjusts the control point, capacity limit, and other functions according to the inputs received.

Enable/Off/Remote Contact Switch — The Enable/Off/Remote Contact switch is a 3-position switch used to control the chiller (see Table 1). When switched to the Enable

position the chiller is under its own control. Move the switch to the Off position to shut the chiller down. Move the switch to the Remote Contact position and a field-installed dry contact can be used to start the chiller. The contacts must be capable of handling a 24-vac, 20-mA load. In the Enable and Remote Contact (dry contacts closed) positions, the chiller is allowed to operate and respond to the scheduling configuration, CCN configuration and set point data.

Emergency On/Off Switch — The Emergency On/Off switch should only be used when it is required to shut the chiller off immediately. Power to the MBB, EMM, EXV, SCB and Navigator display is interrupted when this switch is off and all outputs from these modules will be turned off.

Board Addresses — The Main Base Board (MBB) has an Instance jumper that must be set to '1'. The EXV, SCB and EMM boards have 4-position DIP switches that must be set to 'On' for all boards. The CCP address has a 4-position DIP switch. Switches 3 and 4 set the address.

Control Module Communication

RED LED — Proper operation of the control boards can be visually checked by looking at the red status LEDs (light-emitting diodes). When operating correctly, the red status LEDs should be blinking in unison at a rate of once every 2 seconds. If the red LEDs are not blinking in unison, verify the board address and that correct power is being supplied to all modules. Be sure that the Main Base Board (MBB) is supplied with the current software. If necessary, reload current software. If the problem still persists, replace the MBB. A board LED that is lit continuously or blinking at a rate of once per second or faster indicates that the board should be replaced.

GREEN LED — The MBB has one green LED. The Local Equipment Network (LEN) LED should always be blinking whenever power is on. All other boards have a LEN LED that should be blinking whenever power is on. Check LEN connections for potential communication errors at the board J3 and/or J4 connectors. Communication between modules is accomplished by a 3-wire bus. These 3 wires run in parallel from module to module. The J5 connector on the MBB provides both power and communication directly to the Navigator.

YELLOW LED — The MBB has one yellow LED. The Carrier Comfort Network (CCN) LED will blink during times of network communication.

Carrier Comfort Network (CCN) Interface — The 30GXN,R and 30HX chiller units can be connected to the CCN if desired. The communication bus wiring is a shielded, 3-conductor cable with drain wire and is supplied and installed in the field. The system elements are connected to the communication bus in a daisy chain arrangement. The positive pin of each system element communication connector must be wired to the positive pins of the system elements on either side of it. This is also required for the negative and signal ground pins of each system element. Wiring connections for CCN should be made at TB3. Consult the CCN Contractor's Manual for further information.

NOTE: Conductors and drain wire must be 20 AWG (American Wire Gage) minimum stranded, tinned copper. Individual conductors must be insulated with PVC, PVC/nylon, vinyl, Teflon, or polyethylene. An aluminum/polyester 100% foil shield and an outer jacket of PVC, PVC/nylon, chrome vinyl, or Teflon with a minimum operating temperature range of -20 C to 60 C is required. Wire manufactured by Alpha (2413 or 5463), American (A22503), Belden (8772), or Columbia (02525) meets the above mentioned requirements. It is important when connecting to a CCN communication bus that a color-coding scheme be used for the entire network to simplify the installation. It is recommended that red be used for the signal positive, black for the signal negative and white for the signal ground. Use a similar scheme for cables containing

different colored wires. At each system element, the shields of its communication bus cables must be tied together. If the communication bus is entirely within one building, the resulting continuous shield must be connected to a ground at one point only. If the communication bus cable exits from one building and enters another, the shields must be connected to grounds at the lightning suppressor in each building where the cable enters or exits the building (one point per building only).

To connect the unit to the network:

1. Turn off power to the control box.
2. Cut the CCN wire and strip the ends of the red (+), white (ground), and black (-) conductors. (Substitute appropriate colors for different colored cables.)
3. Connect the red wire to (+) terminal on TB3, the white wire to COM terminal, and the black wire to the (-) terminal.
4. The RJ-14 CCN connector on TB3 can also be used, but is only intended for temporary connection (for example: a laptop computer running Service Tool).

Table 1 — Unit Mode from Control/Enable/Off/Remote Contact and CCN State

SWITCH POSITION	REMOTE CONTACTS	CCN CONFIGURATION	CCN STATE	UNIT MODE
ENABLE	NR	DISABLE	NR	LOCAL ON
		ENABLE	RUN	CCN ON
			STOP	CCN OFF
OFF	NR	NR	NR	LOCAL OFF
	OPEN	NR	NR	LOCAL OFF
REMOTE CONTACT	CLOSED	DISABLE	NR	LOCAL ON
		ENABLE	RUN	CCN ON
			STOP	CCN OFF

LEGEND

CCN — Carrier Comfort Network
NR — Input Not Read by Processor

NOTE: If the unit is configured for a clock, then the unit is under clock control if it is in an ON mode.

OPERATION DATA

Electronic Expansion Valve (EXV) — The MBB controls the EXV through the EXV board. The EXV (electronic expansion valve) is a device that contains a linear actuator stepper motor. See Fig. 1.

EXV OPERATION — High-pressure liquid refrigerant enters the valve through the side. A series of calibrated slots are located inside the orifice assembly. As refrigerant passes through the orifice, the pressure drops and the refrigerant changes to a 2-phase condition (liquid and vapor). To control refrigerant flow for different operating conditions, the sleeve moves up and down over the orifice, thereby changing orifice size. The sleeve is moved by a linear stepper motor. The stepper motor moves in increments and is controlled directly by the processor module. As the stepper motor rotates, motion is transferred into linear movement by the lead screw. Through the stepper motor and lead screw, 15,000 discrete steps of motion are obtained. The large number of steps and long stroke result in very accurate control of refrigerant flow.

Each compressor has a discharge gas temperature sensor mounted vertically in the top of the muffler assembly. The discharge gas temperature sensor monitors the discharge gas temperature leaving each compressor and sends this information to the MBB through LEN communication with the EXV board. At initial start-up, the EXV position is at zero. After that, the microprocessor keeps accurate track of the valve position in order to use this information as input for the other control functions. The processor does this by initializing the EXVs at start-up. The processor sends out enough closing pulses to the valve to move it from fully open to fully closed, then resets the position counter to zero. From this point, until

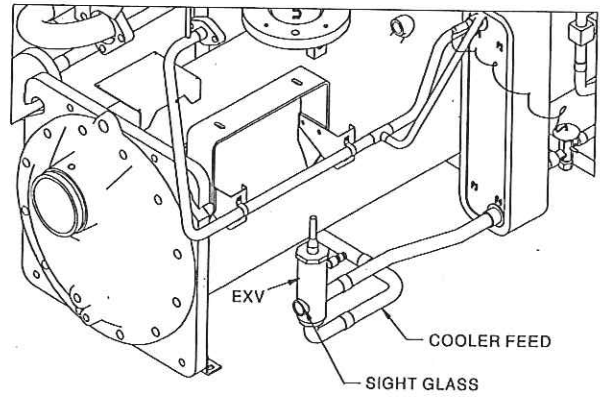


Fig. 1 — Electronic Expansion Valve (EXV)

the next initialization, the processor counts the total number of open and closed steps it has sent to each valve.

ECONOMIZER OPERATION — Economizers are factory installed on 30GXN,R108,118-350 and associated modular units and 30HXA,C161-271 units. All other sizes use standard EXVs. The economizer is a brazed plate heat exchanger designed to improve chiller capacity and efficiency as well as providing compressor motor cooling. See Fig. 2. On 30GX chillers the economizer is active when any compressor is fully loaded. On 30HXA,C chillers the economizer is active all the time.

Liquid refrigerant is supplied from the condenser to the top of the economizer. As the refrigerant passes through the economizer, its pressure is reduced to an intermediate level. Next, the refrigerant flows to the EXV which regulates flow to the cooler to maintain the discharge superheat setpoint.

The increase in performance is achieved by diverting a small amount of liquid through a thermostatic expansion valve to a second circuit in the brazed-plate heat exchanger. This will further subcooling the liquid in the first circuit as the refrigerant flashes to vapor. This increase in subcooling provides additional capacity. Also, since the additional power required to accomplish this is minimal; the efficiency of the machine improves. The vapor that flashes leaves the top of the economizer where it passes to the compressor and is used to provide motor cooling. After passing over the motor windings, the refrigerant reenters the cycle at an intermediate port in the compression cycle.

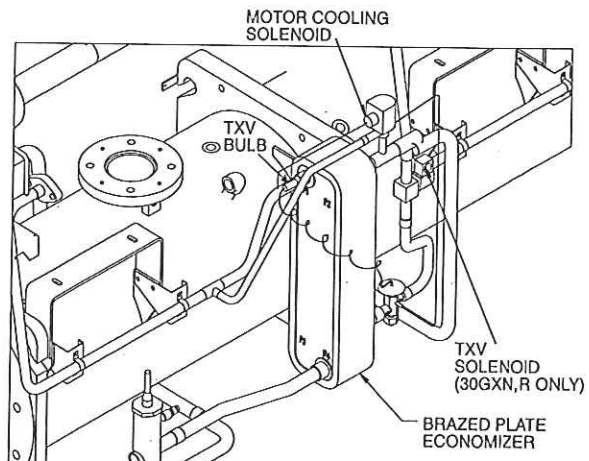


Fig. 2 — Brazed Plate Economizer

Oil Pumps — The 30GXN,GXR,HX screw chillers use one externally mounted prelubricating oil pump per circuit. This pump is operated as part of the start-up sequence. On 30GXN,R units, the pumps are mounted above the base rails on the oil separator side of the unit (see Fig. 3). The pumps are mounted to a bracket on the condensers of 30HXC units and to the oil separator on 30HXA units.

When a circuit is required to start, the controls energize the oil pump first and read the oil pressure transducer reading. The pump is operated for a period of 20 seconds, after which the oil solenoid is energized to open the oil inlet valve at the compressor. The control again reads the pressure from the oil pressure transducer. If the pump has built up sufficient oil pressure, the compressor is allowed to start after 15 seconds.

Once the compressor has started, the oil pump will continue to run for 120 seconds.

If the pump is not able to build up enough oil pressure, the pump is turned off. Within 3 seconds, the pump is re-energized and makes two additional attempts, if necessary, to build oil pressure. The control generates an alarm if the third attempt fails.

The oil pump is also used to supplement system pressure under certain operating conditions. The oil flow requirements of the compressor vary based on pressure differential across the compressor. The oil pump is designed to provide differential oil pressure during low pressure differential conditions. It is not designed to overcome high pressure drop across filters during high pressure differential conditions.

If the differential oil pressure (oil pressure – economizer pressure) for a compressor is too low the oil pump will be started. Just before the oil pump is started the control measures the pressure differential between the discharge pressure and oil pressure (oil system pressure drop). The oil system pressure drop is saved and used to determine when the oil pump should be shut off.

When the oil pump is operating, it is capable of increasing oil pressure from 0 psi to 50 psi depending on the oil flow requirements of the compressor. For example, if the compressor needs 2 gpm (high pressure differential condition) and the oil pump is capable of 1.2 gpm, there is no pressure rise and the oil flow will bypass the check valve and supply the 2 gpm to the compressor. If the compressor requires .75 gpm, the oil pump will increase pressure to satisfy the oil pressure requirement.

The pump will continue to operate until the discharge pressure minus economizer pressure is greater than 17 psi plus the oil system pressure drop.

Example:

Discharge pressure	80 psi
Oil pressure	65 psi
Oil system pressure drop	80 – 65 = 15 psi
Economizer pressure	55 psi
Differential oil pressure	(65 – 55) = 10 psi
Suction pressure	40 psi

Based on the above conditions the oil pump will be started because differential oil pressure equals 10 psi. See Table 2.

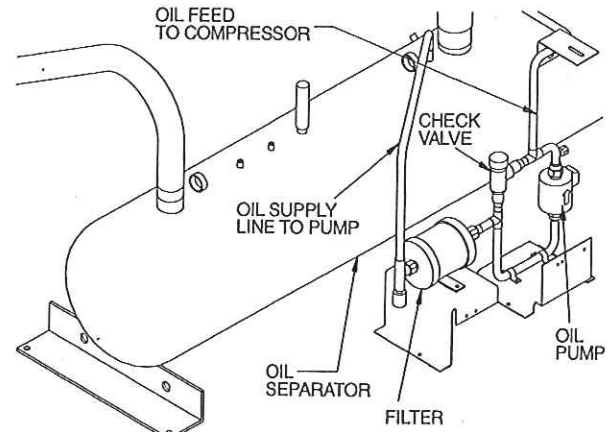


Fig. 3 — Oil Pump

Table 2 — Oil Pump Suction Pressure Requirements

SUCTION PRESSURE (SP)	OIL PUMP TURNS ON WHEN DIFFERENTIAL PRESSURE IS LESS THAN:
≤ 35 psig	12 psig
35 psig < SP < 51 psig	14.5 psig
≥ 51 psig	17 psig

The oil pump will continue to operate until the discharge pressure minus economizer pressure (which equals 25) is greater than 17 plus 15 (oil system loss before pump was started). The only way this can be satisfied is if the discharge pressure increases or the compressor unloads at which point the oil pump will be shut off.

Motor Cooling — Compressor motor winding temperatures are controlled to a set point of 200 F (93.3 C). The control accomplishes this by cycling the motor cooling solenoid valve to allow liquid refrigerant to flow across the motor windings as needed. On 30GXN,R units equipped with economizers, flash gas leaves the top of the economizer (when the circuit is fully loaded for 30GXN,R models only) and continually flows to the motor windings. All refrigerant used for motor cooling reenters the rotors through a port located midway along the compression cycle and is compressed to discharge pressure.

Back Pressure Valve (30GXN,R and 30HXA only) — This valve is located on the oil separator outlet on 30GXN,R units and mounted on the oil separator shell of 30HXA units. The valve's function is to ensure that there is sufficient system differential pressure to allow for oil to be driven back to the compressor. A small copper line (economizer pressure) is connected to the top of the valve, which contains an internal spring that closes a piston if the pressure in the oil separator is not at least 15 psig greater than the economizer pressure.

Sensors — The 30GXN,GXR,HX ComfortLink™ control system gathers information from sensors to control the operation of the chiller. The units use up to 10 standard pressure transducers and up to 10 standard thermistors (including 4 motor temperature thermistors). The sensors are listed in Table 3.

Table 3 — Thermistor and Transducer Locations

THERMISTORS			
Sensor	Description	Location	Connection Terminals
T1	Cooler Leaving Fluid Temp	Cooler Head Leaving Fluid Side	MBB, J8-13,14
T2	Cooler Entering Fluid Temp	Cooler Head Entering Fluid Side	MBB, J8-11,12
Motor Temp A1	Motor Temperature A1	Compressor A1 Junction Box	CCP1, plug J5
Motor Temp A2*	Motor Temperature A2	Compressor A2 Junction Box	CCP2, plug J5
Motor Temp B1	Motor Temperature B1	Compressor B1 Junction Box	CCP1, plug J9
Motor Temp B2†	Motor Temperature B2	Compressor B2 Junction Box	CCP2, plug J9
T5	Discharge Gas Temp Comp A1	Top of Comp A1 Discharge Line	EXV, J5-11,12
T6	Discharge Gas Temp Comp B1	Top of Comp B1 Discharge Line	EXV, J5-9,10
T3*	Discharge Gas Temp Comp A2	Top of Comp A2 Discharge Line	EXV, J5-7,8
T4†	Discharge Gas Temp Comp B2	Top of Comp B2 Discharge Line	EXV, J5-5,6
T9 (optional)**	Outdoor Air Thermistor/Dual LWT	Outside Air Stream/Common Leaving Fluid	TB5, terminals 7,8
T10 (optional)**	Space Temperature	Conditioned Space	TB5, terminals 5,6
COND EWT (optional)**	Condenser Entering Water Thermistor	Condenser Entering Fluid Line	TB2, terminals 1,2
COND LWT (optional)**	Condenser Leaving Water Thermistor	Condenser Leaving Fluid Line	TB2, terminals 3,4
PRESSURE TRANSDUCERS			
Sensor	Description	Location	Connection Terminals
DPT-A	Discharge Pressure Circuit A	Top of Condenser Separator Circuit A	MBB, J8-21,22,23
SPT-A	Suction Pressure Circuit A	Top of Cooler Circuit A	MBB, J8-24,25,26
EPT-A	Economizer Pressure Circuit A	Economizer Line Entering Comp A	SCB, J5-7,8,9
OPT-A1	Oil Pressure Compressor A1	Compressor A1 Oil Connection	SCB, J5-4,5,6
OPT-A2*	Oil Pressure Compressor A2	Compressor A2 Oil Connection	SCB, J5-1,2,3
DPT-B	Discharge Pressure Circuit B	Top of Oil Separator Circuit B	MBB, J8-15,16,17
SPT-B	Suction Pressure Circuit B	Top of Cooler Circuit B	MBB, J8-18,19,20
EPT-B	Economizer Pressure Circuit B	Economizer Line Entering Comp B	SCB, J6-7,8,9
OPT-B1	Oil Pressure Compressor B1	Compressor B1 Oil Connection	SCB, J6-4,5,6
OPT-B2†	Oil Pressure Compressor B2	Compressor B1 Oil Connection	SCB, J6-1,2,3

*30HX206-271 and 30GXN,R204-350, 370-528 only.

†30GXN,R281-350 only.

**Sensors are available as accessories for field installation (30HXC only).

ComfortLink™ Compressor Protection (CCP) Board — One CCP board controls up to 2 compressors. The CCP provides the following functions:

- compressor main contactor control
- Wye-Delta contactor transition
- compressor ground current protection
- motor temperature reading
- high-pressure protection
- reverse rotation protection
- current imbalance protection
- compressor oil solenoid control
- motor cooling solenoid control
- LEN communications
- starting and running overcurrent protection

The CCP has the following 4 output relays and 3 inputs:

OUTPUTS:

- compressor contactor
- compressor oil solenoid
- compressor motor cooling solenoid
- Wye-Delta transition relay

INPUTS:

- motor temperature
- three-phase current
- high-pressure switch

A diagram of the CCP board is shown in Fig. 4. One CCP board is installed on 30GXN,R080-178 and 30HXA,C076-186 units and two CCP boards are installed on 30GXN,R204-350 and 30HXA,C206-271 units. The address for each CCP board is set using DIP (dual in-line package) switches. For CCP1 (compressor A1 and B1), DIP switch 1 should be set to 'L' ('On' position for LEN communication). Switches 2, 3 and 4 should be set to '0' ("OFF" position). For CCP2 (compressor A2 for 30GXN,R204-268 and 30HXA,C206-271 and compressor B2 for 30GXN,R281-350), switch 1 should be set to 'L' and switches 3 and 4 should be set to '1' ("ON" position). Switch 2 should be set to '0' ("OFF" position). See Table 4 for CCP board connections. The CCP has a reset button located between the DIP switch and the J10 connector.

Each compressor's MTA (must trip amps) setting is communicated to the MBB during the initialization period. See Table 5 for DIP switch settings.

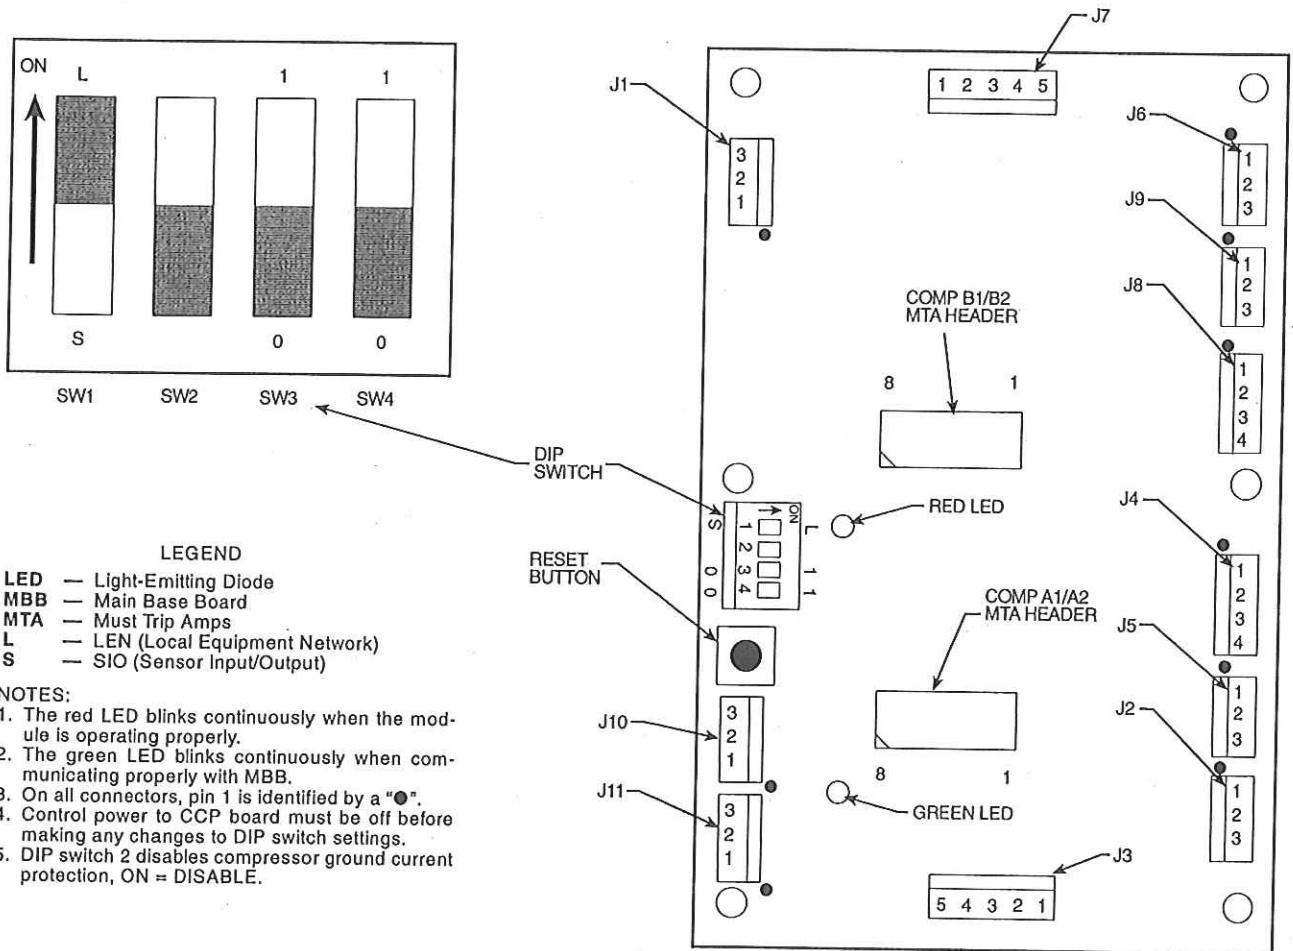


Fig. 4 — ComfortLink™ Compressor Protection (CCP) Board

Table 4 — ComfortLink™ Compressor Protection (CCP) Board Plug Connections

CCP PLUG	DESCRIPTION
J1	24-vac Power Input
J2, J6	Compressor Contactor(s)
J3, J7	High Pressure Switch, Oil and Motor Cooling Solenoids
J4, J8	Current Sensor Input
J5, J9	Compressor Motor Temperature Input
J10, J11	Communication Connections

NOTE: Plugs J2-J5 are for compressors A1 (CCP1) or A2 (CCP2). Plugs J6-J9 are for compressor B1 (CCP1) or B2 (CCP2).

Table 5 — CCP Address DIP Switch Settings

UNIT	CCP1				CCP2			
	1	2	3	4	1	2	3	4
30GXN,R080-178 30HXA076-186 30HXC076-186	L	OFF	0	0	—	—	—	—
30GXN,R204-350 30HXA206-271 30HXC206-271	L	OFF	0	0	L	OFF	1	1

To verify proper must trip amps header configuration, use the Navigator and the Configuration mode portion of Appendix A to locate the items CM.A1, CM.A2, CM.B1 and CM.B2 in the UNIT sub-mode. See Appendix A for correct settings. If the values do not match those in Appendix A, verify that the configuration headers have been properly punched out.

The CCP communicates on the LEN (Local Equipment Network) bus to the MBB. Proper operation of the CCP board can be verified by observing the 2 LEDs located on the board. The red LED blinks at a rate of once every 1 to 2 seconds. This indicates that the module is powered and operating correctly. The green LED blinks when the module is satisfactorily communicating with the MBB. The CCP communicates status of its inputs and outputs and reports 13 different alarm conditions to the MBB.

⚠ CAUTION

The CCP module has many features that are specifically designed to protect the compressor, including reverse rotation protection. Do not attempt to bypass or alter any of the factory wiring. Any compressor operation in the reverse direction will result in a compressor failure that will require compressor replacement.

The MBB will generate an alert when it receives an alarm input from the CCP. The alert will be generated as T051, T052, T055, or T056 (for Compressors A1, A2, B1, B2 respectively). Press the **ENTER** and **ESCAPE** buttons on the Navigator simultaneously to expand the full meaning of the alert. For example, the Navigator will read: T055 CIRCUIT B, COMPRESSOR 1 FAILURE-HIGH PRESSURE SWITCH TRIP.

The high-pressure switch is wired in series with the relay coils of the 8 relays on the CCP. If this switch opens during operation, all relays on the CCP are deenergized and the compressor is stopped. The failure is reported to the MBB and the processor module locks off the compressor from restarting until the alarm is manually reset.

Wye-Delta vs Across-the-Line (XL) Starting Option — All 30GXN,R and 30HX chillers operating at voltages of 230-3-60, 208/230-3-60 or 230-3-50 (4, 5, or 8 at

Position 12 in model number) are supplied with factory-installed Wye-Delta starters. All other voltage options can be ordered with either Wye-Delta or XL starting options. The XL starting method is the most cost effective and simply starts the compressor motor in a Delta configuration (the motors are designed for continuous operation in this configuration) using a single contactor. See Fig. 5. This is the simplest starting method to use and is ideal where starting current does not require limiting.

Where current limitations exist, the Wye-Delta option may be used. See Fig. 6. This option uses a factory-installed starter assembly for each compressor, which consists of 3 contactors labelled 1M, 2M, and S. As the compressor is started, the CCP module energizes contactors 1M and S, which connects and energizes the motor windings in a Wye configuration. The starting current required will be approximately 60% less than that required for an XL start due to the higher impedance of the motor windings when Wye connected. The compressor will attain about 100% of its normal operating speed (approximately 3 to 5 seconds) before the CCP module deenergizes the S contactor and energizes the 2M contactor, switching the compressor windings to a Delta wiring configuration. The S and 2M contactors in the starter assembly are both mechanically and electrically interlocked so that they will not both be energized at the same time.

Do not alter the factory-installed power wiring from the control box terminal block to the compressor junction block. Doing so will cause permanent damage to the compressor and will require that the compressor be replaced.

Capacity Control — The control system cycles compressors, loaders, and minimum load control valves to maintain the user-configured leaving chilled fluid temperature set point. Entering fluid temperature is used by the microprocessor to determine the temperature drop across the cooler and is used in determining the optimum time to add or subtract capacity stages. The chilled fluid temperature set point can be automatically reset by the return fluid temperature, space temperature or outdoor-air temperature reset features. It can also be reset from an external 4 to 20 mA signal (requires optional EMM), or from a network signal.

The capacity control algorithm runs every 30 seconds. The algorithm attempts to maintain the Control Point at the desired set point. Each time it runs, the control reads the entering and leaving fluid temperatures. The control determines the rate at which conditions are changing and calculates 2 variables based on these conditions. Next, a capacity ratio (SMZ, Outputs under Sub-mode GEN.O) is calculated using the 2 variables to determine whether or not to make any changes to the current stages of capacity. This ratio value ranges from -100 to + 100%. If the next stage of capacity is a compressor, the control starts (stops) a compressor when the ratio reaches + 100% (-100%). If the next stage of capacity is a loader, the control energizes (deenergizes) a loader when the ratio reaches + 60% (-60%). Loaders are allowed to cycle faster than compressors, to minimize the number of starts and stops on each compressor. A delay of 90 seconds occurs after each capacity step change.

MINUTES LEFT FOR START — This value is displayed in the Status subfunction and represents the amount of time to elapse before the unit is started. This value can be zero without the machine running in many situations. This can include being unoccupied, Remote Contact/Off/Enable switch in the OFF position, CCN not allowing unit to start, Demand Limit in effect, no call for cooling due to no load, and alarm or alert conditions present. If the machine should be running and none of the above are true, a minimum off time may be in effect. The machine should start normally once the time limit has expired.

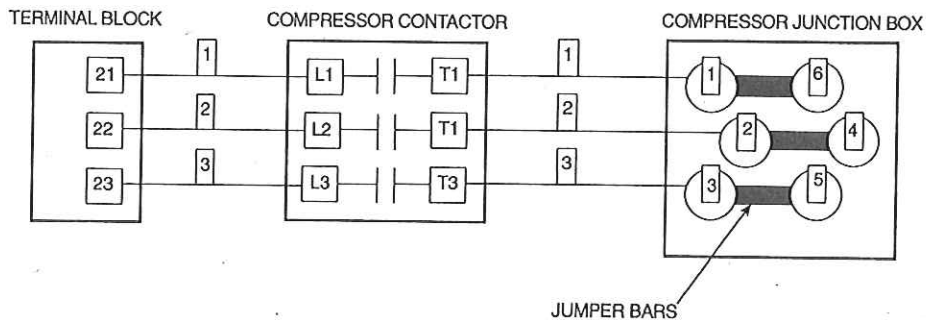


Fig. 5 — Across-the-Line (XL) Compressor Wiring

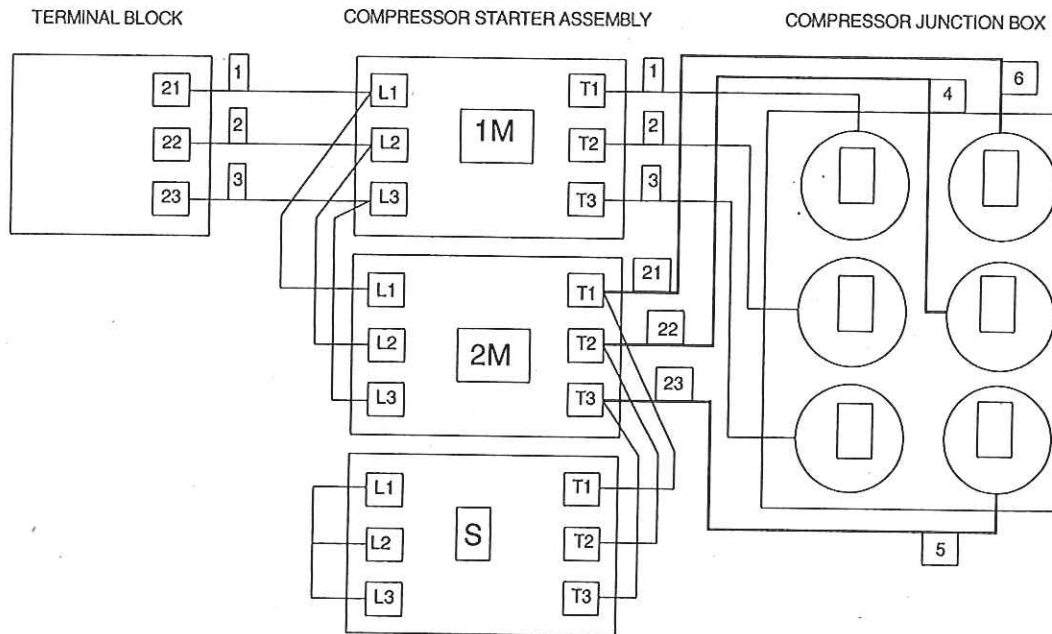


Fig. 6 — Wye-Delta Compressor Wiring

MINUTES OFF TIME (DELY, Configuration mode under sub-mode OPT2) — This user-configurable time period is used by the control to determine how long unit operation is delayed after power is applied/restored to the unit. Typically, this time period is configured when multiple machines are located on a single site. For example, this gives the user the ability to prevent all the units from restarting at once after a power failure. A value of zero for this variable does not mean that the unit should be running.

LOADING SEQUENCE — The 30GXN,GXR,HX compressor efficiency is greatest at full load. Therefore, the following sequence list applies to capacity control.

1. The next compressor is not started until all others are running at 100%.
2. The second unloading stage is only used during initial capacity staging of the unit at start-up.
3. Whenever a compressor is started in a circuit, the loaders in the circuit are deenergized for 15 seconds before the compressor is started. The loaders are energized 90 seconds after the compressor is started.

CLOSE CONTROL (CLS.C, Configuration mode under sub-mode OPT2) — When configured for Close Control, the control is allowed to use any loading/capacity control devices

required to maintain better leaving fluid temperature regulation. All stages of unloading are available. See Appendix B for an example.

LEAD/LAG DETERMINATION (LLCS, Configuration mode under sub-mode OPT2) — This is a configurable choice and is factory set to be automatic. The value can be changed to Circuit A or Circuit B leading, as desired. Set at automatic, the circuit with the lowest hours is started first. Changes to which circuit is the lead circuit and which is the lag are made when shutting off compressors.

On 30HX206-271 and 30GXN,R204-350 units set for staged loading, the control fully loads the lead circuit before starting the lag circuit and unloads the lag circuit first. When these units are set for equal loading, the control maintains nearly equal capacities in each circuit when the chiller is loading and unloading.

CAPACITY SEQUENCE DETERMINATION (LOAD, Configuration mode, under sub-mode OPT2) — This is configurable as equal circuit loading or staged circuit loading with the default set at staged. The control determines the order in which the steps of capacity for each circuit are changed. This control choice does NOT have any impact on machines with only 2 compressors.

MINIMUM LOAD VALVE (MLVS, Configuration mode under sub-mode OPT1) — When this option is installed and configured, the first stage of capacity is altered by energizing the Minimum Load valve relay. Once the control requires more capacity, the minimum load valve is deenergized and normal capacity staging resumes with loaders and compressors. Similarly, the Minimum Load valve relay will be energized for the last stage of capacity to be used before the circuit is shut down.

Configure Unit for Minimum Load Control — The chiller must be configured for minimum load control operation. This may be done using the Navigator. Set the Enable/Off/Remote Contact switch in the Off position.

1. Press until 'Select a Menu Item' is displayed.
2. Press to illuminate the Configuration mode LED.
3. Press and to select 'OPT1'. Press and then to select 'MLV'.
4. Press and enter the Password (use arrow keys and press for each digit) if required.
5. Use to change the flashing 'No' to 'Yes'. Press and the display says 'MLV Yes'.

The chiller is now configured for minimum load valve control.

Test Minimum Load Relay Outputs — After the unit is configured, test the operation of the relay and solenoid valve using the Service Test mode.

1. Switch the Enable/Off/Remote Contact switch to the 'Off' position.
2. Press on the Navigator to display 'Select a Menu Item' and press to illuminate the Service Test LED.
3. Press and 'TEST OFF' will be displayed.
4. Press (enter Password if required), and then to display 'TEST ON'.
5. Switch the EOR (Enable/Off/Remote Contact) switch to the "Enable" position.
6. Press to select 'COMP' and press .
7. Press to select 'MLV OFF'. Press followed by and again. The minimum load valve output will be turned on. Both circuits' solenoids are turned on at the same time.
8. Press , followed by and again to turn the valve output off.

Adjust Setting of Minimum Load Ball Valve — The minimum load ball valve must be adjusted to suit the application. Calibrate one circuit at a time as follows:

1. Adjust the ball valve so that it is approximately half open.
2. Operate the chiller in Manual Control mode, with one circuit operating, and all compressor loaders deenergized.
3. Record the cooler ΔT (the difference between cooler entering fluid temperature and cooler leaving fluid temperature) at this fully unloaded condition.
4. Use the Manual Control feature to enable the minimum load valve for the circuit that is operating.
5. Observe and record the cooler ΔT with the minimum load valve energized.

6. Adjust the minimum load ball valve until the cooler temperature difference reading from Step 5 is equal to half of the temperature difference reading from Step 3.
7. Open the ball valve to decrease the temperature difference or close the ball valve to increase the temperature difference (ΔT). When the valve is adjusted correctly, the difference between cooler entering and leaving fluid temperatures when the minimum load control is energized must be at least half of the temperature difference when the minimum load control is deenergized. For example, if the difference between the cooler entering and leaving water temperature is 3° F with the valve deenergized, then the difference between cooler entering and leaving water temperature must be at least 1.5° F with the valve energized.

Once the outputs have been tested and the ball valve adjusted, the installation is complete. Disable manual control and return chiller to desired operational status.

CAPACITY CONTROL OVERRIDES — The following overrides will modify the normal operation of the routine.

Deadband Multiplier — The user configurable Deadband Multiplier (Z.GN, Configuration mode under sub-mode SLCT) has a default value of 2.0. The range is from 1.0 to 4.0. When set to other than 1.0, this factor is applied to the capacity Load/Unload Factor. The larger this value is set, the longer the control will delay between adding or removing stages of capacity. Figure 7 shows how compressor starts can be reduced over time if the leaving water temperature is allowed to drift a larger amount above and below the set point. This value should be set in the range of 3.0 to 4.0 for systems with small loop volumes. The Main Base Board (MBB) closely follows the rate of compressor cycling for each circuit.

First Stage Override — If the current capacity stage is zero, the control will modify the routine with a 1.2 factor on adding the first stage to reduce cycling. This factor is also applied when the control is attempting to remove the last stage of capacity.

Slow Change Override — The control prevents the capacity stages from being changed when the leaving fluid temperature is close to the set point (within an adjustable deadband) and moving towards the set point.

Ramp Loading — (R.L.S, Configuration mode under sub-mode SLCT) — Limits the rate of change of leaving fluid temperature. If the unit is in a Cooling mode and configured for Ramp Loading, the control makes 2 comparisons before deciding to change stages of capacity. The control calculates a temperature difference between the control point and leaving fluid temperature. If the difference is greater than 4° F (2.2° C) and the rate of change (°F or °C per minute) is more than the configured Cooling Ramp Loading value (CRMP, Configuration mode under sub-mode SLCT), the control does not allow any changes to the current stage of capacity.

Low Entering Fluid Temperature Unloading — When the entering fluid temperature is below the control point, the control will attempt to remove 25% of the current stages being used. If exactly 25% cannot be removed, the control removes an amount greater than 25%, but no more than necessary. The lowest stage will not be removed.

Low Discharge Superheat — If a circuit's discharge superheat is less than 15° F (8.3° C), the control does not increase the current capacity stage. If the discharge superheat is less than 5° F (2.8° C) and decreasing, the circuit is unloaded every 30 seconds until the superheat is greater than 5° F (2.8° C). The final capacity stage is not unloaded unless an alarm condition exists. This override is ignored for the first 3 minutes after a compressor is started.

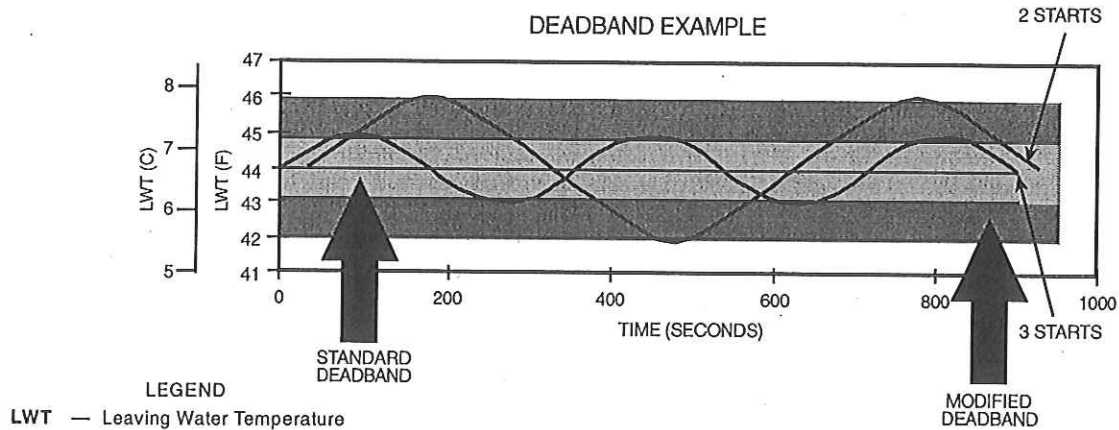


Fig. 7 — Deadband Multiplier

Low Saturated Suction Temperature — To avoid freezing the cooler, the control will compare the circuit Saturated Suction temperature with a predetermined freeze point.

For water [brine] circuits, if the Saturated Suction temperature falls below 34 F (1.1 C) [the Brine Freeze Point], the unit capacity will not increase. If the Saturated Suction temperature falls below 28 F (-2.2 C), [the Brine Freeze Point minus 6° F (3.3° C)], for 90 seconds, all loaders in the circuit are turned off. If this condition continues for a total of 3 minutes, the circuit will alarm and shut down.

For Brine applications, the Brine Freeze Point (Configuration Mode, SERV sub-mode, BR.FZ) must be configured for the freeze point of the brine solution. The control will use the Brine Freeze Point value minus 6° F (3.3° C) as the point to compare with the Saturated Suction Temperature. The default for the Brine Freeze Point is 34 F (1.1 C), which means the control will use 28 F (-2.2 C) as the freeze point. The Brine Freeze Point is adjustable from -20 F to 34 F (-29 C to 1.1 C). Failure to set the Brine Freeze Point correctly will cause improper unit operation.

High Condensing Temperature Unloading — Every 10 seconds the control checks for the conditions below. Loaders will be cycled as needed to control the saturated condensing temperature below the configured maximum condensing temperature. Configured maximums are 154 F (67.8 C) for 30GXN,R, 152 F (66.7 C) for 30HXA, and 122 F (50 C) for 30HXC units. If a circuit's saturated condensing temperature is more than 12° F (6.7° C) below the maximum condensing temperature, the circuit capacity is not allowed to increase. If the saturated condensing temperature is more than 2° F (1.1° C) above the maximum condensing temperature for 60 seconds, a loader is turned off. If the saturated condensing temperature rises to more than 5° F (2.8° C) above the maximum condensing temperature during the 60 seconds, a loader is turned off immediately. If all the loaders were already off, the compressor is shut down and an alarm is generated.

MOP (Maximum Operating Pressure) Override — The control monitors saturated condensing and suction temperature for each circuit as well as differential oil pressure. Based on a configurable maximum operating set point (saturated suction temperature), set maximum condensing temperature, and minimum differential oil pressure, the control may reduce the number of capacity stages being used and/or may lower the EXD position when system pressures approach the set parameters.

Head Pressure Control

GENERAL — The microprocessor controls the condenser fans (30GXN,R) to maintain the saturated condensing temperature to a configurable set point. The 30HXA condenserless units with a 09DK condenser use a combination of factory-supplied

fan cycling pressure switches (shipped in the 30HXA control box), temperature switches, and an accessory Motormaster® control to maintain head pressure independent of 30HXA unit control. The fans are staged or speed varied (30GXN,R) or water valve controlled (30HXC) based on each circuit's saturated condensing temperature and compressor status. Water cooled units (30HXC) operating at less than 70 F (21.1 C) for entering condenser water require the use of head pressure control.

The chiller must be field configured for the options shown in Table 6. Fan stage settings are shown in Table 7.

AIR-COOLED UNITS (30GXN,R) — See Fig. 8 for condenser fan locations.

Without Motormaster V Control — The first stage of fans are turned on based on compressor status or a Head Pressure Set Point based on Saturated Condensing Temperature (SCT). Additional fan stages are added when the SCT exceeds the Head Pressure Set Point. The Head Pressure Set Point is configurable in the Set Point sub-mode. The default is 113 F (45 C). Once a fan stage has been added, the software temporarily modifies the head pressure set point by adding 15° F (8.3° C) for 35 seconds. A fan stage will be removed when the Saturated Condensing Temperature has been less than the Head Pressure Set Point minus 35° F (19.4° C) for 2 minutes. The control uses the higher of the 2 Saturated Condensing Temperature values for 30GXN,R080-160 units. For the 30GXN,R153, 163-350 units, each circuit's fan stages are independently controlled based on the circuit Saturated Condensing Temperature. Refer to Table 8 for condenser fan control information. See Fig. 9A for operational information.

With Motormaster V Control — For low-ambient operation, the lead fan in each circuit can be equipped with the optional or accessory Motormaster head pressure controller. If factory installed, the controller will be configured for 4 to 20 mA control. With the Variable Head Pressure Select option set to 1 (4 to 20 mA), the MBB module calculates the required output based on Saturated Condensing temperature, Head Pressure set point, and a PID (proportional integral derivative) loop calculation. This 4 to 20 mA output is driven through the SCB. Proportional, Integral, and Derivative gain parameters for air-cooled controls are adjustable and can be found in the SERV sub-mode under the Configuration mode. Only certified Carrier Comfort Network technicians should perform checkout and adjustment of the PID loop. To obtain this accessory for field installation, order by part number 30GX-900--071, 072, 073 for a single controller package (30GXN,R080-160). Order part number 30GX-900--074, 075, 076 for a dual controller package (30GXN,R153, 163-350). These packages contain all the hardware required to install this accessory. See Fig. 9B for operational information.

The control will use the higher of the 2 Saturated Condensing Temperature values for 30GXN,R080-160 units. For the 30GXN,R153, 163-350 units, each circuit's fan stages are independently controlled based on the circuit's Saturated Condensing Temperature. Refer to Table 9 for condenser fan staging information.

WATER-COOLED UNITS (30HXC) — The 30HXC chiller can be configured to control direct acting water valves that are controlled by a 4 to 20 mA (2 to 10 vdc) signal. A 0 to 20 mA (0 to 10 vdc) or 20 to 0 mA (10 to 0 vdc) can also be configured. Installing a 500-ohm 1/2 watt resistor across the 2 output terminals of the mA signal enables the use of the vdc signal. Set this configuration (VHPT, configuration mode under sub-mode OPT1) to 1 (4 to 20 mA or 2 to 10 vdc), 2 (0 to 20 mA or 0 to 10 vdc), or 3 (20 to 0 mA or 10 to 0 vdc) as desired depending on valve type. Signal connections are made at terminal block TB2, terminals 14 and 15. The control scheme reads the saturated condensing temperature and uses a PID (proportional integral derivative) loop to control the head pressure. Proportional, Integral and Derivative gain parameters for the water-cooled controls are adjustable and can be found in the SERV sub-mode under the Configuration mode. Only certified Carrier Comfort Network technicians should perform checkout and adjustment of the PID loop.

CONDENSERLESS UNITS (30HXA) — The 30HXA unit is often applied with an 09DK air-cooled condenser. The remote condenser fans are controlled by 2 relay outputs. These connections are in the 30HXA control box. See Field Wiring section on page 72 for wiring details. The 30HXA control must be configured to turn the 09DK fans on and/or off. To set the 30HXA control for this configuration, Unit Type (TYPE, Configuration mode under sub-mode UNIT) must be configured to 3 (Split System). The Head Pressure Control Type

(HPCT under sub-mode OPT1) must be configured to 1 (air-cooled), and Condenser Pump control must be set to 0 (CNPC must be set to No control, Configuration mode under sub-mode OPT1).

Low ambient head pressure control can be accomplished with fan cycling pressure switches (09DK054-094), temperature switches (09DK044, 074-094), and Motormaster® control. The Motormaster control requires a temperature sensor input to control condenser fan cycling. The Motormaster V control also requires a temperature sensor input or the 4 to 20 mA output signal from the Comforlink™ control system. See accessory installation instructions for further information.

The Head Pressure Control Type (HPCT under sub-mode OPT1) may be set to control various types of head pressure control devices. HPCT may be set to 0 (No Control), 1 (Air Cooled), 3 (Common Condenser), or 4 (Independent Condenser).

The 30HXA chillers also support the use of a 4 to 20 mA (2 to 10 vdc), 0 to 20 mA (0 to 10 vdc), or 20 to 0 mA (10 to 0 vdc) for fan speed control. Installing a 500-ohm 1/2 watt resistor across the 2 output terminals of the mA signal enables the use of the vdc signal. Set this configuration (VHPT, configuration mode under sub-mode OPT1) to 1 (4 to 20 mA or 2 to 10 vdc), 2 (0 to 20 mA or 0 to 10 vdc), or 3 (20 to 0 mA or 10 to 0 vdc) as desired depending on control type. For common output applications (single output for both circuits), the signal connections are made at terminal block TB2, terminals 14 and 15. For independent (one output for each circuit) applications, the signal connections are made at terminal block TB2, terminals 14 and 15 for circuit A, and terminals 12 and 13 for circuit B.

Table 6 — Field Configured Head Pressure Control Options

UNIT	CONFIGURATION OPTION	DESCRIPTION	POINT NAME	FACTORY CONFIGURATION
30GX	Head Pressure Control Type	Method of controlling head pressure	HPCT	Air Cooled (30GX Default, Do not modify)
	Fan Staging Select	Method of controlling fan staging	FAN.S	See Table 7
	Variable Head Pressure Select	Method of controlling variable head pressure	VHPT	0 = None (Default) 1 = 4 to 20 mA (Default if Motormaster FIOP is installed.) Set to 4 to 20 mA if Motormaster accessory is installed.
30HXC	Head Pressure Control Type	Method of controlling head pressure	HPCT	Water Cooled (30HXC Default, Do not modify)
	Variable Head Pressure Select	Method of controlling variable head pressure	VHPT	0=None 1 = 4 to 20 mA (*2 to 10 vdc) 2 = 0 to 20 mA (*0 to 10 vdc) 3 = 20 to 0 mA (*10 to 0 vdc)
30HXA	Head Pressure Control Type	Method of controlling head pressure	HPCT	No Control Air Cooled (30HXA Default) Common Condenser Independent Condenser
	Variable Head Pressure Select	Method of controlling variable head pressure	VHPT	0=None 1 = 4 to 20 mA (*2 to 10 vdc) 2 = 0 to 20 mA (*0 to 10 vdc) 3 = 20 to 0 mA (*10 to 0 vdc)

*A vdc signal can be generated by installing a 500-ohm 1/2-watt resistor across the 2 output terminals of the mA signal.


Table 7 — Fan Staging Select Configuration Settings for Air Cooled (30GXN,R) Units

UNIT 30GXN,R	COMPUTER SOFTWARE DISPLAY	NAVIGATOR DISPLAY	DESCRIPTION
080,090*	6	(1 STAGE COM)	1st stage compressor status and SCT set point 2nd stage common control based on highest SCT
083,093,106,108, 114,125,135*	7	(2 STAGE COM)	1st stage compressor status and SCT set point 2nd and 3rd stage common control based on highest SCT
118,128,138, 150,160*	8	(3 STAGE COM)	1st stage compressor status and SCT set point 2nd through 4th stage common control based on highest SCT
153,174, 204,225*	4	(A2B1 IND)	1st stage each circuit, compressor status 2nd stage Circuit B independent 2nd and 3rd stage Circuit A independent
163,178*	2	(2 STAGE IND)	1st stage each circuit, compressor status 2nd and 3rd stage each circuit independent
249,264*	5	(A3B2 IND)	1st stage each circuit, compressor status 2nd stage Circuit B independent 2nd, 3rd and 4th stage Circuit A independent
208,228 253,268,281-350*	3	(3 STAGE IND)	1st stage each circuit, compressor status 2nd, 3rd and 4th stage each circuit independent

LEGEND

SCT — Saturated Condensing Temperature


*And associated modular sizes.

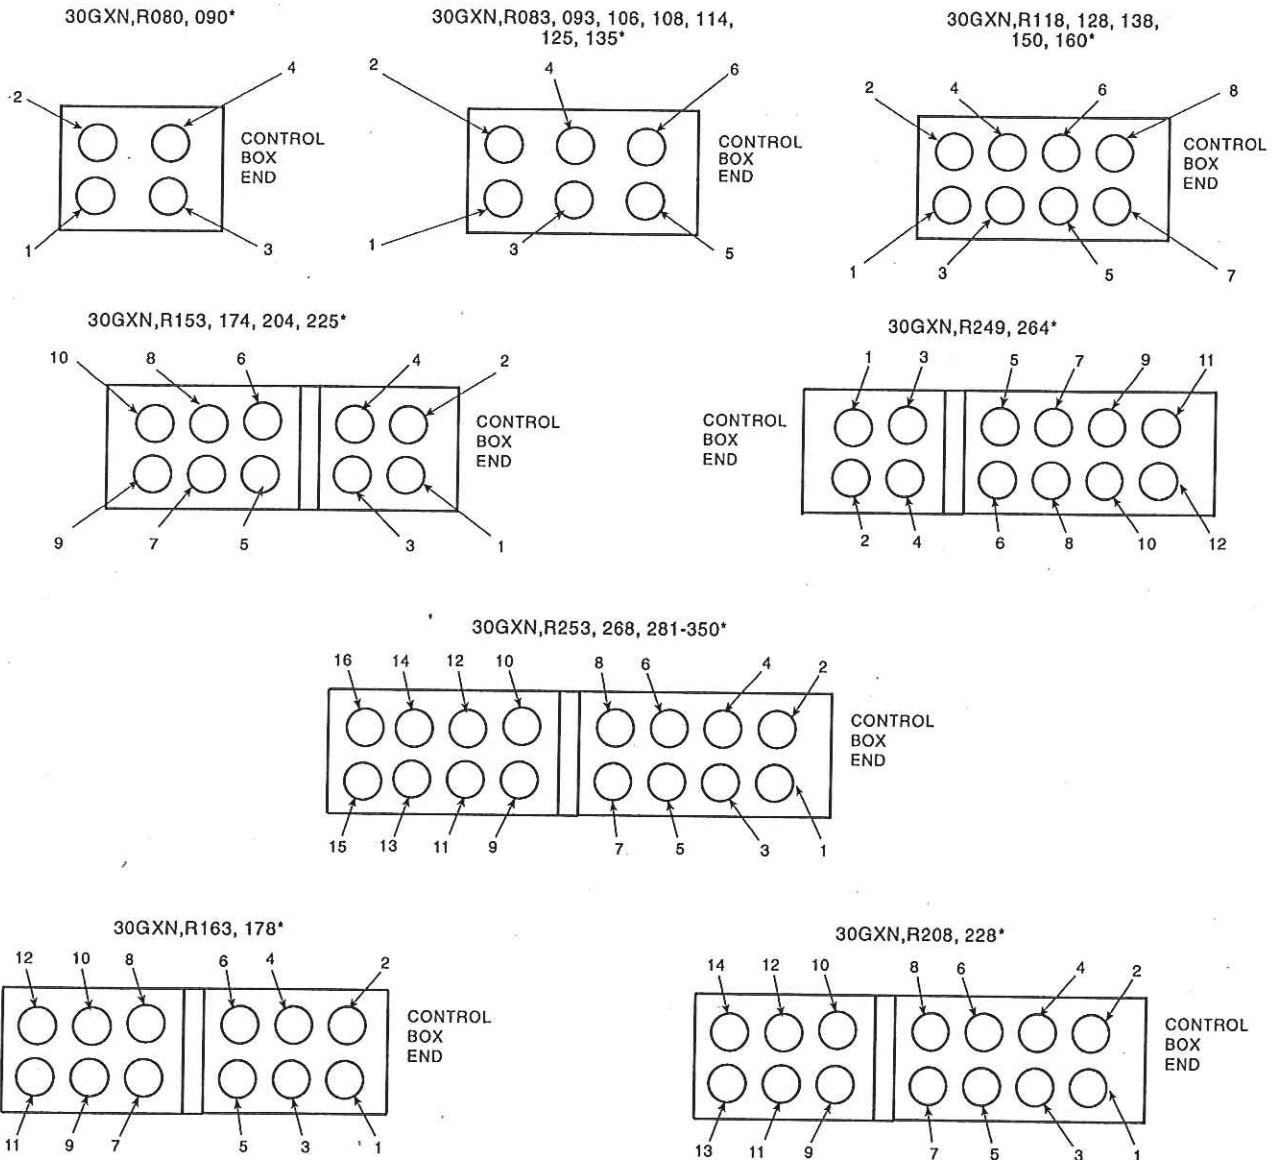

*And associated modular sizes.

Fig. 8 — 30GX Condenser Fan Locations

30GXN,R UNITS — MOTORMASTER V CONTROL NOT INSTALLED

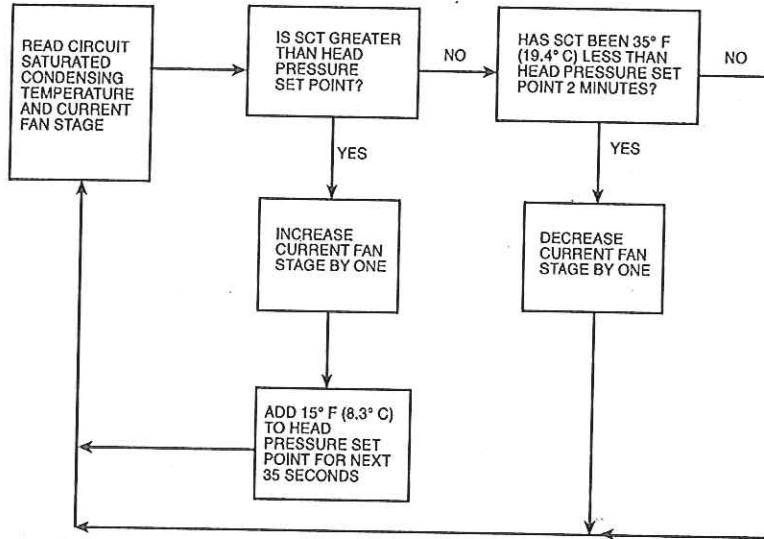

LEGEND

SCT — Saturated Condensing Temperature

Fig. 9A — 30GXN,R Units Head Pressure Control Without Motormaster® V Control

30GXN,R UNITS — MOTORMASTER V CONTROL INSTALLED

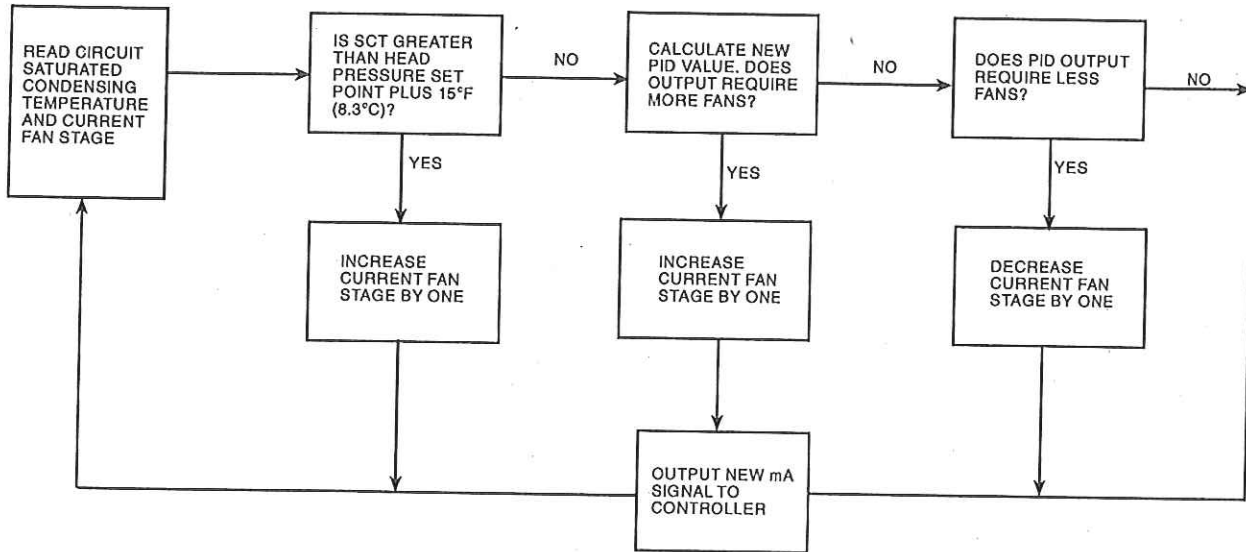


Fig. 9B — 30GXN,R Units Head Pressure Control With Motormaster V Control

Table 8 — Control Methods and Cooling Set Points

CONTROL TYPE (CTRL)	OCCUPANCY STATE	COOLING SET POINT SELECT (CLSP)				
		Single	Dual, Switch	Dual, 7 day	Dual, CCN Occ	4 to 20 mA†
Switch	Occupied	ON,CSP1	ON*	ON,CSP1	ON,CSP1	ON
	Unoccupied	ON,CSP1	ON*	ON,CSP2	ON,CSP2	ON
7 Day Occ	Occupied	ON,CSP1	ON*	Illegal	Illegal	ON
	Unoccupied	OFF	OFF	Illegal	Illegal	OFF
Occupancy	Occupied	ON,CSP1	ON*	Illegal	Illegal	ON
	Unoccupied	OFF	OFF	Illegal	Illegal	OFF
CCN	Occupied	ON,CSP1	ON*	ON,CSP1	ON,CSP1	ON
	Unoccupied	ON,CSP1	ON*	ON,CSP2	ON,CSP2	ON

*Dual set point switch input used. CSP1 used when switch input is open. CSP2 used when switch input is closed.
 †Cooling set point determined from 4 to 20 mA input to Energy Management Module (EMM) to terminals TB6-3,5.

Table 9 — 30GXN,R080-350 Condenser Fan Staging (Main Base Board Controlled)

30GXN,R UNIT SIZE	FAN TYPE	NAVIGATOR OUTPUT POINT NAME	FAN CONTACTOR	FANS CONTROLLED		
080, 090	Standard	Fan 1	FC-1	1, 2		
		Fan 2	FC-2	3, 4		
	High Static	Fan 1	FC-1, 1A	1, 2		
		Fan 2	FC-2, 2A	3, 4		
083, 093, 106-114, 125, 135	Standard	Fan 1	FC-1	1, 2		
		Fan 2	FC-2	3, 4		
		Fan 3	FC-3	5, 6		
		Fan 3	FC-4	7, 8		
	High Static	Fan 1	FC-1, 1A	1, 2		
		Fan 2	FC-2, 2A	3, 4		
		Fan 3	FC-3, 3A	5, 6		
		Fan 3	FC-4, 4A	7, 8		
118, 128, 138, 150, 160	Standard	Fan 1	FC-1	1, 2		
		Fan 2	FC-2	3, 4		
		Fan 3	FC-3	5, 6		
		Fan 3	FC-4	7, 8		
	High Static	Fan 1	FC-1, 1A	1, 2		
		Fan 2	FC-2, 2A	3, 4		
		Fan 3	FC-3, 3A	5, 6		
		Fan 3	FC-4, 4A	7, 8		
		153, 174, 204, 225	Standard	Comp. B1 contactor*	FC-1	1, 2
				Fan 2	FC-2	3, 4
				Fan 3	FC-3	5, 6
				Comp. A1/A2 contactor*	FC-4	7, 8
High Static	Fan 1		FC-5	9, 10		
	Comp. B1 contactor*		FC-1, 1A	1, 2		
	Fan 2		FC-2, 2A	3, 4		
	Fan 3		FC-3, 3A	5, 6		
163, 178	Standard	Comp. A1/A2 contactor*	FC-4, 4A	7, 8		
		Fan 1	FC-5, 5A	9, 10		
		Fan 1	FC-1	1, 2		
		Fan 2	FC-2	3, 4		
		Fan 4	FC-3	5, 6		
		Comp. A1 contactor*	FC-4	7, 8		
	High Static	Fan 1	FC-5	9, 10		
		Fan 3	FC-6	11, 12		
		Comp. B1 contactor*	FC-1, 1A	1, 2		
		Fan 2	FC-2, 2A	3, 4		
		Fan 4	FC-3, 3A	5, 6		
		Comp. A1 contactor*	FC-4, 4A	7, 8		
249, 264	Standard	Fan 1	FC-5, 5A	9, 10		
		Fan 3	FC-6, 6A	11, 12		
		Comp. B1 contactor*	FC-1	1, 2		
		Fan 2	FC-2	3, 4		
		Fan 1	FC-3	5, 6		
		Comp. A1/A2 contactor*	FC-4	7, 8		
	High Static	Fan 3	FC-5	9, 10		
		Fan 3	FC-6	11, 12		
		Comp. B1 contactor*	FC-1, 1A	1, 2		
		Fan 2	FC-2, 2A	3, 4		
		Fan 1	FC-3, 3A	5, 6		
		Comp. A1/A2 contactor*	FC-4, 4A	7, 8		
208, 228	Standard	Fan 3	FC-5, 5A	9, 10		
		Fan 3	FC-6, 6A	11, 12		
		Comp. B1 contactor*	FC-1	1		
		Fan 1	FC-2	2, 4		
		Fan 2	FC-3	3		
		Fan 4	FC-4	5, 7		
		Fan 3	FC-5	6, 8		
		Comp. A1/A2 contactor*	FC-6	9, 10		
	High Static	Fan 3	FC-7	11, 12		
		Fan 3	FC-8	13, 14		
		Comp. B1 contactor*	FC-1	1		
		Fan 1	FC-2, 2A	2, 4		
		Fan 2	FC-3	3		
		Fan 4	FC-4, 4A	5, 7		
		Fan 3	FC-5, 5A	6, 8		
		Comp. A1/A2 contactor*	FC-6, 6A	9, 10		
208, 228	High Static	Fan 3	FC-7, 7A	11, 12		
		Fan 3	FC-8, 8A	13, 14		

LEGEND
 Comp. — Compressor
 FC — Fan Contactor

*Proper rotation of these fans to be checked when compressor(s) is running. See Fig. 8 for condenser fan locations when viewing from the control box end.

NOTE: For 30GXN,R153, 163-350 units, fan relays Fan 1 and Fan 3 energize Circuit A fans. Fan relays Fan 2 and Fan 4 energize Circuit B fans.

Table 9 — 30GXN,R080-350 Condenser Fan Staging (Main Base Board Controlled) (cont)

30GXN,R UNIT SIZE	FAN TYPE	NAVIGATOR OUTPUT POINT NAME	FAN CONTACTOR	FANS CONTROLLED
253, 268	Standard	Comp. B1 contactor*	FC-1	1
		Fan 1	FC-2	2,4
		Fan 2	FC-3	3
		Fan 4	FC-4	5,7
		Fan 3	FC-5	6,8
		Comp. A1/A2 contactor*	FC-6	9,10
		Fan 3	FC-7	11,12
		Fan 3	FC-8	13,14
		Fan 1	FC-9	15,16
	High Static	Comp. B1 contactor*	FC-1	1
		Fan 1	FC-2, 2A	2,4
		Fan 2	FC-3	3
		Fan 4	FC-4, 4A	5,7
		Fan 3	FC-5, 5A	6,8
		Comp. A1/A2 contactor*	FC-6, 6A	9,10
		Fan 3	FC-7, 7A	11,12
		Fan 3	FC-8, 8A	13,14
		Fan 1	FC-9, 9A	15,16
281-350	Standard	Comp. B1/B2 contactor*	FC-1	1,2
		Fan 2	FC-2	3,4
		Fan 4	FC-3	5,6
		Fan 4	FC-4	7,8
		Fan 1	FC-5	9,10
		Comp. A1/A2 contactor*	FC-6	11,12
		Fan 3	FC-7	13,14
		Fan 3	FC-8	15,16
		High Static	Comp. B1/B2 contactor*	FC-1, 1A
	Fan 2		FC-2, 2A	3,4
	Fan 4		FC-3, 3A	5,6
	Fan 4		FC-4, 4A	7,8
	Fan 1		FC-5, 5A	9,10
	Comp. A1/A2 contactor*		FC-6, 6A	11,12
	Fan 3		FC-7, 7A	13,14
	Fan 3		FC-8, 8A	15,16

LEGEND

Comp. — Compressor
FC — Fan Contactor

*Proper rotation of these fans to be checked when compressor(s) is running. See Fig. 8 for condenser fan locations when viewing from the control box end.

NOTE: For 30GXN,R153, 163-350 units, fan relays Fan 1 and Fan 3 energize Circuit A fans. Fan relays Fan 2 and Fan 4 energize Circuit B fans.

09DK AIR-COOLED CONDENSERS

09DK044 Units — The 09DK044 units have accessory provision for fully automatic intermediate-season head pressure control through condenser fan cycling. Fan number 2 and 3 cycling is controlled by outdoor-air temperature through air temperature switches (ATS) 1 and 2.

The air temperature switches are located in the lower divider panel underneath the coil header. The sensing element is exposed to air entering the no. 1 fan compartment through a hole in the panel. Fan no. 1 is non-cycling.

The air temperature switch controls the fans as shown in Table 10.

Table 10 — Air Temperature Switch Control (09DK044 Units)

FAN	FAN SWITCH	TEMPERATURE
FAN 2	ON	Above 65 ± 3 F (18.3 ± 1.7 C)
		Between 55 and 65 F (12.8 and 18.3 C) and temperature falling
	OFF	Below 55 ± 3 F (12.8 ± 1.7 C)
		Between 55 and 65 F (12.8 and 18.3 C) and temperature rising
FAN 3	ON	Above 80 ± 3 F (26.7 ± 1.7 C)
		Between 70 and 80 F (21.1 and 26.7 C) and temperature falling
	OFF	Below 70 ± 3 F (21.1 ± 1.7 C)
		Between 70 and 80 F (21.1 and 26.7 C) and temperature rising

09DK054-094 — The capacity of an air-cooled condenser increases with increased temperature difference (defined as saturated condensing temperature minus entering outdoor-air temperature) and decreases with decreased temperature difference. A drop in entering outdoor-air temperature results in a lower saturated condensing temperature. When outdoor-air temperature drops below the minimum temperature for standard units, additional head pressure control is required.

Model 09DK units have fully automatic intermediate-season head pressure control through condenser fan cycling using electromechanical fan cycling controls. Standard head pressure controls regulate the 100 and 50/50% condenser capacity applications. Head pressure can also be controlled by fan cycling controls supplemented by the accessory Motormaster® V solid-state head pressure control. See Motormaster V installation instructions for more information.

In the standard control scheme, fans 1 and 2 are on when there is a call for cooling from the respective coil circuits. Fans 1 and 2 are non-cycling. On 054 and 064 units, fans 3 and 4 are controlled by using a fan cycling pressure switch on each of the primary coil circuits in response to condensing pressure. Fan cycling switches must be replaced with the switches supplied in the control box of the 30HXA chiller.

The fan cycling pressure switch controls the fans as follows: Fans 3 and 4 are on above 185 ± 10 psig (1276 ± 69 kPa) and off below 97 ± 10 psig (669 ± 69 kPa). If pressure is rising between 97 psig (669 kPa) and 185 psig (1276 kPa), fans 3 and 4 are off. If pressure is falling from 185 psig (1276 kPa) to 97 psig (669 kPa) fans 3 and 4 are on.

The 09DK054-094 condensers are supplied with fan cycling pressure switches suitable for use with R-22 refrigerant. Fan cycling pressure switches that are compatible with R-134a refrigerant pressures are shipped with the 30HXA chillers. These fan cycling pressure switches must be installed in place of the 09DK factory-installed switches before charging to ensure proper head pressure control.

The air temperature switch controls the fans as follows: On the 074-094 condensers, below 70 ± 3 F (21.1 ± 1.7 C) outdoor ambient, fans 5 and 6 are off; above 80 ± 3 F (26.7 ± 1.7 C) fans 5 and 6 are on. Between 70 F (21.1 C) and 80 F (26.7 C), whether fans 5 and 6 are on or off depends on whether temperature is rising or falling. If the temperature is rising from 70 F (21.1 C) to 80 F (26.7 C), fans 5 and 6 are off. If the temperature is falling from 80 F (26.7 C) to 70 F (21.1 C), fans 5 and 6 are on.

09AZ AIR-COOLED CONDENSERS — The 09AZV091-182 units are designed to operate specifically with 30HXA chillers, using R-134a refrigerant. Units with 8 fans have 2 direct controlled (applied to optional variable speed), 4 refrigerant pressure and 2 ambient temperature controlled fans. Units with 10 fans have 2 direct controlled (applied to optional variable speed), 4 refrigerant pressure and 4 ambient temperature controlled fans. Units with 12 fans have 2 direct controlled (applied to optional variable speed), 6 refrigerant pressure and 4 ambient temperature controlled fans. Field adjust 09AZ switch settings as follows:

PRESSURE	AMBIENT
Cut in 175 psi	Cut in 70 F
Cut out 145 psi	Cut out 60 F

OPERATION SEQUENCE — All condenser fans are allowed to operate once a call for cooling comes from the chiller. Direct fans will operate while refrigerant pressure and ambient temperature control fans maintain refrigerant head pressure based on existing refrigerant pressure and ambient temperature conditions. Optional variable speed control will ramp direct fan motor speed for improved low ambient performance.

VARIABLE SPEED FAN CONTROL — All units, when ordered with fan head pressure control are furnished with the number 1 condenser motor as a single-phase motor for use with head pressure control. The optional factory-mounted motor head pressure control contains a fan head pressure control device activated by a pressure sensor. The kit controls condenser-fan motor speed in response to the saturated condensing pressure.

ADJUSTING PID ROUTINES — The 30GXN,R, 30HXA and 30HXC head pressure control routines use PID (proportional integral derivative) loops to maintain a user-configurable head pressure set point. Gain defaults values are located in the SERV sub-mode under the Configuration mode (items H.PGN, H.IGN and H.DGN). The control calculates a new fan speed (30GXN,R) or water valve position (30HXC) every 5 seconds based on these gain values and an error term equal to saturated condensing temperature minus head pressure set point. If the control routine is not responding fast enough to large changes (circuit starting, for example), increase the proportional term.

When the routine is making too great a change to valve position or fan speed, decrease the proportional term. To minimize hunting, keep the integral term positive and as low as possible. This value is used to control "droop," which is common in master/submaster control schemes. The default for the derivative term is zero. The value should not need to be changed.

For more information on tuning PID loops, consult the Comfort Controller Installation manual, catalog number 808-890. Follow the instructions under Tuning Control loops.

Control Methods

SWITCH — Unit is started and stopped manually by switching the ENABLE/OFF/REMOTE CONTACT switch from OFF to ENABLE or by external contacts with the switch in the

REMOTE position. The unit can be enabled and disabled by this action or all control methods.

7-DAY SCHEDULE — Unit is started and stopped in accordance with the schedule configured under Time Clock mode. This schedule can be configured from the Navigator or from CCN.

OCCUPANCY — Unit is started and stopped in accordance with the local occupancy schedule accessible only from CCN. Schedule Number in Table SCHEDOVR must be configured to 1 to utilize the local occupancy schedule, or 65-99 to utilize a global schedule. If the Schedule Number is set to 0 the unit will operate in a continuous 24-hr Occupied mode.

CCN — Unit is started and stopped by communication over the CCN bus. The CHIL_S_S point in the A_UNIT table is provided for this purpose.

Table 8 illustrates how the control method and cooling setpoint select variables direct the operation of the chiller and the set point to which it controls. The illustration also shows the ON/OFF state of the machine for the given combinations.

Cooling Set Point Select

SINGLE — Unit operation is based on Cooling Setpoint 1 (CSP1).

DUAL SWITCH — Unit operation is based on Cooling Setpoint 1 (CSP.1) when the Dual Setpoint switch contacts are open and Cooling Setpoint 2 (CSP.2) when they are closed.

DUAL 7 DAY — Unit operation is based on Cooling Setpoint 1 (CSP.1) during the occupied mode and Cool Setpoint 2 (CSP.2) during the unoccupied mode as configured under Time Clock mode. Control method must be configured for Switch.

DUAL CCN OCCUPIED — Unit operation is based on Cooling Setpoint 1 (CSP.1) during the Occupied mode and Cooling Setpoint 2 (CSP.2) during the Unoccupied mode as configured under the local occupancy schedule accessible only from CCN. Schedule Number in Table SCHEDOVR must be configured to 1. If the Schedule Number is set to 0 the unit will operate in a continuous 24-hr Occupied mode. Control method must be configured for Switch.

4 TO 20 mA INPUT — Unit operation is based on an external 4 to 20 mA signal input to the Energy Management Module (EMM).

Ice Mode — When Ice Mode is enabled Cooling Setpoint Select must be set to Dual Switch, Dual 7 day or Dual CCN Occupied and the Energy Management Module (EMM) must be installed. Unit operation is based on Cooling Setpoint 1 (CSP.1) during the Occupied mode, Ice Setpoint (CSP.3) during the Unoccupied mode with the Ice Done contacts open and Cooling Setpoint 2 (CSP.2) during the Unoccupied mode with the Ice Done contacts closed. These 3 set points can be utilized to develop your specific control strategy.

Cooler and Condenser (30HXC) Pump Control

— The 30GXN,R and 30HX chillers can be configured for cooler and condenser (30HXC) pump control. Inputs for a cooler pump interlock and condenser flow switch or interlock are provided.

COOLER PUMP CONTROL (CPC, Configuration Mode/sub-mode OPT1) — Proper configuration of the cooler pump control is required to prevent possible cooler freeze-up. A cooler flow switch is factory installed to prevent operation without flow through the cooler. It is also recommended that the chiller be interlocked with the chiller water pump starter to provide additional protection. See page 72 of the Field Wiring section for proper connection of the cooler pump interlock.

The factory default setting for cooler pump control is "OFF." It is recommended for all chillers that the cooler pump control be utilized unless the chilled water pump runs continuously or the chilled water system contains a suitable antifreeze solution.

When the cooler pump control is "ON," the cooler pump relay will be energized when the chiller enters an "ON" mode (i.e., ON LOCAL, ON TIME, ON CCN). The cooler pump relay will remain energized for 30 seconds after all compressors stop due to off command. In the event a freeze protection alarm is generated, the cooler pump relay will be energized whether cooler pump control is configured "ON" or "OFF." The cooler pump relay is also energized anytime a compressor is started as well as when certain alarms are generated. The cooler pump relay should be used as an override to the external pump control if cooler pump control is not utilized.

IMPORTANT: If the cooler pump control relay output is not wired to control or override the operation of the chilled water pump an OFF DELAY of 10 minutes must be provided after the chiller is disabled to maintain cooler water flow during the pump down period.

30HXC brine applications below 32 F (0° C) leaving brine temperature require cooler pump control. To reduce the possibility of condenser freeze-up the cooler pump must be stopped or isolation valve closed in the event of loss of condenser water flow.

If cooler pump control is turned "OFF" or "ON" and the chilled water flow switch/interlock does not close within 5 minutes after the unit is enabled and in an "ON" mode, alarm A200 will be generated. If cooler pump control is turned "ON" and the chilled water flow switch/interlock is closed when the unit is enabled and enters an "ON" mode alarm A202 will be generated. Alarm A201 will be generated whenever the cooler pump interlock is open for at least 10 seconds during chiller operation.

CONDENSER PUMP CONTROL (CNPI AND CNPC, Configuration Mode/sub-mode OPT1) — Factory defaults for both condenser pump control and condenser flow switch are set to "NO CONTROL" and "OFF," respectively. The condenser pump can be controlled in one of two ways: In the first method, (CNPC set to "ON WHEN OCCUPIED") the pump can be controlled like the cooler pump. It is turned on whenever the machine is in an "ON" mode and turned off 30 seconds after all compressors stop and the machine is in an "OFF" mode. The second method (CNPC set to "ON WITH COMPRESSORS"), will energize the condenser pump output when the first compressor is started and deenergize the output 30 seconds after the last compressor stops.

When configured for a condenser flow switch/interlock (CNPI set to "ON"), an alarm A159 is generated if the input does not close within one minute after the machine enters an "ON" mode, or within one minute after the condenser pump relay is energized when configured "ON". Alarm A159 is also generated if the flow switch/interlock opens for more than 10 seconds during chiller operation.

30HXC brine applications below 32 F (0° C) leaving brine temperature require condenser pump control to be configured to "ON WHEN OCCUPIED" and condenser pump interlock to be "ON". A condenser water flow switch must be installed and wired to TB2 terminals 5 and 6. The condenser pump output remains energized for 30 minutes after the Enable/Off/Remote Contact switch is placed in the "OFF" position or the Remote Contacts are opened allowing refrigerant pressure equalization.

BRN.L (Configuration Mode, sub-mode SLCT) must be configured to YES if Brine FIOP is installed. This will energize liquid line solenoid valves on brine units when the condenser pump is "ON" and when the compressors are "OFF". Liquid line solenoids are included as part of the Brine FIOP.

Flow Sensor — The factory-installed flow sensor/switch should not require adjustment.

Proper operation of this sensor/switch is necessary to allow the unit to operate and provide running freeze protection for the unit. When power is supplied to the switch, the amber LED in the center of the display will be illuminated.

When there is chilled water flow, but the flow is inadequate to close the switch and allow unit operation, one red LED will illuminate. A red LED can also indicate inoperative pump(s), closed valve, clogged strainer or air in the system.

When the first green LED is illuminated, the switch is closed and the unit will start and run. Various conditions can cause variations in flow and allow the switch to open and cause a "nuisance trip". Greater constant flow will help reduce nuisance trips.

Measure the pressure drop across the cooler and use Appendix E to determine the cooler flow rate then determine if the flow rate is adequate for the application. A green LED does not mean minimum flow requirements have been met.

Cooler Heater Control — Factory-installed cooler heaters can be ordered for the 30GXN,R chillers. The number of heaters depends on the size of the machine. The control system operates the heaters in response to the saturated suction temperature of each circuits as well as Entering and Leaving Water Temperature.

The cooler heater will be energized if the unit is OFF (no mechanical cooling) and either of the following two conditions has been met:

- The Saturated Suction Temperature in either circuit is less than BR.FZ *Brine Freeze Point* (Configuration Mode, Sub-mode SERV), and the unit has been off for more than 30 seconds.
- Entering or Leaving Water Temperature is less than BR.FZ + 3 °F (1.7 °C). The heaters will remain on until both Entering and Leaving Water Temperatures equal or exceed 120 °F (48.9 °C). The heaters will energize again when both water temperatures are below 110 °F (43.3 °C). Cooler flow must be established in order to de-energize the cooler heaters.
- If the Entering or Leaving Water Thermistor has failed, the heaters will stay on.

If after 15 minutes of operation, the Saturated Suction Temperature for both circuits is not greater than BR.FZ + 10 °F (5.6 °C), the Cooler Pump will be commanded ON in attempt to increase the water temperature.

The cooler heaters will be deenergized if the unit is ON (mechanical cooling is ON) or if the Saturated Suction Temperature for both circuits is greater than BR.FZ + 10 °F (5.6 °C) for at least 10 minutes.

Oil Heater Control (30GXN,R Units Only) — Standard feature that controls oil temperature based on the discharge gas temperature (DGT) thermistor. Heaters turn on when DGT < 95 F (35 C) and turn off when DGT > 100 F (37.8 C) and compressors are off. The heater is deenergized if the oil level switch is open.

Navigator Display Module Usage (See Fig. 10 and Tables 11-24B) — The Navigator module provides a mobile user interface to the *ComfortLink™* control system. The display has up and down arrow keys, an **ESCAPE** key, and an **ENTER** key. These keys are used to navigate through the different levels of the display structure. See Table 11. Press the **ESCAPE** key until 'Select a Menu Item' is displayed to move through the top 11 mode levels indicated by LEDs on the left side of the display.

Pressing the **ESCAPE** and **ENTER** keys simultaneously will put the Navigator into expanded text mode where full meaning of all sub-modes, items and their values can be displayed. Pressing the **ESCAPE** and **ENTER** keys when the display says 'Select a Menu Item' (Mode LED level) will return the Navigator to its default menu of rotating display items (those items in the VIEW sub-mode under the Run Status mode). In addition, the

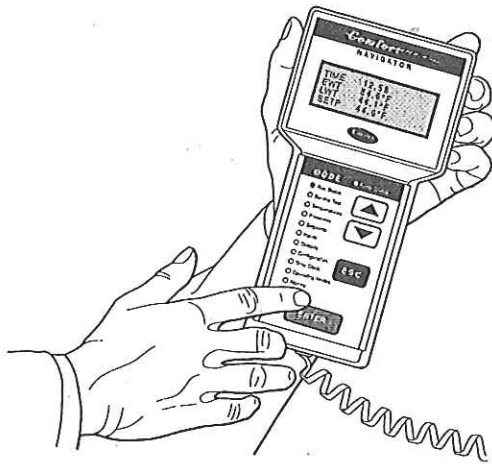


Fig. 10 — Navigator Module

password will be disabled requiring that it be entered again before changes can be made to password protected items.

The Service Test function should be used to verify proper protected items. Press the **ESCAPE** key to exit out of the expanded text mode.

NOTE: When the LANG variable is changed, all appropriate display expansions will immediately change to the new language. No power-off or control reset is required when reconfiguring languages.

When a specific item is located, the item name appears on the left of the display, the value will appear near the middle of the display and the units (if any) will appear on the far right of the display. Press the **ENTER** key at a changeable item and the value will begin to flash. Items in the Configuration and Service Test modes are password protected. The password can be changed utilizing the Navigator or through CCN devices such as ComfortWORKS®, ComfortVIEW™ and Service Tool. The words 'Enter Password' will be displayed when required, with the default password also being displayed. Use the **ENTER** and arrow keys to enter the 4 digits of the password. The default password is 1111. Use the following procedure to change the password:

1. Enter the correct password under PASS, *Service Password* (Configuration Mode, Sub-mode DISP).
2. Change PAS.E *Password Enable* (Configuration Mode, Sub-mode DISP) to DSBL.
3. Return to the PASS, *Service Password*, and change the password to the desired value. For example, 2222. Once changed, the screen will show the new value, 2222.
4. Return to the PAS.E *Password Enable*, and change the value to ENBL.

The password has been changed. If the password is required, the machine will show the default 1111 as the password. Use the up or down arrow keys to change the value to the correct password.

Changing item values or testing outputs is accomplished in the same manner. Locate and display the desired item. Press **ENTER** so that the item value flashes. Use the arrow keys to change the value or state of a item and press the **ENTER** key to accept it. Press the **ESCAPE** key to return to the next higher level of structure. Repeat the process as required for other items. See Tables 12-25 for further details.


Two items, OAT *Outside Air Temperature* (Temperature Mode, Sub-mode UNIT) and SPT *Space Temperature* (Temperature Mode, Sub-mode UNIT) can be forced to a value at the Navigator. If one of these two points has been forced, a flashing "F" will appear next to the value indicating a forced value. To remove the force, select the item and press the **ENTER** key so that the value is flashing. Press the up and down arrow keys simultaneously and the force will be removed.

Service Test (See Table 13) — *Both main power and control circuit power must be on.* The Service Test function should be used to verify proper operation of the compressors, loaders, pumps, solenoids, fans, heaters, etc. To access the Service Test mode, the Enable/Off/Remote Contact switch must be in the Off position. Use the display keys to enter the Service Test mode and display 'TEST OFF'. Press the **ENTER** key and 'Off' will flash (Enter the password if required). Use either arrow key to change the 'Off' to 'On' and press **ENTER**. Switch the Enable/Off/Remote Contact switch to the Enable position. Use the arrow keys to select either sub-mode OUTS or COMP. Test the expansion valves, oil pumps, fans, cooler heaters, cooler/condenser pump relays, remote alarm relay, head pressure control, and compressor oil and motor cooling solenoids under the OUTS sub-mode. Note that condenser-fan motors are NOT started during VH.PA or VH.PB test on 30GXN,R units with Motormaster® control. Measure 4 to 20 mA dc output using meter in series with violet or pink wire to controller. Refer to the Field Wiring section. These discrete outputs are then turned off if there is no keypad activity for 10 minutes. Test the compressors, loaders, minimum load valves and oil heaters under the COMP sub-mode. Compressor loaders, minimum load valve and oil heaters can be tested with compressors on or off. All compressor outputs can be turned on, but the control will limit the rate by staging one compressor per minute. The relays under the COMP sub-mode will stay on for 10 minutes if there is no keypad activity. Compressors will stay on until they are turned off by the operator. The Service Test mode will remain enabled as long as there is more than one compressor turned on. All safeties are monitored during this test and will turn a compressor, circuit or motor off if necessary. Any other mode or sub-mode can be viewed or changed during the TEST mode. The STAT item (Run Status mode under sub-mode VIEW) will display 'SERVICE TEST' as long as the Service mode is enabled. The TEST sub-mode value must be changed back to OFF before the chiller can be switched to Enable or Remote contact for normal operation.

Configuring and Operating Dual Chiller Control (See Table 24A and 24B) — The dual chiller routine is available for the control of two units supplying chilled fluid on a common loop. This control is designed for either series or parallel fluid flow (PARA, Configuration mode under sub-mode RSET) arrangements. One chiller must be configured as the master chiller, the other as the slave chiller. For series fluid flow, the master chiller is installed so that it receives entering fluid from the slave chiller and its leaving fluid supplies the load. See Fig. 11. For parallel flow applications, an additional leaving water temperature thermistor (Dual Chiller LWT) must be installed as shown in Fig. 12 and 13 and connected to the master chiller. Refer to Thermistors section for sensor wiring.



Fig. 11 — Dual Chiller Piping Arrangement (Series Fluid Flow)

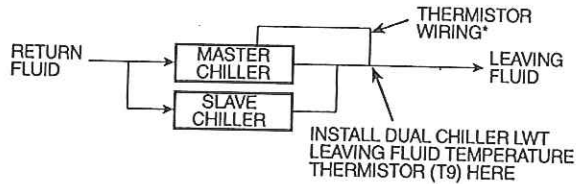

- * Depending on piping sizes, use either:
- HH79NZ014 sensor/10HB50106801 well (3-in. sensor/well)
- HH79NZ029 sensor/10HB50106802 well (4-in. sensor/well)

Fig. 12 — Dual Chiller Thermistor Location Parallel Fluid Flow

To configure the two chillers for operation, follow the example shown in Tables 24A and 24B. The master chiller will be configured with a slave chiller at address 2. Also in this example, the master chiller will be configured to use Lead/Lag Balance to even out the chiller runtimes weekly. The Lag Start Delay feature will be set to 10 minutes. The chillers will be configured for parallel fluid flow. The master and slave chillers cannot have the same CCN address (CCNA, Configuration mode under OPT2). In addition, the chillers must be connected together on the same CCN bus. Connections can be made to the CCN screw terminals on TB3 in both chillers. The master chiller will determine which chiller will be Lead and which will be Lag. The master chiller controls the slave chiller by forcing the slave chiller ON and OFF, and forcing the control

point of the slave chiller. The master chiller will also split demand limiting function appropriately between the two chillers, if demand limiting is enabled.

The master chiller is now configured for dual chiller operation. To configure the slave chiller, only the LLEN, PARA and MSSL variables need to be set. Enable the Lead/Lag chiller variable (LLEN) as shown in Tables 24A and 24B. Similarly, set the Master/Slave Select variable (MSSL) to SLVE. The parallel variable (PARA) must be configured the same as the master chiller. The slave chiller does not use the variables LLBL, LLBD and LLDY.

It is recommended to set the cooling set points to the same setting on both Master and Slave chillers for series flow (Duplex) applications. If outdoor air reset is required the outdoor air thermistor must be connected to the Slave chiller (TB5 term. 7 and 8). Outdoor Air Broadcast (BCST, OAT.B) must be configured "ON". Remote contacts should be connected to both Master and Slave to control unit operation. Optional control inputs and Energy Management Module (EMM) should be connected to the Master chiller.

PART NUMBER	DIMENSIONS In. (mm)	
	A	B
10HB50106801	3.10 (78.7)	1.55 (39.4)
10HB50106802	4.10 (104.1)	1.28 (32.5)

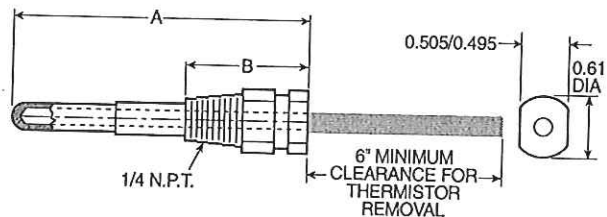


Fig. 13 — Dual Leaving Water Thermistor Well

Table 11 — Navigator Display Menu Structure

RUN STATUS	SERVICE TEST	TEMPERATURES	PRESSURES	SET POINTS	INPUTS	OUTPUTS	CONFIGURATION	TIME CLOCK	OPERATING MODES	ALARMS
Auto Display (VIEW)	Manual Mode On/Off (TEST)	Unit Temperatures (UNIT)	Ckt A Pressures (PRC.A)	Cooling (COOL)	Unit Discrete (GEN.I)	Unit Discrete (GEN.O)	Display (DISP)	Unit Time (TIME)	Modes (MODE)	Current (CRNT)
Machine Hours/Starts (RUN)	Ckt A/B Outputs (OUTS)	Ckt A Temperatures (CIR.A)	Ckt B Pressures (PRC.B)	Heating (HEAT)	Ckt A/B (CRCT)	Ckt A (CIR.A)	Machine (UNIT)	Unit Date (DATE)		Reset Alarms (RCRN)
Compressor Run Hours (HOUR)	Compressor Tests (COMP)	Ckt B Temperatures (CIR.B)		Head Pressure (HEAD)	Unit Analog (4-20)	Ckt B (CIR.B)	Options 1 (OPT1)	Daylight Savings Time (DST)		Alarm History (HIST)
Compressor Starts (STRT)							Options 2 (OPT2)	Schedule (SCHD)		
Software Version (VERS)							Temperature Reset (RSET)			
							Set Point Select (SLCT)			
							Service Configuration (SERV)			
							Broadcast Configuration (BCST)			

LEGEND
Ckt — Circuit

Table 12 — Configuration Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
DISP	<input type="button" value="ENTER"/>	TEST	ON/OFF	TEST DISPLAY LEDs	See Backlight and Contrast adjustment in Tables 21 and 22.
	<input type="button" value="▼"/>	METR	ON/OFF	METRIC DISPLAY	Off = English On = Metric
	<input type="button" value="▼"/>	LANG	X	LANGUAGE SELECTION	Default: English English Español Français Portuguese
	<input type="button" value="▼"/>	PAS.E	ENBL/DSBL	PASSWORD ENABLE	
	<input type="button" value="▼"/>	PASS	XXXX	SERVICE PASSWORD	Default: 1111
UNIT	<input type="button" value="ENTER"/>	TYPE	X	UNIT TYPE	Air Cooled (GXN,R) Water Cooled (HXC) Split (HXA) Heat Machine Heat Reclaim
	<input type="button" value="▼"/>	TONS	XXX	UNIT SIZE	
	<input type="button" value="▼"/>	CAP.A	XXX %	CIRCUIT A % CAPACITY	<u>30GXN,R</u> 080, 083, 135, 138 = 54 090, 093, 108, 114, 125, 128, 153 = 59 106 = 63 150 (60 Hz) = 41 160 = 45 174, 178, 281-350 = 50 204 = 64 225 = 61 118, 163 = 55 249, 253 = 71 208 = 70 264, 268 = 67 228 = 72
	<input type="button" value="▼"/>	CMP.A	X	NUMBER CIRC A COMPRESSOR	HXA,C076-186 = 1 HXA,C206-271 = 2 GXN,R080-178 = 1 GXN,R204-350 = 2
	<input type="button" value="▼"/>	CMP.B	X	NUMBER CIRC B COMPRESSOR	HXA,C076-271 = 1 GXN,R080-268 = 1 GXN,R281-350 = 2
	<input type="button" value="▼"/>	DIS.S	XX.X °F	DISCHARGE SUPER SETPOINT	Default: 22° F DISCHARGE SUPERHEAT
		FAN.S	X	FAN STAGING SELECT	None (30HXA, 30HXC) 1 STAGE IND 2 STAGE IND (30GXN,R163, 178) 3 STAGE IND (30GXN,R281-350, 208, 228, 253, 268) A2B1 IND (30GXN,R153, 174, 204, 225) A3B2 IND (30GXN,R249, 264) 1 STAGE COM (30GXN,R080, 090) 2 STAGE COM (30GXN,R083, 093, 106, 108, 114, 125, 135) 3 STAGE COM (30GXN,R118, 128, 138, 150, 160)
	<input type="button" value="ENTER"/>	CM.A1	XXX AMPS	COMPR. A1 MUST TRIP AMPS	Verify with Appendix A
	<input type="button" value="ENTER"/>	CM.A2	XXX AMPS	COMPR. A2 MUST TRIP AMPS	Verify with Appendix A
	<input type="button" value="ENTER"/>	CM.B1	XXX AMPS	COMPR. B1 MUST TRIP AMPS	Verify with Appendix A
<input type="button" value="ENTER"/>	CM.B2	XXX AMPS	COMPR. B2 MUST TRIP AMPS	Verify with Appendix A	

Table 12 — Configuration Mode and Sub-Mode Directory (cont)

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
OPT1	ENTER	FLUD	X	COOLER FLUID	Default: Water Water Medium Temperature Brine Low Temperature Brine (30HX only)
	▼	MLVS	YES/NO	MIN LOAD VALVE SELCT	Minimum Load Valve
	▼	HPCT	X	HEAD PRESS CONTROL TYPE	No Control Air Cooled (30GXN,R, 30HXA default) Water Cooled (30HXC default) Common Cond (30HXA Common Condenser) Ind Cond (30HXA Independent Condenser)
	▼	VHPT	X	VAR HEAD PRESSURE SELECT	None (30HX, 30GX No Motormaster) 4-20 mA (2-10 vdc)(30GX with Motormaster) 0-20 mA (0-10 vdc) 20-0 mA (10-0 vdc)
	▼	PRTS	YES/NO	PRESSURE TRANSDUCERS	Default: Yes
	▼	CPC	ON/OFF	COOLER PUMP CONTROL	Default: Off
	▼	CNPI	ON/OFF	CONDENSER PUMP INTERLOCK	Default: Off (Does not require condenser pump control)
	▼	CNPC	X	CONDENSER PUMP CONTROL	Default: No Control No Control On when occupied On with compressor(s)
	▼	CWT.S	YES/NO	CONDENSER FLUID SENSORS	Default: No
	▼	EMM	YES/NO	EMM MODULE INSTALLED	
OPT2	ENTER	CTRL	X	CONTROL METHOD	Default: Switch Switch = Enable/Off/Remote Contact 7 Day Occ = 7 Day Schedule Occupancy = CCN Occupancy CCN = CCN Control
	▼	CCNA	XXX	CCN ADDRESS	Default: 1 Range: 1 to 239
	▼	CCNB	XXX	CCN BUS NUMBER	Default: 0 Range: 0 to 239
	▼	BAUD	X	CCN BAUD RATE	Default: 9600 2400 4800 9600 19,200 38,400
	▼	LOAD	X	LOADING SEQUENCE SELECT	Default: Equal Equal Staged
	▼	LLCS	X	LEAD/LAG SEQUENCE SELECT	Default: Automatic Automatic Circuit A Leads Circuit B Leads
	▼	CPSQ	X	COMPRESSOR SEQUENCE	Default: Automatic Automatic Compressor 1 Leads Compressor 2 Leads
	▼	LCWT	XX.X ΔF	HIGH LCW ALERT LIMIT	Default: 60 Range: 2 to 60 F
	▼	DELY	XX	MINUTES OFF TIME	Default: 0 Minutes Range: 0 to 15 Minutes
	▼	CLS.C	ENBL/DSBL	CLOSE CONTROL SELECT	Default: Disable
	▼	ICE.M	ENBL/DSBL	ICE MODE ENABLE	Default: Disable
	▼	C.UNB	XX %	CURRENT UNBALANCE SETPOINT	Default: 15% Range: 10 to 25%
	▼	NO.FL	ENBL/DSBL	ENABLE NO FLOW DETECTION	Default: Enable
	▼	W.MSG	ENBL/DSBL	WINTERIZE ALERT CONFIG	Default: Enable
	▼	ALR.C	X	ALARM RELAY USAGE	Default: Alerts + Alarms Alerts + Alarms Alarms Only Off

Table 12 — Configuration Mode and Sub-Mode Directory (cont)

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
RSET		CRST	X	COOLING RESET TYPE	Default: No Reset No Reset 4 to 20 mA Input Outdoor Air Temperature Return Fluid Space Temperature
		CRT1	XXX.X °F	NO COOL RESET TEMP	Default: 125 F Range: 0° to 125 F For return fluid reset use cooler ΔT
		CRT2	XXX.X °F	FULL COOL RESET TEMP	Default: 0° F Range: 0° to 125 F For return fluid reset use cooler ΔT
		DGRC	XX.X ΔF	DEGREES COOL RESET	Default: 0° F Range: -30 to 30 F
		HRST	X	HEATING RESET TYPE	Default: No Reset No Reset 4 to 20 mA Input Outdoor Air Temperature Return Fluid Space Temperature
		HRT1	XXX.X °F	NO HEAT RESET TEMP	Default: 0° F Range: 0° to 125 F
		HRT2	XXX.X °F	FULL HEAT RESET TEMP	Default: 125 F Range: 0° to 125 F
		DGRH	XX.X ΔF	DEGREES HEAT RESET	Default: 0° F Range: -30 to 30 F
		DMDC	X	DEMAND LIMIT SELECT	Default: None None Switch 4 to 20 mA Input CCN Loadshed
		DM20	XXX %	DEMAND LIMIT AT 20 mA	Default: 100% Range: 0 to 100%
		SHNM	XXX	LOADSHED GROUP NUMBER	Default: 0 Range: 0 to 99
		SHDL	XXX %	LOADSHED DEMAND DELTA	Default: 0% Range: 0 to 60%
		SHTM	XXX	MAXIMUM LOADSHED TIME	Default: 60 Minutes Range: 0 to 120 Minutes
		DLS1	XXX %	DEMAND LIMIT SWITCH 1	Default: 80% Range: 0 to 100%
		DLS2	XXX %	DEMAND LIMIT SWITCH 2	Default: 50% Range: 0 to 100%
		LLEN	ENBL/DSBL	LEAD/LAG CHILLER ENABLE	Default: Disable
		MSSL	SLVE/MAST	MASTER/SLAVE SELECT	Default: Master
		SLVA	XXX	SLAVE ADDRESS	Default: 0 Range: 0 to 239
		LLBL	X	LEAD/LAG BALANCE SELECT	Default: Master Leads Master Leads Slave Leads Automatic
		LLBD	XXX	LEAD/LAG BALANCE DELTA	Default: 168 hours Range: 40 to 400 hours
		LLDY	XXX	LAG START DELAY	Default: 5 minutes Range: 0 to 30 minutes
		PARA	YES/NO	PARALLEL CONFIGURATION	Default: No (Series Flow)

Table 12 — Configuration Mode and Sub-Mode Directory (cont)

SUB MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT	
SLCT	ENTER	CLSP	X	COOLING SETPOINT SELECT	Default: Single Single Dual Switch Dual 7 day Dual CCN Occupied 4 to 20 mA Input (requires EMM)	
	▼	HTSP	X	HEATING SETPOINT SELECT	Default: Single Single Dual Switch Dual 7 day Dual CCN Occupied 4 to 20 mA Input (requires EMM)	
	▼	RL.S	ENBL/DSBL	RAMP LOAD SELECT	Default: Enable	
	▼	CRMP	X.X	COOLING RAMP LOADING	Default: 1.0 Range: 0.2 to 2.0	
	▼	HRMP	X.X	HEATING RAMP LOADING	Default: 1.0 Range: 0.2 to 2.0	
	▼	HCSW	COOL/HEAT	HEAT COOL SELECT	Default: Cool	
	▼	Z.GN	X.X	DEADBAND MULTIPLIER	Default: 2.0 Range: 1.0 to 4.0	
	▼	BRN.L	YES/NO	HXC BRINE CONFIG LOCK	Default: No Yes, if brine FIOF is installed (liquid line solenoid valves).	
SERV	ENTER	H.PGN	XX.X	HEAD PRESSURE P GAIN	Default: 1.0 Range: -20 to 20	
	▼	H.IGN	XX.X	HEAD PRESSURE I GAIN	Default: 0.1 Range: -20 to 20	
	▼	H.DGN	XX.X	HEAD PRESSURE D GAIN	Default: 0.0 Range: -20 to 20	
	▼	H.MIN	XXX.X	WATER VALVE MINIMUM POS.	Default: 20% Range: 0 to 100%	
	▼	MT.SP	XXX.X °F	MOTOR TEMP SETPOINT	Default: 200 F (170 F for Brine)	
	▼	BR.FZ	XXX.X °F	BRINE FREEZE POINT	Default: 34 F Range: -20 to 34 F	
	▼	MC.SP	XXX.X °F	MAX. COND. TEMP SETPOINT	Default: 152 F (GXN,R) 145 F (HXA) 118 F (HXC) Range: 100 F To Default	
	▼	EX.S.A	XX.X %	EXVA START POSITION	Default: 20 % Range: 0 To 40 %	
	▼	EX.S.B	XX.X %	EXVB START POSITION	Default: 20 % Range: 0 To 40 %	
	▼	EN.A1	ENBL/DSBL	ENABLE COMPRESSOR A1	Default: Enable (All)	
	▼	EN.A2	ENBL/DSBL	ENABLE COMPRESSOR A2	Disable (HX076-186, GXN,R080-178) Enable (HX206-271, GXN,R204-350)	
	▼	EN.B1	ENBL/DSBL	ENABLE COMPRESSOR B1	Default: Enable (All)	
	▼	EN.B2	ENBL/DSBL	ENABLE COMPRESSOR B2	Disable (HX076-271, GXN,R080-268) Enable (GXN,R281-350)	
	▼	W.DNE	YES/NO	WINTERIZATION PERFORMED		
	▼	ECON	YES/NO	ECONOMIZED	No (30HX076-146, 30GXN,R080-106,114) Yes (30HX161-271,30GXN,R108,118-350)	
	▼	EVPS	X	NUMBER OF EVAP. PASSES	Range: 1 To 4	
	▼	LWTC	A/B	CIRCUIT WITH LWT SENSOR	According to number of cooler passes.	
	▼	AP.SP	XXX.X °F	APPROACH SETPOINT	Default: 3.0 F Range: 0.1 to 20.0 F	
	BCST	ENTER	TD.B.C	ON/OFF	CCN TIME/DATE BROADCAST	Default: Off
		▼	OAT.B	ON/OFF	CCN OAT BROADCAST	Default: Off
▼		GS.BC	ON/OFF	GLOBAL SCHEDULE BROADCAST	Default: Off	
▼		BC.AK	ON/OFF	BROADCAST ACKNOWLEDGER	Default: Off	

Table 13 — Service Test Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
TEST	<input type="button" value="ENTER"/>		ON/OFF	SERVICE TEST MODE	To Enable Service Test Mode, move Enable/Off/Remote Contact switch to OFF. Change TEST to ON. Move switch to ENABLE.
OUTS	<input type="button" value="ENTER"/>	EXV.A	XXX %	EXV % OPEN	
	<input type="button" value="▼"/>	VH.PA	XXX %	VAR HEAD PRESS %	
	<input type="button" value="▼"/>	OL.PA	ON/OFF	OIL PUMP	
	<input type="button" value="▼"/>	MC.A1	ON/OFF	MOTOR COOLING SOLENOID A1	
	<input type="button" value="▼"/>	MC.A2	ON/OFF	MOTOR COOLING SOLENOID A2	
	<input type="button" value="▼"/>	OS.A1	ON/OFF	OIL SOLENOID A1	
	<input type="button" value="▼"/>	OS.A2	ON/OFF	OIL SOLENOID A2	
	<input type="button" value="▼"/>	EXV.B	XXX %	EXV % OPEN	
	<input type="button" value="▼"/>	VH.PB	XXX %	VAR HEAD PRESS %	
	<input type="button" value="▼"/>	OL.PB	ON/OFF	OIL PUMP	
	<input type="button" value="▼"/>	MC.B1	ON/OFF	MOTOR COOLING SOLENOID B1	
	<input type="button" value="▼"/>	MC.B2	ON/OFF	MOTOR COOLING SOLENOID B2	
	<input type="button" value="▼"/>	OS.B1	ON/OFF	OIL SOLENOID B1	
	<input type="button" value="▼"/>	OS.B2	ON/OFF	OIL SOLENOID B2	
	<input type="button" value="▼"/>	FAN1	ON/OFF	FAN 1 RELAY	Fans 1, 2 (080-150,160) Fans 2, 4 (208, 228, 253, 268) Fans 5, 6 (249, 264) Fans 9, 10 (153, 163-178, 204,225,281-350) Fans 15, 16 (253, 268)
	<input type="button" value="▼"/>	FAN2	ON/OFF	FAN 2 RELAY	Fans 3, 4 (080-178, 204, 225, 249, 264, 281-350) Fan 3 (208, 228, 253, 268)
	<input type="button" value="▼"/>	FAN3	ON/OFF	FAN 3 RELAY	Fans 5, 6 (083, 093-160, 174, 204, 225) Fans 6, 8 (253, 268) Fans 7, 8 (118, 128, 138, 150, 160) Fans 9, 10 (249, 264) Fans 11, 12 (163, 178, 208, 228-268) Fans 13, 14 (208, 228, 253, 268-350) Fans 15, 16 (281-350)
	<input type="button" value="▼"/>	FAN4	ON/OFF	FAN 4 RELAY	Fans 5, 7 (208, 228, 253, 268) Fans 5, 6, 7, 8 (281-350) Fans 11, 12 (163, 178)
	<input type="button" value="▼"/>	CLR.P	ON/OFF	COOLER PUMP RELAY	
	<input type="button" value="▼"/>	CLR.H	ON/OFF	COOLER HEATER	
	<input type="button" value="▼"/>	CND.P	ON/OFF	CONDENSER PUMP RELAY	
	<input type="button" value="▼"/>	RMT.A	ON/OFF	REMOTE ALARM RELAY	
	COMP	<input type="button" value="ENTER"/>	CC.A1	ON/OFF	COMPRESSOR A1 RELAY
<input type="button" value="▼"/>		CC.A2	ON/OFF	COMPRESSOR A2 RELAY	
<input type="button" value="▼"/>		LD.A1	ON/OFF	LOADER A1 RELAY	
<input type="button" value="▼"/>		LD.A2	ON/OFF	LOADER A2 RELAY	
<input type="button" value="▼"/>		MLV	ON/OFF	MINIMUM LOAD VALVE	Energizes circuit A and B solenoids
<input type="button" value="▼"/>		OL.H.A	ON/OFF	OIL HEATER	
<input type="button" value="▼"/>		CC.B1	ON/OFF	COMPRESSOR B1 RELAY	
<input type="button" value="▼"/>		CC.B2	ON/OFF	COMPRESSOR B2 RELAY	
<input type="button" value="▼"/>		LD.B1	ON/OFF	LOADER B1 RELAY	
<input type="button" value="▼"/>		LD.B2	ON/OFF	LOADER B2 RELAY	
<input type="button" value="▼"/>	OL.H.B	ON/OFF	OIL HEATER		

Table 14 — Temperature Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
UNIT	ENTER	CEWT	XXX.X °F	COOLER ENTERING FLUID	
	▼	CLWT	XXX.X °F	COOLER LEAVING FLUID	
	▼	OAT	XXX.X °F	OUTSIDE AIR TEMPERATURE	
	▼	SPT	XXX.X °F	SPACE TEMPERATURE	
	▼	CNDE	XXX.X °F	CONDENSER ENTERING FLUID	
	▼	CNDL	XXX.X °F	CONDENSER LEAVING FLUID	
	▼	DLWT	XXX.X °F	LEAD/LAG LEAVING FLUID	
CIR.A	ENTER	SCT.A	XXX.X °F	SATURATED CONDENSING TMP	
	▼	SST.A	XXX.X °F	SATURATED SUCTION TEMP	
	▼	SH.A	XXX.X °F	DISCHARGE SUPERHEAT TEMP	
	▼	DGT.A	XXX.X °F	DISCHARGE GAS TEMP	Average of A1/A2 values for GXN,R204-350 and HX206-271
	▼	DGA.1	XXX.X °F	DISCHARGE GAS TEMP - A1	
	▼	DGA.2	XXX.X °F	DISCHARGE GAS TEMP - A2	GXN,R204-350 and HX206-271 only
	▼	MT.A1	XXX.X °F	A1 MOTOR TEMPERATURE	
	▼	MT.A2	XXX.X °F	A2 MOTOR TEMPERATURE	GXN,R204-350 and HX206-271 only
CIR.B	ENTER	SCT.B	XXX.X °F	SATURATED CONDENSING TMP	
	▼	SST.B	XXX.X °F	SATURATED SUCTION TEMP	
	▼	SH.B	XXX.X °F	DISCHARGE SUPERHEAT TEMP	
	▼	DGT.B	XXX.X °F	DISCHARGE GAS TEMP	Average of B1/B2 values for GXN,R281-350
	▼	DGB.1	XXX.X °F	DISCHARGE GAS TEMP - B1	
	▼	DGB.2	XXX.X °F	DISCHARGE GAS TEMP - B2	GXN,R281-350 only
	▼	MT.B1	XXX.X °F	B1 MOTOR TEMPERATURE	
	▼	MT.B2	XXX.X °F	B2 MOTOR TEMPERATURE	GXN,R281-350 only

Table 15 — Pressure Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
PRC.A	ENTER	DP.A	XXX.X PSIG	DISCHARGE PRESSURE	
	▼	SP.A	XXX.X PSIG	SUCTION PRESSURE	
	▼	ECN.A	XXX.X PSIG	ECONOMIZER PRESSURE	
	▼	OP.A1	XXX.X PSIG	A1 OIL PRESSURE	
	▼	OP.A2	XXX.X PSIG	A2 OIL PRESSURE	
	▼	DO.A1	XXX.X PSI	A1 OIL PRESSURE DIFF.	Equals oil pressure minus Economizer pressure
	▼	DO.A2	XXX.X PSI	A2 OIL PRESSURE DIFF.	Equals oil pressure minus Economizer pressure
	▼	FD.A1	XXX.X PSI	A1 OIL FILTER DIFF. PRESS	Equals discharge pressure minus oil pressure
	▼	FD.A2	XXX.X PSI	A2 OIL FILTER DIFF. PRESS	Equals discharge pressure minus oil pressure
	▼	PS.A1	XX.X PSI	CALCULATED OIL PRESS A1	CKT A oil pressure setpoint 1 (See notes for Table 32)
	▼	PS.A2	XX.X PSI	CALCULATED OIL PRESS A2	CKT A oil pressure setpoint 2 (See notes for Table 32)
PRC.B	ENTER	DP.B	XXX.X PSIG	DISCHARGE PRESSURE	
	▼	SP.B	XXX.X PSIG	SUCTION PRESSURE	
	▼	ECN.B	XXX.X PSIG	ECONOMIZER PRESSURE	
	▼	OP.B1	XXX.X PSIG	B1 OIL PRESSURE	
	▼	OP.B2	XXX.X PSIG	B2 OIL PRESSURE	
	▼	DO.B1	XXX.X PSI	B1 OIL PRESSURE DIFF.	Equals oil pressure minus Economizer pressure
	▼	DO.B2	XXX.X PSI	B2 OIL PRESSURE DIFF.	Equals oil pressure minus Economizer pressure
	▼	FD.B1	XXX.X PSI	B1 OIL FILTER DIFF.	Equals discharge pressure minus oil pressure
	▼	FD.B2	XXX.X PSI	B2 OIL FILTER DIFF.	Equals discharge pressure minus oil pressure
	▼	PS.B1	XX.X PSI	CALCULATED OIL PRESS B1	CKT B oil pressure setpoint 1 (See notes for Table 32)
	▼	PS.B2	XX.X PSI	CALCULATED OIL PRESS B2	CKT B oil pressure setpoint 2 (See notes for Table 32)

Table 16 — Set Point Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
COOL	ENTER	CSP.1	XXX.X °F	COOLING SETPOINT 1	Default: 44 F
	▼	CSP.2	XXX.X °F	COOLING SETPOINT 2	Default: 44 F
	▼	CSP.3	XXX.X °F	ICE SETPOINT	Default: 32 F
HEAT	ENTER	HSP.1	XXX.X °F	HEATING SETPOINT 1	Default: 100 F
	▼	HSP.2	XXX.X °F	HEATING SETPOINT 2	Default: 100 F
HEAD	ENTER	HD.P.A	XXX.X °F	HEAD PRESSURE SETPOINT A	Default: 113 F (30GX,HXA) 85 F (30HXC)
	▼	HD.P.B	XXX.X °F	HEAD PRESSURE SETPOINT B	Default: 113 F (30GX,HXA) 85 F (30HXC)

Table 17 — Inputs Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
GEN.I	ENTER	STST	STRT/STOP	START/STOP SWITCH	
	▼	FLOW	ON/OFF	COOLER FLOW SWITCH	
	▼	CND.F	ON/OFF	CONDENSER FLOW SWITCH	
	▼	DLS1	ON/OFF	DEMAND LIMIT SWITCH 1	
	▼	DLS2	ON/OFF	DEMAND LIMIT SWITCH 2	
	▼	ICED	ON/OFF	ICE DONE	
	▼	DUAL	ON/OFF	DUAL SETPOINT SWITCH	
CRCT	ENTER	FKA1	ON/OFF	COMPRESSOR A1 FEEDBACK	
	▼	FKA2	ON/OFF	COMPRESSOR A2 FEEDBACK	
	▼	OIL.A	OPEN/CLSE	OIL LEVEL SWITCH	
	▼	A1.CR	XXX AMPS	COMP A1 RUNNING CURRENT	
	▼	A2.CR	XXX AMPS	COMP A2 RUNNING CURRENT	
	▼	FKB1	ON/OFF	COMPRESSOR B1 FEEDBACK	
	▼	FKB2	ON/OFF	COMPRESSOR B2 FEEDBACK	
	▼	OIL.B	OPEN/CLSE	OIL LEVEL SWITCH	
	▼	B1.CR	XXX AMPS	COMP B1 RUNNING CURRENT	
	▼	B2.CR	XXX AMPS	COMP B2 RUNNING CURRENT	
	4-20	ENTER	DMND	XX.X MA	4-20 MA DEMAND SIGNAL
▼		RSET	XX.X MA	4-20 MA RESET SIGNAL	
▼		CSP	XX.X MA	4-20 MA COOLING SETPOINT	
▼		HSP	XX.X MA	4-20 MA HEATING SETPOINT	

Table 18 — Outputs Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
GEN.O	ENTER	FAN1	ON/OFF	FAN 1 RELAY	
	▼	FAN2	ON/OFF	FAN 2 RELAY	
	▼	FAN3	ON/OFF	FAN 3 RELAY	
	▼	FAN4	ON/OFF	FAN 4 RELAY	
	▼	MLV	ON/OFF	MINIMUM LOAD VALVE	
	▼	C.PMP	ON/OFF	COOLER PUMP RELAY	
	▼	C.HT	ON/OFF	COOLER HEATER	
	▼	CNDP	ON/OFF	CONDENSER PUMP RELAY	
	▼	SMZ	X.X	LOAD/UNLOAD FACTOR	
CIR.A	ENTER	CC.A1	ON/OFF	COMPRESSOR A1 RELAY	
	▼	CC.A2	ON/OFF	COMPRESSOR A2 RELAY	
	▼	LD.A1	ON/OFF	LOADER A1 RELAY	
	▼	LD.A2	ON/OFF	LOADER A2 RELAY	
	▼	OL.PA	ON/OFF	OIL PUMP	
	▼	MC.A1	ON/OFF	MOTOR COOLING A1 SOLENOID	
	▼	MC.A2	ON/OFF	MOTOR COOLING A2 SOLENOID	
	▼	OL.H.A	ON/OFF	OIL HEATER	
	▼	OL.A1	ON/OFF	OIL SOLENOID A1	
	▼	OL.A2	ON/OFF	OIL SOLENOID A2	
	▼	EXV.A	XXX %	EXV % OPEN	
	▼	VH.PA	XXX %	VARIABLE HEAD PRESS %	
	CIR.B	ENTER	CC.B1	ON/OFF	COMPRESSOR B1 RELAY
▼		CC.B2	ON/OFF	COMPRESSOR B2 RELAY	
▼		LD.B1	ON/OFF	LOADER B1 RELAY	
▼		LD.B2	ON/OFF	LOADER B2 RELAY	
▼		OL.PB	ON/OFF	OIL PUMP	
▼		MC.B1	ON/OFF	MOTOR COOLING B1 SOLENOID	
▼		MC.B2	ON/OFF	MOTOR COOLING B2 SOLENOID	
▼		OL.H.B	ON/OFF	OIL HEATER	
▼		OL.B1	ON/OFF	OIL SOLENOID B1	
▼		OL.B2	ON/OFF	OIL SOLENOID B2	
▼		EXV.B	XXX %	EXV % OPEN	
▼		VH.PB	XXX %	VARIABLE HEAD PRESS %	

Table 19 — Operating Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
MODE		MD01	ON/OFF	CSM CONTROLLING CHILLER	
		MD02	ON/OFF	WSM CONTROLLING CHILLER	
		MD03	ON/OFF	MASTER/SLAVE CONTROL	
		MD04	ON/OFF	LOW SOURCE PROTECTION	
		MD05	ON/OFF	RAMP LOAD LIMITED	
		MD06	ON/OFF	TIMED OVERRIDE IN EFFECT	
		MD07	ON/OFF	LOW COOLER SUCTION TEMPA	
		MD08	ON/OFF	LOW COOLER SUCTION TEMPB	
		MD09	ON/OFF	SLOW CHANGE OVERRIDE	
		MD10	ON/OFF	MINIMUM OFF TIME ACTIVE	
		MD11	ON/OFF	LOW DISCHRG SUPERHEAT A	
		MD12	ON/OFF	LOW DISCHRG SUPERHEAT B	
		MD13	ON/OFF	DUAL SETPOINT	
		MD14	ON/OFF	TEMPERATURE RESET	
		MD15	ON/OFF	DEMAND LIMIT IN EFFECT	
		MD16	ON/OFF	COOLER FREEZE PROTECTION	
		MD17	ON/OFF	LOW TMP COOL/HI TMP HEAT	
		MD18	ON/OFF	HI TMP COOL/LO TMP HEAT	
		MD19	ON/OFF	MAKING ICE	
		MD20	ON/OFF	STORING ICE	
		MD21	ON/OFF	HIGH SCT CIRCUIT A	
		MD22	ON/OFF	HIGH SCT CIRCUIT B	
		MD23	ON/OFF	HIGH MOTOR CURRENT CIR. A	
		MD24	ON/OFF	HIGH MOTOR CURRENT CIR. B	
		MD25	ON/OFF	CKT A OFF REF FLOW DELAY*	
		MD26	ON/OFF	CKT B OFF REF FLOW DELAY*	
		MD27	ON/OFF	CIRCUIT A — PUMPING OUT	SHUTDOWN IN PROGRESS
		MD28	ON/OFF	CIRCUIT B — PUMPOUT OUT	SHUTDOWN IN PROGRESS
		MD29	ON/OFF	UNIT OFF: NO WATER FLOW	

*Recycle restart pending 15-minute delay due to loss of refrigerant flow detected at start-up.

Table 20 — Run Status Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
VIEW	<input type="button" value="ENTER"/>	EWT	XXX.X °F	ENTERING FLUID TEMP	
	<input type="button" value="▼"/>	LWT	XXX.X °F	LEAVING FLUID TEMP	
	<input type="button" value="▼"/>	SETP	XXX.X °F	ACTIVE SETPOINT	
	<input type="button" value="▼"/>	CTPT	XXX.X °F	CONTROL POINT	
	<input type="button" value="▼"/>	STAT	X	CONTROL MODE	SERVICE TEST OFF LOCAL OFF CCN OFF TIME OFF EMRGCY ON LOCAL ON CCN ON TIME
	<input type="button" value="▼"/>	OCC	YES/NO	OCCUPIED	
	<input type="button" value="▼"/>	MIN.L	XX MIN	MINUTES LEFT FOR START	
	<input type="button" value="▼"/>	MODE	YES/NO	OVERRIDE MODES IN EFFECT	
	<input type="button" value="▼"/>	CAP	XXX %	PERCENT TOTAL CAPACITY	
	<input type="button" value="▼"/>	DEM.L	XXX %	ACTIVE DEMAND LIMIT	
	<input type="button" value="▼"/>	ALRM	XXX	CURRENT ALARMS & ALERTS	
	<input type="button" value="▼"/>	TIME	XX.XX	TIME OF DAY	00.00-23.59
	<input type="button" value="▼"/>	MNTH	XX	MONTH OF YEAR	January, February, etc.
	<input type="button" value="▼"/>	DATE	XX	DAY OF MONTH	01-31
RUN	<input type="button" value="ENTER"/>	HRS.U	XXXX HRS	MACHINE OPERATING HOURS	
	<input type="button" value="▼"/>	STR.U	XXXX	MACHINE STARTS	
HOUR	<input type="button" value="ENTER"/>	HRS.A	XXXX HRS	CIRCUIT A RUN HOURS	
	<input type="button" value="▼"/>	HRS.B	XXXX HRS	CIRCUIT B RUN HOURS	
	<input type="button" value="▼"/>	HR.A1	XXXX HRS	COMPRESSOR A1 RUN HOURS	
	<input type="button" value="▼"/>	HR.A2	XXXX HRS	COMPRESSOR A2 RUN HOURS	
	<input type="button" value="▼"/>	HR.B1	XXXX HRS	COMPRESSOR B1 RUN HOURS	
	<input type="button" value="▼"/>	HR.B2	XXXX HRS	COMPRESSOR B2 RUN HOURS	
STRT	<input type="button" value="ENTER"/>	STR.A	XXXX	CIRCUIT A STARTS	
	<input type="button" value="▼"/>	ST.A1	XXXX	COMPRESSOR A1 STARTS	
	<input type="button" value="▼"/>	ST.A2	XXXX	COMPRESSOR A2 STARTS	
	<input type="button" value="▼"/>	STR.B	XXXX	CIRCUIT B STARTS	
	<input type="button" value="▼"/>	ST.B1	XXXX	COMPRESSOR B1 STARTS	
	<input type="button" value="▼"/>	ST.B2	XXXX	COMPRESSOR B2 STARTS	

Table 20 — Run Status Mode and Sub-Mode Directory (cont)

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
VERS	ENTER	MBB		CESR-131344-xx-xx	xx-xx is Version number
	▼	EXV		CESR-131172-xx-xx	xx-xx is Version number
	▼	EMM		CESR-131174-xx-xx	xx-xx is Version number
	▼	CP1		100233-1R1-xx-xx	xx-xx is Version number
	▼	CP2		100233-1R1-xx-xx	xx-xx is Version number
	▼	SCB		CESR-131226-xx-xx	xx-xx is Version number
	▼	NAVI		CESR-131227-xx-xx	xx-xx is Version number

Table 21 — How to Adjust Navigator Backlight from Configuration Mode

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
DISP	ENTER	TEST	ON/OFF	TEST DISPLAY LEDS	
	ENTER		Enter Password 1111		Enter password as required using ENTER key after each number.
		TEST	OFF		'OFF' will be flashing.
	▲	TEST	ON		Change value to 'ON' ('ON' flashes).
	ENTER	TEST	ON		Display Test is Enabled. The alarm and all mode LED's light up. The Navigator will display all block segments.
	▲ ▼				Press arrow keys at the same time. The Navigator will display 'Adjust Brightness.'
	▲ ▼				Use the up arrow key to brighten the backlight and the down arrow key to dim the backlight. Press the ESCAPE key when finished to exit the mode.

Table 22 — How to Adjust Navigator Contrast from Configuration Mode

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
DISP	ENTER	TEST	ON/OFF	TEST DISPLAY LEDS	
	ENTER		Enter Password 1111		Enter password as required using ENTER key after each number.
		TEST	OFF		'OFF' will be flashing
	▲	TEST	ON		Change value to 'ON' ('ON' flashes).
	ENTER	TEST	ON		Display Test is Enabled. The alarm and all mode LED's light up. The Navigator will display all block segments.
	ENTER ESCAPE				Press Enter and Escape keys at the same time. The Navigator will display 'ADJUST CONTRAST' with a percentage indication.
	▲ ▼				Use the up arrow key to increase contrast and the down arrow key to decrease the contrast. Press the ESCAPE key when finished to exit the mode.

Table 23 — Time Clock Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
TIME	ENTER	HH.MM	XX.XX	HOUR AND MINUTE	Military (00:00 — 23:59)
DATE	▼	MNTH	XX	MONTH OF YEAR	January, February, etc.
	▼	DOM	XX	DAY OF MONTH	Range: 01-31
	▼	DAY	X	DAY OF WEEK	Monday, Tuesday, etc.
	▼	YEAR	XXXX	YEAR	
DST	ENTER	STR.M	XX	MONTH	Default: 4 Range: 1-12
	▼	STR.W	X	WEEK	Default: 1 Range: 1-5
	▼	STR.D	X	DAY	Default: 7 Range: 1-7
	▼	MIN.A	XX	MINUTES TO ADD	Default: 60 Range: 0-99
	▼	STP.M	XX	MONTH	Default: 10 Range: 1-12
	▼	STP.W	XX	WEEK	Default: 5 Range: 1-5
	▼	STR.D	XX	DAY	Default: 7 Range: 1-7
	▼	MIN.5	XX	MINUTES TO SUBTRACT	Default: 60 Range: 0-99
SCHD	ENTER	MON.O	XX.XX	MONDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	MON.U	XX.XX	MONDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	TUE.O	XX.XX	TUESDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	TUE.U	XX.XX	TUESDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	WED.O	XX.XX	WEDNESDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	WED.U	XX.XX	WEDNESDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	THU.O	XX.XX	THURSDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	THU.U	XX.XX	THURSDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	FRI.O	XX.XX	FRIDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	FRI.U	XX.XX	FRIDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	SAT.O	XX.XX	SATURDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	SAT.U	XX.XX	SATURDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	SUN.O	XX.XX	SUNDAY OCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59
	▼	SUN.U	XX.XX	SUNDAY UNOCCUPIED TIME	Default: 00.00 Range: 00.00 to 23.59

Table 24A — Example of Configuring Dual Chiller Control (Master Chiller)

SUB-MODE	ITEM	KEYPAD ENTRY	DISPLAY	ITEM EXPANSION	COMMENT
OPT2	OPT2	ENTER			
	CTRL	ENTER	SWITCH		VALUE FLASHES
	CTRL	ENTER	SWITCH	CONTROL METHOD	SEE NOTE 1
		▼			
	CCNA	ENTER	1		DEFAULT 1
	CCNA	ENTER	1	CCN ADDRESS	CHANGE IF REQUIRED
		▼			
	CCNB	ENTER	0		DEFAULT 0
	CCNB	ENTER	0	CCN BUS NUMBER	CHANGE IF REQUIRED
	CCNB	ESCAPE	OPT2		
RSET		▼	RESET		PROCEED TO SUBMODE RSET
	RSET	ENTER			
	CRST		NO RESET	COOLING RESET TYPE	
		▼			▼ 15 ITEMS
	LLEN	ENTER	DSBL	LEAD/LAG CHILLER ENABLE	SCROLLING STOPS
		ENTER	DSBL		VALUE FLASHES
		▲	ENBL		SELECT ENBL
	LLEN	ENTER	ENBL	LEAD/LAG CHILLER ENABLE	CHANGE ACCEPTED
		▼	MSSL		
	MSSL	ENTER	MAST	MASTER/SLAVE SELECT	DEFAULT MAST
		▼	SLVA	SLAVE ADDRESS	
	SLVA	ENTER	0		VALUE FLASHES
		▲	2		SELECT 2
	SLVA	ENTER	2	SLAVE ADDRESS	CHANGE ACCEPTED
		▼			
	LLBL	ENTER	MASTER LEADS	LEAD/LAG BALANCE SELECT	VALUE FLASHES
		▲	AUTOMATIC		SELECT AUTOMATIC
	LLBL	ENTER	AUTOMATIC	LEAD/LAG BALANCE SELECT	CHANGE ACCEPTED
		▼			
	LLBD	ENTER	168	LEAD/LAG BALANCE DELTA	DEFAULT 168
		ENTER			
		▼			
	LLDY	ENTER	5	LAG START DELAY	
		ENTER	5		VALUE FLASHES
		▲	10		SELECT 10
	LLDY	ENTER	10	LAG START DELAY	CHANGE ACCEPTED
	PARA	ENTER	NO	PARALLEL CONFIGURATION	DEFAULT NO
		▲	YES		SELECT YES
	PARA	ENTER	YES	PARALLEL CONFIGURATION	SEE NOTE 2
		ESCAPE	RSET		MASTER COMPLETE

NOTES:

- The desired control method should be configured for the Master only. The slave is always configured for switch control.
- Yes = Parallel piping configuration. No = Series piping configuration. Master and Slave chillers must both be configured for the same piping configuration.

Table 24B — Example of Configuring Dual Chiller Control (Slave Chiller)

SUB-MODE	ITEM	KEYPAD ENTRY	DISPLAY	ITEM EXPANSION	COMMENT
OPT2	OPT2	ENTER			
	CTRL	ENTER	SWITCH	CONTROL METHOD	SEE NOTE 1
		ESCAPE	SWITCH		
		ESCAPE	CTRL		
	CTRL	▼	CCNA		
	CCNA	ENTER	1	CCN ADDRESS	SCROLLING STOPS
		ENTER	1		VALUE FLASHES
		▲	2		SELECT 2 (SEE NOTE 2)
	CCNA	ENTER	2	CCN ADDRESS	CHANGE ACCEPTED
		ESCAPE	CCNA		
		▼	CCNB		
	CCNB	ENTER	0	CCN BUS NUMBER	DEFAULT 0 (SEE NOTE 3)
		ESCAPE	CCNB		
		ESCAPE	OPT2		
		▼	RSET		PROCEED TO SUBMODE RSET
RSET	RSET	ENTER	CRST	COOLING RESET TYPE	
		▼	LLEN	LEAD/LAG CHILLER ENABLE	▼ 15 ITEMS
	LLEN	ENTER	DSBL		SCROLLING STOPS
		ENTER	DSBL		VALUE FLASHES
		▲	ENBL		SELECT ENBL
	LLEN	ENTER	ENBL	LEAD/LAG CHILLER ENABLE	CHANGE ACCEPTED
		ESCAPE	LLEN		
		▼	MSSL	MASTER/SLAVE SELECT	
	MSSL	ENTER	MAST		SCROLLING STOPS
		ENTER	MAST		VALUE FLASHES
		▲	SLVE		SELECT SLAVE
	MSSL	ENTER	SLVE	MASTER/SLAVE SELECT	CHANGE ACCEPTED
		ESCAPE	MSSL		
		▼			▼ 5 ITEMS
	PARA	ENTER	NO	PARALLEL CONFIGURATION	
	▲	YES		SELECT YES	
PARA	ENTER	YES	PARALLEL CONFIGURATION	SEE NOTE 5	
	ESCAPE	RSET		SLAVE COMPLETE	

NOTES:

1. Slave is always configured for switch control.
2. Slave CCN Address must be different than Master.
3. Slave CCN Bus Number must be the same as Master.
4. Slave does not require LLBL, LLBD or LLDY to be configured.
5. Yes = Parallel piping configuration. No = Series piping configuration.
Master and Slave chillers must both be configured for the same piping configuration.

Alarms/Alerts — Alarms and alerts are messages that one or more faults have been detected. The alarms and alerts indicate failures that cause the unit to shut down, terminate an option (such as reset) or result in the use of a default value such as a set point. Refer to the Troubleshooting section for more information.

Up to 25 alarms/alerts can be displayed in currently active alarms. Up to 50 alarms/alerts can be stored in the alarm history. See Tables 25 and 26 to view and clear alarms.

IMPORTANT: Do not clear the alarms without first reviewing the full list and investigating and correcting the cause of the alarms.

When an alarm or alert is stored in the display and the machine automatically resets, the alarm/alert is deleted. Codes for safeties which do not automatically reset are not deleted until the problem is corrected and the machine is reset. To clear manual reset alarms from the CCP modules, press the reset button located on the CCP board generating the alarm, for 5 seconds, (CCP1 for compressors A1 or B1, CCP2 for compressors A2 or B2). Next, follow the example in Table 26 to clear the alarm from the Main Base Board (MBB) history.

Alarm relay usage alerts and alarms are configurable in (CONFIGURATION MODE, SUB-MODE OPT2) to be both one or the other or off paragraph.

Run Hours and Starts — The HOUR and STRT sub-modes under the Run Status mode contain items for number of hours for each circuit and each compressor and the total number of starts for each compressor. All items are password protected, but can be changed if a replacement MBB is installed.

Press to make the current value flash. Use the arrow keys to configure the correct value and press the key again. Record the current values from the MBB before removing the module or downloading new software.

Temperature Reset — The control system is capable of handling leaving-fluid temperature reset based on return cooler fluid temperature. Because the change in temperature through the cooler is a measure of the building load, the return temperature reset is in effect an average building load reset method. The control system is also capable of temperature reset based on outdoor-air temperature (OAT), space temperature (SPT), or from an externally powered 4 to 20 mA signal. Accessory sensors must be used for OAT and SPT reset (HH79NZ023 for OAT and HH51BX006 for SPT). The Energy Management Module (EMM) must be used for temperature reset using a 4 to 20 mA signal.

To use the return reset, four variables must be configured. In the Configuration mode under the sub-mode RSET, items CRST, CRT1, CRT2, and DGRC must be set properly. See Tables 27 and 28 on page 37 for correct configuration.

To reset the return fluid temperature, the unit set point is reset from full load based on the chilled fluid return temperature. The example uses a reset value of 10 degrees at full reset. Full reset is at a 2-degree temperature difference across the cooler and no reset would be at a 10 F difference across the cooler. See Fig. 14-17 and Table 29.

Under normal operation, the chiller will maintain a constant leaving fluid temperature approximately equal to the chilled fluid set point. As the cooler load varies, the entering cooler fluid will change in proportion to the load as shown in Fig. 14. Usually the chiller size and leaving-fluid temperature set point are selected based on a full-load condition. At part load, the fluid temperature set point may be colder than required. If the leaving fluid temperature was allowed to increase at part load, the efficiency of the machine would increase.

Return temperature reset allows for the leaving temperature set point to be reset upward as a function of the return fluid temperature or, in effect, the building load.

Figure 14 is an example of no reset. Figures 15, 16, and 17 are examples of outdoor air, space and return water temperature resets.

Table 25 — Alarms Mode and Sub-Mode Directory

SUB-MODE	KEYPAD ENTRY	ITEM	ITEM EXPANSION	COMMENT
CRNT	<input type="button" value="ENTER"/>	AXXX or TXXX	CURRENTLY ACTIVE ALARMS	Alarms are shown as AXXX. Alerts are shown as TXXX.
RCRN	<input type="button" value="ENTER"/>	YES/NO	RESET ALL CURRENT ALARMS	
HIST	<input type="button" value="ENTER"/>	AXXX or TXXX	ALARM HISTORY	Alarms are shown as AXXX. Alerts are shown as TXXX.

Table 26 — Example of Reading and Clearing Alarms

SUB-MODE	KEYPAD ENTRY	ITEM	ITEM EXPANSION	COMMENT
CRNT	<input type="button" value="ENTER"/>	AXXX or TXXX	CURRENTLY ACTIVE ALARMS	ACTIVE ALARMS (AXXX) OR ALERTS (TXXX) DISPLAYED.*
CRNT	<input type="button" value="ESCAPE"/>			
RCRN	<input type="button" value="DOWN"/>	NO		Use to clear active alarms/alerts
	<input type="button" value="ENTER"/>	NO		NO Flashes
	<input type="button" value="UP"/>	YES		Select YES
	<input type="button" value="ENTER"/>	NO		Alarms/alerts clear, YES changes to NO


*Press and simultaneously to display expanded alarm description.

Table 27 — Configuring Temperature Reset

MODE	KEYPAD ENTRY	SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
CONFIGURATION	ENTER	DISP	ENTER	TEST	ON/OFF	TEST DISPLAY LEDs	
	▼	UNIT	ENTER	TYPE	X	UNIT TYPE	
	▼	OPT1	ENTER	FLUD	X	COOLER FLUID	
	▼	OPT2	ENTER	CTRL	X	CONTROL METHOD	
	▼	RSET	ENTER	CRST	X	COOLING RESET TYPE	0 = No Reset 1 = 4 to 20 mA Input (EMM required) (Connect to EMM J6-2,5) 2 = Outdoor-Air Temperature (Connect to TB5-7,8) 3 = Return Fluid 4 = Space Temperature (Connect to TB5-5,6)
			▼	CRT1	XXX.X F	NO COOL RESET TEMP	Default: 125 F (51.7 C) Range: 0° to 125 F Set to 4.0 for CRST= 1 No Cool Reset ΔT for CRST=3
			▼	CRT2	XXX.X F	FULL COOL RESET TEMP	Default: 0° F (-17.8 C) Range: 0° to 125 F Set to 20.0 for CRST=1 Full Cool Reset ΔT for CRST=3
			▼	DGRC	XX.X ΔF	DEGREES COOL RESET	Default: 0° F (0° C) Range: -30 to 30 F (-16.7 to 16.7 C)


Table 28 — Return Water Reset

SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
RSET	ENTER	CRST	3	COOLING RESET TYPE	0 = no reset 1 = 4 to 20 mA input 2 = Outdoor air temp 3 = Return Fluid 4 = Space Temperature
	▼	CRT1	10.0 F (5.5 C)	NO COOL RESET TEMP	Default: 125 F (51.7 C) Range: 0° to 125 F
	▼	CRT2	2.0 F (1.1 C)	FULL COOL RESET TEMP	Default: 0° F (-17.8 C) Range: 0° to 125 F
	▼	DGRC	5.0 ΔF (2.8 ΔC)	DEGREES COOL RESET	Default: 0°F (0° C) Range: -30 to 30 F (-16.7 to 16.7 C)

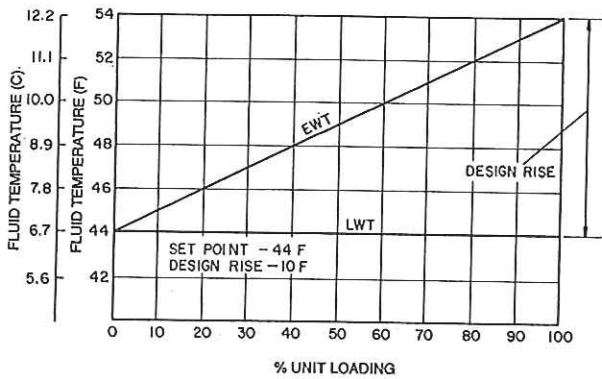


LEGEND
EWT — Entering Water (Fluid) Temperature
LWT — Leaving Water (Fluid) Temperature

Fig. 14 — Cooling Return Water — No Reset

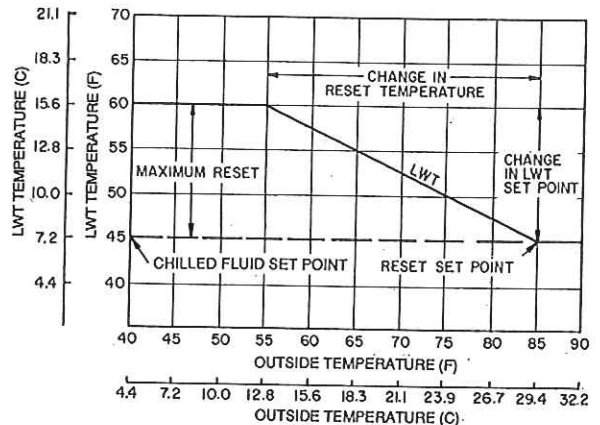

LEGEND
LWT — Leaving Water (Fluid) Temperature


Fig. 15 — Outdoor-Air Temperature Reset

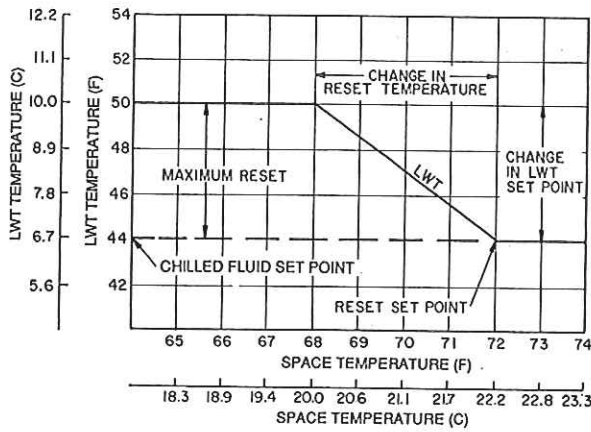

LEGEND

LWT — Leaving Water (Fluid) Temperature

Fig. 16 — Space Temperature Reset

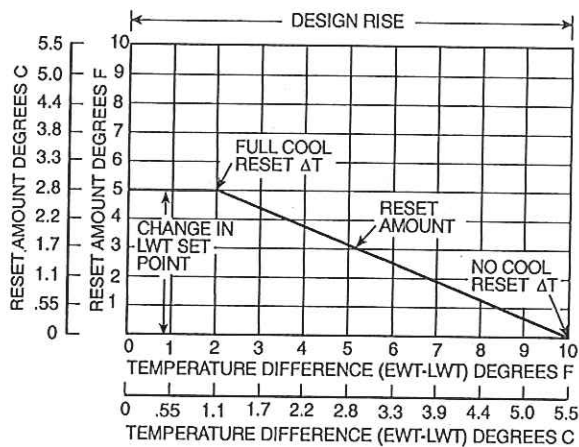

LEGEND

EWT — Entering Water (Fluid) Temperature
LWT — Leaving Water (Fluid) Temperature

Fig. 17 — Return Water Reset

Demand Limit — Demand Limit is a feature that allows the unit capacity to be limited during periods of peak energy usage. See Fig. 18. There are 3 types of demand limiting that can be configured. The first type is through 2-stage switch control, which will reduce the maximum capacity to 2 user-configurable

percentages. The second type is by 4 to 20 mA signal input which will reduce the maximum capacity linearly between 100% at a 4 mA input signal (no reduction) down to the user-configurable level at a 20 mA input signal. The third type uses the CCN Loadshed module and has the ability to limit the current operating capacity to maximum and further reduce the capacity if required.

NOTE: The 2-stage switch control and 4- to 20-mA input signal types of demand limiting require the Energy Management Module (EMM).

To use Demand Limit, select the type of demand limiting to use. Then configure the Demand Limit set points based on the type selected.

DEMAND LIMIT (2-Stage Switch Controlled) — To configure Demand Limit for 2-stage switch control set the Demand Limit Select (DMDC) to 1. Then configure the 2 Demand Limit Switch points (DLS1 and DLS2) to the desired capacity limit. See Table 29. Capacity steps are controlled by 2 relay switch inputs field wired to TB6.

For Demand Limit by 2-stage switch control, closing the first stage demand limit contact will put the unit on the first demand limit level. The unit will not exceed the percentage of capacity entered as Demand Limit Switch 1 set point. Closing contacts on the second demand limit switch prevents the unit from exceeding the capacity entered as Demand Limit Switch 2 set point. The demand limit stage that is set to the lowest demand takes priority if both demand limit inputs are closed. If the demand limit percentage does not match unit staging, the unit will limit capacity to the closest capacity stage.

To disable demand limit configure the DMDC to 0. See Table 29.

EXTERNALLY POWERED DEMAND LIMIT (4 to 20 mA Controlled) — To configure Demand Limit for 4 to 20 mA control set the Demand Limit Select (DMDC) to 2. Then configure the Demand Limit at 20 mA (DM20) to the maximum loadshed value desired. The control will reduce allowable capacity to this level for the 20 mA signal.

DEMAND LIMIT (CCN Loadshed Controlled) — To configure Demand Limit for CCN Loadshed control set the Demand Limit Select (DMDC) to 3. Then configure the Loadshed Group Number (SHNM), Loadshed Demand Delta (SHDL), and Maximum Loadshed Time (SHTM). See Table 29.

The Loadshed Group number is established by the CCN system designer. The *ComfortLink™* Control will respond to a Redline command from the Loadshed control. When the Redline command is received, the current stage of capacity is set to the maximum stages available. Should the loadshed control send a Loadshed command, the *ComfortLink* Control will


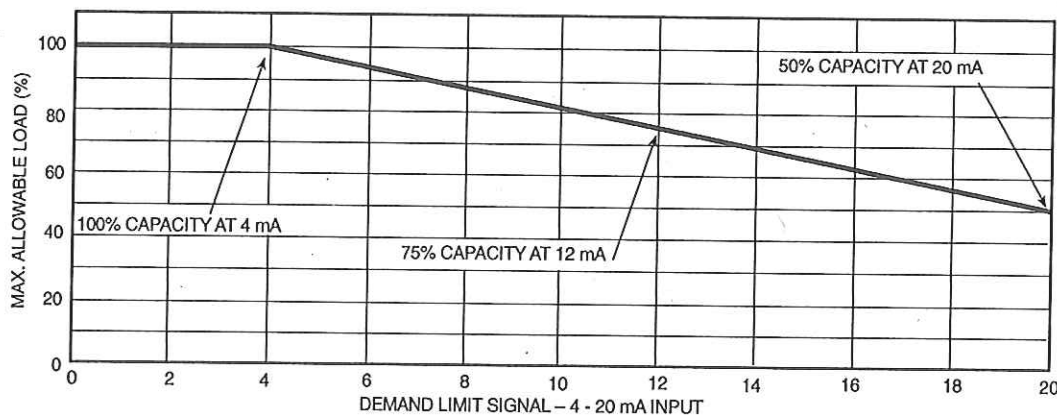


Fig. 18 — 4 to 20 mA Demand Limiting

reduce the current stages by the value entered for Loadshed Demand delta. The Maximum Loadshed Time is the defines the maximum length of time that a loadshed condition is allowed to exist. The control will disable the Redline/Loadshed command if no Cancel command has been received within the configured maximum loadshed time limit.

Cooling Set Point (4 to 20 mA) — Unit operation is based on an external 4 to 20 mA signal input to the Energy Management Module (EMM). The signal is connected to TB6-3,5 (+,-). Figure 19 shows how the 4 to 20 mA signal is linearly calculated on an overall 10 F to 80 F for both Water and Medium Temperature Brine COOLER FLUID configurations. See Table 30 for configuration instructions.

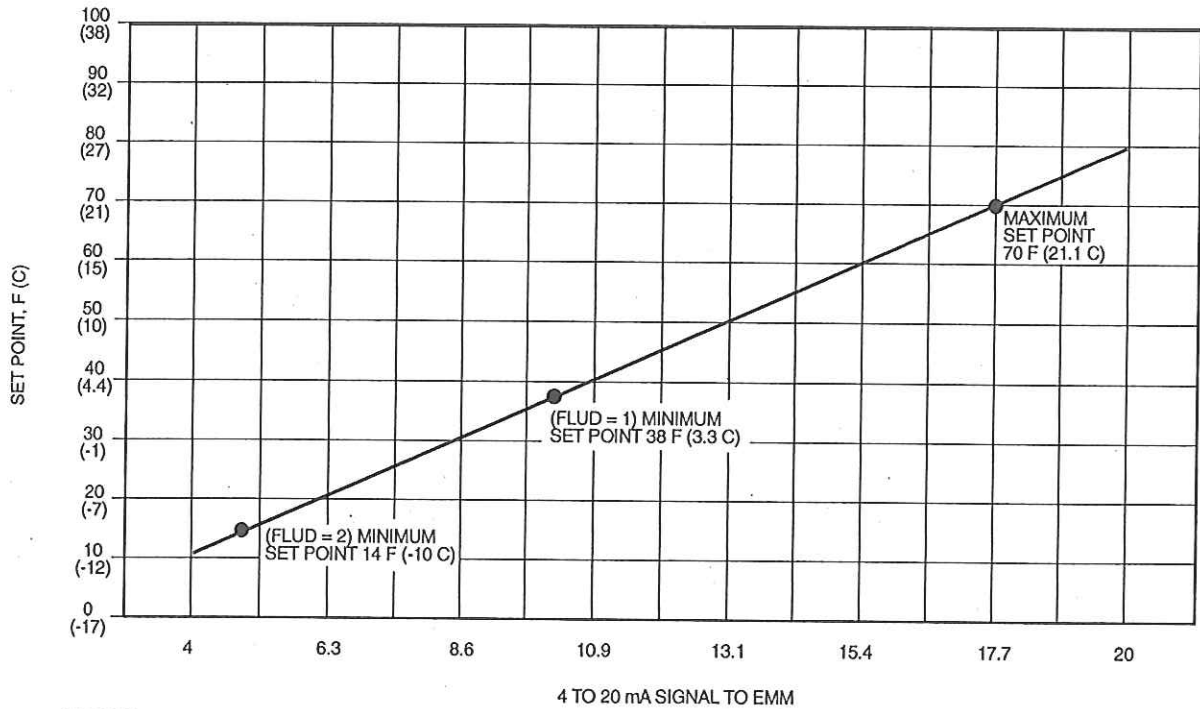

LEGEND

EMM — Energy Management Module

Fig. 19 — Cooling Set Point (4 to 20 mA)

Table 29 — Configuring Demand Limit

MODE	KEYPAD ENTRY	SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
CONFIGURATION	ENTER	DISP	ENTER	TEST	ON/OFF	Test Display LEDs	
	▼	UNIT	ENTER	TYPE	X	Unit Type	
	▼	OPT1	ENTER	FLUD	X	Cooler Fluid	
	▼	OPT2	ENTER	CTRL	X	Control Method	
	▼	RSET	ENTER	CRST	X	Cooling Reset Type	
			▼	CRT1	XXX.X °F	No Cool Reset Temperature	
			▼	CRT2	XXX.X °F	Full Cool Reset Temperature	
			▼	DGRC	XX.X ΔF	Degrees Cool Reset	
			▼	DMDC	X	Demand Limit Select	Default: 0 0 = None 1 = Switch 2 = 4 to 20 mA Input 3 = CCN Loadshed
			▼	DM20	XXX%	Demand Limit at 20 mA	Default: 100% Range: 0 to 100
			▼	SHNM	XXX	Loadshed Group Number	Default: 0 Range: 0 to 99
			▼	SHDL	XXX%	Loadshed Demand Delta	Default: 0% Range: 0 to 60%
			▼	SHTM	XXX MIN	Maximum Loadshed Time	Default: 60 min. Range: 0 to 120 min.
			▼	DLS1	XXX %	Demand Limit Switch 1	Default: 80% Range: 0 to 100%
		▼	DLS2	XXX%	Demand Limit Switch 2	Default: 50% Range: 0 to 100%	

NOTE: Heating reset values skipped in this example.

Table 30 — Menu Configuration of 4 to 20 mA Cooling Set Point Control

MODE (RED LED)	KEYPAD ENTRY	SUB-MODE	KEYPAD ENTRY	ITEM	DISPLAY	ITEM EXPANSION	COMMENT
CONFIGURATION	ENTER	DISP					
	▼	UNIT					
	▼	OPT1					
	▼	OPT2					
	▼	RSET					
	▼	SLCT	ENTER	CLSP	0	COOLING SETPOINT SELECT	
			ENTER		0		Scrolling Stops
			ENTER		0		Flashing '0'
			▲		4		Select '4'
			ENTER		4		Change Accepted

TROUBLESHOOTING

The 30GXN,R and 30HX screw chiller control has many features to aid in troubleshooting. By using the Navigator control, operating conditions of the chiller can be viewed while the chiller is running. The Service Test function allows for testing of all outputs and compressors. Verify that the chiller is properly configured, including options and/or accessories, using the Configuration mode. For checking specific items, refer to the Mode/Sub-Mode directory (Table 11).

Checking Display Codes — To determine how the machine has been programmed to operate, check the diagnostic information displayed in the Status function and the configuration information displayed in the Service function.

Unit Shutoff — To shut the unit off, move the Enable/Off/Remote Contact switch to the Off position. Both circuits will complete a pumpdown cycle and all compressors and solenoids will shut off. For extreme cases, move the Emergency On/Off switch to the Off position. All compressors, solenoids and other outputs will stop immediately.

Complete Unit Stoppage — Complete unit stoppage can be caused by any of the following conditions:

- cooling load satisfied
- remote on/off contacts open
- programmed schedule
- emergency stop command from CCN
- general power failure
- blown fuse in control power feed disconnect
- open control circuit fuse(s)
- Enable/Off/Remote Contact switch moved to Off position
- freeze protection trip
- low flow protection trip
- open contacts in chilled water flow switch
- Open contacts in any auxiliary interlock. Terminals that are jumpered from factory are in series with control switch. Opening the circuit between these terminals places unit in Stop mode, similar to moving the control switch to Off position. Unit cannot start if these contacts are open. If they open while unit is running, the unit stops
- cooler entering or leaving fluid thermistor failure
- low/high transducer supply voltage
- loss of communications between the Main Base Board (MBB) and either the EXV board, SCB board or either CCP module
- low refrigerant pressure
- off-to-on delay is in effect

⚠ CAUTION

If a stoppage occurs more than once as a result of any of the above safety devices, determine and correct the cause before attempting another restart.

Single Circuit Stoppage — Single circuit stoppage can be caused by the following:

- low oil pressure
- open contacts in high pressure switch
- low refrigerant pressure
- thermistor failure
- transducer failure
- alarm condition from CCP module

Stoppage of one circuit by a safety device action does not affect other circuit. When a safety device trips, the circuit is

shut down immediately and EXV closes. Refer to Table 31 for typical stoppage faults and reset types.

⚠ CAUTION

If a stoppage occurs more than once as a result of any of the preceding safety devices, determine and correct the cause before attempting another restart.

Restart Procedure — After the cause for stoppage has been corrected, restart is either automatic or manual, depending on the fault. Manual reset requires that the alarm(s) be reset via the Navigator. Select the RCRN item under the Alarms mode. Press **ENTER**, **▲** and **ENTER** again to reset all current alarms and alerts. A password entry may be required. Some typical fault conditions are described in Table 31. For a complete list of fault conditions, codes and reset type, see Table 32.

POWER FAILURE EXTERNAL TO THE UNIT — Unit restarts automatically when power is restored.

Alarms and Alerts — These are warnings of abnormal or fault conditions and may cause either one circuit or the whole unit to shut down. They are assigned code numbers and a detailed description of each alarm/alert code error including possible causes is shown in Table 32. The alarm descriptions are displayed on the Navigator under the 'CRNT' or 'HIST' sub-modes of the Alarms mode. The Main Base Board also recognizes and reports illegal configurations as shown in Table 32.

When an alarm or alert is activated configurable, the alarm relay output (MBB relay K7, terminals TB5-11,12) is energized. The alarms and alerts indicate failures that cause the unit to shut down, terminate an option (such as reset) or result in the use of a default value such as a set point. Refer to Table 32 for more information.

Up to 50 alarms/alerts can be stored at once. Use Alarm and Alert tables to view and clear alarms. *ComfortLink™* Compressor Protection (CCP) module alarms require an additional step to reset alarms. To clear these alarms, first find and correct the cause of the alarm. Then press and hold the reset button on the CCP board for 5 seconds. This action will reset only the alarmed circuit or compressor, and clear the CCP. Next, reset the alarm(s) using the Navigator as shown in Table 26. For configuration header fault alarms from the CCP module, move the Enable/Off/Remote Contact switch to the Off position. Wait for all compressors to stop. Turn off the unit control power. Correct the configuration header problem and restore unit control power.

Table 31 — Typical Stoppage Faults and Reset Types

STOPPAGE FAULT	RESET TYPE
Loss of Condenser Flow (30HXC)	Manual reset
Cooler Freeze Protection (Chilled Fluid, Low Temperature)	Auto reset first time, manual if repeated in same day
Cooler Pump Interlock	Manual reset
Control Circuit Fuse Blown	Unit restarts automatically when power is restored
High-Pressure Switch Open	Manual reset
Low Sat. Suction Temperature	Manual reset after 1 hour
Low Oil Pressure	Manual reset
Loss of Communications with WSM or CSM Controller	Automatic reset

LEGEND

CSM — Chillervisor™ System Manager
WSM — Water System Manager

Compressor Alarm/Alert Circuit — Each compressor is directly controlled by a CCP module. Compressor faults (T051, T052, T055, T056) are reported as alerts. The specific

fault condition for a compressor alert is included as part of the alert description displayed on the Navigator. Press and simultaneously to display description.

Table 32 — Alarm and Alert Codes

ALARM/ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T026	Alert	Compressor A1 Low Oil Pressure – 1	$P_{O-P_e} < \text{Oil Set Point 1}$. See Note 1 and Fig. 20 on page 49.	Comp A1 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
		Compressor A1 Low Oil Pressure – 2	$P_{O-P_s} < \text{Oil Set Point 2}$. See Note 1 and Fig. 20 on page 49.	Comp A1 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
T027	Alert	Compressor A2 Low Oil Pressure – 1	$P_{O-P_e} < \text{Oil Set Point 1}$. See Note 1 and Fig. 20 on page 49.	Comp A2 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
		Compressor A2 Low Oil Pressure – 2	$P_{O-P_s} < \text{Oil Set Point 2}$. See Note 1 and Fig. 20 on page 49.	Comp A2 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
T028	Alert	Compressor B1 Low Oil Pressure – 1	$P_{O-P_e} < \text{Oil Set Point 1}$. See Note 1 and Fig. 20 on page 49.	Comp B1 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
		Compressor B1 Low Oil Pressure – 2	$P_{O-P_s} < \text{Oil Set Point 2}$. See Note 1 and Fig. 20 on page 49.	Comp B1 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
T029	Alert	Compressor B2 Low Oil Pressure – 1	$P_{O-P_e} < \text{Oil Set Point 1}$. See Note 1 and Fig. 20 on page 49.	Comp B2 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
		Compressor B2 Low Oil Pressure – 2	$P_{O-P_s} < \text{Oil Set Point 2}$. See Note 1 and Fig. 20 on page 49.	Comp B2 shut down	Manual	Low Water Temperature, low refrigerant charge, plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
A030	Alarm	Compressor A1 Pre-Start Oil Pressure	Oil Pump did not build sufficient pressure during pre-lube cycle.	Compressor cannot start.	Manual	Low oil, oil pump failure, oil solenoid failure, oil transducer failure, check valve failed open, oil shutoff valve closed.
A031	Alarm	Compressor A2 Pre-Start Oil Pressure	Oil Pump did not build sufficient pressure during pre-lube cycle.	Compressor cannot start.	Manual	Low oil, oil pump failure, oil solenoid failure, oil transducer failure, check valve failed open, oil shutoff valve closed.
A032	Alarm	Compressor B1 Pre-Start Oil Pressure	Oil Pump did not build sufficient pressure during pre-lube cycle.	Compressor cannot start.	Manual	Low oil, oil pump failure, oil solenoid failure, oil transducer failure, check valve failed open, oil shutoff valve closed.
A033	Alarm	Compressor B2 Pre-Start Oil Pressure	Oil Pump did not build sufficient pressure during pre-lube cycle.	Compressor cannot start.	Manual	Low oil, oil pump failure, oil solenoid failure, oil transducer failure, check valve failed open, oil shutoff valve closed.

Table 32 — Alarm and Alert Codes (cont)

ALARM/ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
A034	Alarm	Comp. A1 Max. Oil Delta P, check oil line	(Discharge press – Oil press) > 100 PSI for more than 5 seconds	Comp. A1 shut down	Manual	Plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
A035	Alarm	Comp. A2 Max. Oil Delta P, check oil line	(Discharge press – Oil press) > 100 PSI for more than 5 seconds	Comp. A2 shut down	Manual	Plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
A036	Alarm	Comp. B1 Max. Oil Delta P, check oil line	(Discharge press – Oil press) > 100 PSI for more than 5 seconds	Comp. B1 shut down	Manual	Plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
A037	Alarm	Comp. B2 Max. Oil Delta P, check oil line	(Discharge press – Oil press) > 100 PSI for more than 5 seconds	Comp. B2 shut down	Manual	Plugged oil filter, closed oil valve, bad oil solenoid, compressor oil check valve stuck, oil line check valve stuck, plugged oil strainer
A038	Alarm	Comp. A1 Failed Oil Solenoid	Diff. Oil Pressure > 2.5 PSI during period after oil pump starts and before oil solenoid opens	Comp. A1 not allowed to start	Manual	Faulty oil solenoid valve
A039	Alarm	Comp. A2 Failed Oil Solenoid	Diff. Oil Pressure > 2.5 PSI during period after oil pump starts and before oil solenoid opens	Comp. A2 not allowed to start	Manual	Faulty oil solenoid valve
A040	Alarm	Comp. B1 Failed Oil Solenoid	Diff. Oil Pressure > 2.5 PSI during period after oil pump starts and before oil solenoid opens	Comp. B1 not allowed to start	Manual	Faulty oil solenoid valve
A041	Alarm	Comp. B2 Failed Oil Solenoid	Diff. Oil Pressure > 2.5 PSI during period after oil pump starts and before oil solenoid opens	Comp. B2 not allowed to start	Manual	Faulty oil solenoid valve

Table 32 — Alarm and Alert Codes (cont)

ALARM/ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T051	Alert	Compressor A1 Failure – (See below)	See additional descriptions below.			
T052	Alert	Compressor A2 Failure – (See below)				
T055	Alert	Compressor B1 Failure – (See below)				
T056	Alert	Compressor B2 Failure – (See below)				
		High Pressure Switch Trip	HPS input to CCP module open	Comp. shut down	Manual	Loss of condenser air/water flow. Operation beyond chiller capability. Liquid valve not open.
		No Motor Current	CCP reads less than 10% of MTA on all legs for >3.0 seconds	Comp. shut down	Manual	Power supply disconnected, blown fuse(s), wiring error, contactor not energized, faulty current toroid, check toroid wiring.
		Current Unbalance	CCP measures current imbalance between phases must be above C.UNB for 25 minutes	Circuit shut down	Manual	Loose terminals on power wires. Alert will be generated if measured imbalance exceeds set point.
		Single Phase Current Loss	CCP measures current imbalance between phases greater than 50% (running current <50% of MTA) or 30% (running current ≥ 50% of MTA) for 1 second.	Circuit shut down	Manual	Blown fuse, wiring error, loose terminals
		High Motor Current	CCP detects high current compared to MTA setting	Comp. shut down	Manual	Operation beyond chiller capability, improperly punched configuration header, blown fuse
		Ground Fault Trip	CCP detects ground current (4.0 ± 2.0 amps)	Comp. shut down	Manual	Motor winding(s) gone to ground, wiring error, loose plug connector.
		Contactors Failure	CCP detects min. 10% of MTA for 10 seconds after shutting off compressor contactor. Oil solenoid is energized.	All remaining compressors shut down. All loaders deenergized. Min. load valve of affected circuit energized (if equipped)	Manual	Faulty contactor, contactor welded, wiring error.
		Current Phase Reversal	CCP detects phase reversal from toroid reading or from incoming power supply.	Circuit shut down	Manual	Terminal block power supply leads not in correct phase. Toroid wire harness crossed. Check compressor contactor.
		Motor Over Temperature	CCP detects motor winding temperature >245 F	Comp. shut down	Manual	Motor cooling (all) or Economizer (2 comp. circuits) solenoid failure, low refrigerant charge. Faulty economizer TXV or poor bulb connection to motor cooling line.
		Open Thermistor	CCP detects open circuit in motor temp thermistor	Comp. shut down	Manual	Wiring error or faulty thermistor*
		MTA Header Fault	CCP finds error with MTA value punched out in header.	Comp. shut down	Manual	Header pins on CCP board either all or none punched out, header not fully seated in CCP board.
		MTA Value Error	MTA value stored in MBB does not agree with MTA header value from CCP.	Comp. not allowed to start	Manual	Header pin(s) on CCP board not punched out correctly. See Appendix A. Incorrect size or voltage entered when MBB was downloaded.
		Shorted Thermistor	CCP detects short circuit in motor temp thermistor	Comp. shut down	Manual	Wiring error or faulty thermistor*
A060	Alarm	Cooler Leaving Fluid Thermistor Failure – 1	Thermistor outside range of –40 to 240° F (–40 to 116° C)	Chiller shut down	Automatic	Thermistor failure, damaged cable/wire or wiring error.
		Cooler Leaving Fluid Thermistor Failure – 2	LWT > EWT + 5° F for 15 minutes	Chiller shut down	Manual	Thermistor failure, damaged cable/wire, wiring error or water piping error.
A061	Alarm	Cooler Entering Fluid Thermistor Failure	Thermistor outside range of –40 to 240° F (–40 to 116° C)	Uses 0.1x F/% Total Capacity as rise/ton	Automatic	Thermistor failure, damaged cable/wire or wiring error.
T062	Alert	Condenser Leaving Fluid Thermistor Failure	Thermistor outside range of –40 to 240° F (–40 to 116° C)	None. Chiller continues to run.	Automatic	Thermistor failure, damaged cable/wire or wiring error.
T063	Alert	Condenser Entering Fluid Thermistor Failure	Thermistor outside range of –40 to 240° F (–40 to 116° C)	None. Chiller continues to run.	Automatic	Thermistor failure, damaged cable/wire or wiring error.
T070	Alert	Cir. A Discharge Gas Thermistor Failure	Average of compressor A1 and A2 (if installed) sensors > 210° F for 30 seconds.	Circuit A shut down	Manual	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.

Table 32 — Alarm and Alert Codes (cont)

ALARM/ ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T071	Alert	Cir. B Discharge Gas Thermistor Failure	Average of compressor B1 and B2 (if installed) sensors > 210° F for 30 seconds.	Circuit B shut down	Manual	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.
T073	Alert	Outside Air Temperature Thermistor Failure	Thermistor outside range of -40 to 240 F (-40 to 116 C)	Reset disabled. Runs under normal control/set points.	Automatic	Thermistor failure, damaged cable/wire, wiring error or sensor not installed.
T074	Alert	Space Temperature Thermistor Failure	Thermistor outside range of -40 to 240 F (-40 to 116 C)	Reset disabled. Runs under normal control/set points.	Automatic	Thermistor failure, damaged cable/wire, wiring error or sensor not installed.
T075	Alert	Compressor A1 Discharge Gas Thermistor Failure	Thermistor outside range of -40 to 240° F (-40 to 116° C)	Comp A1 shut down	Automatic	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.
T076	Alert	Compressor A2 Discharge Gas Thermistor Failure	Thermistor outside range of -40 to 240° F (-40 to 116° C)	Comp A2 shut down	Automatic	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.
T077	Alert	Compressor B1 Discharge Gas Thermistor Failure	Thermistor outside range of -40 to 240° F (-40 to 116° C)	Comp B1 shut down	Automatic	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.
T078	Alert	Compressor B2 Discharge Gas Thermistor Failure	Thermistor outside range of -40 to 240° F (-40 to 116° C)	Comp B2 shut down	Automatic	Thermistor failure, damaged cable/wire, wiring error or motor cooling solenoid failure.
T079	Alert	Lead/Lag Leaving Fluid Temperature Thermistor Failure	Thermistor outside range of -40 to 240 F (-40 to 116 C)	Breaks Dual Chiller link if set up for Parallel operation.	Automatic	Thermistor failure, damaged cable/wire, wiring error or sensor not installed.
T090	Alert	Circuit A Discharge Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Circuit A shut down	Automatic	Transducer failure, poor connection to MBB, or wiring damage/error.
T091	Alert	Circuit B Discharge Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Circuit B shut down	Automatic	Transducer failure, poor connection to MBB, or wiring damage/error.
T092	Alert	Circuit A Suction Pressure Transducer Failure	Voltage ratio more than 99.9% or less than 0.5% for 50 seconds.	Circuit A shut down	Automatic	Transducer failure, poor connection to MBB, or wiring damage/error.
T093	Alert	Circuit B Suction Pressure Transducer Failure	Voltage ratio more than 99.9% or less than 0.5% for 50 seconds.	Circuit B shut down	Automatic	Transducer failure, poor connection to MBB, or wiring damage/error.
T094	Alert	Comp A1 Oil Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Comp A1 shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T095	Alert	Comp A2 Oil Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Comp A2 shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T096	Alert	Comp B1 Oil Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Comp B1 shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T097	Alert	Comp B2 Oil Pressure Transducer Failure	Voltage ratio more than 98.9% or less than 6%.	Comp B2 shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T098	Alert	Circuit A Economizer Pressure Transducer Failure - 1	Voltage ratio more than 99.9% or less than 0.5% for 50 seconds.	Circuit A shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T099	Alert	Circuit A Economizer Pressure Transducer Failure - 2	Economizer pressure is more than 12 psi (83 kPa) less than suction pressure.	Circuit A shut down	Manual	Suction and Economizer pressure connectors/wiring are swapped.
	Alert	Circuit B Economizer Pressure Transducer Failure - 1	Voltage ratio more than 99.9% or less than 0.5% for 50 seconds.	Circuit B shut down	Automatic	Transducer failure, poor connection to SCB, or wiring damage/error.
T110	Alert	Circuit A Loss of Charge	Discharge pressure reading < 10 psig for 30 seconds.	Circuit A shut down	Manual	Refrigerant leak or transducer failure.
	Alert	Circuit B Loss of Charge	Discharge pressure reading < 10 psig for 30 seconds.	Circuit B shut down	Manual	Refrigerant leak or transducer failure.

Table 32 — Alarm and Alert Codes (cont)

ALARM/ ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T120	Alert	Circuit A Low Saturated Suction Temperature	SST reads 6° F (3.3° C) or more below the brine freeze point for 3 minutes or 28° F below brine freeze point for 2 minutes.	Circuit A shut down	Manual†	Low refrigerant charge, plugged strainer, faulty expansion valve, or low water flow.
T121	Alert	Circuit B Low Saturated Suction Temperature	SST reads 6° F (3.3° C) or more below the brine freeze point for 3 minutes or 28° F below brine freeze point for 2 minutes.	Circuit B shut down	Manual†	Low refrigerant charge, plugged strainer, faulty expansion valve, or low water flow.
T122	Alert	Circuit A High Saturated Suction Temperature	After first 90 seconds, SST > 55 F (12.8 C) and EXV < 1% for 5 minutes.	Circuit A shut down	Manual	Faulty expansion valve or transducer.
T123	Alert	Circuit B High Saturated Suction Temperature	After first 90 seconds, SST > 55 F (12.8 C) and EXV < 1% for 5 minutes.	Circuit B shut down	Manual	Faulty expansion valve or transducer.
T124	Alert	Circuit A Low Oil Level/Flow	Level switch input open.	Circuit A shut down after 4th failure in 18 hours.	Manual	Low oil level, failed switch, wiring error, failed control module.
T125	Alert	Circuit B Low Oil Level/Flow	Level switch input open.	Circuit B shut down after 4th failure in 18 hours.	Manual	Low oil level, failed switch, wiring error, failed control module.
T126	Alert	Circuit A High Discharge Pressure	SCT > MCT_SP + 5° F (2.8° C)	Circuit A shut down.	Automatic**	Faulty transducer/high pressure switch, low/restricted condenser air/water flow††
T127	Alert	Circuit B High Discharge Pressure	SCT > MCT_SP + 5° F (2.8° C)	Circuit B shut down.	Automatic**	Faulty transducer/high pressure switch, low/restricted condenser air/water flow††
A128	Alarm	Circuit A Condenser Freeze Protection (alarm ignored for brine chillers)	For water cooled chillers only, if SCT < 34 F (1.1° C)	Chiller shut down. Turns condenser pump On if Chiller is Off.	Automatic	Failed/bad discharge pressure transducer, refrigerant leak, configured for water-cooled condenser.
A129	Alarm	Circuit B Condenser Freeze Protection (alarm ignored for brine chillers)	For water cooled chillers only, if SCT < 34 F (1.1° C)	Chiller shut down. Turns condenser pump On if Chiller is Off.	Automatic	Failed/bad discharge pressure transducer, refrigerant leak, configured for water-cooled condenser.
T135	Alert	Circuit A Failure to Pump Out	With EXV closed, SST did not drop 10° F (5.6° C) in 6 minutes, or SST is not 6° F (3.3° C) less than Brine Freeze, or SST is not less than 10 F (-12 C).	None	Manual	Faulty transducer or EXV.
T136	Alert	Circuit B Failure to Pump Out	With EXV closed, SST did not drop 10° F (5.6° C) in 6 minutes, or SST is not 6° F (3.3° C) less than Brine Freeze, or SST is not less than 10 F (-12 C).	None	Manual	Faulty transducer or EXV
T137	Alert	Circuit A Low Discharge Superheat	Superheat < 5° F (2.8° C) for 10 minutes.	Circuit A shut down	Manual	Faulty thermistor, transducer, EXV, or Economizer TXV. Motor cooling solenoid stuck open.
T138	Alert	Circuit B Low Discharge Superheat	Superheat < 5° F (2.8° C) for 10 minutes.	Circuit B shut down	Manual	Faulty thermistor, transducer, EXV, or Economizer TXV. Motor cooling solenoid stuck open.
T140	Alert	Compressor A1 – High Oil Filter Pressure Drop	Oil filter pressure drop (FD.A1) exceeds 25 psig (172 kPa) for water-cooled units or 30 psig (207 kPa) for air-cooled and split system units.	None	Manual	Filter change needed to prevent machine from shutting down.
T141	Alert	Compressor A2 – High Oil Filter Pressure Drop	Oil filter pressure drop (FD.A2) exceeds 25 psig (172 kPa) for water-cooled units or 30 psig (207 kPa) for air-cooled and split system units.	None	Manual	Filter change needed to prevent machine from shutting down.

Table 32 — Alarm and Alert Codes (cont)

ALARM/ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T142	Alert	Compressor B1 – High Oil Filter Pressure Drop	Oil filter pressure drop (FD.B1) exceeds 25 psig (172 kPa) for water-cooled units or 30 psig (207 kPa) for air-cooled and split system units.	None	Manual	Filter change needed to prevent machine from shutting down.
T143	Alert	Compressor B2 – High Oil Filter Pressure Drop	Oil filter pressure drop (FD.B2) exceeds 25 psig (172 kPa) for water-cooled units or 30 psig (207 kPa) for air-cooled and split system units.	None	Manual	Filter change needed to prevent machine from shutting down.
A150	Alarm	Unit is in Emergency Stop	CCN command received to shut unit down	Chiller shut down	CCN/ Automatic	Network command
A151	Alarm	Illegal Configuration-x	Illegal Configuration has been entered. Correction needed.	Chiller cannot start.	Manual	Configuration error. See Table 33.
A152	Alarm	Circuit A&B Off for Alerts. Unit down.	Control has shut down both circuits due to alerts.	None	Automatic	Check individual alarms.
T153	Alert	Real Time Clock Hardware Failure	Time not advancing on board,	Defaults to occupied	Automatic	Time clock not initialized or board fail
A154	Alarm	Serial EEPROM Hardware Failure	Internal failure of the EEPROM.	Machine shuts down	Manual	Replace Main Base Board.
A155	Alarm	Serial EEPROM Storage Failure Error	Internal diagnostic has found an error on critical data.	Machine shuts down	Manual	Re-download the software of consider replacement of the Main Base Board.
A156	Alarm	Critical Serial EEPROM Storage Failure Error	Internal diagnostic has found an error on critical data.	Machine shuts down	Manual	Replace Main Base Board.
A157	Alarm	A/D Hardware Failure	A/D converter on the MBB has failed.	Machine shuts down	Manual	Replace Main Base Board.
A159	Alarm	Loss of Condenser Flow	Flow switch not closed within 1 minute after pump is started or if flow switch opens during normal operation for > 10 sec.	Chiller shut down.	Manual	Low condenser water flow, failed condenser pump.
A172	Alarm	Loss of Communication with EXV Module	MBB has lost communication with the EXV Module	Chiller shut down.	Automatic	Failed EXV Module, wiring error, loose connections, failed transformer, wrong address.
T173	Alert	Loss of Communication with Energy Management Module	MBB has lost communication with the Energy Management Module when this option is installed.	EMM options are disabled.	Automatic	Failed EMM, wiring error, loose connections, failed transformer, wrong address, wrong configuration.
T174	Alert	4-20 mA Cool Setpoint Input Failure	If configured and input signal to EMM less than 2 mA or greater than 22 mA.	Function disabled. Normal set point used.	Automatic	Faulty signal generator, wiring error, loss of signal
T175	Alert	4-20 mA Heat Setpoint Input Failure	If configured and input signal to EMM less than 2 mA or greater than 22 mA.	Function disabled. Normal set point used.	Automatic	Faulty signal generator, wiring error, loss of signal
T176	Alert	4-20 mA Reset Input Out of Range	If configured and input signal to EMM less than 2 mA or greater than 22 mA.	Reset function disabled. Normal set point used.	Automatic	Faulty signal generator, wiring error loss of signal
T177	Alert	4-20 mA Demand Limit Input Out of Range	If configured and input signal to EMM less than 2 mA or greater than 22 mA.	Reset function disabled. Normal set point used.	Automatic	Faulty signal generator, wiring error, loss of signal
A178	Alarm	Loss of Communication with Screw Chiller Module	MBB has lost communication with the Screw Chiller Module	Chiller shut down.	Automatic	Failed SCB Module, wiring error, loose connections, failed transformer, wrong address.
A180	Alarm	Loss of Communication with Compressor Protection Module 1	MBB has lost communication with the Compressor Protection Module 1	Chiller shut down.	Automatic	Failed CCP Module, wiring error, loose connections, failed transformer, wrong address.
A181	Alarm	Loss of Communication with Compressor Protection Module 2	MBB has lost communication with the Compressor Protection Module 2	Chiller shut down.	Automatic	Failed CCP Module, wiring error, loose connections, failed transformer, wrong address.

Table 32 — Alarm and Alert Codes (cont)

ALARM/ALERT CODE	ALARM OR ALERT	DESCRIPTION	WHY WAS THIS ALARM GENERATED?	ACTION TAKEN BY CONTROL	RESET METHOD	PROBABLE CAUSE
T182	Alert	Compressor Protection Module 1 Internal Diagnostic	The <i>ComfortLink™</i> Compressor Protection Module has generated an internal diagnostic alert.	Affected compressors are shut down.	Manual on CCP and MBB	Eliminate EMI sources around the module, consider replacement of the CCP module if alerts continue.
T183	Alert	Compressor Protection Module 2 Internal Diagnostic	The <i>ComfortLink</i> Compressor Protection Module has generated an internal diagnostic alert.	Affected compressors are shut down.	Manual on CCP and MBB	Eliminate EMI sources around the module, consider replacement of the CCP module if alerts continue.
T184	Alarm	Compressor Protection Module 1	CCP has experienced too many power cycles***	Chiller shut down	Manual	Loose connections, frequent power interruptions.
T185	Alarm	Compressor Protection Module 2	CCP has experienced too many power cycles***	Chiller shut down	Manual	Loose connections, frequent power interruptions.
A200	Alarm	Cooler Pump Interlock Failed at Start-Up	Interlock did not close within 5 minutes after chiller was enabled	Chiller shut down. Pump turned off.	Manual	Failure of cooler pump, cooler pump interlock, or flow switch
A201	Alarm	Cooler Pump Interlock Opened Unexpectedly	Interlock opened for at least 10 seconds during operation and does not close within 5 min.	Chiller shut down. Pump turned off.	Manual	Failure of cooler pump, cooler pump interlock, or flow switch
A202	Alarm	Cooler Pump Interlock Closed When Pump OFF	Interlock closed when pump relay is off	Cooler pump remains off. Unit prevented from starting.	Manual	Failure of cooler pump relay or interlock, welded contacts. Cooler pump enabled but not controlling pump
T203	Alert	Loss of Communication with the Slave Chiller	The master chiller (when configured) has lost communication with the slave chiller for 3 minutes.	Master chiller runs as a stand-alone chiller.	Automatic	Failed Slave MBB Module, wiring error, loose connections, wrong address, loss of control power on slave chiller.
T204	Alert	Loss of Communication with the Master Chiller	The slave chiller (when configured) has lost communication with the master chiller for 3 minutes.	Slave chiller runs as a stand-alone chiller.	Automatic	Failed Master MBB Module, wiring error, loose connections, wrong address, loss of control power on master chiller.
T205	Alert	Master and Slave Chiller with Same Address	The master chiller (when configured) has determined that its address is the same as the slave address.	Dual chiller control disabled.	Automatic	Master and Slave chiller must have different addresses.
T206	Alert	High Leaving Chilled Water Temperature	LCW read > LCW Delta Alarm limit and total capacity is 100% and current LCW > LCW reading 1 minute ago	None.	Automatic	Building load greater than unit capacity, low water/brine flow, or compressor fault. Check for other alarms or alerts.
A207	Alarm	Cooler Freeze Protection	Cooler EWT or LWT less than freeze point. Freeze point is the brine freeze setpoint +2 F (1.1 C).	Chiller shut down. Leave Cooler pump on. Turn Cooler pump on if Chiller is off.	Automatic	Faulty thermistor, low water flow
T210	Alert	Winterization Required	SCT < 32 F in either circuit	None	Manual	Winterization must be performed to avoid cooler freeze-up. After winterization has been completed, configure W.DNE Winterization Performed (Configuration Mode, Sub-mode SERV) to YES to reset alert.
T950	Alert	Loss of Communication with WSM	No communications have been received by the MBB within 5 minutes of transmission.	WSM forces removed. Runs under own control.	Automatic	Failed module, wiring error, failed transformer, loose connection plug, wrong address
A951	Alarm	Loss of Communication with Chillervisor System Manager (CSM)	No communications have been received by the MBB within 5 minutes of last transmission.	CSM forces removed. Runs under own control.	Automatic	Wiring faulty or module failure
T998	Alert	Loss of Refrigerant Flow in Circuit A.	Between 40 and 90 seconds of runtime, SST is less than 0° F (-18 C) and the rate of change is negative (in 5 second increments).	Circuit A compressor is shut down.	Manual	Refrigerant restriction such as closed suction service valve, closed liquid line service valve, faulty liquid line solenoid valve, faulty EXV/Economizer operation, plugged refrigerant strainer, closed discharge line valve.
T999	Alert	Loss of Refrigerant Flow in Circuit B.	Between 40 and 90 seconds of runtime, if SST is less than 0° F (-18 C) and the rate of change is negative (in 5 second increments).	Circuit B compressor is shut down.	Manual	Refrigerant restriction such as closed suction service valve, closed liquid line service valve, faulty liquid line solenoid valve, faulty EXV/Economizer operation, plugged refrigerant strainer, closed discharge line valve.

LEGEND AND NOTES FOR TABLE

LEGEND

A/D	— Analog to Digital Converter
CCN	— Carrier Comfort Network
CCP	— <i>ComfortLink™</i> Compressor Protection
EMI	— Electromagnetic Interference
EMM	— Energy Management Module
EWT	— Entering Water Temperature
EXV	— Electronic Expansion Valve
HPS	— High-Pressure Switch
LCW	— Leaving Chilled Water
LWT	— Leaving Water Temperature
MBB	— Main Base Board
MCT_SP	— Maximum Condensing Temperature Set Point
MTA	— Compressor Must Trip Amps
SCB	— Screw Compressor Board
SCT	— Saturated Condensing Temperature
SST	— Saturated Suction Temperature
TXV	— Thermostatic Expansion Valve
WSM	— Water-System Manager

*Compressors are equipped with 2 motor winding temperature thermistors. Verify first that the problem is not a wiring error before using backup thermistor.

†Manual reset after 1 hour from occurrence.

**Reset automatic first time, manual if repeated on the same date.

††Note that the high-pressure switch should trip before this alert is generated. Check HPS operation if this alert is generated.

***Maximum 5 power losses at CCP in one hour.

NOTES:

1. Low Oil Pressure Alert Criteria and Set Points
Where: P_d = Discharge Pressure, P_s = Suction Pressure.
 P_o = Oil Pressure and P_e = Economizer Pressure
Two oil set points are used by the control for the Low Oil Pressure alert trip.

Oil Set Point 1 is defined as:

- a. If $P_s < 35$, then Oil Set Point 1 = 10 psig.
- b. If $P_s > 35$ and < 51 , then Oil Set Point 1 = 12.5 psig.
- c. If $P_s \geq 51$, then Oil Set Point 1 = 15 psig.

Oil Set Point 2 (see Fig. 20) is defined as:

- a. If $(P_d - P_s) < 125$, then Oil Set Point 2 = $0.235 \times (P_d - P_s) + 0.588$
 - b. If $(P_d - P_s) > 125$ and < 165 , then Oil Set Point 2 = $2.0 \times (P_d - P_s) - 220.0$
 - c. If $(P_d - P_s) \geq 165$ then Oil Set Point 2 = $0.6364 \times (P_d - P_s) + 5.0$
2. $(P_o - P_e)$ is the Oil pressure differential displayed as items DO.A1 and DO.A2 (Pressures mode under sub-mode PRC.A) for Circuit A and DO.B1 and DO.B2 (Pressures mode under sub-mode PRC.B) for Circuit B.
3. Alert criteria is based on operating time.
- a. On time less than 5 seconds oil pressure is ignored.
 - b. On time between 5 and 120 seconds, the alert will be generated if the following condition is true for 3 consecutive readings:
 $(P_o - P_e) < [15 \text{ psig}/120 \text{ sec.}] \times [\text{Compressor Run Time in sec.}]$
 - c. On time greater than 120 seconds the alarm will be generated if one of the following conditions is true:
 $(P_o - P_e) < \text{Oil Set Point 1 for 15 seconds.}$
 $(P_o - P_s) < \text{Oil Set Point 2 for 15 seconds.}$

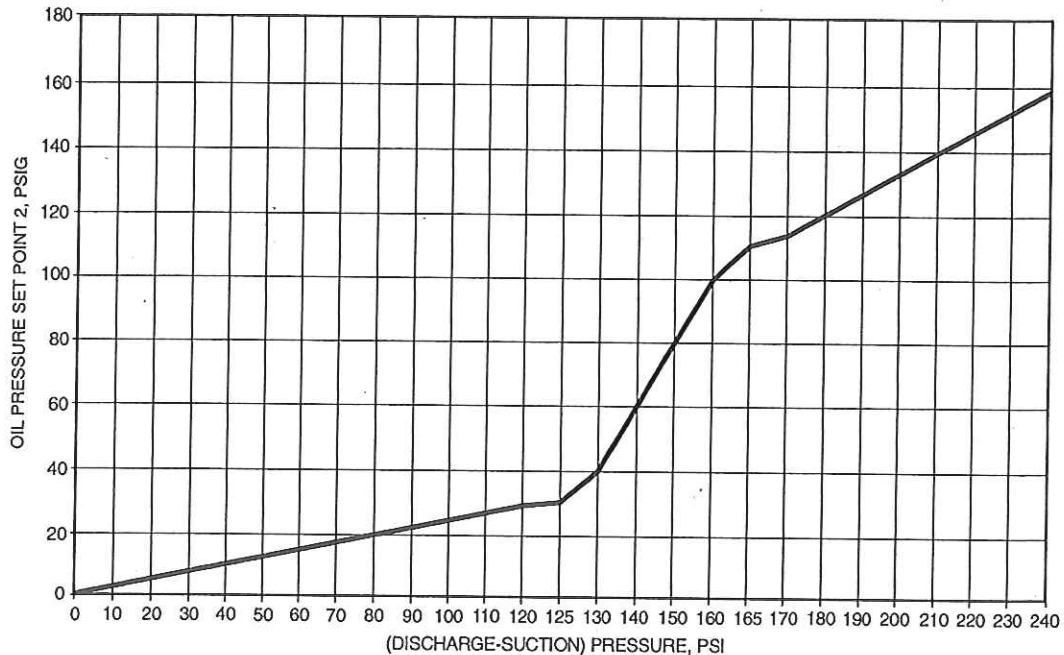


Fig. 20 — Oil Pressure Set Point 2 Calculation

Table 33 — Illegal Configurations (Alarm A151)

CODE NUMBER	ILLEGAL CONFIGURATION DESCRIPTION
1	Unit type outside range of 1-5
2	Number of compressors in Circuit A outside range of 1-2
3	Number of compressors in Circuit B outside range of 1-2
4	Invalid FAN.S or HPCT Selection
5	Air-cooled chiller with Low Temperature Brine fluid (FLUD = Low Brine)
6	Water-cooled chiller configured for air-cooled head pressure control type (HPCT)
7	Air-cooled chiller with condenser pump control enabled
8	Air-cooled chiller with condenser fluid sensors enabled

EXV Troubleshooting Procedure — Follow steps below to diagnose and correct EXV/Economizer problems.

Check EXV motor operation first. Switch the Enable/Off/Remote (EOR) Contact switch to the Off position. Press **ESCAPE** on the Navigator until 'Select a menu item' appears on the display. Use the arrow keys to select the Service Test mode. Press **ENTER**. The display will be:

```
> TEST    OFF
      OUTS
      COMP
```

Press **ENTER** (password entry may be required) and use **▲** to change 'OFF' to 'ON'. Switch the EOR switch to Enable. The Service Test mode is now enabled. Move the pointer down to the OUTS sub-mode and press **ENTER**. Move the pointer to item EXV.A or EXV.B as needed. Press **ENTER** and the valve position will flash. Use **▲** to select 100% valve position (hold **▲** for quick movement) and press **ENTER**.

You should be able to feel the actuator moving by placing your hand on the EXV. A sight glass is located on the valve body to verify that the sleeve is moving to expose/cover slots in the orifice. A hard knocking should be felt from the actuator when it reaches the top of its stroke (can be heard if surroundings are relatively quiet). Press **ENTER** again twice if necessary to confirm this. To close the valve, press **ENTER**, select 0% with **▼** and press **ENTER**. The actuator should knock when it reaches the bottom of its stroke. If it is believed that the valve is not working properly, continue with the checkout procedure below:

Check the EXV output signals at appropriate terminals on the EXV module (see Fig. 21). Connect positive test lead to red wire (EXV-J6 terminal 3 for Circuit A, EXV-J7 terminal 3 for Circuit B). Set meter to approximately 20 vdc. Using the Service Test procedure above, move the valve output under test to 100%. DO NOT short meter leads together or pin 3 to any other pin as board damage will occur. During the next several seconds, carefully connect the negative test lead to pins 1,2,4 and 5 in succession (plug J6 for Circuit A, plug J7 for Circuit B). Digital voltmeters will average this signal and display approximately 6 vdc. If it remains constant at a voltage other than 6 VDC or shows 0 volts, remove the connector to the valve and recheck.

The EXV motor moves at 300 steps per second. Commanding the valve to either 0% or 100% will add 7500 steps to the move. For example, if the EXV is fully closed, selecting 100% would allow 75 seconds for the dc voltage to be checked ($15,000/300 + 7500/300$).

Press **ENTER** and select 0% to close the valve. Check the 4 position DIP switch on the board (all switches should be set to On). If a problem still exists, replace the EXV module. If the reading is correct, the expansion valve and EXV wiring should be checked. Check the EXV terminal strip and interconnecting wiring.

1. Check color coding and wire connections. Make sure they are connected to the correct terminals at the EXV driver and EXV plug and that the cables are not crossed.
2. Check for continuity and tight connection at all pin terminals.

Check the resistance of the EXV motor windings. Remove the EXV module plug (J6 for Circuit A, J7 for Circuit B) and check the resistance of the two windings between pins 1 and 2 for one winding and pins 4 and 5 for the other winding (see Fig. 21). The resistance should be 75 ohms \pm 7.5 ohms.

INSPECTING/OPENING ELECTRONIC EXPANSION VALVES

IMPORTANT: Obtain replacement O-ring before opening EXV. Do not reuse O-rings.

To check the physical operation of an EXV, the following steps must be performed.

1. Close the liquid line service valve of the circuit to be checked. Put the Enable/Off/Remote Contact switch in the Off position. Using the Navigator, enter the Service Test mode and change the sub-mode TEST from 'OFF' to 'ON'. Switch the EOR switch to the Enable position. Under the COMP sub-mode, enable the desired compressor (CC.xx) for the circuit. Let compressor run until gage on suction pressure port reads 10 psig. Press **ENTER**, **▼** and **ENTER** to turn the compressor off. The compressor will complete its pumpout routine and turn off. Immediately after the compressor shuts off, close the discharge valve.
2. Remove any remaining refrigerant from the system low side using proper reclaiming techniques. Drain oil from cooler using Schrader port in cooler inlet line. Turn off the line voltage power supply to the compressors and control circuit power.
3. The expansion valve motor is hermetically sealed inside the top portion of the valve. Carefully unscrew the large retaining nut securing the motor portion to the body of the valve making sure the EXV plug is still connected. The EXV lead screw and sleeve will come off with the motor portion of the device.
4. Enter the appropriate EXV test step under the OUTS sub-mode in the Service Test mode. Locate the desired item 'EXV.A' or 'EXV.B'. Press **ENTER** to make the valve position of 0% flash. Press and hold **▲** until 100% is displayed and press **ENTER**. Observe the operation of the lead screw and sleeve. The motor should be turning the lead screw and sleeve counterclockwise, raising the sleeve closer to the motor. Lead screw movement should be smooth and uniform from fully closed to fully open position. Press **ENTER**, use **▼** to select 0% and press **ENTER** again to check open to closed operation. If the valve is properly connected to the processor and receiving correct signals, yet does not operate as described above, the sealed motor portion of the valve should be replaced.

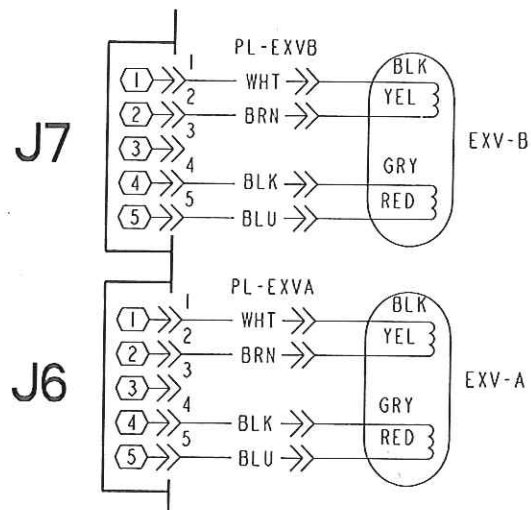


Fig. 21 — EXV Cable Connections to EXV Module

BRAZED-PLATE ECONOMIZERS — Brazed-plate economizers are factory-installed in each circuit on 30GXN,R108, 118-350 and 30HXA,C161-271 models. A TXV is included to meter the flow of refrigerant to the economizer port of the compressor. Flow through the TXV is enabled only when the circuit is fully loaded for 30GXN,R models. The TXV bulb is secured to the side of the economizer outlet tube. See Fig. 22 for typical piping arrangement.

Brazed-plate heat exchangers cannot be repaired if they develop a leak. If a refrigerant leak is detected, the heat exchanger **must be** replaced. To replace a brazed-plate heat exchanger the following steps must be performed:

1. Using proper techniques, move the refrigerant remaining in the circuit to the high side and close the discharge and liquid line ball valves. Reclaim any refrigerant remaining in the low side.
2. Un-solder the refrigerant-in and refrigerant-out connections.
3. Remove the four 8mm (1/4-20 on 30HX units) nuts holding the heat exchanger to the brackets. Save the nuts and hardware.
4. Check that the replacement heat exchanger is the same as the original heat exchanger.
5. Insulate the new heat exchanger to match the original and attach to the mounting brackets with the hardware removed in Step 3.
6. *Carefully* braze the refrigerant lines to the connections on the heat exchanger. Lines should be soldered using silver as the soldering material with a minimum of 45% silver. Keep the temperature below 1472 F (800 C) under normal soldering conditions (no vacuum) to prevent the copper solder of the brazed plate heat exchanger from changing its structure. Failure to do so can result in internal or external leakage at the connections which cannot be repaired.
7. Braze equalizer line in place if removed. Attach economizer and motor cooling solenoid coils to their bodies if removed.
8. Dehydrate and recharge the circuit. Check for leaks.

NOTE: The brazed-plate heat economizers are not serviceable.

If operating problems persist after economizer replacement, they may be due to a bad liquid level sensor, suction pressure transducer, discharge gas thermistor or intermittent connections between the processor board terminals and EXV plug. Recheck all wiring connections and voltage signals.

Other possible causes of improper refrigerant flow control could be restrictions in the liquid line. Check for plugged strainer(s) or restricted metering slots in the EXV (see Fig. 23). Formation of ice or frost on lower body of electronic expansion valve is one symptom of restricted metering slots. However, frost or ice formation is normally expected when leaving fluid temperature from the cooler is below 40 F (4.4 C). Clean or replace valve if necessary.

NOTE (non-economized units only): Frosting of valve is normal during compressor test steps and at initial start-up. Frost should dissipate after 5 to 10 minutes operation in a system that is operating properly. If valve is to be replaced, wrap valve with a wet cloth to prevent excessive heat from damaging internal components.


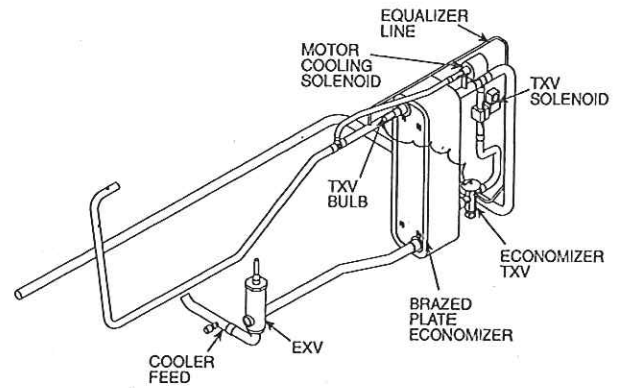


Fig. 22 — Brazed-Plate Economizer

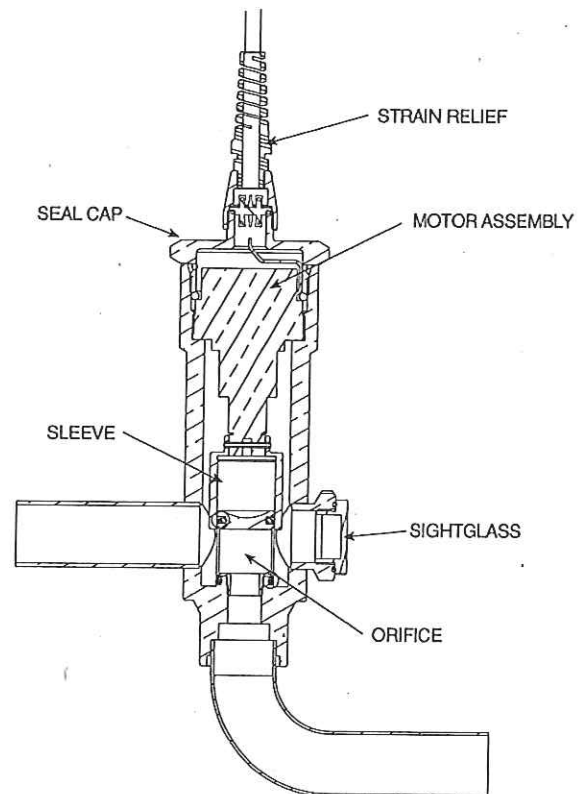

Torque Specifications

ITEM	ft-lb	n-m
Sight Glass	15-25	20-34
Seal Cap	18-22	24-30

Fig. 23 — Typical 30GXN,GXR,HX EXV

SERVICE

Servicing Coolers and Condensers — When cooler heads and partition plates are removed, tube sheets are exposed showing the ends of tubes. The 30GXN,GXR,HX units use a flooded cooler design. Water flows inside the tubes.

TUBE PLUGGING — A leaky tube in one circuit can be plugged until retubing can be done. The number of tubes plugged determines how soon the cooler must be retubed. All tubes in the 30GXN,R and 30HX coolers and 30HX condensers can be removed. Loss of unit capacity and efficiency as well as increased pump power will result from plugging tubes. Failed tubes should be replaced as soon as possible. Up to 10% of the total number of tubes can be plugged before retubing is necessary. Figure 24 shows an Elliott tube plug and a cross-sectional view of a plug in place. The same components for plugging and rolling tubes can be used for all coolers and 30HXC condensers. See Table 34. If tube failure is in both circuits, using tube plugs will not correct problem. Contact your Carrier representative for assistance.

⚠ CAUTION

Use extreme care when installing plugs to prevent damage to the tube sheet section between the holes.

RETUBING (See Table 35) — When retubing is to be done, obtain service of qualified personnel experienced in boiler maintenance and repair. Most standard procedures can be followed when retubing the 30GXN,R and 30HX heat exchangers. Care must be taken as the tubes are rolled in the center tube sheet and require special pulling tools. A 7% crush is recommended when rolling replacement tubes into the tubesheet. A 7% crush can be achieved by setting the torque on the gun at 48 to 50 in.-lb (5.4 to 5.6 N-m).

The following Elliott Co. tube rolling tools are required:

113123 Expander Assembly	213123 Mandrel
2134123 Cage	2115122 Rolls

Place one drop of Loctite No. 675 or equivalent on top of tube prior to rolling. This material is intended to "wick" into the area of the tube that is not rolled into the tube sheet, and prevent fluid from accumulating between the tube and the tube sheet. New tubes must also be rolled into the center tube sheet to prevent circuit-to-circuit refrigerant leakage.

Table 34 — Plugging Components

COMPONENTS FOR PLUGGING	PART NUMBER
For Tubes	
Brass Pin	853103-1*
Brass Ring	853002-640* or -657†
For Holes without Tubes	
Brass Pin	853103-1A*
Brass Ring	853002-738*
Roller Extension	S82-112/11
Loctite	No. 675**
Locquic	"N"***

*Order directly from: Elliott Tube Company, Dayton, Ohio.

†Measure tube ID before ordering.

**Can be obtained locally.

Table 35 — Tube Diameters

ITEM	INCHES	MILLIMETERS
Tube sheet hole diameter:	0.756	19.20
Tube OD	0.750	19.05
Tube ID after rolling:	0.650	16.51
(Includes expansion due to clearance)	to 0.667	to 16.94

NOTE: Tubes replaced along heat exchanger head partitions must be flush with tube sheet.

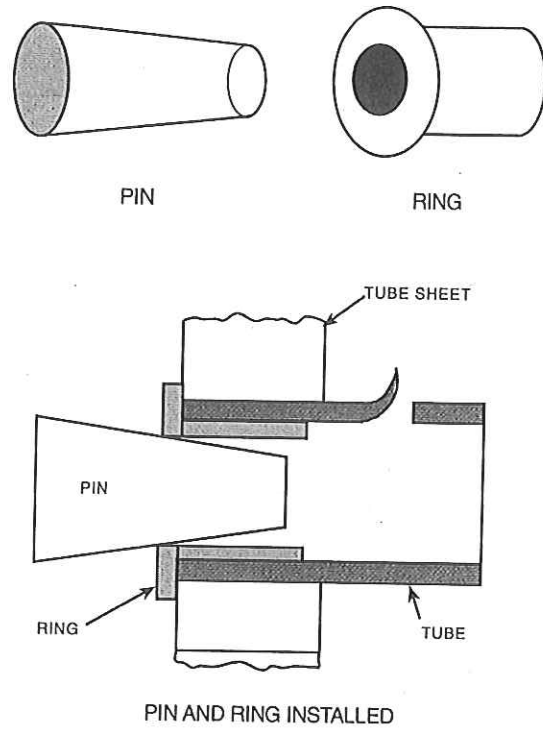


Fig. 24 — Tube Plugging

TIGHTENING COOLER/CONDENSER HEAD BOLTS

O-Ring Preparation — When reassembling cooler and condenser heads, always check the condition of the O-ring(s) first. The O-ring should be replaced if there are any visible signs of deterioration, cuts or damage. Apply a thin film of grease to the O-ring before installation. This will aid in holding the O-ring into the groove while the head is installed. Torque all bolts to the following specification and in the sequence shown in Fig. 25.

3/4-in. Diameter Perimeter and Plate Bolts 200 to 225 ft-lb (271 to 305 N-m)

1. Install all bolts finger tight.
2. Follow numbered sequence shown for head type being installed. This will apply even pressure to the O-ring.
3. Apply torque in one-third steps until required torque is reached. Load all bolts to each one-third step before proceeding to the next one-third step.
4. No less than one hour later, retighten all bolts to required torque values.
5. Restore water/brine flow and check for leaks. Fix leaks as necessary. Replace insulation (on cooler heads only).

Inspecting/Cleaning Heat Exchangers

COOLERS — Inspect and clean the cooler tubes at the end of the first operating season. Because these tubes have internal ridges, a rotary-type tube cleaning system is necessary to fully clean the tubes. Tube condition in the cooler will determine the scheduled frequency for cleaning, and will indicate whether water treatment is adequate in the chilled water/brine circuit. Inspect the entering and leaving thermistors for signs of corrosion or scale. Replace the sensor if corroded or remove any scale if found.

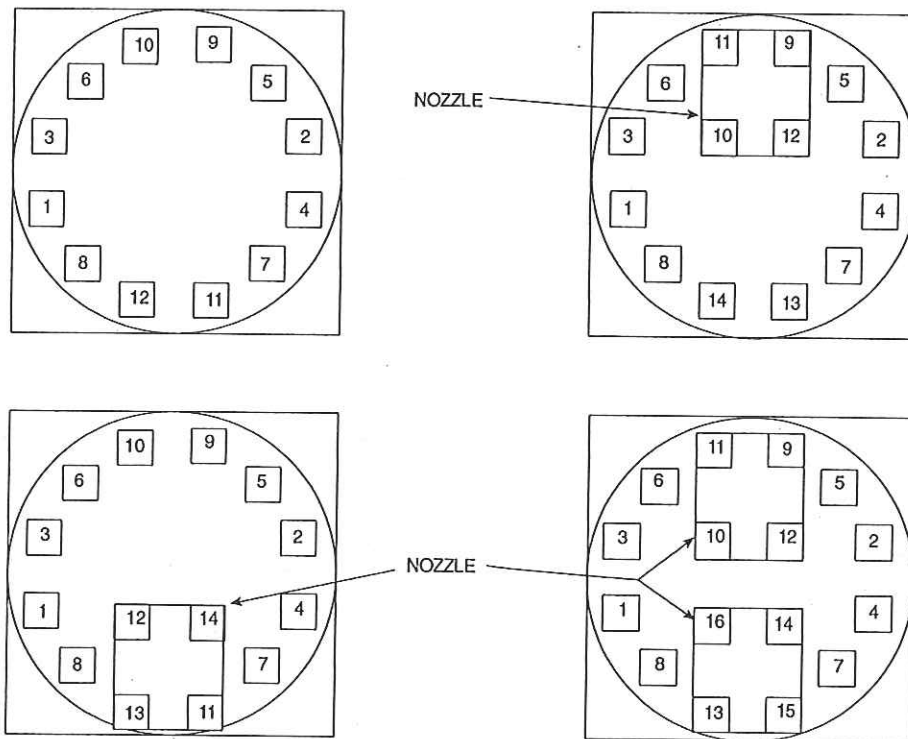


Fig. 25 — Cooler and Condenser Head Recommended Bolt Torque Sequence

CONDENSERS (30HX Only) — Since this water circuit is usually an open-type system, the tubes may be subject to contamination and scale. Clean the condenser tubes with a rotary tube cleaning system at regular intervals, and more often if the water is contaminated. Inspect the entering and leaving condenser water thermistors (if installed) for signs of corrosion or scale. Replace the sensor if corroded or remove any scale if found.

Higher than normal condenser pressures, together with inability to reach full refrigeration load, usually indicate dirty tubes or air in the machine. If the refrigeration log indicates a rise above normal condenser pressures, check the condenser refrigerant temperature against the leaving condenser water temperature. If this reading is more than what the design difference is supposed to be, then the condenser tubes may be dirty, or water flow may be incorrect. Due to the pressure in the R-134a system, air usually will not enter the machine; the refrigerant will leak out.

During the tube cleaning process, use brushes specially designed to avoid scraping and scratching the tube wall. Contact your Carrier representative to obtain these brushes. Do not use wire brushes.

⚠ CAUTION

Hard scale may require chemical treatment for its prevention or removal. Consult a water treatment specialist for proper treatment procedures.

Water Treatment — Untreated or improperly treated water may result in corrosion, scaling, erosion, or algae. The services of a qualified water treatment specialist should be obtained to develop and monitor a treatment program.

⚠ CAUTION

Water must be within design flow limits, clean and treated to ensure proper machine performance and reduce the potential of tubing damage due to corrosion, scaling, erosion, and algae. Carrier assumes no responsibility for chiller or condenser damage resulting from untreated or improperly treated water.

Condenser Coils (30GXN,R only)

COIL CLEANING — For standard aluminum, copper and pre-coated aluminum fin coils, clean the coils with a vacuum cleaner, fresh water, compressed air, or a bristle brush (not wire). Units installed in corrosive environments should have coil cleaning as part of a planned maintenance schedule. In this type of application, all accumulations of dirt should be cleaned off the coil.

⚠ CAUTION

Do not use high-pressure water or air to clean coils — fin damage may result.

CLEANING E-COATED COILS — Follow the outlined procedure below for proper care, cleaning and maintenance of E-coated aluminum or copper fin coils:

Coil Maintenance and Cleaning Recommendations — Routine cleaning of coil surfaces is essential to maintain proper operation of the unit. Elimination of contamination and removal of harmful residues will greatly increase the life of the coil and extend the life of the unit.

Remove Surface Loaded Fibers — Surface loaded fibers or dirt should be removed with a vacuum cleaner. If a vacuum cleaner is not available, a soft brush may be used. In either case, the tool should be applied in the direction of the fins. Coil surfaces can be easily damaged (fin edges bent over) if the tool is applied across the fins.

NOTE: Use of a water stream, such as a garden hose, against a surface loaded coil will drive the fibers and dirt into the coil. This will make cleaning efforts more difficult. Surface loaded fibers must be completely removed prior to using low velocity clean water rinse.

Periodic Clean Water Rinse — A periodic clean water rinse is very beneficial for coils that are applied in coastal or industrial environments. However, it is very important that the water rinse is made with very low velocity water stream to avoid damaging the fin edges. Monthly cleaning as described below is recommended.

Routine Cleaning of Coil Surfaces — Monthly cleaning with Environmentally Sound Coil Cleaner is essential to extend the life of coils. It is recommended that all coils, including standard aluminum, pre-coated, copper/copper or E-coated coils are cleaned with the Environmentally Sound Coil Cleaner as described below. Coil cleaning should be part of the units regularly scheduled maintenance procedures to ensure long life of the coil. Failure to clean the coils may result in reduced durability in the environment.

Environmentally Sound Coil Cleaner is non-flammable, hypoallergenic, non-bacterial, USDA accepted biodegradable and 100% ecologically safe agent that will not harm the coil or surrounding components such as electrical wiring, painted metal surfaces or insulation. Use of non-recommended coil cleaners is strongly discouraged since coil and unit durability could be affected.

Environmentally Sound Coil Cleaner Application Equipment

- 2½ Gallon Garden Sprayer
- Water Rinse with Low Velocity Spray Nozzle

Environmentally Sound Coil Cleaner Application Instructions — Although Environmentally Sound Coil Cleaner is harmless to humans, animals, and marine life, proper eye protection such as safety glasses is recommended during mixing and application.

1. Remove all surface loaded fibers and dirt with a vacuum cleaner as described above.
2. Thoroughly wet finned surfaces with clean water and a low velocity garden hose being careful not to bend fins.
3. Mix Environmentally Sound Coil Cleaner in a 2½ gallon garden sprayer according to the instructions included with the Enzyme Cleaner. The optimum solution temperature is 100 F.

NOTE: DO NOT USE water in excess of 130 F as the enzymatic activity will be destroyed.

4. Thoroughly apply Environmentally Sound Coil Cleaner solution to all coil surfaces including finned area, tube sheets and coil headers.
5. Hold garden sprayer nozzle close to finned areas and apply cleaner with a vertical, up-and-down motion. Avoid spraying in horizontal pattern to minimize potential for fin damage.
6. Ensure cleaner thoroughly penetrates deep into finned areas. Interior and exterior finned areas must be thoroughly cleaned. Finned surfaces should remain wet with cleaning solution for 10 minutes. Ensure surfaces are not allowed to dry before rinsing. Reapply cleaner as needed to ensure 10-minute saturation is achieved.

7. Thoroughly rinse all surfaces with low velocity clean water using downward rinsing motion of water spray nozzle. Protect fins from damage from the spray nozzle.

⚠ CAUTION

Harsh Chemical and Acid Cleaners — Harsh chemical, household bleach or acid cleaners should not be used to clean outdoor or indoors coils of any kind. These cleaners can be very difficult to rinse out of the coil and can accelerate corrosion at the fin/tube interface where dissimilar materials are in contact. If there is dirt below the surface of the coil, use the Environmentally Sound Coil Cleaner as described above.

High Velocity Water or Compressed Air — High velocity water from a pressure washer, garden hose or compressed air should never be used to clean a coil. The force of the water or air jet will bend the fin edges and increase airside pressure drop. Reduced unit performance or nuisance unit shutdown may occur.

Condenser Fans (30GXN,R Only) — Each fan is supported by a formed wire mount bolted to a fan deck and covered with a wire guard. The exposed end of the fan motor shaft is protected from weather by grease. If the fan motor must be removed for service or replacement, be sure to regrease fan shaft and reinstall fan cover, retaining clips, and fan guard. For proper performance, the fans should be positioned as shown in Fig. 26 or 27. Tighten setscrews to 14 ± 1 ft-lb (18 ± 1.3 N-m).

Check for proper rotation of the fan(s) once reinstalled (clockwise for high static and counterclockwise for standard viewed from above). If necessary to reverse, switch leads at contactor(s) in control box.

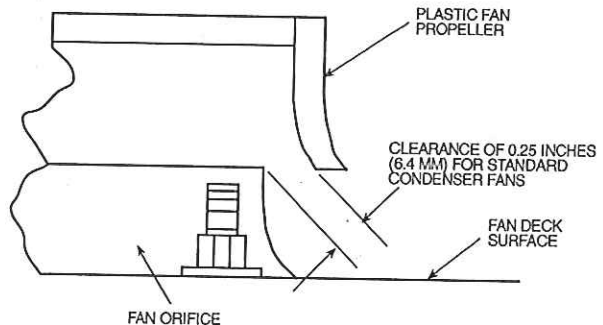


Fig. 26 — Condenser Fan Position (Standard Fan)

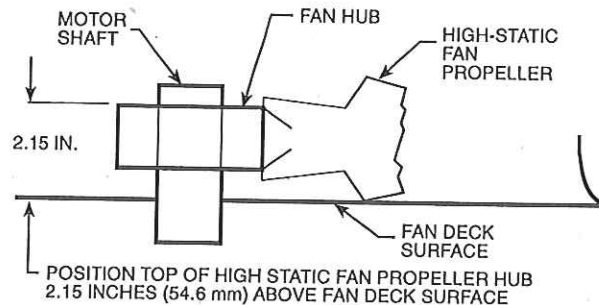


Fig. 27 — Condenser Fan Position (High-Static Fan)

Refrigerant Charging/Adding Charge

IMPORTANT: These units are designed for use with R-134a only. DO NOT USE ANY OTHER REFRIGERANT in these units without first consulting your Carrier representative.

▲ CAUTION

When adding or removing charge, circulate water through the condenser (30HXC) and cooler at all times to prevent freezing. Freezing damage is considered abuse and may void the Carrier warranty.

▲ CAUTION

DO NOT OVERCHARGE system. Overcharging results in higher discharge pressure with higher cooling fluid consumption, possible compressor damage and higher power consumption.

Indication of low charge on a system:

NOTE: To check for low refrigerant charge on a 30HXC unit, several factors must be considered. A flashing liquid line sight glass (located in the EXV body) is not necessarily an indication of inadequate charge. There are many system conditions where a flashing sight glass occurs under normal operation. The EXV metering device is designed to work properly under these conditions.

1. Make sure that the circuit is running at a full-load condition. To check whether circuit A is fully loaded, enter the Outputs mode from the Navigator and then sub-mode 'CIR.A' or 'CIR.B' depending on the circuit under investigation. The circuit is fully loaded if its compressor and loader relays all show 'On'.
2. It may be necessary to use the Service Test feature to force the circuit into a full-load condition. If this is the case, see the instructions for using the Service Test feature in Table 13 of this manual.
3. With the circuit running at full load, verify that the cooler leaving fluid temperature is in the range of 38 to 46 F (3.3 to 7.8 C). Check temperature drop across liquid line strainer/drier. Maximum allowable temperature drop is 3° F (1.7° C). Strainer is cleanable if necessary and contains 1 standard drier core on all 30GX and 30HXA,C 161-271 models.
4. At this condition, observe the refrigerant in the liquid line sight glass. If there is a clear sight glass, and no signs of flashing, then the circuit is adequately charged. Skip the remaining steps.
5. If the refrigerant appears to be flashing, the circuit is probably low on charge. Verify this by checking the EXV Percent Open. This information is located under the sub-mode 'CIR.A' or 'CIR.B' (Outputs mode) and is shown as items 'EXV.A' and 'EXV.B' Scroll through the Navigator until the desired item is located.
6. If the EXV Percent Open is greater than 60%, and the liquid line sight glass is flashing, then the circuit is low on charge. Follow the procedure for adding charge for 30HXC units.

To add charge to the 30HXC systems:

1. Make sure that the unit is running at full load, and that the cooler leaving fluid temperature is in the range of 42 to 46 F (5.6 to 7.8 C).

2. At these operating conditions, check the liquid line sight glass. If there is a clear sight glass, then the unit has sufficient charge. If the sight glass is flashing, then check the EXV Percent Open. If this is greater than 60%, then begin adding charge.

NOTE: A flashing liquid line sight glass at operating conditions other than those mentioned above is not necessarily an indication of low refrigerant charge.

3. Add 5 lb (2.3 kg) of liquid charge into the cooler using the fitting located on the tube entering the bottom of the cooler. This fitting is located between the Electronic Expansion Valve (EXV) and the cooler.
4. Observe the EXV Percent Open value. The EXV should begin closing as charge is being added. Allow the unit to stabilize. If the EXV Percent Open remains above 60%, and the sight glass continues flashing, add an additional 5 lb (2.3 kg) of liquid charge.
5. Allow the unit to stabilize, and again check the EXV Percent Open. Continue adding 5 lb (2.3 kg) at a time of liquid refrigerant charge, and allow the unit to stabilize before checking the EXV position.
6. When the EXV Percent Open is in the range of 40 to 60%, check the liquid line sight glass. Slowly add enough additional liquid charge to ensure a clear sight glass. This should be done slowly to avoid overcharging the unit.
7. Verify adequate charge by continuing to run at full load with 42 to 46 F (5.6 to 7.8 C) cooler leaving fluid temperature. Check that the refrigerant is not flashing in the liquid-line sight glass. The EXV Percent Open should be between 40 and 60%.

To add charge to the 30GX and 30HXA systems:

1. Make sure that the circuit is running at a full load condition and all condenser fans are energized and running on the keypad, at the appropriate line on the display. To check whether circuit A is fully loaded, enter the Outputs mode from the Navigator and then sub-mode 'CIR.A' or 'CIR.B' depending on the circuit under investigation. The circuit is fully loaded if its compressor and loader relays all show 'On'.
2. It may be necessary to use the Service Test feature to force the circuit into a full-load condition. If this is the case, see the instructions for using the Service Test feature in Table 13 of this manual.
3. With the circuit running at full-load, verify that the cooler leaving fluid temperature is in the range of 38 to 48 F (5.6 to 7.8 C).
4. For 30HXA chillers, raise the compressor discharge to approximately 125 F (51.7 C) saturated condensing temperature (185 psig [1276 kPa]). For 30GXN,R chillers, raise the compressor discharge to approximately 130 F (54.4 C) saturated condensing temperature (198 psig [1366 kPa]). Measure the liquid temperature entering the EXV for 30HXA units. For 30GXN,R units, measure the liquid temperature after the tee where all liquid lines have joined (see Fig. 28 and 29). The liquid temperature should be approximately 107 F (41.7 C) for optimum charge. If the temperature is greater than 107 F (41.7 C) and the sight glass is flashing, the circuit is undercharged.
5. Add 5 lb (2.3 kg) of liquid charge into the cooler using the fitting located on the tube entering the bottom of the cooler. This fitting is located between the Electronic Expansion Valve (EXV) and the cooler.
6. Allow the system to stabilize and then recheck the liquid temperature. Repeat Step 5 as needed allowing the system to stabilize between each charge addition. Slowly add charge as the sight glass begins to clear to avoid overcharging.

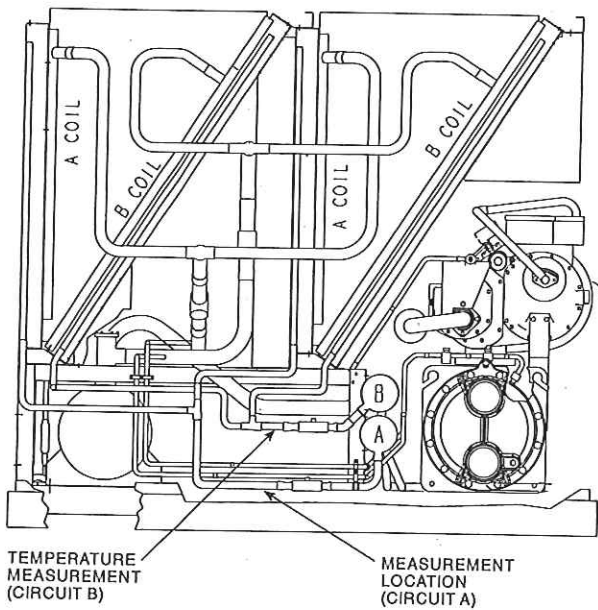


Fig. 28 — Saturated Liquid Temperature Measurement (30GXN,R080-150 and 160)

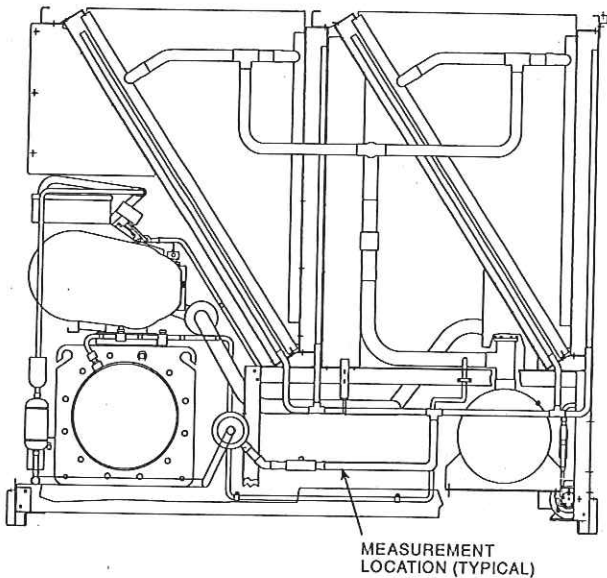


Fig. 29 — Saturated Liquid Temperature Measurement (30GXN,R153, 163-350)

Oil Charging/Low Oil Recharging

OIL SPECIFICATION — If oil is added, it must meet the following Carrier specifications:

- Castrol Icematic® SW-220
- Oil type Inhibited polyolester-based synthetic compressor lubricant for use in screw compressors.
- ISO Viscosity Grade 220

This oil is available in the following quantities from your local Carrier representative (see Table 36).

Table 36 — Available Oil Quantities and Part Numbers

QUANTITY	TOTALINE PART NUMBER	RCD PART NUMBER
1 Quart	P903-1225	—
1 Gallon	P903-1201	PP23BZ104-001
5 Gallons	P903-1205	PP23BZ104-005

Addition of oil charge to 30HX,GXN,GXR systems:

1. If the 30HX,GXN,GXR unit shuts off repeatedly on Low Oil Level (Alert number 124 or 125), this may be an indication of inadequate oil charge. It could also mean simply that oil is in the process of being reclaimed from the low-side of the system.
2. Begin by running the unit at full load for 1½ hours. Use the Manual Control feature of the software if the unit does not normally run at full load.
3. After running the unit for 1½ hours, allow the unit to restart and run normally. If the Low Oil Level alarms persist, continue following this procedure.
4. Close the liquid line service valve, and place a pressure gage on top of the cooler. Enable the Service Test feature using the Navigator and turn the EOR switch to Enable. Start the desired compressor by turning it On under the 'COMP' sub-mode. Select item 'CC.A1' for compressor A1, 'CC.B1' for compressor B1, etc.
5. Before starting the compressor, the unit will go through its normal pre-lube pump routine. If there is an insufficient level of oil in the oil separator, the compressor will not start, and a pre-start oil pressure alarm will be posted. Skip to Step 8.
6. If the compressor starts successfully, observe the cooler pressure gage. When this gage reads approximately 10 psig, turn the selected compressor Off from the Navigator and move the EOR switch to the Off position.
7. Open the liquid line service valve and allow the unit to restart and run normally. If the Low Oil Level alarms persist, continue following this procedure.
8. If none of the previous steps were successful, the unit is low on oil charge. Add oil to the oil separator using the ¼-in. Schrader-type fitting on the discharge line entering the top of the oil separator (30HX units) or through the Schrader fitting on the top of the oil separator (30GXN,R units).

⚠ CAUTION

Do not add oil at any other location as improper unit operation may result.

9. Make sure that the unit is not running when adding oil, as this will make the oil charging process easier. Because the system is under pressure even when the unit is not running, it will be necessary to use a suitable pump (hand pump or electric pump) to add oil to the system.
10. Using a suitable pump, add ½ gal. (1.89 L) of Castrol Icematic® SW-220 Polyolester oil (absolutely no substitutes are approved) to the system. Make sure that the oil level safety switch is NOT jumpered, and allow the unit to restart and run normally. Do not exceed maximum oil change. See Table 37.

Table 37 — Factory Oil Charges

UNIT SIZE	CIRCUIT A (gal)	CIRCUIT A (L)	CIRCUIT B (gal)	CIRCUIT B (L)
30GX080-178	5.0	18.9	5.0	18.9
30GX204-268	7.0	26.5	5.0	18.9
30GX281-350	7.0	26.5	7.0	26.5
30HXA076-186	5.0	18.9	5.0	18.9
30HXC076-186	4.5	17.0	4.5	17.0
30HXA206-271	8.0	30.2	5.0	18.9
30HXC206-271	7.5	28.4	5.0	18.9

- If low-oil level problems persist, add another 1.89 L (1/2 gal.) of oil. Continue adding oil in 1.89 L (1/2 gal.) increments until the problem is resolved. If it is necessary to add more than 5.75 L (1.5 gallons) of oil to the system, contact your Carrier representative.

Oil Filter Maintenance — Each compressor has its own internal oil filter and each circuit also has an in-line external filter. The internal oil filter pressure drop should be checked and filter changed (if necessary) after the initial 200 to 300 hours of compressor operation. Oil line pressure loss is monitored by the control and reported for each compressor as the oil filter pressure drop. This information can be found in the Pressures mode of the Navigator for each circuit. The 'PRC.A' sub-mode contains oil filter pressure differentials for each Circuit A compressor (items 'FD.A1' 'FD.A2'). Similarly, the PRC.B sub-mode contains oil filter pressure differentials for each circuit B compressor (items FD.B1, FD.B2). This pressure differential (discharge pressure minus oil pressure, both from pressure transducer inputs) is typically 15 to 20 psi (103 to 138 kPa) for a system with clean internal and external filters. To determine the oil pressure drop due to the oil lines and external filter only, connect a gage to the oil pressure bleed port. Compare this value to the discharge pressure read at the Navigator. If this value exceeds 10 psi (69 kPa), replace the external filter. The difference between the gauge pressure and compressor oil pressure read at the Navigator is the pressure drop through the internal oil filter. Replace the internal oil filter if the pressure drop is greater than 25 psi (173 kPa) for 30HXC and 30 psi (207 kPa) for 30GXN,R and 30HXA chillers.

REPLACING THE EXTERNAL OIL FILTER

⚠ CAUTION

Compressor oil is pressurized. Use proper safety precautions when relieving pressure.

Fully front seat (close) the angle valve on the filter and the ball valve at the compressor. Connect a charging hose to the oil pressure bleed port and drain the oil trapped between service valves. A quart (liter) of oil is typically what is removed during this process. Remove the charging hose.

Unscrew the nut from the other side of the filter and remove the old filter. Remove protective plastic caps from new filter and install. Draw a vacuum at the bleed port. Remove charging hose. Open angle valve enough to let oil flow. Check both fittings for leaks and repair if necessary. Backseat angle valve and open ball valve.

REPLACING THE INTERNAL OIL FILTER — Close the service valves at the compressor and drain the oil using the bleed port. If the oil pressure does not bleed off using this method it will be necessary to remove the entire circuit charge. Using a 3/4-in. Allen wrench, remove the internal filter access cover (see Fig. 30). Remove the old filter. Replacement filters (one for each compressor) are factory supplied to cover the first changeout. After that, filters are field supplied. Lightly oil O-ring in the filter and install with filter open end first into the housing. Replace access cover and retorque to 75 ft-lb (101 N-m). Follow procedure in previous section for opening angle valve and purging lines. Check for leaks and repair if necessary.

Compressor Changeout Sequence — Compressor service requires metric tools and hardware. Change compressors according to the following procedure:

- Turn off all main and control circuit power supplying the machine.
- Close the discharge and liquid valve(s), suction valve (if equipped), and cooler inlet line service valve (if equipped), oil line shutoff valve, and minimum load

shutoff valve (if equipped) for circuit to be changed. Disconnect the oil inlet line from the compressor. Disconnect oil filter with fitting at shutoff valve side and set filter and compressor inlet line assembly aside.

- Remove any remaining refrigerant in the compressor and refrigerant lines using proper reclaiming techniques. All of the refrigerant that is in the cooler must be removed if there is no suction service valve installed on the cooler.

IMPORTANT: Cooler and condenser pumps must be energized. Fluid must be flowing through heat exchangers whenever adding or removing charge.

- Remove junction box cover of compressor to be changed. Check main power leads for marked numbers. If no numbers are visible on leads, mark leads with appropriate numbers to match those printed on the ends of the terminal lugs. This is extremely important as power leads **MUST** be installed on the exact terminals from which they were removed.
- Disconnect main power leads from compressor terminal lugs. Mark remaining control circuit wires (connected together with wire nuts) for ease of reconnecting later. The following color scheme applies (verify with label diagram on panel):

Loader 1	2 Violet wires
Loader 2	2 Pink wires
Motor Cooling Solenoid	1 Blue wire, 1 Brown wire *
Oil Solenoid	1 Orange wire, 1 Brown wire*
High-Pressure Switch	2 Red wires

*One lead from the motor cooling and oil solenoids are connected together with a single brown wire.

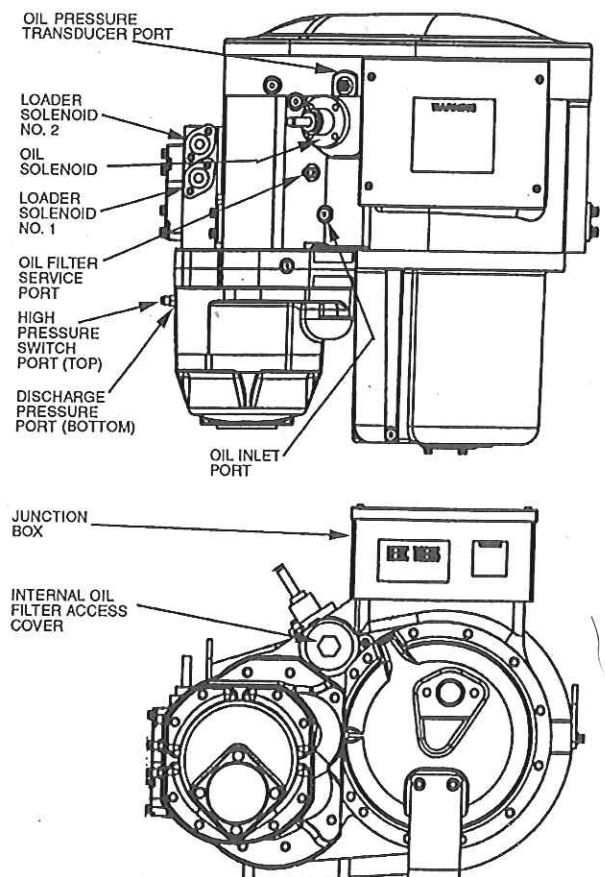


Fig. 30 — Compressor Component Diagram

- Remove loader (mark solenoids no. 1 and 2 for replacement) and oil solenoids and high-pressure switch from compressor. Using 2 wrenches, carefully remove the oil pressure transducer from the compressor. These will all be reconnected to the replacement compressor.

NOTE: Some oil will leak out of the transducer fitting when the transducer is removed. See Fig. 30.


- Mark motor temperature leads (2 blue wires) and remove from quick connect terminals in the junction box.

▲ CAUTION

The next steps involve compressor unbolting and removal. Compressor seals are made using O-rings. Use care when removing bolts and disconnecting flanges. The O-rings must NOT be re-used. New O-rings are provided with the replacement compressor. The 06N screw compressors weigh approximately 920 lb (417 kg). Be sure that an appropriate lifting cart or hoist is used to avoid injury. See Fig. 31 for lifting locations and center of gravity dimensions. Make sure compressor is properly rigged before unbolting.

- Remove the 2 bolts securing the motor cooling/economizer line flange to the compressor.
- Remove the four M14 bolts securing the discharge line flange to the compressor. Two of the bolts also secure the mounting bracket for the external oil filter. Support the oil line to prevent damage to the line while the compressor is being changed. For 30GX units, place temporary protection over coils to prevent fin and tube damage.
- Move lifting apparatus into place and attach to the 2 lifting rings on the compressor. Apply minimal tension to hold the compressor while the remaining bolts are removed.
- Remove the $\frac{3}{8}$ -in. holddown bolt securing the foot at the discharge end of the compressor to the mounting bracket on the cooler. A foot bracket will be mounted to the replacement compressor.
- Remove the 4 lockwashers and nuts securing the compressor to the suction flange of the cooler. The compressor is held in place using four M14 x 2 studs through the suction nozzle of the cooler. The studs have an E-12 external Torx drive head. If possible, remove studs; if studs hit the cooler insulation, leave them in place — they will not interfere with compressor removal or installation. Save all the hardware as it will be needed to install the replacement compressor.


LIFTING LUGS BOTH OUTSIDE EDGES
EQUIDISTANT FROM GEAR COVER END

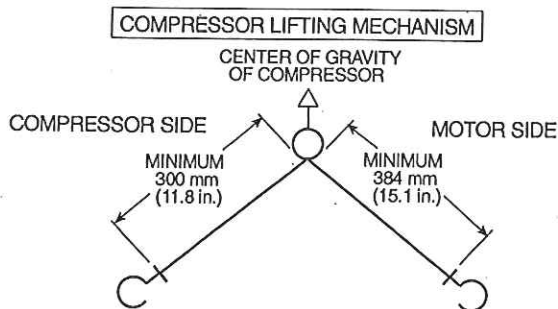

NOTE: Locate strap from center of gravity lifting ring and support motor casing to provide 3-point level rigging.

Fig. 31 — Compressor Lifting Diagrams

- After checking to ensure all lines, wires, conduits, etc. are free and out of the way, remove compressor from cooler. Apply a light film of O-ring grease to new O-ring and place back into groove in mounting flange of compressor. If the new compressor is the A1/A2 (30HX units), A2 (30GXN,R204-268 units) or B2 (30GXN,R281-350 units) compressor, remove the compressor junction box and rotate it 180 degrees. Tighten screws to 6.8 to 9.5 N-m (5 to 7 ft-lb). The A1 and A2 compressors are on the right side of the unit when facing the unit control box.
- Remove suction cover plate and bolts from new compressor and set compressor on unit flange. Thread the studs all the way back into the compressor. Install the 4 lock washers and nuts finger-tight. Tighten bolts in a crossing pattern to a range of 81.4 to 135.6 N-m (60 to 100 ft-lb). Do NOT overtighten as damage may result to O-ring. Install and tighten holddown bolt in mounting foot.
- Remove motor cooling/economizer and discharge line cover plates from new compressor.
- Apply a light film of O-ring grease to motor cooling/economizer and discharge line O-rings, place back into grooves and install flange bolts. Tighten discharge line bolts in a crossing pattern to a range of 81.4 to 135.6 N-m (60 to 100 ft-lb). Tighten motor cooling/economizer bolts to a range of 81.4 to 108.5 N-m (60 to 80 ft-lb). Do NOT overtighten as damage may result to O-rings.
- Reconnect the oil filter to the shutoff valve and oil line to the compressor. Install oil line straight into fitting until ferrule seats against fitting. Thread packing nut onto fitting and tighten finger tight. Use a backup wrench to finish tightening the nut. Do not overtighten.
- Reinstall the loader and oil solenoids, high-pressure switch, and oil pressure transducer. Make sure the loader solenoids are installed on the correct number loader.
- Reconnect conduits back into compressor junction box. Reconnect all wiring that was removed in Steps 4, 5, and 7. Temporarily install the reverse rotation low pressure switch that is supplied with the replacement compressor. Connect the switch to the second high pressure port using a standard $\frac{1}{4}$ -in. service hose. The switch will not reset until 10 psig of pressure is present on the switch. Temporarily wire the reverse rotation low pressure switch in series with the compressor's high pressure switch as shown in Fig. 32.
- Leak check compressor and refrigerant lines with nitrogen. Repair any leaks found. Remove nitrogen from system. Evacuate compressor and refrigerant lines. Refer to the Refrigerant Charging/Adding Charge and Oil Charging/Low Oil Recharging sections on pages 55 and 56 for recharging procedures.
- Open all shutoff valves and leak check the circuit and all fittings and joints. Repair any leaks found.
- Reset the reverse rotation low pressure switch.
- Restore main and control power to the machine. Put the Enable/Off/Remote Contact switch in the Enable position. Using the Navigator under the Service Test mode, turn the TEST sub-mode 'On'. Under the OUTS sub-mode, test each compressor's oil and motor cooling solenoids (items 'MC.A1', 'OS.A1', etc.). Next, locate and test each loader solenoid under the COMP sub-mode (items 'LD.A1', etc.). It is important that the loaders are located properly (loader 1 on right hand side when viewed from side opposite control box on 30HXA,HXC units, on left hand side when reaching over compressor to far side on 30GXN,R units).



LEGEND
 HPS — High-Pressure Switch
 RRS — Reverse Rotation Switch (HK01CB002)

Fig. 32 — Reverse Rotation Switch Wiring

24. Locate the appropriate compressor item ('CC.A1', etc.) under the COMP sub-mode and start the compressor. Press **ENTER**, followed by **▲** to change the value to On, and then **ENTER** again. Once the compressor has successfully started, energize both loaders one at a time. Let the circuit stabilize with both loaders energized. Refer to the Refrigerant Charging/Adding Charge and Oil Charging/Low Oil Recharging sections of this document for recharging procedures and performance criteria.
25. Once proper rotation has been verified, disconnect and lock out the power to the chiller. The reverse rotation low pressure switch can now be removed from the compressor and high pressure switch circuit.

BURNOUT CLEAN-UP PROCEDURE — If a screw compressor motor burns out on a 30GX,HX chiller, a simple cleanup should be performed. The following procedure provides the minimum steps to be taken before restarting the circuit.

1. Remove the oil from the oil separator. This can be facilitated by connecting a hose to the port located on the service valve entering the external oil filter. Run the hose to a container(s) that can hold up to 5 to 6 gallons (19 to 20 L) of oil. Pressurize the circuit to force out most of the oil in the separator. To remove the remaining oil, the pre-lube pump can be run in the Service Test mode from the Navigator. Enable the desired pump (either item 'OL.P.A' or 'OL.P.B' in the OUTS sub-mode). To prevent wear to the pump components, do not allow the pre-lube pump to operate "dry."
2. Remove the failed compressor following the Compressor Changeout Sequence procedure on page 57.
3. Once the compressor is removed access the oil catch pan through the cooler-compressor mounting flange. Clean out any debris which may have collected in the oil catch pan.
4. Install a new compressor.
5. To dilute and remove any residual oil left in the separator, pump approximately 1/2 gallon (2 L) of compressor oil into the oil separator using the Schrader port located on top of the separator (30GXN,R) or on the discharge line (30HXA,HXC) and remove using the pre-lube pump described in Step 1.
6. Disconnect the hose from the external oil filter service valve.
7. Install a new filter drier core and compressor external oil filter. If desired, a burnout (activated carbon) core may be used, but should be replaced with a standard filter drier core during the next filter replacement.
8. Measure in the amount of Castrol SW 220 Polyolester oil as specified on the nameplate of the chiller.
9. Leak check, evacuate and recharge the machine as described in this manual with the amount of R-134a stated on the chiller nameplate.
10. Perform periodic acid checks on the circuit and change the filter drier core in the liquid line as necessary. Use the Carrier Standard Service Techniques Manual as a source of reference.

Moisture-Liquid Indicator — Clear flow of liquid refrigerant indicates sufficient charge in the system. Note, however, that bubbles in the sight glass do not necessarily indicate insufficient charge. Moisture in the system is measured in parts per million (ppm), changes of color of indicator are:

Green — moisture is below 80 ppm;
Yellow-green (chartreuse) — 80 to 225 ppm (caution);
Yellow (wet) — above 225 ppm.

Change filter drier at the first sign of moisture in the system.

IMPORTANT: Unit must in operation for at least 12 hours before moisture indicator can give an accurate reading. With the unit running, the indicating element must be in contact with liquid refrigerant to give true reading.

Filter Drier — Whenever moisture-liquid indicator shows presence of moisture, replace filter drier core. Refer to Carrier Standards Service Technique Manual, Chapter 1, Refrigerants, for details on servicing filter driers. Cleanable strainers have been installed in each circuit's liquid line to aid in removal of system contaminants and debris. There is one industry standard drier core in each strainer. See Fig. 33.

Liquid Line Service Valve — This valve is located ahead of the filter drier and provides a 1/4-in. Schrader connection (30GXN,R only) for field charging. In combination with compressor discharge service valve, each circuit can be pumped down into the high side for servicing.

Thermistors — To aid in verifying thermistor performance, resistances at various temperatures are listed for all thermistors (except motor thermistors) in Tables 38A-39B. See Table 40 for motor thermistor values.

LOCATION — General location of thermistor sensors and terminal connections in the control box are listed in Table 3.

THERMISTOR REPLACEMENT

▲ CAUTION

All thermistors are installed in wells and will slide out of the wells easily. The wells are under refrigerant pressure (cooler EWT and LWT are under waterside pressure) and do not need to be removed to replace a faulty thermistor.

To Replace Thermistors T1, T2, T3, T4, T5, or T6 (Entering, Leaving Water, Discharge Gas Temperature) — Disconnect appropriate connector from the Main Base Board (MBB) or Screw Compressor Board (SCB). Thermistors T1 and T2 are connected to MBB-J8 and thermistors T3 through T6 are connected to EXV-J5. These six thermistors use insulation displacement connectors. New thermistors should be spliced to existing wiring close to the connector unless new connectors are required. A special AMP crimping tool, part no. 58580-1, is needed if new connectors are used. Remove thermistor cable from harness. Remove and discard original thermistor from well. Insert new thermistor in well body to its full depth. Add a small amount of thermal conductive grease to thermistor probe and well. Thermistors are friction-fit thermistors and will slip back into well located at the cooler head (T1, T2) or at the top of each compressor discharge line (T3 through T6). Secure thermistor to well body with a wire tie to prevent thermistor from working its way out of the well. See Fig. 34.

To Service Compressor Motor Thermistors — Two thermistors are factory installed in each compressor. Connections for the thermistors are located in the compressor junction box. There are 3 terminals for the thermistors: S1, S2, and C. Motor temperature is measured by leads connected to one of the S terminals and the C terminal. If a compressor motor thermistor failure occurs, verify that there is a true short or open circuit at

these terminals. If one of the thermistors fails, disconnect and relocate the wire on one of the S terminals to the other S terminal (S1 to S2 or S2 to S1). The thermistors are not serviceable in the field. If both of the compressor motor thermistors fail, compressor replacement is required. See Table 40 for motor thermistor temperature and resistance values.

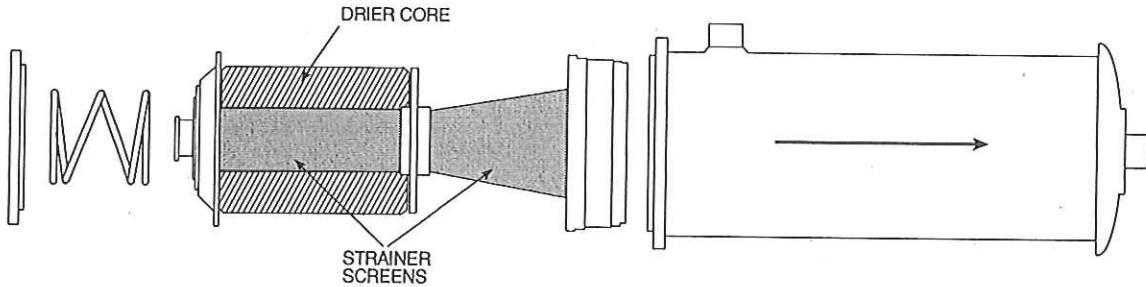


Fig. 33 — Filter Drier

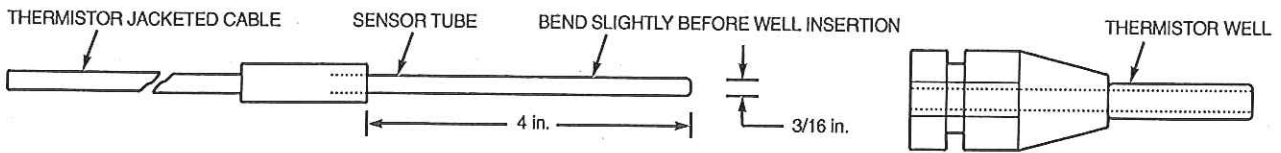


Fig. 34 — Thermistor Replacement (T1 through T6)

Table 38A — 5K Thermistor Temperature (°F) vs Resistance/Voltage

TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)
-25	3.699	98,010	59	1.982	7,686	143	0.511	1,190
-24	3.689	94,707	60	1.956	7,665	144	0.502	1,165
-23	3.679	91,522	61	1.930	7,468	145	0.494	1,141
-22	3.668	88,449	62	1.905	7,277	146	0.485	1,118
-21	3.658	85,486	63	1.879	7,091	147	0.477	1,095
-20	3.647	82,627	64	1.854	6,911	148	0.469	1,072
-19	3.636	79,871	65	1.829	6,735	149	0.461	1,050
-18	3.624	77,212	66	1.804	6,564	150	0.453	1,029
-17	3.613	74,648	67	1.779	6,399	151	0.445	1,007
-16	3.601	72,175	68	1.754	6,238	152	0.438	986
-15	3.588	69,790	69	1.729	6,081	153	0.430	965
-14	3.576	67,490	70	1.705	5,929	154	0.423	945
-13	3.563	65,272	71	1.681	5,781	155	0.416	925
-12	3.550	63,133	72	1.656	5,637	156	0.408	906
-11	3.536	61,070	73	1.632	5,497	157	0.402	887
-10	3.523	59,081	74	1.609	5,361	158	0.395	868
-9	3.509	57,162	75	1.585	5,229	159	0.388	850
-8	3.494	55,311	76	1.562	5,101	160	0.381	832
-7	3.480	53,526	77	1.538	4,976	161	0.375	815
-6	3.465	51,804	78	1.516	4,855	162	0.369	798
-5	3.450	50,143	79	1.493	4,737	163	0.362	782
-4	3.434	48,541	80	1.470	4,622	164	0.356	765
-3	3.418	46,996	81	1.448	4,511	165	0.350	750
-2	3.402	45,505	82	1.426	4,403	166	0.344	734
-1	3.386	44,066	83	1.404	4,298	167	0.339	719
0	3.369	42,679	84	1.382	4,196	168	0.333	705
1	3.352	41,339	85	1.361	4,096	169	0.327	690
2	3.335	40,047	86	1.340	4,000	170	0.322	677
3	3.317	38,800	87	1.319	3,906	171	0.317	663
4	3.299	37,596	88	1.298	3,814	172	0.311	650
5	3.281	36,435	89	1.278	3,726	173	0.306	638
6	3.262	35,313	90	1.257	3,640	174	0.301	626
7	3.243	34,231	91	1.237	3,556	175	0.296	614
8	3.224	33,185	92	1.217	3,474	176	0.291	602
9	3.205	32,176	93	1.198	3,395	177	0.286	591
10	3.185	31,202	94	1.179	3,318	178	0.282	581
11	3.165	30,260	95	1.160	3,243	179	0.277	570
12	3.145	29,351	96	1.141	3,170	180	0.272	561
13	3.124	28,473	97	1.122	3,099	181	0.268	551
14	3.103	27,624	98	1.104	3,031	182	0.264	542
15	3.082	26,804	99	1.086	2,964	183	0.259	533
16	3.060	26,011	100	1.068	2,898	184	0.255	524
17	3.038	25,245	101	1.051	2,835	185	0.251	516
18	3.016	24,505	102	1.033	2,773	186	0.247	508
19	2.994	23,789	103	1.016	2,713	187	0.243	501
20	2.972	23,096	104	0.999	2,655	188	0.239	494
21	2.949	22,427	105	0.983	2,597	189	0.235	487
22	2.926	21,779	106	0.966	2,542	190	0.231	480
23	2.903	21,153	107	0.950	2,488	191	0.228	473
24	2.879	20,547	108	0.934	2,436	192	0.224	467
25	2.856	19,960	109	0.918	2,385	193	0.220	461
26	2.832	19,393	110	0.903	2,335	194	0.217	456
27	2.808	18,843	111	0.888	2,286	195	0.213	450
28	2.784	18,311	112	0.873	2,239	196	0.210	445
29	2.759	17,796	113	0.858	2,192	197	0.206	439
30	2.735	17,297	114	0.843	2,147	198	0.203	434
31	2.710	16,814	115	0.829	2,103	199	0.200	429
32	2.685	16,346	116	0.815	2,060	200	0.197	424
33	2.660	15,892	117	0.801	2,018	201	0.194	419
34	2.634	15,453	118	0.787	1,977	202	0.191	415
35	2.609	15,027	119	0.774	1,937	203	0.188	410
36	2.583	14,614	120	0.761	1,898	204	0.185	405
37	2.558	14,214	121	0.748	1,860	205	0.182	401
38	2.532	13,826	122	0.735	1,822	206	0.179	396
39	2.506	13,449	123	0.723	1,786	207	0.176	391
40	2.480	13,084	124	0.710	1,750	208	0.173	386
41	2.454	12,730	125	0.698	1,715	209	0.171	382
42	2.428	12,387	126	0.686	1,680	210	0.168	377
43	2.402	12,053	127	0.674	1,647	211	0.165	372
44	2.376	11,730	128	0.663	1,614	212	0.163	367
45	2.349	11,416	129	0.651	1,582	213	0.160	361
46	2.323	11,112	130	0.640	1,550	214	0.158	356
47	2.296	10,816	131	0.629	1,519	215	0.155	350
48	2.270	10,529	132	0.618	1,489	216	0.153	344
49	2.244	10,250	133	0.608	1,459	217	0.151	338
50	2.217	9,979	134	0.597	1,430	218	0.148	332
51	2.191	9,717	135	0.587	1,401	219	0.146	325
52	2.165	9,461	136	0.577	1,373	220	0.144	318
53	2.138	9,213	137	0.567	1,345	221	0.142	311
54	2.112	8,973	138	0.557	1,318	222	0.140	304
55	2.086	8,739	139	0.548	1,291	223	0.138	297
56	2.060	8,511	140	0.538	1,265	224	0.135	289
57	2.034	8,291	141	0.529	1,240	225	0.133	282
58	2.008	8,076	142	0.520	1,214			

Table 38B — 5K Thermistor Temperature (°C) vs Resistance/Voltage

TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)
-32	3.705	100,260	15	1.982	7,855	62	0.506	1,158
-31	3.687	94,165	16	1.935	7,499	63	0.490	1,118
-30	3.668	88,480	17	1.889	7,161	64	0.475	1,079
-29	3.649	83,170	18	1.844	6,840	65	0.461	1,041
-28	3.629	78,125	19	1.799	6,536	66	0.447	1,006
-27	3.608	73,580	20	1.754	6,246	67	0.433	971
-26	3.586	69,250	21	1.710	5,971	68	0.420	938
-25	3.563	65,205	22	1.666	5,710	69	0.407	906
-24	3.539	61,420	23	1.623	5,461	70	0.395	876
-23	3.514	57,875	24	1.580	5,225	71	0.383	836
-22	3.489	54,555	25	1.538	5,000	72	0.371	805
-21	3.462	51,450	26	1.497	4,786	73	0.360	775
-20	3.434	48,536	27	1.457	4,583	74	0.349	747
-19	3.406	45,807	28	1.417	4,389	75	0.339	719
-18	3.376	43,247	29	1.378	4,204	76	0.329	693
-17	3.345	40,845	30	1.340	4,028	77	0.319	669
-16	3.313	38,592	31	1.302	3,861	78	0.309	645
-15	3.281	38,476	32	1.265	3,701	79	0.300	623
-14	3.247	34,489	33	1.229	3,549	80	0.291	602
-13	3.212	32,621	34	1.194	3,404	81	0.283	583
-12	3.177	30,866	35	1.160	3,266	82	0.274	564
-11	3.140	29,216	36	1.126	3,134	83	0.266	547
-10	3.103	27,633	37	1.093	3,008	84	0.258	531
-9	3.065	26,202	38	1.061	2,888	85	0.251	516
-8	3.025	24,827	39	1.030	2,773	86	0.244	502
-7	2.985	23,532	40	0.999	2,663	87	0.237	489
-6	2.945	22,313	41	0.969	2,559	88	0.230	477
-5	2.903	21,163	42	0.940	2,459	89	0.223	466
-4	2.860	20,079	43	0.912	2,363	90	0.217	456
-3	2.817	19,058	44	0.885	2,272	91	0.211	446
-2	2.774	18,094	45	0.858	2,184	92	0.204	436
-1	2.730	17,184	46	0.832	2,101	93	0.199	427
0	2.685	16,325	47	0.807	2,021	94	0.193	419
1	2.639	15,515	48	0.782	1,944	95	0.188	410
2	2.593	14,749	49	0.758	1,871	96	0.182	402
3	2.547	14,026	50	0.735	1,801	97	0.177	393
4	2.500	13,342	51	0.713	1,734	98	0.172	385
5	2.454	12,696	52	0.691	1,670	99	0.168	376
6	2.407	12,085	53	0.669	1,609	100	0.163	367
7	2.360	11,506	54	0.649	1,550	101	0.158	357
8	2.312	10,959	55	0.629	1,493	102	0.154	346
9	2.265	10,441	56	0.610	1,439	103	0.150	335
10	2.217	9,949	57	0.591	1,387	104	0.146	324
11	2.170	9,485	58	0.573	1,337	105	0.142	312
12	2.123	9,044	59	0.555	1,290	106	0.138	299
13	2.076	8,627	60	0.538	1,244	107	0.134	285
14	2.029	8,231	61	0.522	1,200			

Table 39A — 10K Thermistor Temperatures (°F) vs Resistance/Voltage Drop
(For Thermistor T10)

TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (F)	VOLTAGE DROP (V)	RESISTANCE (Ohms)
-25	4.758	196,453	61	2.994	14,925	147	0.890	2,166
-24	4.750	189,692	62	2.963	14,549	148	0.876	2,124
-23	4.741	183,300	63	2.932	14,180	149	0.862	2,083
-22	4.733	177,000	64	2.901	13,824	150	0.848	2,043
-21	4.724	171,079	65	2.870	13,478	151	0.835	2,003
-20	4.715	165,238	66	2.839	13,139	152	0.821	1,966
-19	4.705	159,717	67	2.808	12,814	153	0.808	1,928
-18	4.696	154,344	68	2.777	12,493	154	0.795	1,891
-17	4.686	149,194	69	2.746	12,187	155	0.782	1,855
-16	4.676	144,250	70	2.715	11,884	156	0.770	1,820
-15	4.665	139,443	71	2.684	11,593	157	0.758	1,786
-14	4.655	134,891	72	2.653	11,308	158	0.745	1,752
-13	4.644	130,402	73	2.622	11,031	159	0.733	1,719
-12	4.633	126,183	74	2.592	10,764	160	0.722	1,687
-11	4.621	122,018	75	2.561	10,501	161	0.710	1,656
-10	4.609	118,076	76	2.530	10,249	162	0.699	1,625
-9	4.597	114,236	77	2.500	10,000	163	0.687	1,594
-8	4.585	110,549	78	2.470	9,762	164	0.676	1,565
-7	4.572	107,006	79	2.439	9,526	165	0.666	1,536
-6	4.560	103,558	80	2.409	9,300	166	0.655	1,508
-5	4.546	100,287	81	2.379	9,078	167	0.645	1,480
-4	4.533	97,060	82	2.349	8,862	168	0.634	1,453
-3	4.519	94,020	83	2.319	8,653	169	0.624	1,426
-2	4.505	91,019	84	2.290	8,448	170	0.614	1,400
-1	4.490	88,171	85	2.260	8,251	171	0.604	1,375
0	4.476	85,396	86	2.231	8,056	172	0.595	1,350
1	4.461	82,729	87	2.202	7,869	173	0.585	1,326
2	4.445	80,162	88	2.173	7,685	174	0.576	1,302
3	4.429	77,662	89	2.144	7,507	175	0.567	1,278
4	4.413	75,286	90	2.115	7,333	176	0.558	1,255
5	4.397	72,940	91	2.087	7,165	177	0.549	1,233
6	4.380	70,727	92	2.059	6,999	178	0.540	1,211
7	4.363	68,542	93	2.030	6,838	179	0.532	1,190
8	4.346	66,465	94	2.003	6,683	180	0.523	1,169
9	4.328	64,439	95	1.975	6,530	181	0.515	1,148
10	4.310	62,491	96	1.948	6,383	182	0.507	1,128
11	4.292	60,612	97	1.921	6,238	183	0.499	1,108
12	4.273	58,781	98	1.894	6,098	184	0.491	1,089
13	4.254	57,039	99	1.867	5,961	185	0.483	1,070
14	4.235	55,319	100	1.841	5,827	186	0.476	1,052
15	4.215	53,693	101	1.815	5,698	187	0.468	1,033
16	4.195	52,086	102	1.789	5,571	188	0.461	1,016
17	4.174	50,557	103	1.763	5,449	189	0.454	998
18	4.153	49,065	104	1.738	5,327	190	0.447	981
19	4.132	47,627	105	1.713	5,210	191	0.440	964
20	4.111	46,240	106	1.688	5,095	192	0.433	947
21	4.089	44,888	107	1.663	4,984	193	0.426	931
22	4.067	43,598	108	1.639	4,876	194	0.419	915
23	4.044	42,324	109	1.615	4,769	195	0.413	900
24	4.021	41,118	110	1.591	4,666	196	0.407	885
25	3.998	39,926	111	1.567	4,564	197	0.400	870
26	3.975	38,790	112	1.544	4,467	198	0.394	855
27	3.951	37,681	113	1.521	4,370	199	0.388	841
28	3.927	36,610	114	1.498	4,277	200	0.382	827
29	3.903	35,577	115	1.475	4,185	201	0.376	814
30	3.878	34,569	116	1.453	4,096	202	0.370	800
31	3.853	33,606	117	1.431	4,008	203	0.365	787
32	3.828	32,654	118	1.409	3,923	204	0.359	774
33	3.802	31,752	119	1.387	3,840	205	0.354	762
34	3.776	30,860	120	1.366	3,759	206	0.349	749
35	3.750	30,009	121	1.345	3,681	207	0.343	737
36	3.723	29,177	122	1.324	3,603	208	0.338	725
37	3.697	28,373	123	1.304	3,529	209	0.333	714
38	3.670	27,597	124	1.284	3,455	210	0.328	702
39	3.654	26,838	125	1.264	3,383	211	0.323	691
40	3.615	26,113	126	1.244	3,313	212	0.318	680
41	3.587	25,396	127	1.225	3,244	213	0.314	670
42	3.559	24,715	128	1.206	3,178	214	0.309	659
43	3.531	24,042	129	1.187	3,112	215	0.305	649
44	3.503	23,399	130	1.168	3,049	216	0.300	639
45	3.474	22,770	131	1.150	2,986	217	0.296	629
46	3.445	22,161	132	1.132	2,926	218	0.292	620
47	3.416	21,573	133	1.114	2,866	219	0.288	610
48	3.387	20,998	134	1.096	2,809	220	0.284	601
49	3.357	20,447	135	1.079	2,752	221	0.279	592
50	3.328	19,903	136	1.062	2,697	222	0.275	583
51	3.298	19,386	137	1.045	2,643	223	0.272	574
52	3.268	18,874	138	1.028	2,590	224	0.268	566
53	3.238	18,384	139	1.012	2,539	225	0.264	557
54	3.208	17,904	140	0.996	2,488			
55	3.178	17,441	141	0.980	2,439			
56	3.147	16,991	142	0.965	2,391			
57	3.117	16,552	143	0.949	2,343			
58	3.086	16,131	144	0.934	2,297			
59	3.056	15,714	145	0.919	2,253			
60	3.025	15,317	146	0.905	2,209			

Table 39B — 10K Thermistor Temperatures (°C) vs Resistance/Voltage Drop
(For Thermistor T10)

TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)	TEMP (C)	VOLTAGE DROP (V)	RESISTANCE (Ohms)
-32	4.762	200,510	15	3.056	15,714	62	0.940	2,315
-31	4.748	188,340	16	3.000	15,000	63	0.913	2,235
-30	4.733	177,000	17	2.944	14,323	64	0.887	2,157
-29	4.716	166,342	18	2.889	13,681	65	0.862	2,083
-28	4.700	156,404	19	2.833	13,071	66	0.837	2,011
-27	4.682	147,134	20	2.777	12,493	67	0.813	1,943
-26	4.663	138,482	21	2.721	11,942	68	0.790	1,876
-25	4.644	130,402	22	2.666	11,418	69	0.767	1,813
-24	4.624	122,807	23	2.610	10,921	70	0.745	1,752
-23	4.602	115,710	24	2.555	10,449	71	0.724	1,693
-22	4.580	109,075	25	2.500	10,000	72	0.703	1,637
-21	4.557	102,868	26	2.445	9,571	73	0.683	1,582
-20	4.533	97,060	27	2.391	9,164	74	0.663	1,530
-19	4.508	91,588	28	2.337	8,776	75	0.645	1,480
-18	4.482	86,463	29	2.284	8,407	76	0.626	1,431
-17	4.455	81,662	30	2.231	8,056	77	0.608	1,385
-16	4.426	77,162	31	2.178	7,720	78	0.591	1,340
-15	4.397	72,940	32	2.127	7,401	79	0.574	1,297
-14	4.367	68,957	33	2.075	7,096	80	0.558	1,255
-13	4.335	65,219	34	2.025	6,806	81	0.542	1,215
-12	4.303	61,711	35	1.975	6,530	82	0.527	1,177
-11	4.269	58,415	36	1.926	6,266	83	0.512	1,140
-10	4.235	55,319	37	1.878	6,014	84	0.497	1,104
-9	4.199	52,392	38	1.830	5,774	85	0.483	1,070
-8	4.162	49,640	39	1.784	5,546	86	0.470	1,037
-7	4.124	47,052	40	1.738	5,327	87	0.457	1,005
-6	4.085	44,617	41	1.692	5,117	88	0.444	974
-5	4.044	42,324	42	1.648	4,918	89	0.431	944
-4	4.003	40,153	43	1.605	4,727	90	0.419	915
-3	3.961	38,109	44	1.562	4,544	91	0.408	889
-2	3.917	36,182	45	1.521	4,370	92	0.396	861
-1	3.873	34,367	46	1.480	4,203	93	0.386	836
0	3.828	32,654	47	1.439	4,042	94	0.375	811
1	3.781	31,030	48	1.400	3,889	95	0.365	787
2	3.734	29,498	49	1.362	3,743	96	0.355	764
3	3.686	28,052	50	1.324	3,603	97	0.345	742
4	3.637	26,686	51	1.288	3,469	98	0.336	721
5	3.587	25,396	52	1.252	3,340	99	0.327	700
6	3.537	24,171	53	1.217	3,217	100	0.318	680
7	3.485	23,013	54	1.183	3,099	101	0.310	661
8	3.433	21,918	55	1.150	2,986	102	0.302	643
9	3.381	20,883	56	1.117	2,878	103	0.294	626
10	3.328	19,903	57	1.086	2,774	104	0.287	609
11	3.274	18,972	58	1.055	2,675	105	0.279	592
12	3.220	18,090	59	1.025	2,579	106	0.272	576
13	3.165	17,255	60	0.996	2,488	107	0.265	561
14	3.111	16,474	61	0.968	2,400			

Table 40 — Thermistor Temperature vs Resistance, Motor Temperature Thermistors

TEMP (F)	TEMP (C)	RESISTANCE (Ohms)
-22	-30	88,480.0
-13	-25	65,205.0
-4	-20	48,536.0
5	-15	36,476.0
14	-10	27,663.0
23	-5	21,163.0
32	0	16,325.0
41	5	12,696.0
50	10	9,949.5
59	15	7,855.5
68	20	6,246.0
77	25	5,000.0
86	30	4,028.4
95	35	3,265.7
104	40	2,663.2
113	45	2,184.2
122	50	1,801.2
131	55	1,493.1
140	60	1,243.9
149	65	1,041.4
158	70	875.8
167	75	739.7
176	80	627.6
185	85	534.9
194	90	457.7
203	95	393.3
212	100	339.3
221	105	293.8
230	110	255.3
239	115	222.6
248	120	194.8

NOTE: Motor temperature thermistor values must be verified using resistance. Voltage drop cannot be used.

Pressure Transducers — Discrete high and low pressure transducers are used for pressure sensing on all 30GXN,GXR,HX chillers. The discharge and oil pressure transducers are high pressure transducers, and the suction and economizer pressure transducers are low pressure transducers (white dot). No pressure transducer calibration is required. The transducers operate on a 5 vdc supply, which is generated by the Main Base Board (MBB) for suction and discharge pressure transducers and by the Screw Compressor Board (SCB) for the oil and economizer pressure transducers. See unit wiring labels for specific MBB and SCB pressure transducer power and signal connections. Refer to Fig. 35A-35C for pressure transducer locations.

TROUBLESHOOTING — If transducer is suspected of being faulty, first check supply voltage to transducer. Supply voltage should be 5 vdc \pm .2 v. If supply voltage is correct, compare pressure reading displayed on keypad and display module against pressure shown on a calibrated pressure gage. If the 2 pressure readings are not reasonably close, replace pressure transducer. Low pressure transducers suction and economizer pressures should be within \pm 2 psig. Discharge and oil pressures should be within \pm 5 psig.

FLOW SENSOR — Figure 36 shows a typical view of the flow sensor as attached to a victaulic nozzle. It also shows the connector pin orientation of the sensor. If nuisance trips of the sensor are occurring, follow the steps below to correct the situation:

When power is supplied to the device, a warm-up period is initiated. During this period, the right-most green LED is lit and turned off as each LED to the left is successively lit until the left-most red LED is lit. The warm-up period may take up

to 30 seconds. When some flow is detected but not enough for machine operation, a red LED at the far left will be illuminated. With increasing flow, successive red LEDs illuminate. When the switch determines flow is present, the amber LED illuminates indicating the output has closed. **This is not an indication of minimum flow.** Increasing flow above the amber LED output indication illuminates the first green LED. Each successive green LED indicates greater flow. The switch closure does not indicate minimum flow for the machine. With one green LED lit, minor fluctuations in water flow may cause nuisance alarms. Additional green LEDs indicate higher flow rates, and can avoid the nuisance alarms. Refer to Fig. 37.

1. Check to confirm that all strainers are clean, valves are open and pumps are running. For the case of VFD controlled pumps, ensure that the minimum speed setting has not been changed.
2. Measure the pressure drop across the cooler and using Appendix E on pages 95-100, calculate the cooler flow and compare this to the system requirements.
3. If the measured flow rate through the cooler agrees with the system requirements. At least 2 green LEDs should be lit.
4. If the contacts do not close while two green LEDs are lit, verify operation of the flow switch relay. Without changing fluid flow through the cooler, check for power at the flow switch relay (FSR) coil. If power is not present, check continuity of flow sensor cable. If the sensor cable is not shorted or open when correct flow has been confirmed and the green sensor LEDs are lit, the sensor has failed and must be replaced.

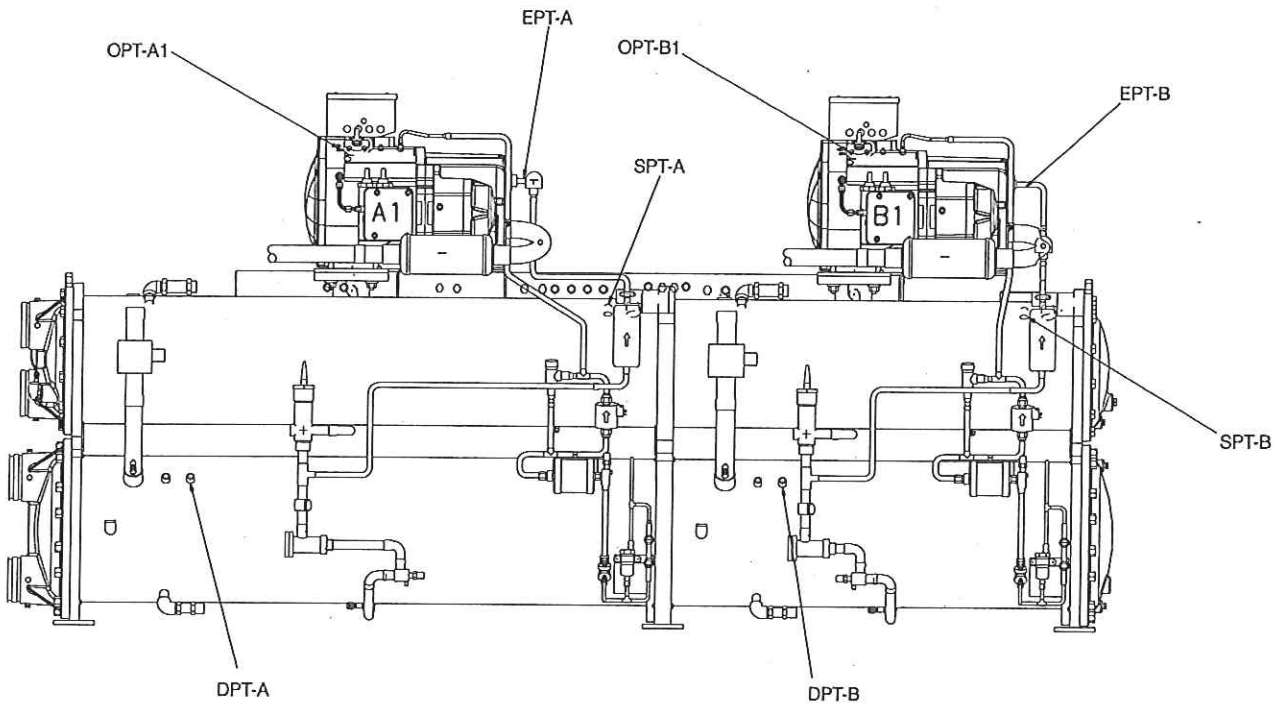


Fig. 35A — 30HX Pressure Transducer Locations (2-Compressor Unit)

LEGEND FOR FIG. 35A-35C

- DPT — Discharge Pressure Transducer
- EPT — Economizer Pressure Transducer
- EXV — Electronic Expansion Valve
- OPT — Oil Pressure Transducer
- SPT — Suction Pressure Transducer

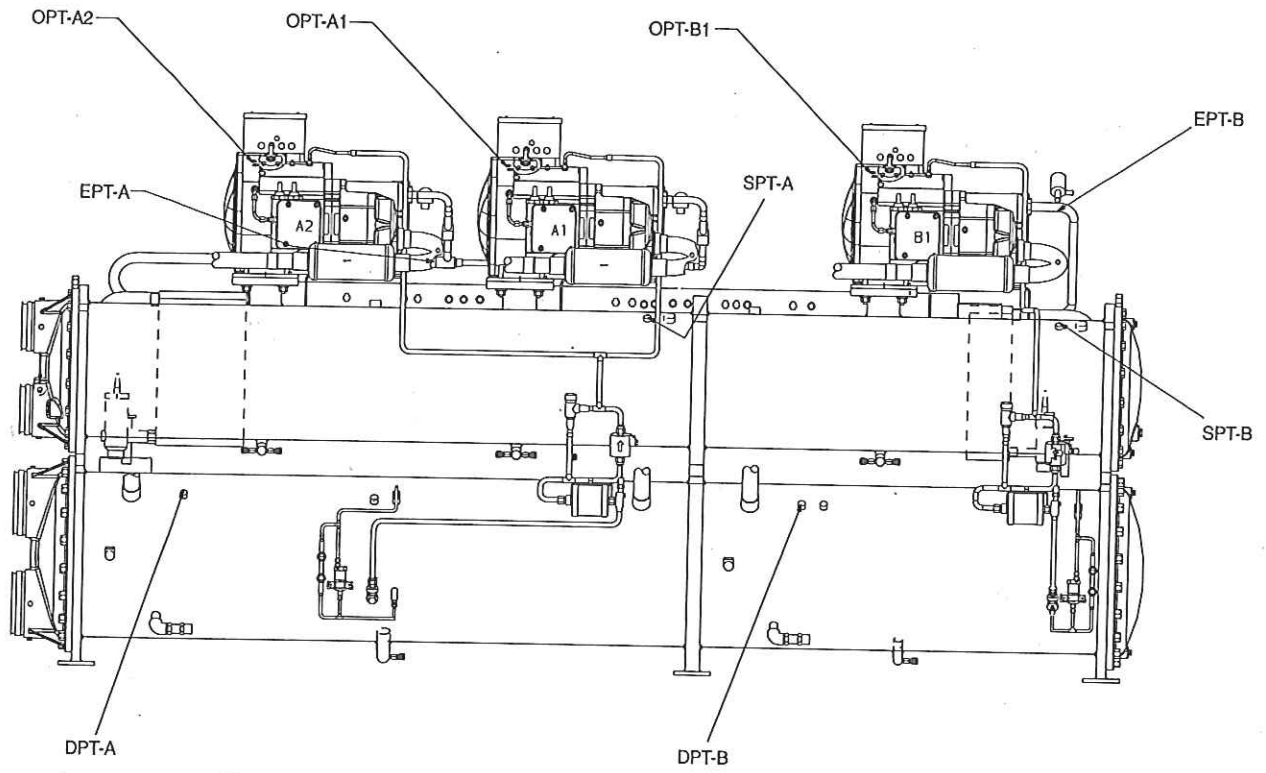


Fig. 35B — 30HX Pressure Transducer Locations (3-Compressor Unit)



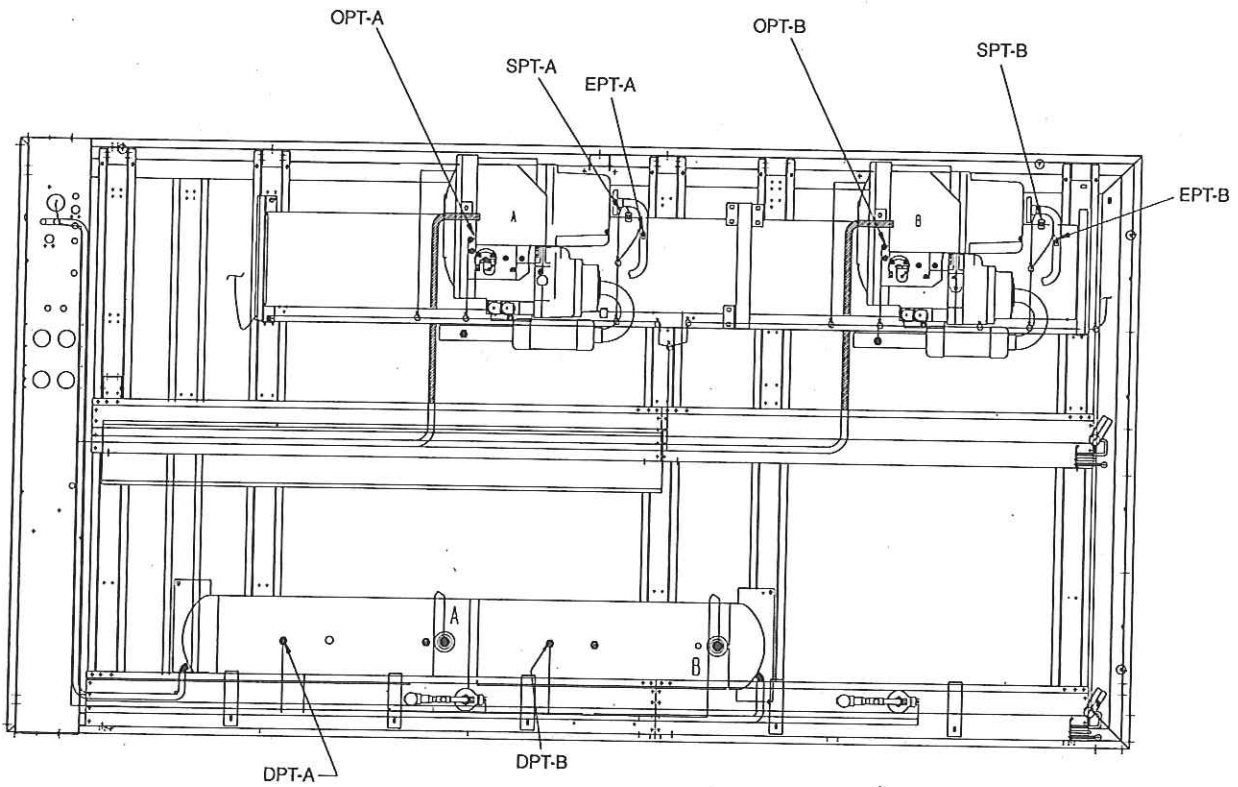



Fig. 35C — 30GXN,R Pressure Transducer Locations (Top View)

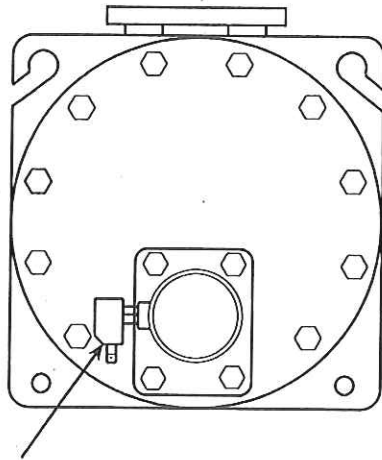

FLOW SWITCH
LOCATION STANDARD 3-PASS
(UNIT SIZES 080-119, 125, 135)*

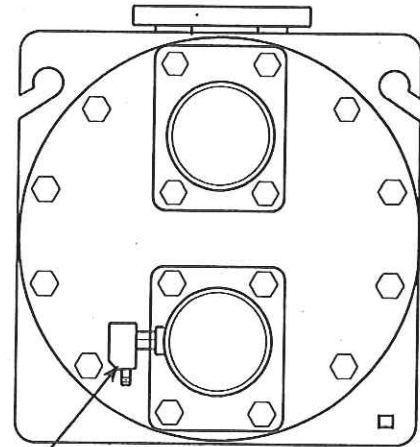

FLOW SWITCH
LOCATION STANDARD 2-PASS
(UNIT SIZES 118, 128, 138-178, 204-350)*

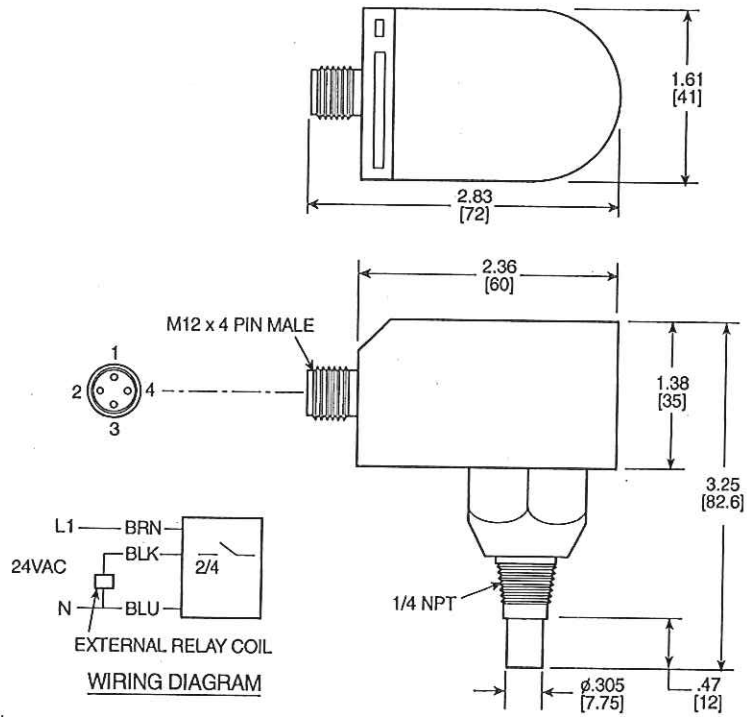

*And associated modular units.

Fig. 36 — 30GXN,R Flow Sensor

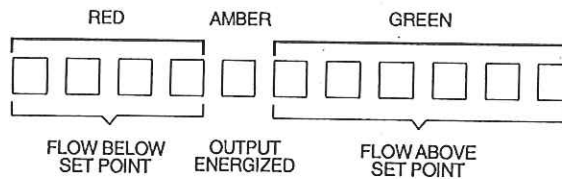


Fig. 37 — Chilled Water Flow Switch LED Display

Safety Devices — The 30GX,HX chillers contain many safety devices and protection logic built into the electronic control. Following is a description of the major safeties.

COMPRESSOR PROTECTION

Motor Overload — The compressor protection modules (CCP) protect each compressor against overcurrent. Do not bypass the current transducers or make any changes to the factory-installed and configured 8-pin headers. The configuration of these headers defines the Must Trip Amps (MTA) at which the CCP will turn the compressors off. Determine the cause for trouble and correct the problem before resetting the CCP. See Appendix A for setting of MTAs and configuration headers.

Each CCP board also reads the status of each compressor's high-pressure switch. All compressors have factory-installed high-pressure switches. See Table 41.

Table 41 — High-pressure Switch Settings

UNIT	SWITCH SETTING	
	psig	kPa
30GX	303 ±7	2089 ±48
30HXA	275 ±7	1896 ±48
30HXC	191 ±7	1317 ±48

If the switch opens during operation, the compressor will be shut down. The CCP will reset automatically when the switch closes, however, a manual reset is required to restart the compressor.

OIL SEPARATOR HEATERS (30GX) — Each oil separator circuit has a heater mounted on the underside of the vessel. The heater is energized with control circuit power. Oil heaters are energized when the discharge gas temperature falls below 105 F (40.6 C). The heaters are deenergized when the discharge gas temperature rises above 110 F (43.3 C). The control will allow the chiller to attempt to start with the heaters energized and will keep the heaters on, even when running, until the discharge gas temperature reaches 110 F (43.3 C). Note that the oil heaters are deenergized if the oil level switch is open.

COOLER PROTECTION

Low Water Temperature — Microprocessor is programmed to shut the chiller down if the leaving fluid temperature drops below 34 F (1.1 C) for water or more than 8° F (4.4° C) below set point for brine units. When the fluid temperature rises 6° F (3.3° C) above the leaving fluid set point, the safety resets and the chiller restarts. Reset is automatic as long as this is the first occurrence of the day.

IMPORTANT: If the unit is installed in an area where ambient temperatures fall below 32 F (0° C), cooler heaters and inhibited ethylene glycol or other suitable solution must be used in the chilled fluid circuit.

Relief Devices — Fusible plugs are located in each circuit (30GXN,R only) between the condenser and the liquid line shutoff valve.

PRESSURE RELIEF VALVES — Valves are installed in each circuit and are located on all coolers. One relief valve is also installed on each 30HXC condenser. Both circuits' oil separators on 30GXN,R and 30HXA units have factory-installed relief valves as well. These valves are designed to relieve if an abnormal pressure condition arises. Relief valves on all coolers and 30HXC condensers relieve at 220 psi (1517 kPa). Relief valves on 30GXN,R and 30HXA oil separators relieve at 320 psi (2206 kPa). All 30HXA, HXC units with factory-installed suction service valves also have a relief valve in each compressor discharge line. These valves are designed to relieve at 350 psig (2413 kPa). These valves should not be capped. If a valve relieves, it should be replaced. If the valve is

not replaced, it may relieve at a lower pressure, or leak due to trapped dirt from the system which may prevent resealing.

Pressure relief valves located on cooler and condenser shells and 30HXA oil separator shells have 3/4-in. NPT connections for relief. The 30GXN,R oil separators have 1/2-in. male flare connections. Some local building codes require that relieved gases be removed. This connection allows conformance to this requirement.

Control Modules

▲ CAUTION

Turn controller power off before servicing controls. This ensures safety and prevents damage to controller.

MAIN BASE BOARD (MBB), SCREW COMPRESSOR BOARD (SCB), EXPANSION VALVE BOARD (EXV), ENERGY MANAGEMENT MODULE (EMM), COMFORTLINK™ COMPRESSOR PROTECTION BOARDS (CCP) AND THE NAVIGATOR — All of the ComfortLink modules perform continuous diagnostic evaluations of the condition of the hardware. Proper operation and communication of these modules is indicated by LEDs on the surface of each module (all except the Navigator that displays 'Communication Failure' when it occurs).

RED LED — All module red LEDs will blink in unison at a 1 to 2 second rate when communicating and functioning properly. Lighted continuously indicates a problem requiring replacement of module. Off continuously indicates power should be checked. If there is no input power, check fuses. If fuse is bad, check for shorted secondary of transformer, tripped circuit breaker or bad module. An LED blinking at a rate of twice per second indicates potential loss of program. The suspect board(s) should be downloaded using the SmartLoader program. If this is not successful, the module should be replaced.

GREEN LED — Each module has a green LED that should always be blinking when power is on. Each module's green LED will be blinking at different rates. This is a normal condition. If the green LED is not blinking, check the red LED. If the red LED is normal, verify that all communication connections (J3 for MBB, J3/J4 for SCB, EXV, EMM and J10/J11 for CCP1 and CCP2) are correct. If wiring is correct, check the Main Base Board instance jumper (should be set to '1'). The EXV, EMM and SCB module address switches should all be set to ON. For CCP1, switch 1 should be On and switches 2, 3 and 4 should be Off. For CCP2, switches 1,3 and 4 should be On and switch 2 should be Off. Remote terminal strip (TB3) connections are made to the Main Base Board at plug MBB-J5.

YELLOW LED — The Main Base Board (MBB) has a yellow LED. This light will blink whenever CCN (Carrier Comfort Network) communications are in progress. Only the MBB is designed to communicate on the CCN bus. All other modules (including the Navigator) are designed to communicate only on the LEN bus.

The majority of the system operating intelligence resides in the MBB, however each individual module does have its own operating software. The machine operator communicates with the MBB through the Navigator. Communications between all modules is accomplished by a 3-wire sensor bus called the Local Equipment Network (LEN). These 3 wires run in parallel from module to module.

For all models, control modules are powered by 24 vac power sources protected by circuit breakers. Separate power sources are used for the CCP modules. Refer to the 24-v wiring schematic located on the chiller for detailed information. Refer to Table 42 for control troubleshooting information.

Table 42 — Compressor Control Troubleshooting

SYMPTOMS	CAUSE	REMEDY
COMPRESSOR DOES NOT RUN	Power line open Control fuse open High-Pressure Switch (HPS) tripped Loose terminal connection Improperly wired controls Low line voltage Compressor motor defective Seized compressor Pre-lubrication not successful	Check main disconnect. Check control circuit for ground or short. Replace fuse. Use Navigator to reset current alarms. Check connections from CCP to contactor Check wiring and rewire. Check line voltage. Determine location of voltage drop and remedy deficiency. Check motor winding for open or short. Replace compressor if necessary. Replace compressor. Check oil pump operation, oil pressure transducer, verify oil solenoid valve operation.
COMPRESSOR CYCLES OFF ON LOW SATURATED SUCTION TEMPERATURE	Loss of charge Bad transducer Low refrigerant charge Failed expansion device Partially plugged or plugged strainer	Repair leak and recharge. Replace transducer. Add refrigerant. Repair/replace as needed. Remove and clean strainer.
COMPRESSOR SHUTS DOWN ON HIGH PRESSURE CONTROL	High-pressure switch erratic in action Compressor discharge valve partially closed Condenser fan(s) not operating (air cooled units) Condenser coil plugged or dirty (air cooled units) Condenser water valve not operating (water cooled units) Circuit overcharged	Replace switch. Open valve or replace if defective. Check wiring. Repair or replace motor(s) if defective. Clean coil. Check wiring. Repair or replace valve if defective. Clean condenser.
UNIT OPERATES LONG OR CONTINUOUSLY	Low refrigerant charge Control contacts fused Partially plugged or plugged strainer Defective insulation Service load exceeding design capacity Inefficient compressor	Add refrigerant. Replace control. Clean or replace. Replace or repair. Evaluate load requirements. Check loader solenoid valves. Replace if necessary.
SYSTEM NOISES	Piping vibration Expansion valve hissing Compressor noisy	Support piping as required. Add refrigerant. Check for plugged liquid line strainer. Replace compressor (worn bearings). Check for loose compressor bolts securing compressor to cooler.
COMPRESSOR LOSES OIL	Leak in system Mechanical damage to rotors	Find and repair leak. Replace compressor.
HOT LIQUID LINE	Shortage of refrigerant due to leak	Repair leak and recharge.
FROSTED LIQUID LINE	Shutoff valve partially closed or restricted	Open valve or remove restriction.
COMPRESSOR LOADERS NOT WORKING PROPERLY	Burned out coil Defective loader solenoid valve Miswired solenoid	Replace coil. Replace valve. Rewire correctly.

Carrier Comfort Network (CCN) Interface —

The 30GX,HX chiller units can be connected to the CCN if desired. The communication bus wiring is a shielded, 3-conductor cable with drain wire and is supplied and installed in the field. The system elements are connected to the communication bus in a daisy chain arrangement. The positive pin of each system element communication connector must be wired to the positive pins of each system element. Wiring connections for CCN can be made at terminal block TB3. There are four terminals (including shield) located at TB3 for permanent CCN connection. For temporary CCN connection to the chiller, there is also an RJ-11 (6 position, 6 conductor) connector. The connector is for field connection of a laptop computer running Service Tool or ComfortVIEW™ software programs. Consult CCN Contractor's Manual for further information.

NOTE: Conductors and drain wire must be 20 AWG (American Wire Gage) minimum stranded, tinned copper. Individual conductors must be insulated with PVC, PVC/nylon, vinyl, Teflon, or polyethylene. An aluminum/polyester 100% foil shield and an outer jacket of PVC, PVC/nylon, chrome vinyl, or Teflon with a minimum operating temperature range of -20 C to 60 C is required. Wire manufactured by Alpha (2413 or 5463), American (A22503), Belden (8772), or Columbia (02525) meets the above mentioned requirements.

It is important when connecting to a CCN communication bus that a color coding scheme be used for the entire network to simplify the installation. It is recommended that red be used for the signal positive, black for the signal negative, and white for the signal ground. Use a similar scheme for cables containing different colored wires.

At each system element, the shields of its communication bus cables must be tied together. If the communication bus is entirely within one building, the resulting continuous shield must be connected to a ground at one point only. If the communication bus cable exits from one building and enters another, the shields must be connected to grounds at the lightning suppressor in each building where the cable enters or exits the building (one point per building only).

IMPORTANT: A shorted CCN bus cable will prevent some routines from running and may prevent the unit from starting. If abnormal conditions occur, disconnect the CCN bus. If conditions return to normal, check the CCN connections and cable. Run new cable if necessary. A short in one section of the bus can cause problems with all system elements on the bus.

Replacing Defective Modules — The *ComfortLink™* replacement modules are shown in Table 43. The unit model and serial numbers are printed on the unit nameplate located on an exterior corner post (30GX) or the corner of the control box (30HX). The basic software and unit configuration data is factory installed by Carrier in the replacement module. Therefore, when ordering any replacement module, specify the replacement part number (located on each module front or back), full unit model number and serial number. The replacement modules will be downloaded with the basic software. If the Main Base Board (MBB) has been replaced, verify that all configuration data is correct. Follow the Configuration mode table and verify that all items under sub-modes UNIT, OPT1 and OPT2 are correct. Any additional field installed accessories or options (sub-mode RSET,SLCT) should also be verified.

Table 43 — Replacement Module Part Number

MODULE	REPLACEMENT PART NUMBER (With Software)	REPLACEMENT PART NUMBER (Without Software)
Main Base Board (MBB)	30GX506748	HK50AA029
Expansion Valve Board (EXV)	30HX515217	HK50AA026
Screw Compressor Board (SCB)	30HX501316	HK50AA032
Navigator Display	HK50AA033	N/A
Energy Management Module (EMM)	30HX515218	HK50AA028
ComfortLink™ Compressor Protection Boards (CCP1, CCP2)	HN67LM103	N/A

Refer to the Start-Up Checklist for 30GXN,GXR,HX Liquid Chillers (completed at time of original start-up) found in the job folder. This information is needed later in this procedure. If the checklist does not exist, fill out the current information in the Configuration mode on a new checklist. Tailor the various options and configurations as needed for this particular installation.

⚠ CAUTION

Electrical shock can cause personal injury. Disconnect all electrical power before servicing.

1. Check that all power to unit is off. Carefully disconnect all wires from the defective module by unplugging its connectors. Remove the screw securing the communication drain wire (CCP modules only). Save the screws.
2. Remove the defective module by removing its mounting screws with a Phillips screwdriver, and removing the module from the control box. Save the screws later use. For Navigator replacement, remove the screw securing the cable clamp near TB3.
3. Verify that the instance jumper (MBB) or address switches (all other modules) exactly match the settings of the defective module.
4. Package the defective module in the carton of the new module for return to Carrier.
5. Mount the new module in the unit's control box using a Phillips screwdriver and the screws saved in Step 2.
6. Reinstall all module connectors and communication drain wire (CCP modules only). For Navigator replacement, make sure the plug is installed at TB3 in the LEN connector.
7. Carefully check all wiring connections before restoring power.
8. Verify the Enable/Off/Remote Contact switch is in the OFF position.
9. Restore control power. Verify that all module red LEDs blink in unison. Verify that all green LEDs are blinking and that the Navigator is communicating correctly.
10. Verify all configuration information, settings, setpoints and schedules. Return the Enable/Off/Remote Contact switch to normal operation position.

Winter Shutdown Preparation — At the end of each cooling season the fluid should be drained from the system. However, due to the cooler circuiting, some fluid will remain in the cooler after draining. To prevent freeze-up damage to the cooler tubes perform the following procedure.

1. If cooler heaters have been installed, deenergize the heaters to prevent damage and possible safety hazards

when draining, or when there is no liquid in the system. Remove Fuse 1 to deenergize the heaters. Drain the fluid from the system.

2. Isolate the cooler from the rest of the system with water shut off valves.
3. Completely fill the cooler with an appropriate amount of inhibited ethylene glycol solution (or other suitable corrosion-inhibitive antifreeze) for 15° F (8.3° C) below the expected low ambient conditions (5 gallon [19 L] minimum).
4. Leave the cooler filled with the antifreeze solution for the winter, or drain if desired. Be sure to deenergize heaters (if installed) as explained in Step 1 to prevent damage. Use an approved method of disposal when removing the antifreeze solution.
5. Update item W.DNE *Winterization Performed* (Configuration Mode, Sub-mode SERV) to YES. Winterization is complete.

Maintenance

RECOMMENDED MAINTENANCE SCHEDULE — The following are only recommended guidelines. Job site conditions may dictate that maintenance schedules be performed more frequently than listed here.

ROUTINE (as conditions dictate)

30GX machines with E-coat condenser coils:

- Check condenser coils for debris, clean as necessary
- Periodic clean water rinse, especially in coastal and industrial applications.

MONTHLY

30GX machines with E-coat Condenser Coils:

- Check condenser coils for debris, clean as necessary
- Coil cleaning with Carrier approved coil cleaner.

EVERY 3 MONTHS

All machines:

- Check all refrigerant joints and valves for refrigerant leaks, repair as necessary.
- Check moisture indicating sight glass for possible refrigerant loss and presence of moisture.
- Check oil filter pressure drops, replace as necessary.
- Check chilled water flow switch operation.

30GX machines:

- Check condenser coils for debris, clean as necessary.
- Check condenser fan operation.

YEARLY:

All machines:

- Check all electrical connections. Tighten as necessary.
- Check accuracy of all transducers for each circuit, replace as necessary.
- Check accuracy of thermistors, replace if greater than ± 2° F (1.2° C) variance from calibrated thermometer.
- Obtain and test an oil sample, change as necessary.
- Clean cooler tubes if appropriate.
- Check to be sure that the proper concentration of antifreeze is present in the chilled water loop.
- Check to be sure that the proper amount of inhibitor is present in the chilled water loop.
- Check all refrigerant strainers and filter driers for pressure drops, replace/clean as necessary
- Check chilled water strainers, clean as necessary

30GX machines:

- Check cooler heater operation
- Check condenser fan blades to insure they are securely fastened to the motor shaft and their condition.

30HXC machines:

- Check Condenser Water Regulating Valve operation, if equipped.
- Clean condenser tubes if appropriate.
- Check condenser water strainers, clean as necessary

PRE-START-UP PROCEDURE

IMPORTANT: Before beginning Pre-Start-Up or Start-Up, complete the Start-Up Checklist for the 30GX,HX Liquid Chillers on pages CL-1 to CL-10. This Checklist assures proper start-up of the chiller, and provides a record of unit condition, application requirements, system information and operation at initial start-up. The checklist should be removed from the manual and kept with the job file for future reference.

IMPORTANT: DO NOT ATTEMPT TO START THE CHILLER UNTIL THE FOLLOWING CHECKS HAVE BEEN COMPLETED.

⚠ CAUTION

DO NOT make any changes to the factory-installed compressor power wiring in the control box or at the compressor junction box. Doing so will cause permanent damage to the compressor and will require compressor replacement. Proper phasing has already been checked at the factory.

System Check

1. Check all auxiliary components such as the chilled fluid circulating pump, air-handling equipment, or other equipment to which the chiller supplies liquid. Consult the manufacturer's instructions. If the unit has field-installed accessories, be sure all are properly installed and wired correctly. Refer to the unit wiring diagrams.
2. Check the cooler flow switch for proper operation (item 'FLOW', Inputs mode under sub-mode GEN.I). Ensure sensor contacts close when the pump is on and open when the pump is turned off. A flow switch is factory installed on all models with two or more pass coolers. For single pass cooler models, the flow switch is factory supplied for field installation with factory-supplied victaulic nozzles.
3. Open the discharge and liquid valves in each circuit. Both shutoff valves are in-line ball type and are open when stem is parallel with the refrigerant flow.
4. If factory-installed suction service valves are installed, open the suction service valves in each circuit. Service valve is located below the compressor in the cooler suction connection flange. To operate the valve, first remove the cap. Use a back-up wrench on the packing gland to prevent loosening while removing cap. Loosen the jam nut. Rotating the valve handle clockwise will close valve and counterclockwise will open valve. When closing the valve, the linkage arm must swing past center of the actuator shaft cam to seat and prevent accidental opening of the valve. Tighten the jam nut. See Fig. 38 and 39.
5. Before filling the system with fluid following a winter shutdown, check the chilled water loop for pressure. Higher than atmospheric pressure could be the result of a refrigerant leak in the cooler.
6. Open the oil shutoff valves located by the oil pre-filter, and the ball valve to each compressor.
7. Check the tightness of all electrical connections. Check incoming power supply for proper nameplate voltage.

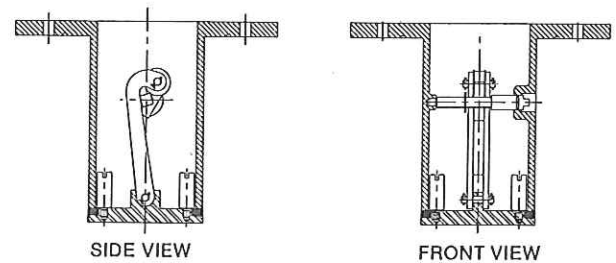


Fig. 38 — Suction Valve Detail

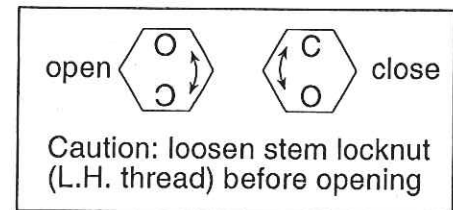
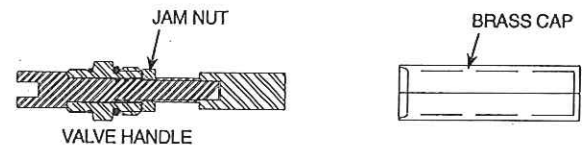


Fig. 39 — Suction Valve Handle Details

8. Check to ensure the unit is level per the installation instructions.
9. Check all field configuration data and set points.
10. Enter correct date, time, and operating schedule(s).
11. Verify operation of solenoids, pumps, valves, compressors, fans, etc. as listed in the Start-Up Checklist.
12. Open condenser water valves. Check condenser water pump for proper operation (30HXC).

START-UP AND OPERATION

Actual Start-Up — Actual start-up should be done only under supervision of a qualified refrigeration mechanic and qualified Carrier Comfort Network personnel.

1. Set leaving fluid temperature. No cooling range adjustment is necessary.
2. Start chilled fluid pump and condenser pump (30HXC) if not controlled by unit.
3. Switch Enable/Off/Remote Contact switch to Enable or Remote Contact.
4. Provided there is a load on the chiller, allow the machine to operate and confirm that everything is functioning properly. Verify that the leaving fluid temperature agrees with the cooling set point (1 or 2), or if reset is being used, the modified set point. Chiller is controlling to the Control Point (item 'CTPT') displayed on the Navigator.

Operating Sequence — The chiller is started by switching the Enable/Off/Remote Contact switch to either Enable or Remote Contact position. If cooler pump control is enabled, the cooler pump is started. If condenser pump control (30HXC) is enabled, the condenser pump is started. On a command for cooling, the oil pump is turned on to start the pre-lubrication process. After 20 seconds, the oil solenoid is opened and the control reads the oil pressure from the transducer and determines if sufficient pressure has been built up. If there is not sufficient pressure, an alarm is generated after the second attempt and the compressor is not started.

Upon building pressure, the compressor is allowed to start (after 15 seconds). For across-the-line (XL) start chillers, the compressor starts and comes up to full speed within 1 to 3 seconds. For Wye-Delta start chillers, contactors 1M and S (starter

contactor assembly) are closed and the compressor is started in a Wye configuration. This method reduces the locked rotor current requirements by approximately 60% while maintaining enough torque to bring the compressor up to full speed.

FIELD WIRING

Field wiring is shown in Fig. 40-54.

LEGEND FOR FIG. 40-54

- ALM — Alarm
- CFR — Condenser Fan Relay
- CMP — Chiller Water Pump
- CNFS — Condenser Flow Switch
- CNPI — Condenser Pump Interlock
- CNP-R — Condenser Pump Relay
- CWP — Chilled Water Pump
- EMM — Energy Management Module
- EWT — Entering Water Thermistor
- FIOP — Factory-Installed Option
- FSR — Flow Switch Relay
- FU — Fuse
- GFI-CO — Ground Fault Interrupter Convenience Outlet
- GND — Ground
- LLSV — Liquid Line Solenoid Valve
- LWT — Leaving Water Thermistor
- MBB — Main Base Board
- MLV — Minimum Load Valve
- NEC — National Electrical Code
- OAT — Outdoor-Air Thermistor
- SCB — Screw Compressor Board
- SPT — Space Temperature Sensor
- SW — Switch
- TB — Terminal Block
- Field-Wired
- Factory Wired

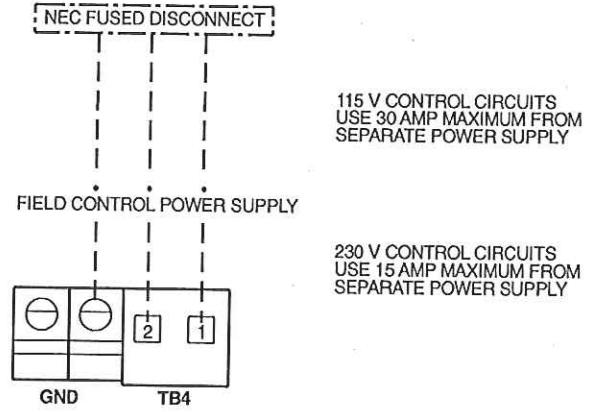


Fig. 40 — Power Supply Wiring

* Dependant on control circuit power supply voltage.

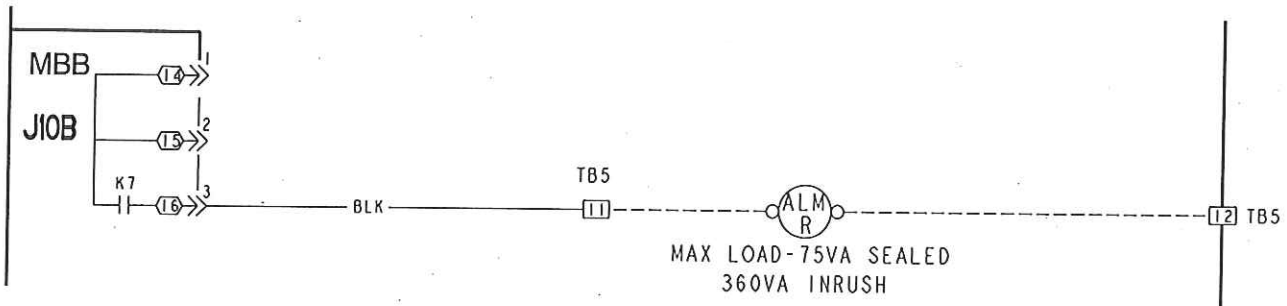


Fig. 41 — Remote Alarm Relay Accessory Wiring; All Models, 115 or 230 V*

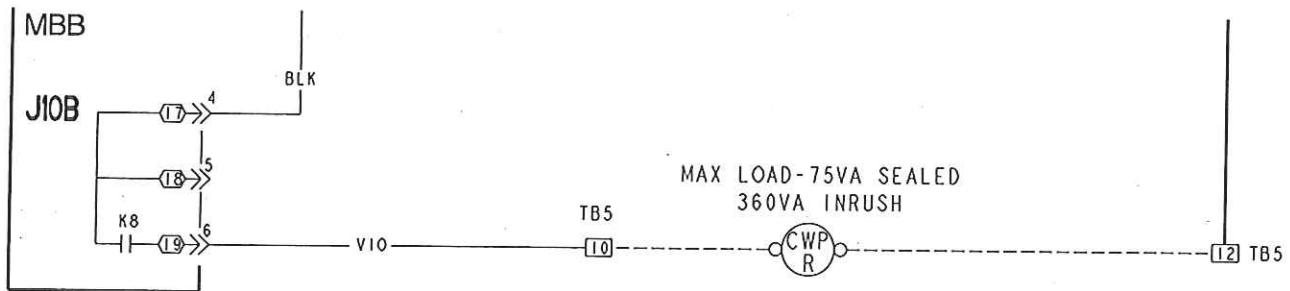


Fig. 42 — Chilled Water Pump Relay Wiring; All Models, 115 or 230 V*

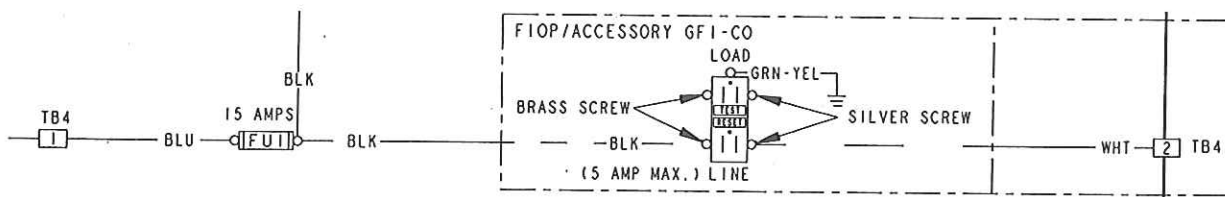


Fig. 43 — Optional Ground Fault Interrupter; Convenience Outlet Accessory Wiring

MAIN BASE BOARD

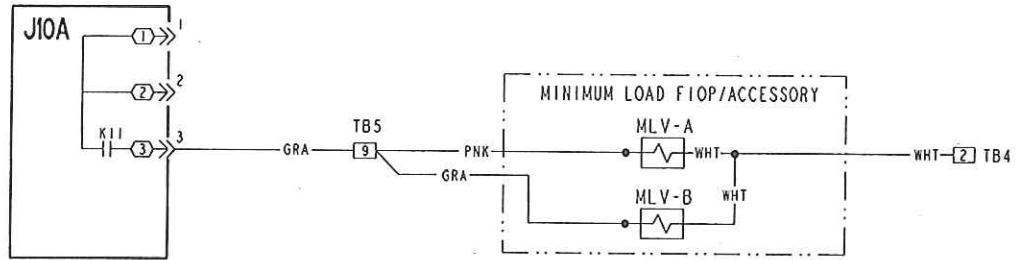


Fig. 44A — 30GXN,R Minimum Load Valve Accessory Wiring, 115 or 230 V*

MAIN BASE BOARD

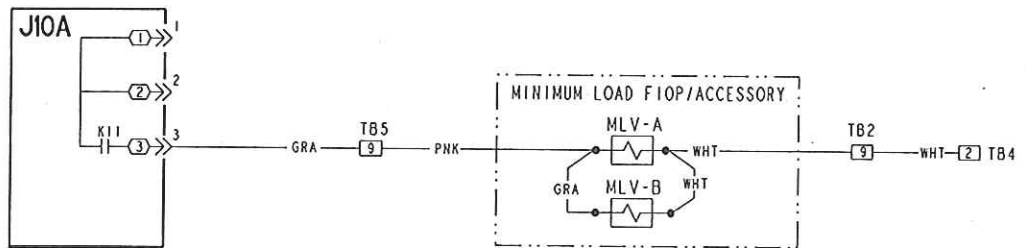


Fig. 44B — 30HX Minimum Load Valve Accessory Wiring, 115 or 230 V*

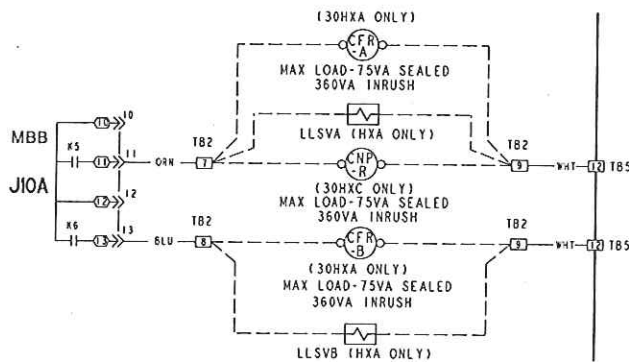


Fig. 45 — Condenser Pump Relay Wiring; 30HXC and Remote Condenser Fan/Liquid Line Solenoid Valve Wiring; 30HXA 115 or 230 V*

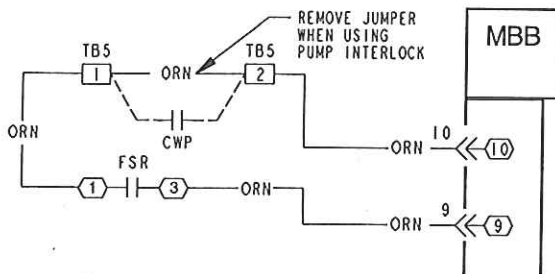


Fig. 46 — Chilled Water Interlock and Flow Switch Input Wiring

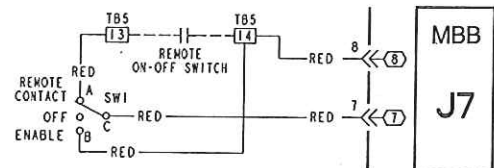


Fig. 47 — Remote On/Off Switch Input Wiring

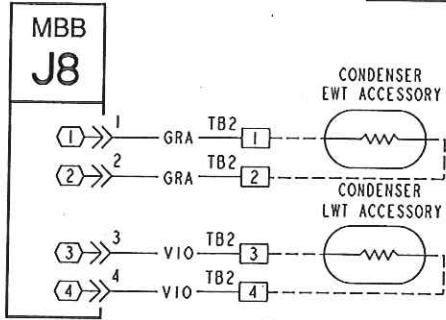
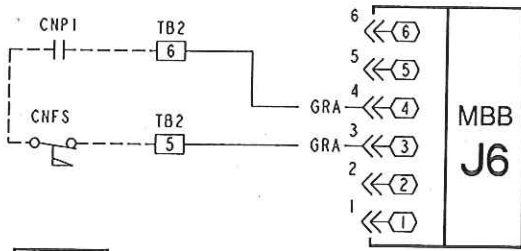


Fig. 48 — Condenser Flow Switch Interlock and Entering/Leaving Water Thermistor Wiring; 30HXC Units

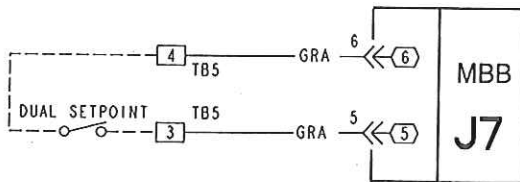


Fig. 49 — Remote Dual Setpoint Wiring; All Units

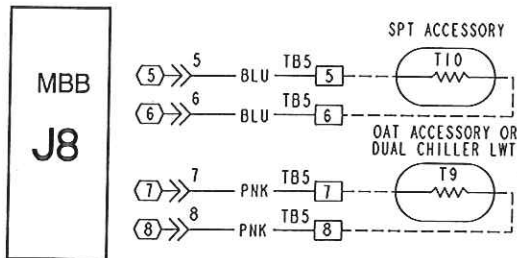


Fig. 50 — Outdoor-Air Thermistor (5KΩ at 77 F [25 C]) and Space Temperature Sensor (10KΩ at 77 F [25 C]) All Units, Field Supplied


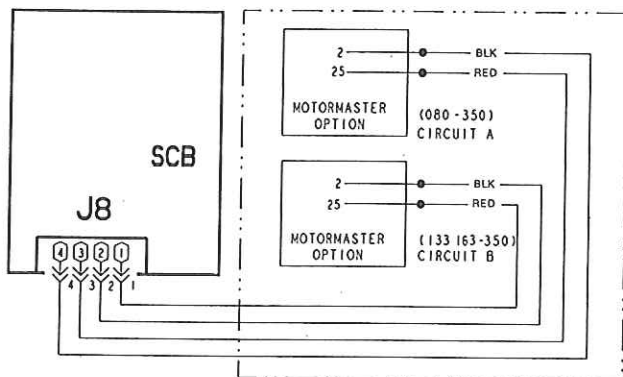


Fig. 51 — Motormaster® Option; 30GXN,R Units

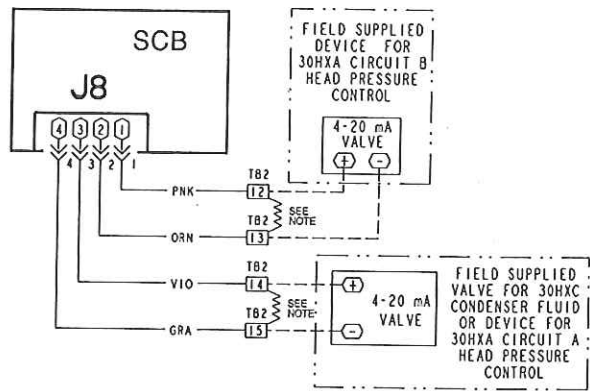

NOTE: Install a 500 Ω resistor across output terminals to convert output signal to 2-10 vdc.

Fig. 52 — Field-Supplied Head Pressure Device Wiring; 30HX Units



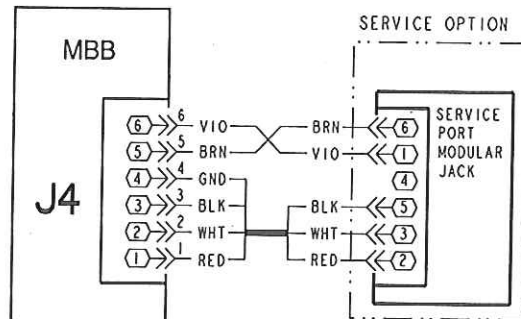


Fig. 53 — Service Port Option or Accessory Wiring; 30GX Units

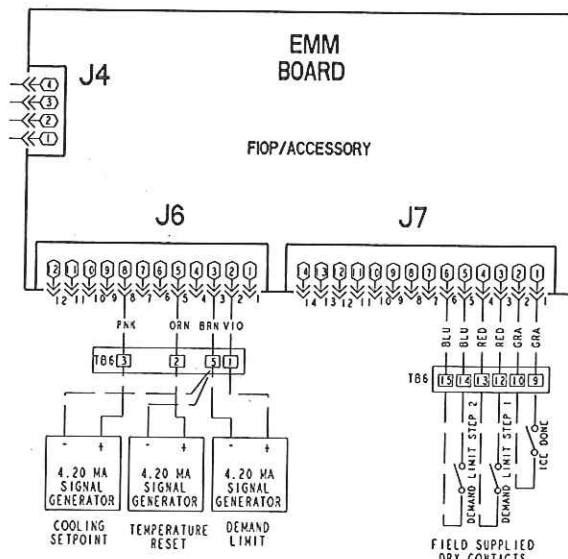

NOTE: Use signal converter for input types other than 4-20 mA.

Fig. 54 — Energy Management Module Option or Accessory Wiring; All Units

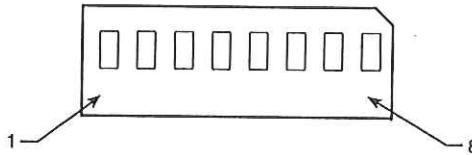

APPENDIX A

30GXN,R (High Ambient Data [Position 10 in model no. equal to 'A', 'F', 'T', or 'V'], All Models)
ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
080	575-60	1,2,3,5,8	—	1,2,3,4,8	—	94	—	78	—
	380-60	1,2,4,8	—	1,2,4,5,6,8	—	142	—	118	—
	230-60	1,3,6	—	1,3,4,5	—	232	—	192	—
	208/230-60	1,4,6,7,8	—	1,3,5,6,8	—	258	—	214	—
	460-60	1,2,4,5,6,7	—	1,2,3,5	—	116	—	96	—
	230-50	1,4,5,6	—	1,3,4,8	—	248	—	206	—
083	380/415-50	1,2,5,6,8	—	1,2,4,5,7	—	150	—	124	—
	575-60	1,2,3,5,6,7	—	1,2,3,4,6,8	—	84	—	70	—
	380-60	1,2,4,5	—	1,2,3,7	—	128	—	108	—
	230-60	1,3,5,6,7	—	1,2	—	212	—	176	—
	208/230-60	1,3,7,8	—	1,3,4,6,7	—	234	—	196	—
	460-60	1,2,3,7,8	—	1,2,3,5,6	—	106	—	88	—
090	230-50	1,3,5	—	1,3,4,5,6,8	—	224	—	182	—
	380/415-50	1,2,4,6,8	—	1,2,3,8	—	134	—	110	—
	575-60	1,2,4,5,6,7	—	1,2,3,4,8	—	116	—	78	—
	380-60	1,2	—	1,2,4,5,6,8	—	176	—	118	—
	230-60	1,5	—	1,3,4,5	—	288	—	192	—
	208/230-60	2,3,4,5,7,8	—	1,3,5,6,8	—	314	—	214	—
093	460-60	1,2,4	—	1,2,3,5	—	144	—	96	—
	230-50	2,3,4,5,6,7	—	1,3,4,8	—	308	—	206	—
	380/415-50	1,3,4,5,7,8	—	1,2,4,5,7	—	186	—	124	—
	575-60	1,2,3,6	—	1,2,3,4,6,8	—	104	—	70	—
	380-60	1,2,5,8	—	1,2,3,7	—	158	—	108	—
	230-60	1,4,6,7	—	1,2	—	260	—	176	—
106	208/230-60	1,5	—	1,3,4,6,7	—	288	—	196	—
	460-60	1,2,4,6,7,8	—	1,2,3,5,6	—	130	—	88	—
	230-50	1,4,7	—	1,3,4,5,6,8	—	268	—	182	—
	380/415-50	1,2,6,7,8	—	1,2,3,8	—	162	—	110	—
	575-60	1,2,4,7	—	1,2,3,4,8	—	140	—	78	—
	380-60	1,3,5,6,7	—	1,2,4,5,6,8	—	212	—	118	—
108	230-60	2,3,5,7	—	1,3,4,5	—	348	—	192	—
	208/230-60	2,4,5	—	1,3,5,6,8	—	384	—	214	—
	460-60	1,2,8	—	1,2,3,5	—	174	—	96	—
	230-50	2,4,5,6,7	—	1,3,4,8	—	372	—	206	—
	380/415-50	1,3,5	—	1,2,4,5,7	—	224	—	124	—
	575-60	1,2,4,5	—	1,2,3,5,6	—	128	—	88	—
114	380-60	1,3,4,6,7,8	—	1,2,4,6,7	—	194	—	132	—
	230-60	2,3,4,5	—	1,3,5,7	—	320	—	220	—
	208/230-60	2,3,6,7,8	—	1,4,5,6,7	—	354	—	244	—
	460-60	1,2,5	—	1,2,3,8	—	160	—	110	—
	230-50	2,3,4,6,7	—	1,3,6,7	—	324	—	228	—
	380/415-50	1,3,4,7,8	—	1,2,4,7,8	—	202	—	138	—
118	575-60	1,2,4,7	—	1,2,3,5,8	—	140	—	94	—
	380-60	1,3,5,6,7	—	1,2,4,8	—	212	—	142	—
	230-60	2,3,5,7	—	1,3,6	—	348	—	232	—
	208/230-60	2,4,5	—	1,4,6,7,8	—	384	—	258	—
	460-60	1,2,8	—	1,2,4,5,6,7	—	174	—	116	—
	230-50	1,2,4,5	—	1,2,3,6	—	128	—	104	—
118	380-60	1,3,4,6,7,8	—	1,2,5,8	—	194	—	158	—
	230-60	2,3,4,5	—	1,4,6,8	—	320	—	262	—
	208/230-60	2,3,6,7,8	—	1,5	—	354	—	288	—
	460-60	1,2,5	—	1,2,4,6,7,8	—	160	—	130	—
	230-50	2,3,4,6,7	—	1,5,6,8	—	324	—	278	—
	380/415-50	1,3,4,7,8	—	1,2,6	—	202	—	168	—

APPENDIX A (cont)

30GXN,R (High Ambient Data [Position 10 In model no. equal to 'A', 'F', 'T', or 'V'], All Models)

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
125	575-60	1,2,5,7,8	—	1,2,3,7	—	154	—	108	—
	380-60	1,3,7,8	—	1,2,6,7	—	234	—	164	—
	230-60	2,4,6,7	—	1,4,7	—	388	—	268	—
	208/230-60	2,7	—	1,7,8	—	428	—	298	—
	460-60	1,3,4,6,7,8	—	1,2,4,6,8	—	194	—	134	—
	230-50	2,4,8	—	1,5,6,7	—	398	—	276	—
	380/415-50	1,3	—	1,2,6,8	—	240	—	166	—
128	575-60	1,2,5,7,8	—	1,2,3,6	—	154	—	104	—
	380-60	1,3,7,8	—	1,2,5,8	—	234	—	158	—
	230-60	2,4,6,7	—	1,4,6,8	—	388	—	262	—
	208/230-60	2,7	—	1,5	—	428	—	288	—
	460-60	1,3,4,6,7,8	—	1,2,4,6,7,8	—	194	—	130	—
	230-50	2,4,8	—	1,5,6,8	—	398	—	278	—
	380/415-50	1,3	—	1,2,6	—	240	—	168	—
135, 390B	575-60	1,2,5,7,8	—	1,2,4,5	—	154	—	128	—
	380-60	1,3,7,8	—	1,3,4,6,7,8	—	234	—	194	—
	230-60	2,4,6,7	—	2,3,4,5	—	388	—	320	—
	208/230-60	2,7	—	2,3,6,7,8	—	428	—	354	—
	460-60	1,3,4,6,7,8	—	1,2,5	—	194	—	160	—
	230-50	2,4,8	—	2,3,4,6,7	—	398	—	324	—
	380/415-50	1,3	—	1,3,4,7,8	—	240	—	202	—
138, 283B, 303B, 373B	575-60	1,2,5,7,8	—	1,2,4,5	—	154	—	128	—
	380-60	1,3,7,8	—	1,3,4,6,7,8	—	234	—	194	—
	230-60	2,4,6,7	—	2,3,4,5	—	388	—	320	—
	208/230-60	2,7	—	2,3,6,7,8	—	428	—	354	—
	460-60	1,3,4,6,7,8	—	1,2,5	—	194	—	160	—
	230-50	2,4,8	—	2,3,4,6,7	—	398	—	324	—
	380/415-50	1,3	—	1,3,4,7,8	—	240	—	202	—
150, 370B	575-60	1,2,4,5	—	1,3,4,5,7	—	128	—	188	—
	380-60	1,3,4,6,7,8	—	1,5,8	—	194	—	286	—
	230-60	2,3,4,5	—	3,5,6	—	320	—	472	—
	208/230-60	2,3,6,7,8	—	4,7,8	—	354	—	522	—
	460-60	1,2,5	—	1,3,7	—	160	—	236	—
	230-50	2,3,5,7	—	2,5,6,7	—	348	—	404	—
	380/415-50	1,3,5,6,7,8	—	1,4,5,6,8	—	210	—	246	—
153, 283A, 328B, 393B, 418B	575-60	1,3,4,5,7	—	1,2,4,5	—	188	—	128	—
	380-60	1,5,8	—	1,3,4,6,7,8	—	286	—	194	—
	230-60	3,5,6	—	2,3,4,5	—	472	—	320	—
	208/230-60	4,7,8	—	2,3,6,7,8	—	522	—	354	—
	460-60	1,3,7	—	1,2,5	—	236	—	160	—
	230-50	3,6,7	—	2,3,5,7	—	484	—	348	—
	380/415-50	1,6,8	—	1,3,5,6,7,8	—	294	—	210	—
160, 415B	575-60	1,2,5,7,8	—	1,3,4,5,7	—	154	—	188	—
	380-60	1,3,7,8	—	1,5,8	—	234	—	286	—
	230-60	2,4,6,7	—	3,5,6	—	388	—	472	—
	208/230-60	2,7	—	4,7,8	—	428	—	522	—
	460-60	1,3,4,6,7,8	—	1,3,7	—	194	—	236	—
	230-50	2,4,8	—	3,6	—	398	—	488	—
	380/415-50	1,3	—	1,6,8	—	240	—	294	—
163, 303A	575-60	1,3,4,5,7	—	1,2,5,7,8	—	188	—	154	—
	380-60	1,5,8	—	1,3,7,8	—	286	—	234	—
	230-60	3,5,6	—	2,4,6,7	—	472	—	388	—
	208/230-60	4,7,8	—	2,7	—	522	—	428	—
	460-60	1,3,7	—	1,3,4,6,7,8	—	236	—	194	—
	230-50	3,6,7	—	2,4,8	—	484	—	398	—
	380/415-50	1,6,8	—	1,3	—	294	—	240	—
174	575-60	1,3,4,5,7	—	1,3,4,5,7	—	188	—	188	—
	380-60	1,5,8	—	1,5,8	—	286	—	286	—
	230-60	3,5,6	—	3,5,6	—	472	—	472	—
	208/230-60	4,7,8	—	4,7,8	—	522	—	522	—
	460-60	1,3,7	—	1,3,7	—	236	—	236	—

APPENDIX A (cont)

30GXN,R (High Ambient Data [Position 10 in model no. equal to 'A', 'F', 'T', or 'V'], All Models)

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
178, 328A, 353A, 353B	575-60	1,3,4,5,7	—	1,3,4,5,7	—	188	—	188	—
	380-60	1,5,8	—	1,5,8	—	286	—	286	—
	230-60	3,5,6	—	3,5,6	—	472	—	472	—
	208/230-60	4,7,8	—	4,7,8	—	522	—	522	—
	460-60	1,3,7	—	1,3,7	—	236	—	236	—
	230-50	3,6,7	—	3,6,7	—	484	—	484	—
	380/415-50	1,6,8	—	1,6,8	—	294	—	294	—
204	575-60	1,3,4,5,7	1,2,3,5,7,8	1,2,5,7,8	—	188	90	154	—
	380-60	1,5,8	1,2,4,6	1,3,7,8	—	286	136	234	—
	230-60	3,5,6	1,3,6,7	2,4,6,7	—	472	228	388	—
	208/230-60	4,7,8	1,4,5,7	2,7	—	522	252	428	—
	460-60	1,3,7	1,2,4,5,6,7,8	1,3,4,6,7,8	—	236	114	194	—
208	575-60	1,2,5,7,8	1,2,5,7,8	1,2,4,5	—	154	154	128	—
	380-60	1,3,7,8	1,3,7,8	1,3,4,6,7,8	—	234	234	194	—
	230-60	2,4,6,7	2,4,6,7	2,3,4,5	—	388	388	320	—
	208/230-60	2,7	2,7	2,3,6,7,8	—	428	428	354	—
	460-60	1,3,4,6,7,8	1,3,4,6,7,8	1,2,5	—	194	194	160	—
	230-50	2,4,8	2,4,8	2,3,5,7	—	398	398	348	—
	380/415-50	1,3	1,3	1,3,5,6,7,8	—	240	240	210	—
225, 370A, 450A/B, 475B	575-60	1,3,4,5,7	1,2,3,7	1,3,4,5,7	—	188	108	188	—
	380-60	1,5,8	1,2,6,7	1,5,8	—	286	164	286	—
	230-60	3,5,6	1,4,7	3,5,6	—	472	268	472	—
	208/230-60	4,7,8	1,7,8	4,7,8	—	522	298	522	—
	460-60	1,3,7	1,2,4,6,8	1,3,7	—	236	134	236	—
	230-50	3,6	1,5,6,7	3,6	—	488	276	488	—
	380/415-50	1,6,8	1,2,6,8	1,6,8	—	294	166	294	—
228, 453A/B, 478B	575-60	1,3,4,5,7	1,2,5,7,8	1,2,4,5	—	188	154	128	—
	380-60	1,5,8	1,3,7,8	1,3,4,6,7,8	—	286	234	194	—
	230-60	3,5,6	2,4,6,7	2,3,4,5	—	472	388	320	—
	208/230-60	4,7,8	2,7	2,3,6,7,8	—	522	428	354	—
	460-60	1,3,7	1,3,4,6,7,8	1,2,5	—	236	194	160	—
	230-50	3,6,7	2,4,8	2,3,5,7	—	484	398	348	—
	380/415-50	1,6,8	1,3	1,3,5,6,7,8	—	294	240	210	—
249, 475A, 500A/B	575-60	1,3,4,5,7	1,3,4,5,7	1,2,5,7,8	—	188	188	154	—
	380-60	1,5,8	1,5,8	1,3,7,8	—	286	286	234	—
	230-60	3,5,6	3,5,6	2,4,6,7	—	472	472	388	—
	208/230-60	4,7,8	4,7,8	2,7	—	522	522	428	—
	460-60	1,3,7	1,3,7	1,3,4,6,7,8	—	236	236	194	—
253, 373A, 393A, 478A, 503A, 503B	575-60	1,3,4,5,7	1,3,4,5,7	1,2,5,7,8	—	188	188	154	—
	380-60	1,5,8	1,5,8	1,3,7,8	—	286	286	234	—
	230-60	3,5,6	3,5,6	2,4,6,7	—	472	472	388	—
	208/230-60	4,7,8	4,7,8	2,7	—	522	522	428	—
	460-60	1,3,7	1,3,7	1,3,4,6,7,8	—	236	236	194	—
	230-50	3,6,7	3,6,7	2,4,8	—	484	484	398	—
	380/415-50	1,6,8	1,6,8	1,3	—	294	294	240	—
264, 390A, 415A, 525A/B	575-60	1,3,4,5,7	1,3,4,5,7	1,3,4,5,7	—	188	188	188	—
	380-60	1,5,8	1,5,8	1,5,8	—	286	286	286	—
	230-60	3,5,6	3,5,6	3,5,6	—	472	472	472	—
	208/230-60	4,7,8	4,7,8	4,7,8	—	522	522	522	—
	460-60	1,3,7	1,3,7	1,3,7	—	236	236	236	—
	230-50	3,6	3,6	3,6	—	488	488	488	—
	380/415-50	1,6,8	1,6,8	1,6,8	—	294	294	294	—
268, 418A, 528A, 528B	575-60	1,3,4,5,7	1,3,4,5,7	1,3,4,5,7	—	188	188	188	—
	380-60	1,5,8	1,5,8	1,5,8	—	286	286	286	—
	230-60	3,5,6	3,5,6	3,5,6	—	472	472	472	—
	208/230-60	4,7,8	4,7,8	4,7,8	—	522	522	522	—
	460-60	1,3,7	1,3,7	1,3,7	—	236	236	236	—
	230-50	3,6,7	3,6,7	3,6,7	—	484	484	484	—
	380/415-50	1,6,8	1,6,8	1,6,8	—	294	294	294	—

APPENDIX A (cont)

30GXN,R (High Ambient Data [Position 10 in model no. equal to 'A', 'F', 'T', or 'V'], All Models)
ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
281	575-60	1,3,4,5,7	1,2,3,7	1,3,4,5,7	1,2,3,7	188	108	188	108
	380-60	1,5,8	1,2,6,7	1,5,8	1,2,6,7	286	164	286	164
	460-60	1,3,7	1,2,4,6,8	1,3,7	1,2,4,6,8	236	134	236	134
	380/415-50	1,6,8	1,2,6,8	1,6,8	1,2,6,8	294	166	294	166
301	575-60	1,3,4,5,7	1,2,4,5	1,3,4,5,7	1,2,4,5	188	128	188	128
	380-60	1,5,8	1,3,4,6,7,8	1,5,8	1,3,4,6,7,8	286	194	286	194
	460-60	1,3,7	1,2,5	1,3,7	1,2,5	236	160	236	160
	380/415-50	1,6,8	1,3,4,7,8	1,6,8	1,3,4,7,8	294	202	294	202
325	575-60	1,3,4,5,7	1,2,5,7,8	1,3,4,5,7	1,2,5,7,8	188	154	188	154
	380-60	1,5,8	1,3,7,8	1,5,8	1,3,7,8	286	234	286	234
	460-60	1,3,7	1,3,4,6,7,8	1,3,7	1,3,4,6,7,8	236	194	236	194
	380/415-50	1,6,8	1,3	1,6,8	1,3	294	240	294	240
350	575-60	1,3,4,5,7	1,3,4,5,7	1,3,4,5,7	1,3,4,5,7	188	188	188	188
	380-60	1,5,8	1,5,8	1,5,8	1,5,8	286	286	286	286
	460-60	1,3,7	1,3,7	1,3,7	1,3,7	236	236	236	236
	380/415-50	1,6,8	1,6,8	1,6,8	1,6,8	294	294	294	294

APPENDIX A (cont)

30GXN,R (Reduced Ambient Data [Position 10 in model no. equal to '-', 'E', 'S', or 'U'], Limited Models Only)
ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
080	575-60	1,2,3,5,6	—	1,2,3,4,7,8	—	88	—	74	—
	380-60	1,2,4,6,8	—	1,2,3	—	134	—	112	—
	230-60	1,3,5,7	—	1,3,4,5,6	—	220	—	184	—
	208/230-60	1,4,5,6,7	—	1,3,4,7	—	244	—	204	—
	460-60	1,2,3,8	—	1,2,3,5,7	—	110	—	92	—
	230-50	1,3,8	—	1,3,4,6	—	238	—	200	—
380/415-50	1,2,4	—	1,2,4,5,6	—	144	—	120	—	
083	575-60	1,2,3,4,7,8	—	1,2,3,4,6,7,8	—	74	—	66	—
	380-60	1,2,4,5,6,7,8	—	1,2,3,6,8	—	114	—	102	—
	230-60	1,3,4,5,7	—	1,2,6	—	188	—	168	—
	208/230-60	1,3,4	—	1,3,4,5,7,8	—	208	—	186	—
	460-60	1,2,3,5,8	—	1,2,3,5,6,7	—	94	—	84	—
	230-50	1,3,4,8	—	1,2,7	—	206	—	172	—
380/415-50	1,2,4,5,8	—	1,2,3,6	—	126	—	104	—	
090	575-60	1,2,3	—	1,2,3,4,7,8	—	112	—	74	—
	380-60	1,2,6	—	1,2,3	—	168	—	112	—
	230-60	1,5,6,7	—	1,3,4,5,6	—	276	—	184	—
	208/230-60	2,3,4,5,6,7,8	—	1,3,4,7	—	306	—	204	—
	460-60	1,2,4,7,8	—	1,2,3,5,7	—	138	—	92	—
	230-50	1,6,8	—	1,3,4,6	—	294	—	200	—
380/415-50	1,3,4,5,6,7,8	—	1,2,4,5,6	—	178	—	120	—	
093	575-60	1,2,3,5	—	1,2,3,4,6,7,8	—	96	—	66	—
	380-60	1,2,4	—	1,2,3,6,8	—	144	—	102	—
	230-60	1,3	—	1,2,6	—	240	—	168	—
	208/230-60	1,4,7,8	—	1,3,4,5,7,8	—	266	—	186	—
	460-60	1,2,4,5,6	—	1,2,3,5,6,7	—	120	—	84	—
	230-50	1,4,5,6	—	1,2,7	—	248	—	172	—
380/415-50	1,2,5,6,8	—	1,2,3,6	—	150	—	104	—	
106	575-60	1,2,4,7,8	—	1,2,3,4,7,8	—	138	—	74	—
	380-60	1,3,5,6,7,8	—	1,2,3	—	210	—	112	—
	230-60	2,3,5,6	—	1,3,4,5,6	—	344	—	184	—
	208/230-60	2,4,5,8	—	1,3,4,7	—	382	—	204	—
	460-60	1,2,7	—	1,2,3,5,7	—	172	—	92	—
	230-50	2,3	—	1,3,4,6	—	368	—	200	—
380/415-50	1,3,5,8	—	1,2,4,5,6	—	222	—	120	—	
108	575-60	1,2,4,5,6,8	—	1,2,3,4	—	118	—	80	—
	380-60	1,3,4,5,6,7,8	—	1,2,4,5,6	—	178	—	120	—
	230-60	2,3,4,5,7	—	1,3,4,6	—	316	—	200	—
	208/230-60	2,3,4,6,8	—	1,3,5,8	—	326	—	222	—
	460-60	1,2,5,6,7,8	—	1,2,3,6,7	—	146	—	100	—
	230-50	2,3,4,5,7	—	1,3,4	—	316	—	208	—
380/415-50	1,3,4,5,7,8	—	1,2,4,5,8	—	186	—	126	—	
114	575-60	1,2,4,7,8	—	1,2,3,5,6	—	138	—	88	—
	380-60	1,3,5,6,7,8	—	1,2,4,6,8	—	210	—	134	—
	230-60	2,3,5,6	—	1,3,5,7	—	344	—	220	—
	208/230-60	2,4,5,8	—	1,4,5,6,7	—	382	—	244	—
118	460-60	1,2,7	—	1,2,3,8	—	172	—	110	—
	575-60	1,2,4,5,6,8	—	1,2,3,5,8	—	118	—	94	—
	380-60	1,3,4,5,6,7,8	—	1,2,4,8	—	178	—	142	—
	230-60	2,3,4,5,7	—	1,3,7	—	316	—	236	—
	208/230-60	2,3,4,6,8	—	1,4,6,7	—	326	—	260	—
	460-60	1,2,5,6,7,8	—	1,2,4,5,6,8	—	146	—	118	—
125	230-50	2,3,4,5,7	—	1,4,5,7,8	—	316	—	250	—
	380/415-50	1,3,4,5,7,8	—	1,2,5,6	—	186	—	152	—
	575-60	1,2,5,7,8	—	1,2,3,7,8	—	154	—	106	—
	380-60	1,3,7,8	—	1,2,6,7,8	—	234	—	162	—
	230-60	2,4,6,7	—	1,4,6	—	388	—	264	—
	208/230-60	2,7	—	1,6,8	—	428	—	294	—
125	460-60	1,3,4,6,7,8	—	1,2,4,6,7	—	194	—	132	—
	230-50	2,4,8	—	1,4	—	398	—	272	—
	380/415-50	1,3	—	1,2,6,7	—	240	—	164	—

APPENDIX A (cont)

30GXN,R (Reduced Ambient Data [Position 10 in model no. equal to '-', 'E', 'S', or 'U'], Limited Models Only)
ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30GXN,R	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	PUNCHOUTS FOR COMP B2	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING	COMP B2 MUST TRIP AMPS SETTING
128	575-60	1,2,4,6	—	1,2,3,5,8	—	136	—	94	—
	380-60	1,3,4,7	—	1,2,4,8	—	204	—	142	—
	230-60	2,3,5,6,7,8	—	1,3,7	—	338	—	236	—
	208/230-60	2,4,5,6,8	—	1,4,6,7	—	374	—	260	—
	460-60	1,2,7,8	—	1,2,4,5,6,8	—	170	—	118	—
	230-50	2,3,6,7,8	—	1,4,5,7,8	—	354	—	250	—
	380/415-50	1,3,5,6,8	—	1,2,5,6	—	214	—	152	—
138, 283B, 303B, 373B	575-60	1,2,4,6	—	1,2,4,5,6,8	—	136	—	118	—
	380-60	1,3,4,7	—	1,3,4,5,6,7,8	—	204	—	178	—
	230-60	2,3,5,6,7,8	—	2,3,4,5,7	—	338	—	316	—
	208/230-60	2,4,5,6,8	—	2,3,4,6,8	—	374	—	326	—
	460-60	1,2,7,8	—	1,2,5,6,7,8	—	170	—	146	—
	230-50	2,3,6,7,8	—	2,3,4,5,7	—	354	—	316	—
	380/415-50	1,3,5,6,8	—	1,3,4,5,7,8	—	214	—	186	—
153, 283A, 328B, 393B, 418B	575-60	1,2,7,8	—	1,2,4,5,6,8	—	170	—	118	—
	380-60	1,4,6,7,8	—	1,3,4,5,6,7,8	—	258	—	178	—
	230-60	2,7	—	2,3,4,5,7	—	428	—	316	—
	208/230-60	3,5,6	—	2,3,4,6,8	—	472	—	326	—
	460-60	1,3,5,6,8	—	1,2,5,6,7,8	—	214	—	146	—
	230-50	3,4,5,6	—	2,3,4,5,7	—	440	—	316	—
	380/415-50	1,4,7,8	—	1,3,4,5,7,8	—	266	—	186	—
163, 303A	575-60	1,2,7,8	—	1,2,4,6	—	170	—	136	—
	380-60	1,4,6,7,8	—	1,3,4,7	—	258	—	204	—
	230-60	2,7	—	2,3,5,6,7,8	—	428	—	338	—
	208/230-60	3,5,6	—	2,4,5,6,8	—	472	—	374	—
	460-60	1,3,5,6,8	—	1,2,7,8	—	214	—	170	—
	230-50	3,4,5,6	—	2,3,6,7,8	—	440	—	354	—
	380/415-50	1,4,7,8	—	1,3,5,6,8	—	266	—	214	—
178, 328A, 353A/B	575-60	1,2,7,8	—	1,2,7,8	—	170	—	170	—
	380-60	1,4,6,7,8	—	1,4,6,7,8	—	258	—	258	—
	230-60	2,7	—	2,7	—	428	—	428	—
	208/230-60	3,5,6	—	3,5,6	—	472	—	472	—
	460-60	1,3,5,6,8	—	1,3,5,6,8	—	214	—	214	—
	230-50	3,4,5,6	—	3,4,5,6	—	440	—	440	—
	380/415-50	1,4,7,8	—	1,4,7,8	—	266	—	266	—
208	575-60	1,2,4,6	1,2,4,6	1,2,4,5,6,8	—	136	136	118	—
	380-60	1,3,4,7	1,3,4,7	1,3,4,5,6,7,8	—	204	204	178	—
	230-60	2,3,5,6,7,8	2,3,5,6,7,8	2,3,4,5,7	—	338	338	316	—
	208/230-60	2,4,5,6,8	2,4,5,6,8	2,3,4,6,8	—	374	374	326	—
	460-60	1,2,7,8	1,2,7,8	1,2,5,6,7,8	—	170	170	146	—
	230-50	2,3,6,7,8	2,3,6,7,8	2,3,4,5,7	—	354	354	316	—
	380/415-50	1,3,5,6,8	1,3,5,6,8	1,3,4,5,7,8	—	214	214	186	—
228, 453A/B, 478B	575-60	1,2,7,8	1,2,4,6	1,2,4,5,6,8	—	170	136	118	—
	380-60	1,4,6,7,8	1,3,4,7	1,3,4,5,6,7,8	—	258	204	178	—
	230-60	2,7	2,3,5,6,7,8	2,3,4,5,7	—	428	338	316	—
	208/230-60	3,5,6	2,4,5,6,8	2,3,4,6,8	—	472	374	326	—
	460-60	1,3,5,6,8	1,2,7,8	1,2,5,6,7,8	—	214	170	146	—
	230-50	3,4,5,6	2,3,6,7,8	2,3,4,5,7	—	440	354	316	—
	380/415-50	1,4,7,8	1,3,5,6,8	1,3,4,5,7,8	—	266	214	186	—
253, 373A, 393A, 478A, 503A/B	575-60	1,2,7,8	1,2,7,8	1,2,4,6	—	170	170	136	—
	380-60	1,4,6,7,8	1,4,6,7,8	1,3,4,7	—	258	258	204	—
	230-60	2,7	2,7	2,3,5,6,7,8	—	428	428	338	—
	208/230-60	3,5,6	3,5,6	2,4,5,6,8	—	472	472	374	—
	460-60	1,3,5,6,8	1,3,5,6,8	1,2,7,8	—	214	214	170	—
	230-50	3,4,5,6	3,4,5,6	2,3,6,7,8	—	440	440	354	—
	380/415-50	1,4,7,8	1,4,7,8	1,3,5,6,8	—	266	266	214	—
268, 418A, 528A/B	575-60	1,2,7,8	1,2,7,8	1,2,7,8	—	170	170	170	—
	380-60	1,4,6,7,8	1,4,6,7,8	1,4,6,7,8	—	258	258	258	—
	230-60	2,7	2,7	2,7	—	428	428	428	—
	208/230-60	3,5,6	3,5,6	3,5,6	—	472	472	472	—
	460-60	1,3,5,6,8	1,3,5,6,8	1,3,5,6,8	—	214	214	214	—
	230-50	3,4,5,6	3,4,5,6	3,4,5,6	—	440	440	440	—
	380/415-50	1,4,7,8	1,4,7,8	1,4,7,8	—	266	266	266	—

APPENDIX A (cont)

30HXC Models

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30HXC	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING
076	575-3-60	1,2,3,4,5,6,8	—	1,2,3,4,5,6,8	54	—	54
	380-3-60	1,2,3,5,6,7,8	—	1,2,3,5,6,7,8	82	—	82
	230-3-60	1,2,4,6	—	1,2,4,6	136	—	136
	208/230-3-60	1,2,5,6	—	1,2,5,6	152	—	152
	460-3-60	1,2,3,4,6,7	—	1,2,3,4,6,7	68	—	68
	230-3-50	1,2,4,8	—	1,2,4,8	142	—	142
	380/415-3-50	1,2,3,5,6,8	—	1,2,3,5,6,8	86	—	86
086	575-3-60	1,2,3,4,6,7,8	—	1,2,3,4,6,7,8	66	—	54
	380-3-60	1,2,3,6,7	—	1,2,3,5,6,7,8	100	—	82
	230-3-60	1,2,6,8	—	1,2,4,6	166	—	136
	208/230-3-60	1,3,4,5,6	—	1,2,5,6	184	—	152
	460-3-60	1,2,3,5,6,7,8	—	1,2,3,4,6,7	82	—	68
	230-3-50	1,2,8	—	1,2,4,8	174	—	142
	380/415-3-50	1,2,3,6	—	1,2,3,5,6,8	104	—	86
096	575-3-60	1,2,3,4	—	1,2,3,4,5,6,8	80	—	54
	380-3-60	1,2,4,5,7,8	—	1,2,3,5,6,7,8	122	—	82
	230-3-60	1,3,4,7,8	—	1,2,4,6	202	—	136
	208/230-3-60	1,3,5	—	1,2,5,6	224	—	152
	460-3-60	1,2,3,6,8	—	1,2,3,4,6,7	102	—	68
	230-3-50	1,3,5,6,7,8	—	1,2,4,8	210	—	142
	380/415-3-50	1,2,4,5,8	—	1,2,3,5,6,8	126	—	86
106	575-3-60	1,2,3,6,7,8	—	1,2,3,4,5,6,8	98	—	54
	380-3-60	1,2,5,6,7	—	1,2,3,5,6,7,8	148	—	82
	230-3-60	1,4,5,6,8	—	1,2,4,6	246	—	136
	208/230-3-60	1,4	—	1,2,5,6	272	—	152
	460-3-60	1,2,4,5,7,8	—	1,2,3,4,6,7	122	—	68
	230-3-50	1,4,5,7	—	1,2,4,8	252	—	142
	380/415-3-50	1,2,5,6	—	1,2,3,5,6,8	152	—	86
116	575-3-60	1,2,3,6,7,8	—	1,2,3,4,6,7,8	98	—	66
	380-3-60	1,2,5,6,7	—	1,2,3,6,7	148	—	100
	230-3-60	1,4,5,6,8	—	1,2,6,8	246	—	166
	208/230-3-60	1,4	—	1,3,4,5,6	272	—	184
	460-3-60	1,2,4,5,7,8	—	1,2,3,5,6,7,8	122	—	82
	230-3-50	1,4,5,7	—	1,2,8	252	—	174
	380/415-3-50	1,2,5,6	—	1,2,3,6	152	—	104
126	575-3-60	1,2,3,6,7,8	—	1,2,3,4	98	—	80
	380-3-60	1,2,5,6,7	—	1,2,4,5,7,8	148	—	122
	230-3-60	1,4,5,6,8	—	1,3,4,7,8	246	—	202
	208/230-3-60	1,4	—	1,3,5	272	—	224
	460-3-60	1,2,4,5,7,8	—	1,2,3,6,8	122	—	102
	230-3-50	1,4,5,7	—	1,3,5,6,7,8	252	—	210
	380/415-3-50	1,2,5,6	—	1,2,4,5,8	152	—	126
136	575-3-60	1,2,4,5,6,8	—	1,2,3,4	118	—	80
	380-3-60	1,3,4,5,6,7,8	—	1,2,4,5,7,8	178	—	122
	230-3-60	1,6,8	—	1,3,4,7,8	294	—	202
	208/230-3-60	2,3,4,6,8	—	1,3,5	326	—	224
	460-3-60	1,2,5,6,7,8	—	1,2,3,6,8	146	—	102
	230-3-50	2,3,4,5,6,7,8	—	1,3,5,6,7,8	306	—	210
	380/415-3-50	1,3,4,5,6	—	1,2,4,5,8	184	—	126
146	575-3-60	1,2,4,5,6,8	—	1,2,3,6,7,8	118	—	98
	380-3-60	1,3,4,5,6,7,8	—	1,2,5,6,7	178	—	148
	230-3-60	1,6,8	—	1,4,5,6,7	294	—	244
	208/230-3-60	2,3,4,6,8	—	1,4	326	—	272
	460-3-60	1,2,5,6,7,8	—	1,2,4,5,7,8	146	—	122
	230-3-50	2,3,4,5,6,7,8	—	1,4,5,7	306	—	252
	380/415-3-50	1,3,4,5,6	—	1,2,5,6	184	—	152

APPENDIX A (cont

30HXC Models

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30HXC	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING
161	575-3-60	1,2,4,5	—	1,2,3,5,6	128	—	88
	380-3-60	1,3,4,6,7,8	—	1,2,4,6,8	194	—	134
	230-3-60	2,3,4,5	—	1,3,5,7	320	—	220
	208/230-3-60	2,3,6,7	—	1,4,5,6,7	356	—	244
	460-3-60	1,2,5	—	1,2,3,8	160	—	110
	230-3-50	2,3,4,7,8	—	1,3,6,7,8	330	—	226
	380/415-3-50	1,3,4,6	—	1,2,4,6	200	—	136
171	575-3-60	1,2,3,7,8	—	1,2,4,5	106	—	128
	380-3-60	1,2,6,7,8	—	1,3,4,6,7,8	162	—	194
	230-3-60	1,4,7,8	—	2,3,4,5	266	—	320
	208/230-3-60	1,6	—	2,3,6,7	296	—	356
	460-3-60	1,2,4,6,8	—	1,2,5	134	—	160
	230-3-50	1,4	—	2,3,4,7,8	272	—	330
	380/415-3-50	1,2,6,7	—	1,3,4,6	164	—	200
186	575-3-60	1,2,4,5	—	1,2,4,5	128	—	128
	380-3-60	1,3,4,6,7,8	—	1,3,4,6,7,8	194	—	194
	230-3-60	2,3,4,5	—	2,3,4,5	320	—	320
	208/230-3-60	2,3,6,7	—	2,3,6,7	356	—	356
	460-3-60	1,2,5	—	1,2,5	160	—	160
	230-3-50	2,3,4,7,8	—	2,3,4,7,8	330	—	330
	380/415-3-50	1,3,4,6	—	1,3,4,6	200	—	200
206	575-3-60	1,2,3,7,8	1,2,3,4,5,7	1,2,4,5	106	60	128
	380-3-60	1,2,6,7,8	1,2,3,5,7,8	1,3,4,6,7,8	162	90	194
	230-3-60	1,4,7,8	1,2,5,6,8	2,3,4,5	266	150	320
	208/230-3-60	1,6	1,2,6,8	2,3,6,7	296	166	356
	460-3-60	1,2,4,6,8	1,2,3,4,7,8	1,2,5	134	74	160
	230-3-50	1,4	1,2,5,7,8	2,3,4,7,8	272	154	330
	380/415-3-50	1,2,6,7	1,2,3,5,7	1,3,4,6	164	92	200
246	575-3-60	1,2,4,5	1,2,3,5,6	1,2,4,5	128	88	128
	380-3-60	1,3,4,6,7,8	1,2,4,6,8	1,3,4,6,7,8	194	134	194
	230-3-60	2,3,4,5	1,3,5,7	2,3,4,5	320	220	320
	208/230-3-60	2,3,6,7	1,4,5,6,7	2,3,6,7	356	244	356
	460-3-60	1,2,5	1,2,3,8	1,2,5	160	110	160
	230-3-50	2,3,4,7,8	1,3,6,7,8	2,3,4,7,8	330	226	330
	380/415-3-50	1,3,4,6	1,2,4,6	1,3,4,6	200	136	200
261	575-3-60	1,2,4,5	1,2,3,7,8	1,2,4,5	128	106	128
	380-3-60	1,3,4,6,7,8	1,2,6,7,8	1,3,4,6,7,8	194	162	194
	230-3-60	2,3,4,5	1,4,7,8	2,3,4,5	320	266	320
	208/230-3-60	2,3,6,7	1,6	2,3,6,7	356	296	356
	460-3-60	1,2,5	1,2,4,6,8	1,2,5	160	134	160
	230-3-50	2,3,4,7,8	1,4	2,3,4,7,8	330	272	330
	380/415-3-50	1,3,4,6	1,2,6,7	1,3,4,6	200	164	200
271	575-3-60	1,2,4,5	1,2,4,5	1,2,4,5	128	128	128
	380-3-60	1,3,4,6,7,8	1,3,4,6,7,8	1,3,4,6,7,8	194	194	194
	230-3-60	2,3,4,5	2,3,4,5	2,3,4,5	320	320	320
	208/230-3-60	2,3,6,7	2,3,6,7	2,3,6,7	356	356	356
	460-3-60	1,2,5	1,2,5	1,2,5	160	160	160
	230-3-50	2,3,4,7,8	2,3,4,7,8	2,3,4,7,8	330	330	330
	380/415-3-50	1,3,4,6	1,3,4,6	1,3,4,6	200	200	200

APPENDIX A (cont)

30HXA Models

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30HXA	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMPS SETTING
076	575-3-60	1,2,3,4	—	1,2,3,4	80	—	80
	380-3-60	1,2,4,5,7,8	—	1,2,4,5,7,8	122	—	122
	230-3-60	1,3,4,7,8	—	1,3,4,7,8	202	—	202
	208/230-3-60	1,3,5	—	1,3,5	224	—	224
	460-3-60	1,2,3,6,7	—	1,2,3,6,7	100	—	100
	230-3-50	1,3,5,6,7,8	—	1,3,5,6,7,8	210	—	210
380/415-3-50	1,2,4,5,8	—	1,2,4,5,8	126	—	126	
086	575-3-60	1,2,3,5	—	1,2,3,4	96	—	80
	380-3-60	1,2,5,6,7,8	—	1,2,4,5,7,8	146	—	122
	230-3-60	1,4,5,6,7,8	—	1,3,4,7,8	242	—	202
	208/230-3-60	1,4,7	—	1,3,5	268	—	224
	460-3-60	1,2,4,5,6	—	1,2,3,6,7	120	—	100
	230-3-50	1,4,5,8	—	1,3,5,6,7,8	254	—	210
380/415-3-50	1,2,5,7,8	—	1,2,4,5,8	154	—	126	
096	575-3-60	1,2,4,5,6,8	—	1,2,3,4	118	—	80
	380-3-60	1,3,4,5,6,7,8	—	1,2,4,5,7,8	178	—	122
	230-3-60	1,6,8	—	1,3,4,7,8	294	—	202
	208/230-3-60	2,3,4,6,8	—	1,3,5	326	—	224
	460-3-60	1,2,5,6,7,8	—	1,2,3,6,7	146	—	100
	230-3-50	2,3,4,5,6,7	—	1,3,5,6,7,8	308	—	210
380/415-3-50	1,3,4,5,7,8	—	1,2,4,5,8	186	—	126	
106	575-3-60	1,2,4,8	—	1,2,3,4	142	—	80
	380-3-60	1,3,5,6	—	1,2,4,5,7,8	216	—	122
	230-3-60	2,3,6,8	—	1,3,4,7,8	358	—	202
	208/230-3-60	2,4,8	—	1,3,5	398	—	224
	460-3-60	1,3,4,5,6,7,8	—	1,2,3,6,7	178	—	100
	230-3-50	2,4,5,6,8	—	1,3,5,6,7,8	374	—	210
380/415-3-50	1,3,6,7,8	—	1,2,4,5,8	226	—	126	
116	575-3-60	1,2,4,8	—	1,2,3,5	142	—	96
	380-3-60	1,3,5,6	—	1,2,5,6,7,8	216	—	146
	230-3-60	2,3,6,8	—	1,4,5,6,7,8	358	—	242
	208/230-3-60	2,4,8	—	1,4,7	398	—	268
	460-3-60	1,3,4,5,6,7,8	—	1,2,4,5,6	178	—	120
	230-3-50	2,4,5,6,8	—	1,4,5,8	374	—	254
380/415-3-50	1,3,6,7,8	—	1,2,5,7,8	226	—	154	
126	575-3-60	1,2,4,8	—	1,2,4,5,6,8	142	—	118
	380-3-60	1,3,5,6	—	1,3,4,5,6,7,8	216	—	178
	230-3-60	2,3,6,8	—	1,6,8	358	—	294
	208/230-3-60	2,4,8	—	2,3,4,6,8	398	—	326
	460-3-60	1,3,4,5,6,7,8	—	1,2,5,6,7,8	178	—	146
	230-3-50	2,4,5,6,8	—	2,3,4,5,6,7	374	—	308
380/415-3-50	1,3,6,7,8	—	1,3,4,5,7,8	226	—	186	
136	575-3-60	1,2,8	—	1,2,4,5,6,8	174	—	118
	380-3-60	1,4,6	—	1,3,4,5,6,7,8	264	—	178
	230-3-60	3,4,5,6,7	—	1,6,8	436	—	294
	208/230-3-60	3,6,7	—	2,3,4,6,8	484	—	326
	460-3-60	1,3,5,7,8	—	1,2,5,6,7,8	218	—	146
	230-3-50	3,4,7	—	2,3,4,5,6,7	460	—	308
380/415-3-50	1,5,6,8	—	1,3,4,5,7,8	278	—	186	
146	575-3-60	1,2,8	—	1,2,4,8	174	—	142
	380-3-60	1,4,6	—	1,3,5,6	264	—	216
	230-3-60	3,4,5,6,7	—	2,3,6,8	436	—	358
	208/230-3-60	3,6,7	—	2,4,8	484	—	398
	460-3-60	1,3,5,7,8	—	1,3,4,5,6,7,8	218	—	178
	230-3-50	3,4,7	—	2,4,5,6,8	460	—	374
380/415-3-50	1,5,6,8	—	1,3,6,7,8	278	—	226	

APPENDIX A (cont)

30HXA Models

ComfortLink™ Compressor Protection Module Configuration Header Punch-Outs and Must Trip Amps

UNIT 30HXA	VOLTS-Hz	PUNCHOUTS FOR COMP A1	PUNCHOUTS FOR COMP A2	PUNCHOUTS FOR COMP B1	COMP A1 MUST TRIP AMPS SETTING	COMP A2 MUST TRIP AMPS SETTING	COMP B1 MUST TRIP AMP SETTING
161	575-3-60	1,3,4,6,7	—	1,2,4,6,7	196	—	132
	380-3-60	1,7,8	—	1,3,4,6	298	—	200
	230-3-60	3,7,8	—	2,3,4,7,8	490	—	330
	208/230-3-60	5	—	2,3,8	544	—	366
	460-3-60	1,4,5,6,8	—	1,2,6,8	246	—	166
	230-3-50	4,6,8	—	2,3,5,6,8	518	—	342
	380/415-3-50	2,3,4,5,6	—	1,3,4,8	312	—	206
171	575-3-60	1,2,5	—	1,3,4,6,7	160	—	196
	380-3-60	1,4,5,6,7	—	1,7,8	244	—	298
	230-3-60	2,5,6,7,8	—	3,7,8	402	—	490
	208/230-3-60	3,4,5,8	—	5	446	—	544
	460-3-60	1,3,4,7,8	—	1,4,5,6,8	202	—	246
	230-3-50	2,5	—	4,6,8	416	—	518
	380/415-3-50	1,4,5,7	—	2,3,4,5,6	252	—	312
186	575-3-60	1,3,4,6,7	—	1,3,4,6,7	196	—	196
	380-3-60	1,7,8	—	1,7,8	298	—	298
	230-3-60	3,7,8	—	3,7,8	490	—	490
	208/230-3-60	5	—	5	544	—	544
	460-3-60	1,4,5,6,8	—	1,4,5,6,8	246	—	246
	230-3-50	4,6,8	—	4,6,8	518	—	518
	380/415-3-50	2,3,4,5,6	—	2,3,4,5,6	312	—	312
206	575-3-60	1,2,5	1,2,3,5,7,8	1,3,4,6,7	160	90	196
	380-3-60	1,4,5,6,7	1,2,4,6	1,7,8	244	136	298
	230-3-60	2,5,6,7,8	1,3,6,7,8	3,7,8	402	226	490
	208/230-3-60	3,4,5,8	1,4,5,7	5	446	252	544
	460-3-60	1,3,4,7,8	1,2,4,5,6,7,8	1,4,5,6,8	202	114	246
	230-3-50	2,5	1,3,7	4,6,8	416	236	518
	380/415-3-50	1,4,5,7	1,2,4,8	2,3,4,5,6	252	142	312
246	575-3-60	1,3,4,6,7	1,2,4,6,7	1,3,4,6,7	196	132	196
	380-3-60	1,7,8	1,3,4,6	1,7,8	298	200	298
	230-3-60	3,7,8	2,3,4,7,8	3,7,8	490	330	490
	208/230-3-60	5	2,3,8	5	544	366	544
	460-3-60	1,4,5,6,8	1,2,6,8	1,4,5,6,8	246	166	246
	230-3-50	4,6,8	2,3,5,6,8	4,6,8	518	342	518
	380/415-3-50	2,3,4,5,6	1,3,4,8	2,3,4,5,6	312	206	312
261	575-3-60	1,3,4,6,7	1,2,5	1,3,4,6,7	196	160	196
	380-3-60	1,7,8	1,4,5,6,7	1,7,8	298	244	298
	230-3-60	3,7,8	2,5,6,7,8	3,7,8	490	402	490
	208/230-3-60	5	3,4,5,8	5	544	446	544
	460-3-60	1,4,5,6,8	1,3,4,7,8	1,4,5,6,8	246	202	246
	230-3-50	4,6,8	2,5	4,6,8	518	416	518
	380/415-3-50	2,3,4,5,6	1,4,5,7	2,3,4,5,6	312	252	312
271	575-3-60	1,3,4,6,7	1,3,4,6,7	1,3,4,6,7	196	196	196
	380-3-60	1,7,8	1,7,8	1,7,8	298	298	298
	230-3-60	3,7,8	3,7,8	3,7,8	490	490	490
	208/230-3-60	5	5	5	544	544	544
	460-3-60	1,4,5,6,8	1,4,5,6,8	1,4,5,6,8	246	246	246
	230-3-50	4,6,8	4,6,8	4,6,8	518	518	518
	380/415-3-50	2,3,4,5,6	2,3,4,5,6	2,3,4,5,6	312	312	312

APPENDIX B

Capacity Loading Sequence Example — The following tables show the loading sequence for a 30HX186 (50/50 split) and a 30HX161 (59/41 split) chiller. Each

compressor has 2 loaders. There is no difference in operation between "Staged" and "Equal" circuit loading on 2 compressor chillers.

STANDARD LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 2-COMPRESSOR UNIT)								
STAGE	COMP A1	LOADER A1	LOADER A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (50/50 Split)	% TOTAL CAPACITY (59/41 Split)
0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	20.0	23.5
2	1	1	0	0	0	0	35.0	41.1
3	1	1	1	0	0	0	50.0	58.8
4	1	1	0	1	1	0	70.0	70.0
5	1	1	0	1	1	1	85.0	82.4
6	1	1	1	1	1	1	100.0	100.0

CLOSE CONTROL LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 2-COMPRESSOR UNIT)								
STAGE	COMP A1	LOADER A1	LOADER A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (50/50 Split)	% TOTAL CAPACITY (59/41 Split)
0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	20.0	23.5
2	1	1	0	0	0	0	35.0	41.1
3	1	1	1	0	0	0	50.0	58.8
3A	1	0	0	1	0	0	40.0	40.0
3B	1	0	0	1	1	0	55.0	52.4
4	1	0	0	1	1	1	70.0	64.7
5	1	1	0	1	1	1	85.0	82.4
6	1	1	1	1	1	1	100.0	100.0

LEGEND

0 — Off
1 — On

NOTES:

1. Stage 3A (and 3B for 59/41 split) is not used by the algorithm when increasing stages. Stage 3 (and 2 for a 59/41 split) is not used when decreasing stages.
2. The % Total Capacities above are calculated based on compressor nominal tons. For the case of the 59/41 split above, the 30HX uses compressors with flow rates of 250 and 174 cfm (from compressor model numbers 06N_250 and 06N_174), which represent nominal tons of 80 and 56 (respectively) at 60 Hz. A factor of 40% is used when no loaders are energized, and a factor of 70% is used when Loader 1 is energized. The capacity shown for Stage 3B above is calculated as follows:

$$\% \text{ Total Capacity} = [(0.40 \times 80 + 0.70 \times 56) / (80 + 56)] \times 100\% = 52.4 \%$$

Nominal Tons

COMPRESSOR PART NO.	60 Hz NOM. TONS	50 Hz NOM. TONS
06N_123	39	—
06N_146	46	39
06N_174	56	46
06N_209	66	56
06N_250	80	66
06N_300	—	80

APPENDIX B (cont)

The following tables show the loading sequence for 30HX206 (57/43 split) and 30HX271 (67/33 split) chillers. All compressors

have two loaders and the chillers are configured for *equal circuit loading*. See Note 2.

STANDARD LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 3-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (57/43 Split)	% TOTAL CAPACITY (67/33 Split)
0	0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	0	14.3	13.3
2	1	1	0	0	0	0	0	25.0	23.3
3	1	1	1	0	0	0	0	35.7	33.3
4	1	1	0	0	1	1	0	55.2	46.7
5	1	1	0	0	1	1	1	68.2	56.7
6	1	1	1	0	1	1	1	78.9	66.7
7	1	1	0	1	1	1	1	83.0	80.0
8	1	1	1	1	1	1	1	100.0	100.0

CLOSE CONTROL LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 3-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (57/43 Split)	% TOTAL CAPACITY (67/33 Split)
0	0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	0	14.3	13.3
2	1	1	0	0	0	0	0	25.0	23.3
3	1	1	1	0	0	0	0	35.7	33.3
3A	1	0	0	0	1	0	0	31.6	26.7
4	1	0	0	0	1	1	0	44.5	36.7
5	1	0	0	0	1	1	1	57.5	46.7
6	1	1	0	0	1	1	1	68.2	56.7
7	1	1	1	0	1	1	1	78.9	66.7
7A	1	0	0	1	1	1	1	65.9	60.0
8	1	1	0	1	1	1	1	83.0	80.0
9	1	1	1	1	1	1	1	100.0	100.0

LEGEND

0 — Off
1 — On

NOTES:

1. Stages 3A and 7A are not used by the algorithm when increasing stages. Stages 3 and 7 are not used when decreasing stages.
2. The loading sequence for 30GXN,R204-264 units is the same as those shown for the 30HX206,271 above.

APPENDIX B (cont)

The following tables show the loading sequence for 30HX206 (57/43 split) and 30HX271 (67/33 split) chillers. All compressors have two loaders and the chiller is configured for

staged circuit loading. Loaders A1 on compressors A1 and A2 are energized in parallel. The same is true for Loaders A2 on both compressors A1 and A2. See Note 3.

STANDARD LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 3-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (57/43 Split)	% TOTAL CAPACITY (67/33 Split)
0	0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	0	14.3	13.3
2	1	1	0	0	0	0	0	25.0	23.3
3	1	1	1	0	0	0	0	35.7	33.3
4	1	1	0	1	0	0	0	39.7	46.7
5	1	1	1	1	0	0	0	56.8	66.7
6	1	1	1	1	1	1	0	87.0	90.0
7	1	1	1	1	1	1	1	100.0	100.0

CLOSE CONTROL LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 3-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	% TOTAL CAPACITY (57/43 Split)	% TOTAL CAPACITY (67/33 Split)
0	0	0	0	0	0	0	0	0.0	0.0
1	1	0	0	0	0	0	0	14.3	13.3
2	1	1	0	0	0	0	0	25.0	23.3
3	1	1	1	0	0	0	0	35.7	33.3
3A	1	0	0	1	0	0	0	22.7	26.7
4	1	1	0	1	0	0	0	39.7	46.7
5	1	1	1	1	0	0	0	56.8	66.7
6	1	1	1	1	1	0	0	74.1	80.0
7	1	1	1	1	1	1	0	87.0	90.0
8	1	1	1	1	1	1	1	100.0	100.0

LEGEND

0 — Off
1 — On

NOTES:

1. Stage 3A is not used by the algorithm when increasing stages. Stage 3 is not used by the algorithm when decreasing stages.
2. The % Total Capacities above are calculated based on compressor nominal tons. For the case of the 57/43 split above, the 30HX uses compressors with flow rates of 209, 123, and 250 cfm (from compressor model numbers 06N_209, 06N_123, and 06N_250), which represent nominal tons of 66, 39, and 80 (respectively) at 60 Hz. A factor of 40% is used when no loaders are energized, and a factor of 70% is used when Loader 1 is energized. The capacity shown for Stage 4 above is calculated as follows:

$$\% \text{ Total Capacity} = [(0.70 \times 66 + 0.70 \times 39 + 0.0 \times 80) / (66 + 39 + 80)] \times 100\% = 39.7\%$$
3. The loading sequence for 30GXN,R204-264 units is the same as those shown for the 30HX206, 271 above.

APPENDIX B (cont)

The following tables show the loading sequence for a 30GXN,R350 chiller.
Each compressor has 2 loaders and the chiller is configured for *equal circuit loading*. See Note 2.

STANDARD LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 4-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	COMP B2	% TOTAL CAPACITY (50/50 Split)
0	0	0	0	0	0	0	0	0	0.0
1	1	0	0	0	0	0	0	0	10.0
2	1	1	0	0	0	0	0	0	18.0
3	1	1	1	0	0	0	0	0	25.0
4	1	1	0	0	1	1	0	0	35.0
5	1	1	1	0	1	1	0	0	43.0
6	1	1	1	0	1	1	1	0	50.0
7	1	1	0	1	1	1	1	0	60.0
8	1	1	0	1	1	1	0	1	70.0
9	1	1	1	1	1	1	0	1	85.0
10	1	1	1	1	1	1	1	1	100.0

CLOSE CONTROL LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 4-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	COMP B2	% TOTAL CAPACITY (50/50 Split)
0	0	0	0	0	0	0	0	0	0.0
1	1	0	0	0	0	0	0	0	10.0
2	1	1	0	0	0	0	0	0	18.0
3	1	1	1	0	0	0	0	0	25.0
3A	1	0	0	0	1	0	0	0	20.0
4	1	0	0	0	1	1	0	0	28.0
5	1	1	0	0	1	1	0	0	35.0
6	1	1	1	0	1	1	0	0	43.0
7	1	1	1	0	1	1	1	0	50.0
7A	1	0	0	1	1	1	1	0	45.0
8	1	1	0	1	1	1	1	0	60.0
9	1	1	0	1	1	1	0	1	70.0
10	1	1	1	1	1	1	0	1	85.0
11	1	1	1	1	1	1	1	1	100.0

LEGEND

0 — Off
1 — On

NOTES:

1. Stages 3A and 7A are not used by the algorithm when increasing stages. Stages 3 and 7 are not used by the algorithm when decreasing stages.
2. The loading sequence for 30GXN,R281-325 units is the same as those shown for the 30GXN,R350 above.

APPENDIX B (cont)

The following tables show the loading sequence for a 30GXN,R350 chiller.
Each compressor has 2 loaders and the chillers are configured for *staged circuit loading*. See Note 2.

STANDARD LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 4-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	COMP B2	% TOTAL CAPACITY (50/50 Split)
0	0	0	0	0	0	0	0	0	0.0
1	1	0	0	0	0	0	0	0	10.0
2	1	1	0	0	0	0	0	0	18.0
3	1	1	1	0	0	0	0	0	25.0
4	1	1	0	1	0	0	0	0	35.0
5	1	1	1	1	0	0	0	0	50.0
6	1	1	1	1	1	1	0	0	68.0
7	1	1	1	1	1	1	1	0	75.0
8	1	1	1	1	1	1	0	1	85.0
9	1	1	1	1	1	1	1	1	100.0

CLOSE CONTROL LOADING SEQUENCE (CIRCUIT A LEAD CIRCUIT, 4-COMPRESSOR UNIT)									
STAGE	COMP A1	LOADER A1	LOADER A2	COMP A2	COMP B1	LOADER B1	LOADER B2	COMP B2	% TOTAL CAPACITY (50/50 Split)
0	0	0	0	0	0	0	0	0	0.0
1	1	0	0	0	0	0	0	0	10.0
2	1	1	0	0	0	0	0	0	18.0
3	1	1	1	0	0	0	0	0	25.0
3A	1	0	0	1	0	0	0	0	20.0
4	1	1	0	1	0	0	0	0	35.0
5	1	1	1	1	0	0	0	0	50.0
6	1	1	1	1	1	0	0	0	60.0
7	1	1	1	1	1	1	0	0	68.0
8	1	1	1	1	1	1	1	0	75.0
8A	1	1	1	1	1	0	0	1	70.0
9	1	1	1	1	1	1	0	1	85.0
10	1	1	1	1	1	1	1	1	100.0

LEGEND

0 — Off
1 — On

NOTES:

1. Stages 3A and 8A are not used by the algorithm when increasing stages. Stages 3 and 8 are not used by the algorithm when decreasing stages.
2. The loading sequence for 30GXN,R281-325 units is the same as those shown for the 30GXN,R350 above.

APPENDIX C
Available Accessories

ACCESSORY PART NUMBER	UNITS	DESCRIPTION OF ACCESSORY	COMMENTS
30GX-900---001	30GXN,R080,090*	Condenser Grille Package	
30GX-900---002	30GXN,R083, 093, 106, 108, 114, 125, 135*	Condenser Grille Package	
30GX-900---003	30GXN,R118, 128, 138, 150, 160*	Condenser Grille Package	
30GX-900---013	30GXN,R153, 174, 204, 225*	Condenser Grille Package	
30GX-900---024	30GXN,R163, 178*	Condenser Grille Package	
30GX-900---009	30GXN,R249, 264*	Condenser Grille Package	
30GX-900---010	30GXN,R208, 228*	Condenser Grille Package	
30GX-900---034	30GXN,R253, 268, 281-350	Condenser Grille Package	
30GX-900---048	30GXN,R and 30HX (115 V Control)	Minimum Load Valve	Both circuits
30GX-900---049	30GXN,R and 30HX (230 V Control)	Minimum Load Valve	Both circuits
30GX-900---015	30GXN,R080-350	Sound Enclosure/Hail Guard/Wind Baffle	Header end only
30GX-900---016	30GXN,R080,090*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---017	30GXN,R083, 093, 106, 108, 114, 125, 135*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---018	30GXN,R118, 128, 138, 150, 160*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---019	30GXN,R153, 174, 204, 225*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---020	30GXN,R163, 178, 249, 264*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---030	30GXN,R208, 228*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---039	30GXN,R253, 268, 281-350*	Sound Enclosure/Hail Guard/Wind Baffle	One side per package
30GX-900---023	30GXN,R080-228, 264*	Vibration Isolation Pads	
30GX-900---035	30GXN,R253, 268-350*	Vibration Isolation Pads	
30HX-900---010	30HX All	Vibration Isolation Pads	
30GX-900---027	30GXN,R118,128,138,150,153 (-1P)	Insulation Kit (14", 1-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---032	30GXN,R204-268 (+1P), 30HX206-271 (+1P)	Insulation Kit (18", 3-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---036	30GXN,R281-350 (+1P)	Insulation Kit (20", 3-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---038	30GXN,R281-350 (-1P)	Insulation Kit (20", 1-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---045	30GXN,R303A,390B,415B (STD)	Insulation Kit (16", 1-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---046	30GXN,R204-268 (-1P), 30GXN,R370A,373A,390A,393A,415A,418A, 450A/B, 453A/B,475A/B, 478A/B,500A/B,503A/B, 525A/B,528A/B (STD)	Insulation Kit (18", 1-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---047	30GXN,R283A/B,303B,328A/B, 353A/B,370B,373B,393B,418B (STD)	Insulation Kit (14", 1-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---067	30GXN,R108,125,135 (STD), 30GXN,R160,163,174,178, 30HX161-186 (+1P)	Insulation Kit (16", 3-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---068	30GXN,R118,128,138,150,153 (STD)	Insulation Kit (14", 2-Pass Cooler with Economizer)	Tubesheets and heads
30GX-900---069	30GXN,R118,128,138,150,153 (+1P)	Insulation Kit (14", 3-Pass Cooler, with Economizer)	Tubesheets and heads
30GX-900---070	30GXN,R281-350 (STD)	Insulation Kit (20", 2-Pass Cooler, with Economizer)	Tubesheets and heads
30HX-900---017	30GXN,R080,083,090,093 (+1P), 30HX076-096 (+1P)	Insulation Kit (14", 4-Pass Cooler, no Economizer)	Tubesheets and heads
30HX-900---018	30HX116-146 (-1P)	Insulation Kit (14", 1-Pass Cooler no Economizer)	Tubesheets and heads
30HX-900---020	30GXN,R108,125,135 (+1P)	Insulation Kit (16", 4-Pass Cooler with Economizer)	Tubesheets and heads
30HX-900---021	30GXN,R160-178 (-1P), 30HX161-186 (-1P)	Insulation Kit (16", 1-Pass Cooler with Economizer)	Tubesheets and heads
30HX-900---023	30HX206-271 (-1P)	Insulation Kit (18", 1-Pass Cooler with Economizer)	Tubesheets and heads
30HX-900---024	30GXN,R106,114 (+1P), 30HX106 (+1P)	Insulation Kit (16", 4-Pass Cooler, no Economizer)	Tubesheets and heads

*And associated modular sizes.

LEGEND

- (STD) — Chillers with standard number of cooler passes
- (-1P) — Chillers with minus one pass cooler option
- (+1P) — Chillers with plus one pass cooler option

APPENDIX C (cont)
Available Accessories (cont)

ACCESSORY PART NUMBER	UNITS	DESCRIPTION OF ACCESSORY	COMMENTS
30HX-900---035	30GXN,R080,083,090,093, 30HX076-096 (STD) 30HX116-146 (+1P)	Insulation Kit (14", 3-Pass Cooler, no Economizer)	Tubesheets and heads
30HX-900---036	30GXN,R106,114 (STD) 30HX106 (STD)	Insulation Kit (16", 3-Pass Cooler, no Economizer)	Tubesheets and heads
30HX-900---037	30GXN,R080,083,090,093, 30HX076-096 (-1P), 30HX116-146 (STD)	Insulation Kit (14", 2-Pass Cooler, no Economizer)	Tubesheets and heads
30HX-900---038	30GXN,R108,125,135 (-1P), 30GXN,R160,163,174,178,30HX161-186 (STD)	Insulation Kit (16", 2-Pass Cooler, with Economizer)	Tubesheets and heads
30HX-900---039	30GXN,R204-268 (STD), 30HX206-271 (STD)	Insulation Kit (18", 2-Pass Cooler, with Economizer)	Tubesheets and heads
30HX-900---040	30GXN,R106,114 (-1P), 30HX106 (-1P)	Insulation Kit (16", 2-Pass Cooler, no Economizer)	Tubesheets and heads
30HX-900---001	30HX116-271	Sound Enclosure Panels	
30HX-900---011	30HX076-106	Sound Enclosure Panels	
30HX-900---004	30HX076-146	Victaulic Condenser Connections (18 in.)	
30HX-900---005	30HX161-186	Victaulic Condenser Connections (20 in.)	
30HX-900---015	30HX206-271	Victaulic Condenser Connections (22 in.)	
30HX-900---032	30GXN,R and 30HX All	Energy Management Module	
30HX-900---033	30HX (230 V, 460 V)	Control Transformer	
30HX-900---034	30HX (575 V)	Control Transformer	
30GX-900---050	30GXN,R (230 V, 460 V)	Control Transformer (080-178*)	
30GX-900---051	30GXN,R (575 V)	Control Transformer (080-178*)	
30GX-900---052	30GXN,R (208 V)	Control Transformer (080-178*)	
30GX-900---055	30GXN,R (230 V, 460 V)	Control Transformer (204-350*)	
30GX-900---056	30GXN,R (575 V)	Control Transformer (204-350*)	
30GX-900---057	30GXN,R (208 V)	Control Transformer (204-350*)	
30GX-900---058	30GXN,R220-528 Duplex	Duplex Trim Kit	
30GX-900---071	30GXN,R080-150, 160*	Motormaster® V Control (575 V)	Single controller
30GX-900---072	30GXN,R080-150, 160*	Motormaster V Control (208/230 V)	Single controller
30GX-900---073	30GXN,R080-150,160*	Motormaster V Control (380/460 V)	Single controller
30GX-900---074	30GXN,R153,163-350*	Motormaster V Control (575 V)	Two controllers
30GX-900---075	30GXN,R153,163-350*	Motormaster V Control (208/230 V)	Two controllers
30GX-900---076	30GXN,R153,163-350*	Motormaster V Control (380/460 V)	Two controllers
CEPL130322-02	30GXN,R and 30HX All	Chillervisor System Manager III	
CPNLDLK-01	30GXN,R and 30HX All	DataLink Control Panel	
CPNLDPT-01	30GXN,R and 30HX All	DataPort Control Panel	
CRLIDASY001A00	30GXN,R and 30HX All	Remote Enhanced Display	
30GT-911---049	30GXN,R and 30HX All	GFI Convenience Outlet (60 Hz only)	
30GT-911---057	30GXN,R All	Unit Control Display Window	
30GT-911---063	30GXN,R All	Remote Service Port	

*And associated modular sizes.

LEGEND

- (STD) — Chillers with standard number of cooler passes
- (-1P) — Chillers with minus one pass cooler option
- (+1P) — Chillers with plus one pass cooler option

APPENDIX D

Building Interface — The 30GXN,GXR,HX chiller can be interfaced with multi-vendor control systems through 3 levels of inter-operability using BacLink, DataPort™, or DataLINK™ devices. BacLink functions as a gateway between a CCN and a BACnet system to facilitate the passing of data from the CCN to BACnet. The Carrier DataPort is an interface device that allows other HVAC control systems to “read only” values in system elements connected to a CCN communication bus. The Carrier

DataLINK device is an interface device that allows other HVAC control systems to read and change (“read/write”) values in system elements connected to a CCN bus. Both DataPort and DataLINK devices request data from a specified CCN system element and translate this data into ASCII characters off network. Information from the 30GXN,GXR,HX chiller control to support interface are listed in the following tables.

Object Definitions

30GXN/GXR/HXA/HXC Series 6 with Software Version 1.1 and later								
CCN Table Name	Description	Status	Units	Point	DataPort	DataLink	BACLink	
A_UNIT	GENERAL PARAMETERS							
	Control Mode	0 = Service Test 1 = OFF Local 2 = OFF CCN 3 = OFF Clock 4 = OFF Emergency 5 = ON Local 6 = ON CCN 7 = ON Clock		STAT	RO	RO	RO	
	Occupied	No/Yes		OCC	RO	RO	RO	
	CCN Chiller	Start/Stop		CHIL_S_S	RO	RW	RW	
	Alarm State	Normal/Alert/Alarm		ALM	RO	RO	RO	
	Active Demand Limit	0 to 100	%	DEM_LIM	RO	RW	RW	
	Override Modes In Effect	No/Yes		MODE	RO	RO	NA	
	Percent Total Capacity	0 to 100	%	CAP_T	RO	RO	RO	
	Active Setpoint	-20 to 70 (-28.8 to 21.1)	°F (°C)	SP	RO	RO	NA	
	Control Point	-20 to 70 (-28.8 to 21.1)	°F (°C)	CTRL_PNT	RO	RW	RW	
	Entering Fluid Temp	snnn.n	°F (°C)	EWT	RO	RO	RO	
	Leaving Fluid Temp	snnn.n	°F (°C)	LWT	RO	RO	RO	
	Emergency Stop	Enable/Emstop	°F (°C)	EMSTOP	RO	RW	RW	
	Minutes Left for Start	00:00 to 15:00	Minutes	MIN_LEFT	RO	RO	NA	
	Heat/Cool Select	Heat/Cool		HEATCOOL	RO	RW	RW	
	CIRCADIO	CIRC. A DISCRETE OUTPUTS						
		Compressor A1 Relay	Off/On		K_A1_RLY	RO	RO	RO
Compressor A2 Relay		Off/On		K_A2_RLY	RO	RO	RO	
Loader A1 Relay		Off/On		LOADR_A1	RO	RO	NA	
Loader A2 Relay		Off/On		LOADR_A2	RO	RO	NA	
Minimum Load Valve		Off/On		MLV	RO	RO	NA	
Oil Heater		Off/On		OILA_HTR	RO	RO	NA	
Motor Cooling A1 Solenoid		Off/On		MTRCL_A1	RO	RO	NA	
Motor Cooling A2 Solenoid		Off/On		MTRCL_A2	RO	RO	NA	
Oil Pump		Off/On		OILPMP_A	RO	RO	NA	
Oil Solenoid A1		Off/On		OILSL_A1	RO	RO	NA	
Oil Solenoid A2		Off/On		OILSL_A2	RO	RO	NA	
CIRC. A DISCRETE INPUTS								
Compressor A1 Feedback		Off/On		K_A1_FBK	RO	RO	NA	
Compressor A2 Feedback		Off/On		K_A2_FBK	RO	RO	NA	
Oil Level Switch		Close/Open		OILA_SW	RO	RO	NA	
CIRCA_AN		CIRCUIT A ANALOG VALUES						
	Percent Total Capacity	0 to 100	%	CAPA_T	RO	RO	RO	
	Percent Available Cap.	0 to 100	%	CAPA_A	RO	RO	RO	
	Circuit Running Current	0 to 1200	Amps	A_CURR	RO	RO	NA	
	Discharge Pressure	nnn.n	PSIG (KPA)	DP_A	RO	RO	RO	
	Suction Pressure	nnn.n	PSIG (KPA)	SP_A	RO	RO	RO	
	Economizer Pressure	nnn.n	PSIG (KPA)	ECNP_A	RO	RO	NA	
	Discharge Superheat Temp	snnn.n	°F (°C)	SH_A	RO	RO	RO	
	Discharge Gas Temp	nnn.n	°F (°C)	DISTMP_A	RO	RO	NA	
	Discharge Gas Temp – A1	nnn.n	°F (°C)	DISTMPA1	RO	RO		
	Discharge Gas Temp – A2	nnn.n	°F (°C)	DISTMPA2	RO	RO		
	Saturated Condensing Tmp	snnn.n	°F (°C)	TMP_SCTA	RO	RO	RO	
	Saturated Suction Temp	snnn.n	°F (°C)	TMP_SSTA	RO	RO	RO	
	EXV% Open	0 to 100	%	EXV_A	RO	RO	NA	
	Variable Head Press Pct.	0 to 100	%	VHFA	RO	RO	NA	
	COMP A1 ANALOG VALUES							
	A1 Oil Pressure Diff.	nnn.n	PSIG (KPA)	DOP_A1	RO	RO	NA	
	A1 Oil Pressure	nnn.n	PSIG (KPA)	OP_A1	RO	RO	NA	
	A1 Motor Temperature	nnn.n	°F (°C)	TMTR_A1	RO	RO	NA	
	Comp A1 Running Current	0 to 600	Amps	A1_CURR	RO	RO	NA	
	Comp A1 % Must Trip Amps	0 to 100	%	A1_MTA	RO	RO	NA	
	COMP A2 ANALOG VALUES							
	A2 Oil Pressure Diff.	nnn.n	PSIG (KPA)	DOP_A2	RO	RO	NA	
	A2 Oil Pressure	nnn.n	PSIG (KPA)	OP_A2	RO	RO	NA	
	A2 Motor Temperature	nnn.n	°F (°C)	TMTR_A2	RO	RO	NA	
	Comp A2 Running Current	0 to 600	Amps	A2_CURR	RO	RO	NA	
	Comp A2 % Must Trip Amps	0 to 100	%	A2_MTA	RO	RO	NA	

APPENDIX D (cont)
Object Definitions (cont)

30GXN/GXR/HXA/HXC Series 6 with Software Version 1.1 and later							
CCN Table Name	Description	Status	Units	Point	DataPort	DataLink	BACLink
CIRCBADIO	CIRC. B DISCRETE OUTPUTS						
	Compressor B1 Relay	Off/On		K_B1_RLY	RO	RO	RO
	Compressor B2 Relay	Off/On		K_B2_RLY	RO	RO	RO
	Loader B1 Relay	Off/On		LOADR_B1	RO	RO	NA
	Loader B2 Relay	Off/On		LOADR_B2	RO	RO	NA
	Minimum Load Valve	Off/On		MLV	RO	RO	NA
	Oil Heater	Off/On		OILB_HTR	RO	RO	NA
	Motor Cooling B1 Solenoid	Off/On		MTRCL_B1	RO	RO	NA
	Motor Cooling B2 Solenoid	Off/On		MTRCL_B2	RO	RO	NA
	Oil Pump	Off/On		OILPMP_B	RO	RO	NA
	Oil Solenoid B1	Off/On		OILSL_B1	RO	RO	NA
	Oil Solenoid B2	Off/On		OILSL_B2	RO	RO	NA
	CIRC. B DISCRETE INPUTS						
	Compressor B1 Feedback	Off/On		K_B1_FBK	RO	RO	NA
Compressor B2 Feedback	Off/On		K_B2_FBK	RO	RO	NA	
Oil Level Switch	Close/Open		OILB_SW	RO	RO	NA	
CIRCB_AN	CIRCUIT B ANALOG VALUES						
	Percent Total Capacity	0 to 100	%	CAPB_T	RO	RO	RO
	Percent Available Cap.	0 to 100	%	CAPB_A	RO	RO	RO
	Circuit Running Current	0 to 1200	Amps	B_CURR	RO	RO	NA
	Discharge Pressure	nnn.n	PSIG (KPA)	DP_B	RO	RO	RO
	Suction Pressure	nnn.n	PSIG (KPA)	SP_B	RO	RO	RO
	Economizer Pressure	nnn.n	PSIG (KPA)	ECNP_B	RO	RO	NA
	Discharge Superheat Temp	snnn.n	°F (°C)	SH_B	RO	RO	RO
	Discharge Gas Temp	nnn.n	°F (°C)	DISTMP_B	RO	RO	NA
	Discharge Gas Temp - B1	nnn.n	°F (°C)	DISTMPB1	RO	RO	
	Discharge Gas Temp - B2	nnn.n	°F (°C)	DISTMPB2	RO	RO	
	Saturated Condensing Tmp	snnn.n	°F (°C)	TMP_SCTB	RO	RO	RO
	Saturated Suction Temp	snnn.n	°F (°C)	TMP_SSTB	RO	RO	RO
	EXV% Open	0 to 100	%	EXV_B	RO	RO	NA
	Variable Head Press Pct.	0 to 100	%	VHPB	RO	RO	NA
	COMP B1 ANALOG VALUES						
	B1 Oil Pressure Diff.	nnn.n	PSIG (KPA)	DOP_B1	RO	RO	NA
	B1 Oil Pressure	nnn.n	PSIG (KPA)	OP_B1	RO	RO	NA
	B1 Motor Temperature	nnn.n	°F (°C)	TMTR_B1	RO	RO	NA
	Comp B1 Running Current	0 to 600	Amps	B1_CURR	RO	RO	NA
	Comp B1 % Must Trip Amps	0 to 100	%	B1_MTA	RO	RO	NA
	COMP B2 ANALOG VALUES						
	B2 Oil Pressure Diff.	nnn.n	PSIG (KPA)	DOP_B2	RO	RO	NA
B2 Oil Pressure	nnn.n	PSIG (KPA)	OP_B2	RO	RO	NA	
B2 Motor Temperature	nnn.n	°F (°C)	TMTR_B2	RO	RO	NA	
Comp B2 Running Current	0 to 600	Amps	B2_CURR	RO	RO	NA	
Comp B2 % Must Trip Amps	0 to 100	%	B2_MTA	RO	RO	NA	
OPTIONS	FANS						
	Fan 1 Relay *	Off/On		FAN_1	RO	RO	RO
	Fan 2 Relay †	Off/On		FAN_2	RO	RO	RO
	Fan 3 Relay	Off/On		FAN_3	RO	RO	RO
	Fan 4 Relay	Off/On		FAN_4	RO	RO	RO
	UNIT ANALOG VALUES						
	Cooler Entering Fluid	snnn.n	°F (°C)	COOL_EWT	RO	RO	RO
	Cooler Leaving Fluid	snnn.n	°F (°C)	COOL_LWT	RO	RO	RO
	Condenser Entering Fluid	snnn.n	°F (°C)	COND_EWT	RO	RO	RO
	Condenser Leaving Fluid	snnn.n	°F (°C)	COND_LWT	RO	RO	RO
	Lead/Lag Leaving Fluid	snnn.n	°F (°C)	DUAL_LWT	RO	RO	NA
	TEMPERATURE RESET						
	4-20 mA Reset Signal	nn.n	mA	RST_MA	RO	RO	RO
	Outside Air Temperature	snnn.n	°F (°C)	OAT	RO	RW	NA
	Space Temperature	snnn.n	°F (°C)	SPT	RO	RW	NA
	DEMAND LIMIT						
	4-20 mA Demand Signal	nn.n	mA	LMT_MA	RO	RO	RO
Demand Limit Switch 1	Off/On		DMD_SW1	RO	RO	NA	
Demand Limit Switch 2	Off/On		DMD_SW2	RO	RO	NA	
CCN Loadshed Signal	0 = Normal 1 = Redline 2 = Loadshed		DL_STAT	RO	RO	RO	

APPENDIX D (cont)
Object Definitions (cont)

30GXN/GXR/HXA/HXC Series 6 with Software Version 1.1 and later							
CCN Table Name	Description	Status	Units	Point	DataPort	DataLink	BAClink
OPTIONS (cont)	PUMPS						
	Cooler Pump Relay	Off/On		COOL_PMP	RO	RO	RO
	Condenser Pump Relay	Off/On		COND_PMP	RO	RO	RO
	MISCELLANEOUS						
	Dual Setpoint Switch	Off/On		DUAL_IN	RO	RO	NA
	Cooler Flow Switch	Off/On		COOLFLOW	RO	RO	NA
	Condenser Flow Switch	Off/On		CONDFLOW	RO	RO	NA
	Ice Done	No/Yes		ICE	RO	RO	NA
	Cooler Heater	Off/On		COOL_HTR	RO	RO	NA
	4-20 mA Cooling Setpoint	nn.n	mA	CSP_IN	RO	RO	NA
	4-20 mA Heating Setpoint	nn.n	mA	HSP_IN	RO	RO	NA
	Liq. Line Solenoid Valve	Open/Close		LLSV	RO	RO	NA
	Dual Chiller Size	nnn	Tons	SIZE_DPX	RO	RO	NA
	Dual Chiller Pct Total Cap	0-100	%	CAPT_DPX	RO	RO	NA
Dual Chiller Tons Avail	nnn	Tons	SIZEADPX	RO	RO	NA	
Dual Chiller Pct Avail Cap	0-100	%	CAPA_DPX	RO	RO	NA	
SETPOINT	COOLING						
	Cooling Setpoint 1	-20 to 70 (-28.8 to 21.1)	°F (°C)	CSP1	NA	RW	RW
	Cooling Setpoint 2	-20 to 70 (-28.8 to 21.1)	°F (°C)	CSP2	NA	RW	NA
	ICE Setpoint	-20 to 32 (-28.8 to 0.0)	°F (°C)	CSP3	NA	RW	NA
	HEATING						
	Heating Setpoint 1	80 to 140 (26.7 to 60.0)	°F (°C)	HSP1	NA	RW	RW
	Heating Setpoint 2	80 to 140 (26.7 to 60.0)	°F (°C)	HSP2	NA	RW	NA
	RAMP LOADING						
	Cooling Ramp Loading	0.2 to 2.0 (0.1 to 1.1)		CRAMP	NA	RW	NA
	Heating Ramp Loading	0.2 to 2.0 (0.1 to 1.1)		HRAMP	NA	RW	NA
HEAD PRESSURE							
Head Pressure Setpoint A	80 to 140 (26.7 to 60.0)	°F (°C)	HSP_A	NA	RW	NA	
Head Pressure Setpoint B	80 to 140 (26.7 to 60.0)	°F (°C)	HSP_B	NA	RW	NA	
Approach Setpoint	0.1 to 20.0	°F (°C)	APRCH_SP	NA	RW	NA	
OCCPC01S	Timed Override Hours	0	Hours	OVR-EXT	NA	RW	RW
	Period 1 DOW (MTWTFSSH)	00000000		DOW1	NA	RW	RW
	Occupied Time	00:00		OCCTOD1	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD1	NA	RW	RW
	Period 2 DOW (MTWTFSSH)	00000000		DOW2	NA	RW	RW
	Occupied Time	00:00		OCCTOD2	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD2	NA	RW	RW
	Period 3 DOW (MTWTFSSH)	00000000		DOW3	NA	RW	RW
	Occupied Time	00:00		OCCTOD3	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD3	NA	RW	RW
	Period 4 DOW (MTWTFSSH)	00000000		DOW4	NA	RW	RW
	Occupied Time	00:00		OCCTOD4	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD4	NA	RW	RW
	Period 5 DOW (MTWTFSSH)	00000000		DOW5	NA	RW	RW
	Occupied Time	00:00		OCCTOD5	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD5	NA	RW	RW
	Period 6 DOW (MTWTFSSH)	00000000		DOW6	NA	RW	RW
	Occupied Time	00:00		OCCTOD6	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD6	NA	RW	RW
	Period 7 DOW (MTWTFSSH)	00000000		DOW7	NA	RW	RW
	Occupied Time	00:00		OCCTOD7	NA	RW	RW
	Unoccupied Time	00:00		UNOCTOD7	NA	RW	RW
	Period 8 DOW (MTWTFSSH)	00000000		DOW8	NA	RW	RW
	Occupied Time	00:00		OCCTOD8	NA	RW	RW
Unoccupied Time	00:00		UNOCTOD8	NA	RW	RW	


LEGEND

- °C — Degrees Celsius
- °F — Degrees Fahrenheit
- NA — Not Available
- RO — Read Only
- RW — Read/Write

*Circuit A Condenser Fan Output (30HXA only).
†Circuit B Condenser Fan Output (30HXA only).

APPENDIX E


The following charts list pressure drops for coolers and condensers.

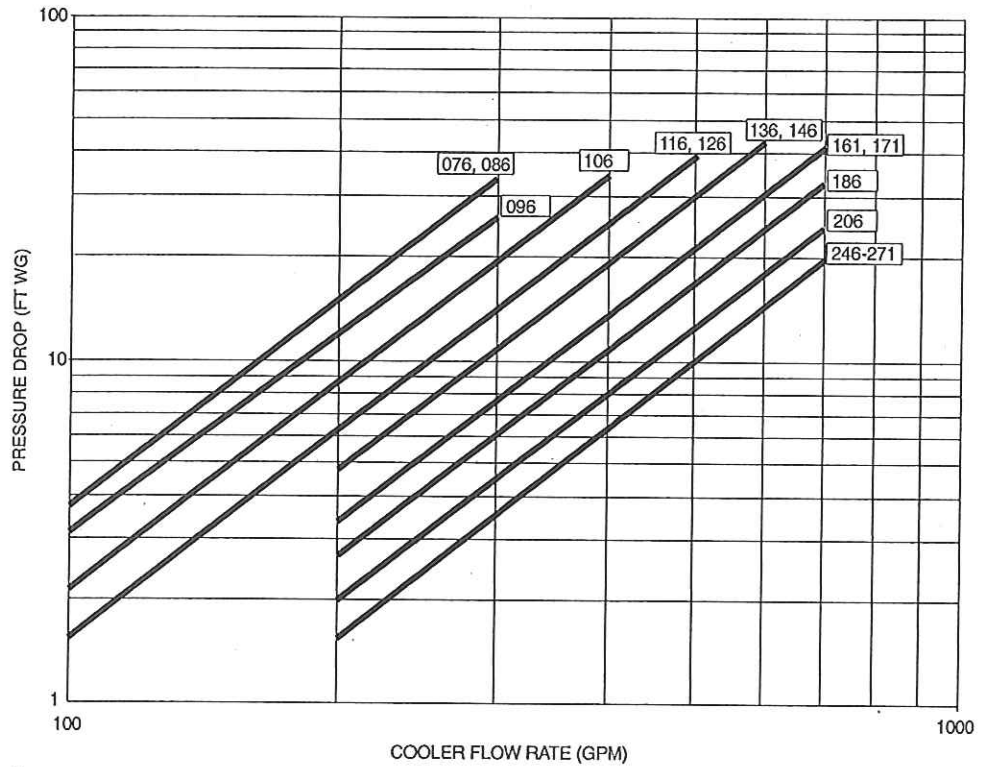

Unit Size Range

NOTE: Ft of water = 2.31 x psig.


30HX COOLER PRESSURE DROP — ENGLISH

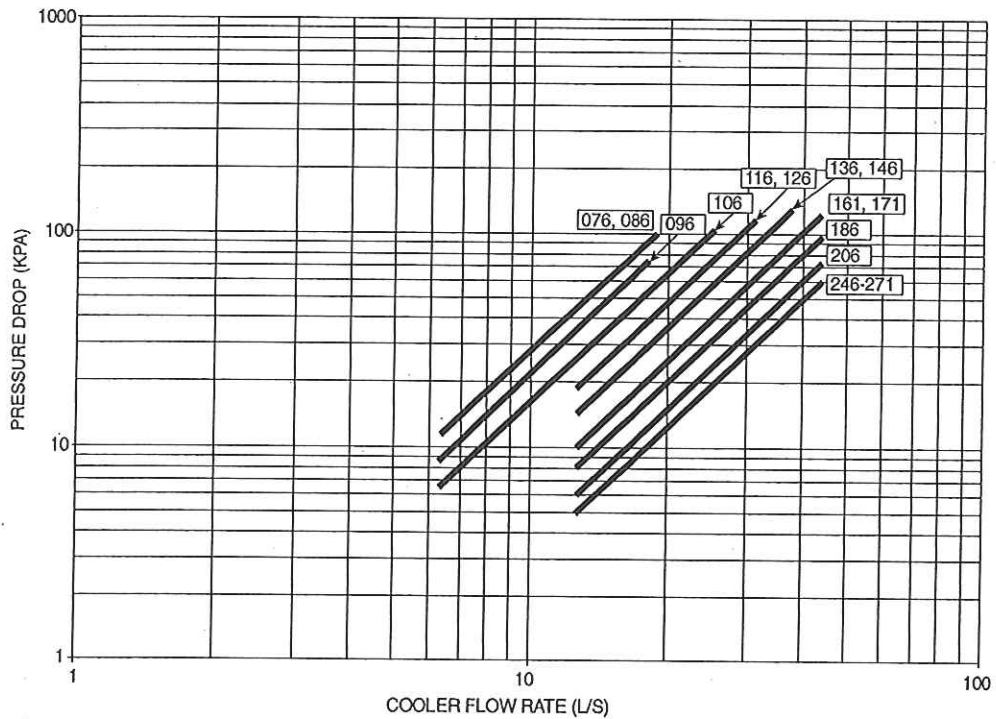


Unit Size Range

30HX COOLER PRESSURE DROP — SI

APPENDIX E (cont)

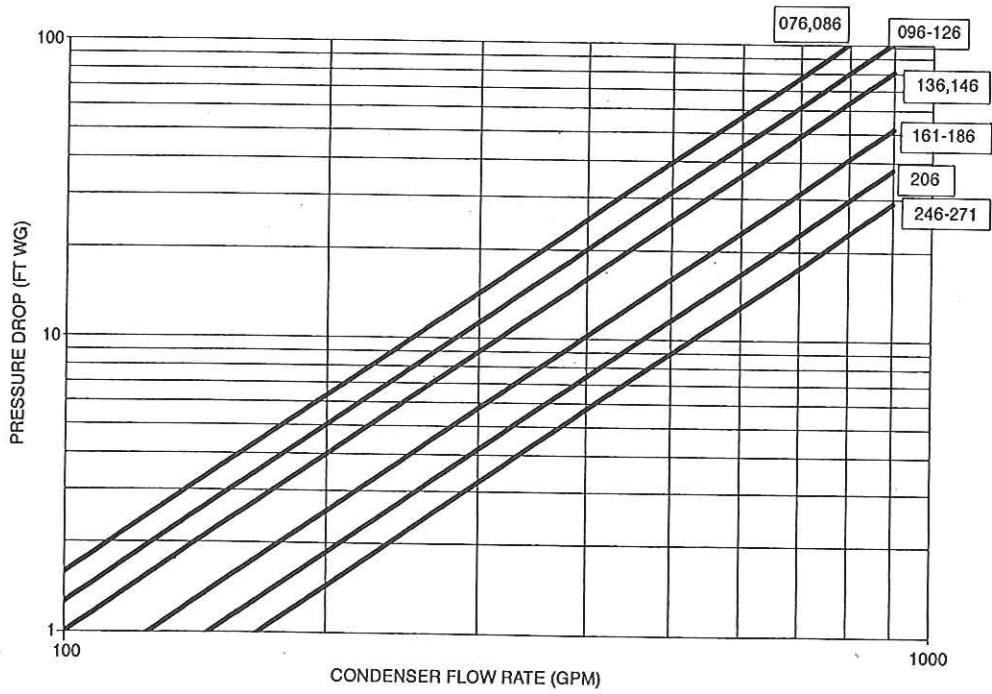


30HX CONDENSER PRESSURE DROP — ENGLISH

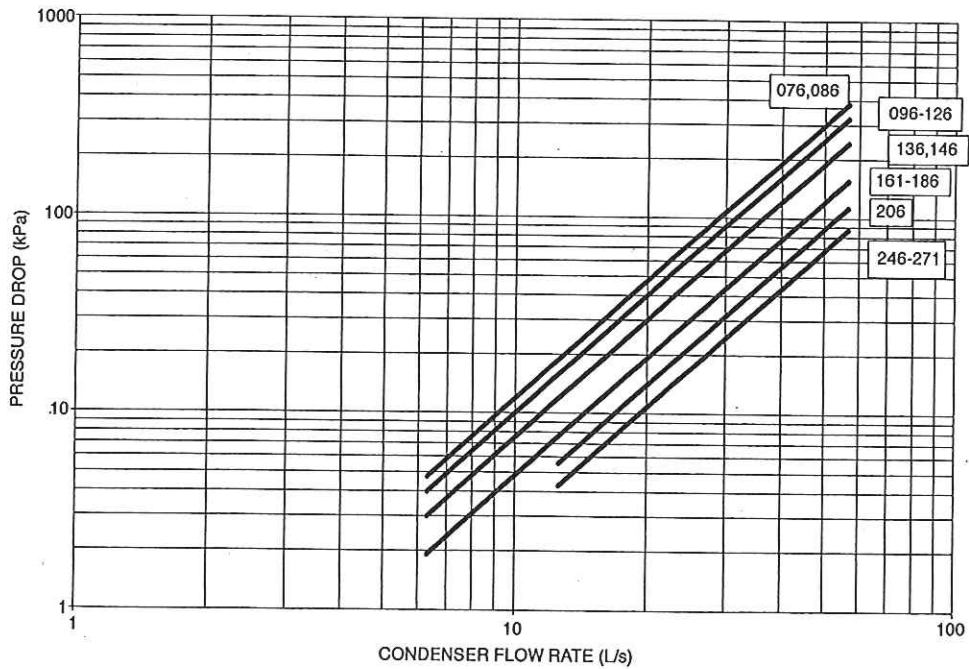


30HX CONDENSER PRESSURE DROP — SI

APPENDIX E (cont)

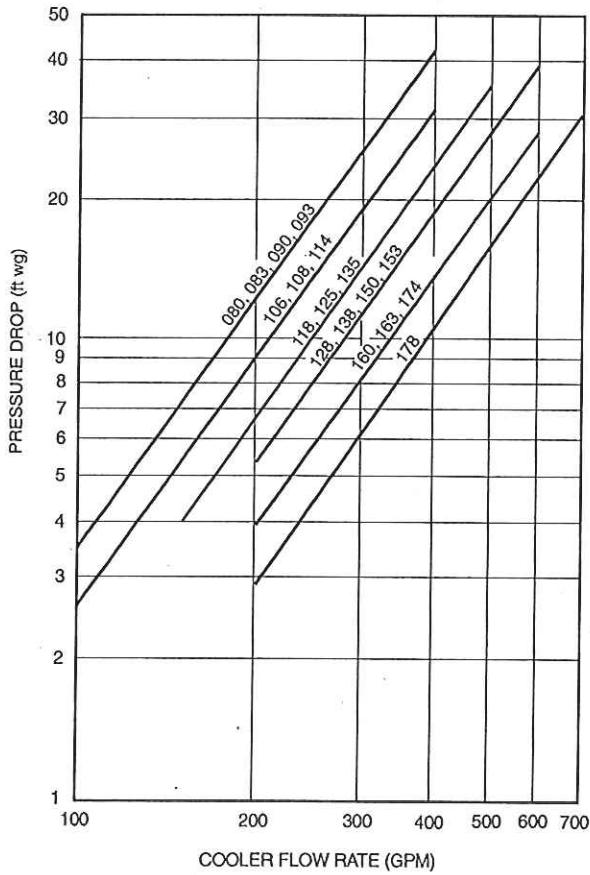


NOTE: Ft of water = 2.31 x psig.


30GXN, R080-178 COOLER PRESSURE DROP — ENGLISH

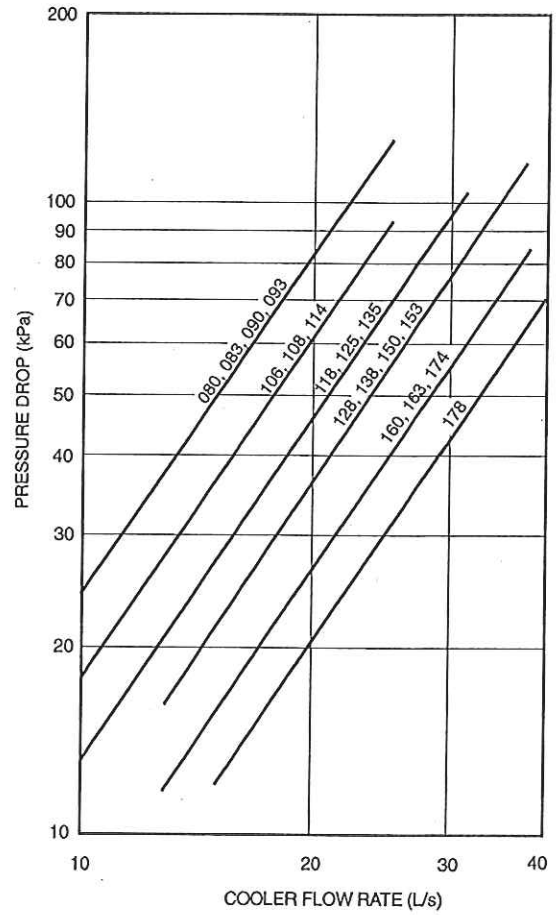

30GXN, R080-178 COOLER PRESSURE DROP — SI

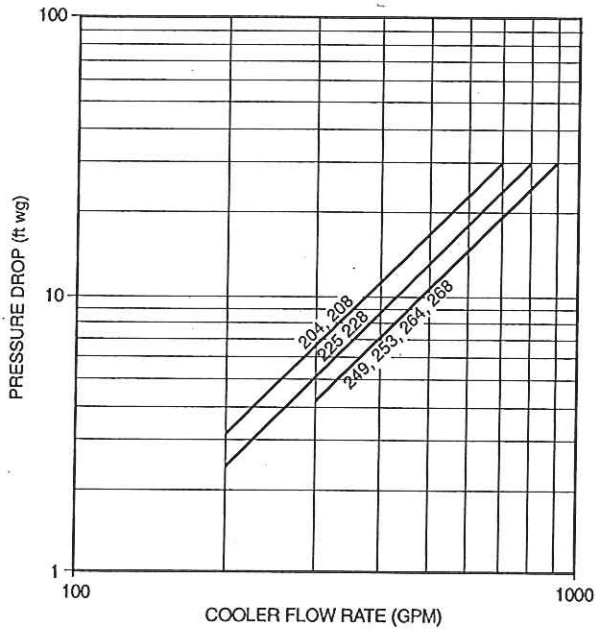


30GXN, R204-268 COOLER PRESSURE DROP — ENGLISH

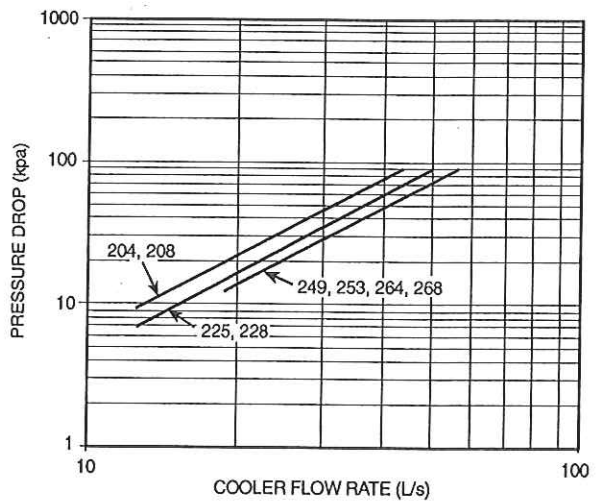


30GXN, R204-268 COOLER PRESSURE DROP — SI

APPENDIX E (cont)

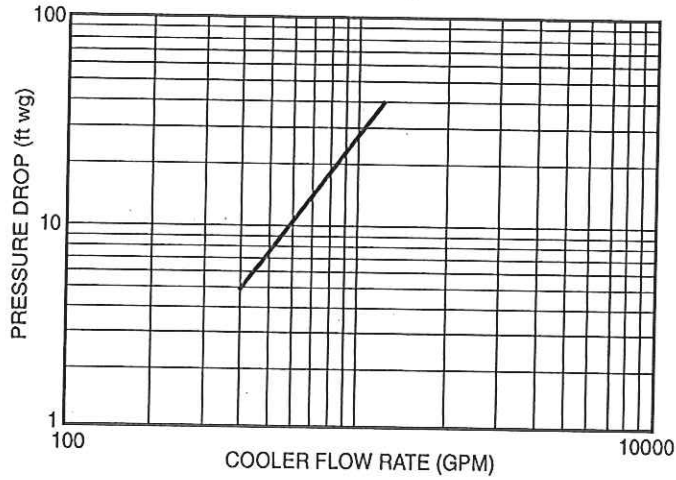


30GXN,R281-350 COOLER PRESSURE DROP — ENGLISH

NOTE: Ft of water = 2.31 x psig.

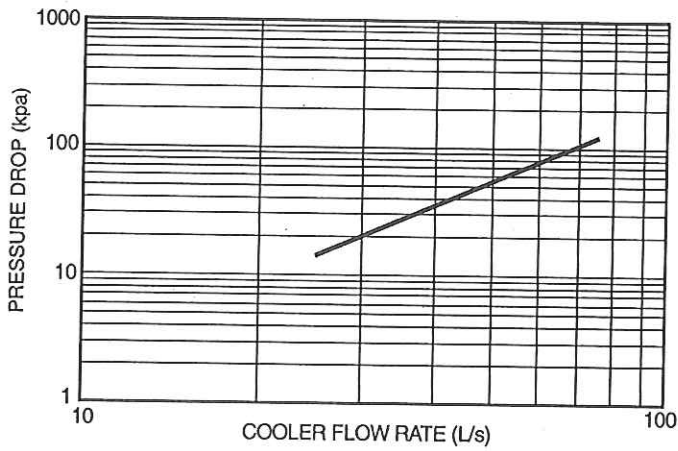


30GXN,R281-350 COOLER PRESSURE DROP — SI

APPENDIX E (cont)

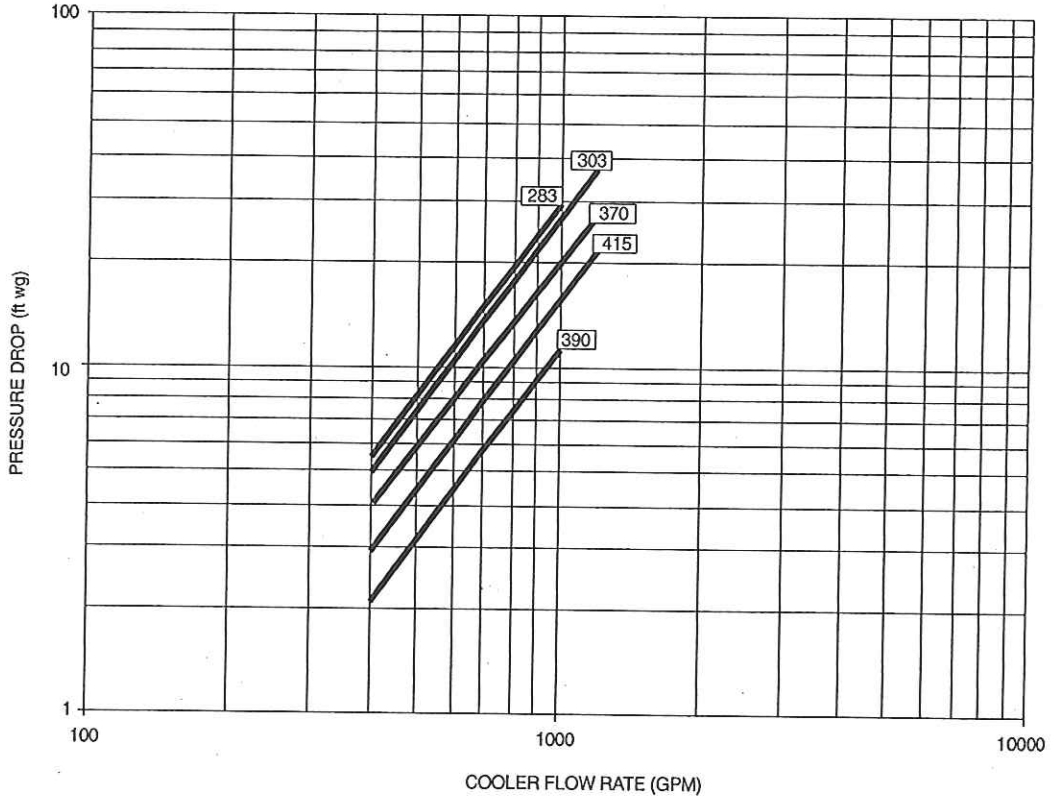


30GXN,R283, 303, 370, 390, 415 DUPLEX COOLER PRESSURE DROP — ENGLISH

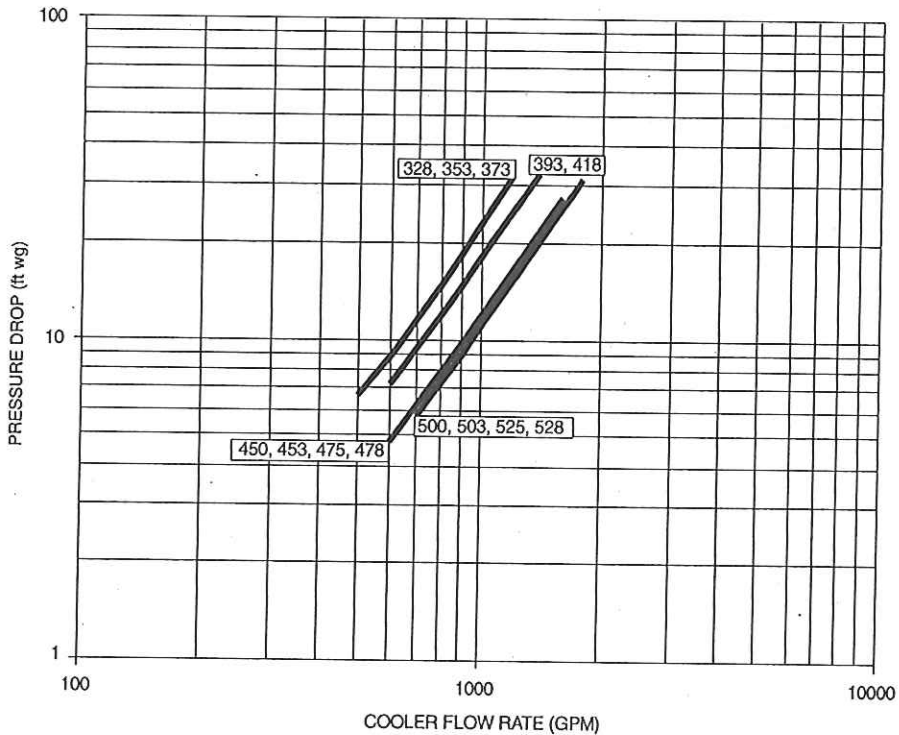


30GXN,R328, 353, 373, 393, 418-528 DUPLEX COOLER PRESSURE DROP — ENGLISH

APPENDIX E (cont)

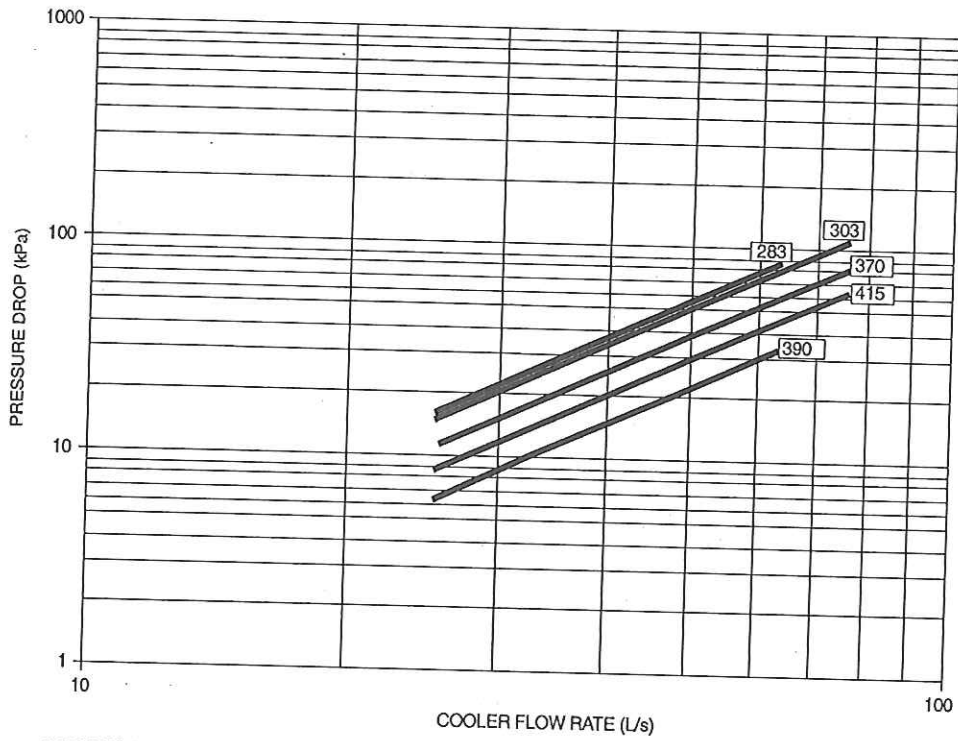


30GXN,R283, 303, 370, 390, 415 DUPLEX COOLER PRESSURE DROP — SI

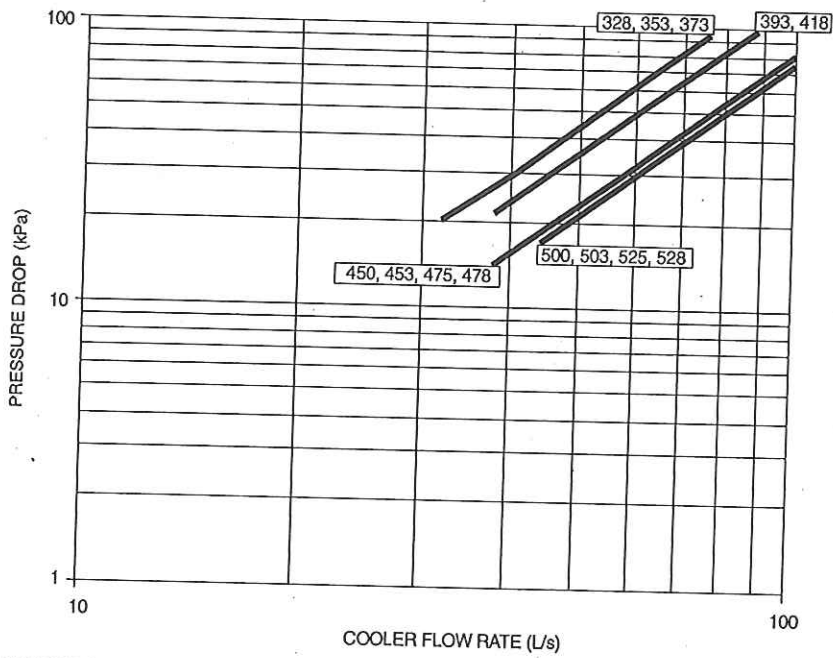


30GXN,R328, 353, 373, 393, 418-528 DUPLEX COOLER PRESSURE DROP — SI

APPENDIX F

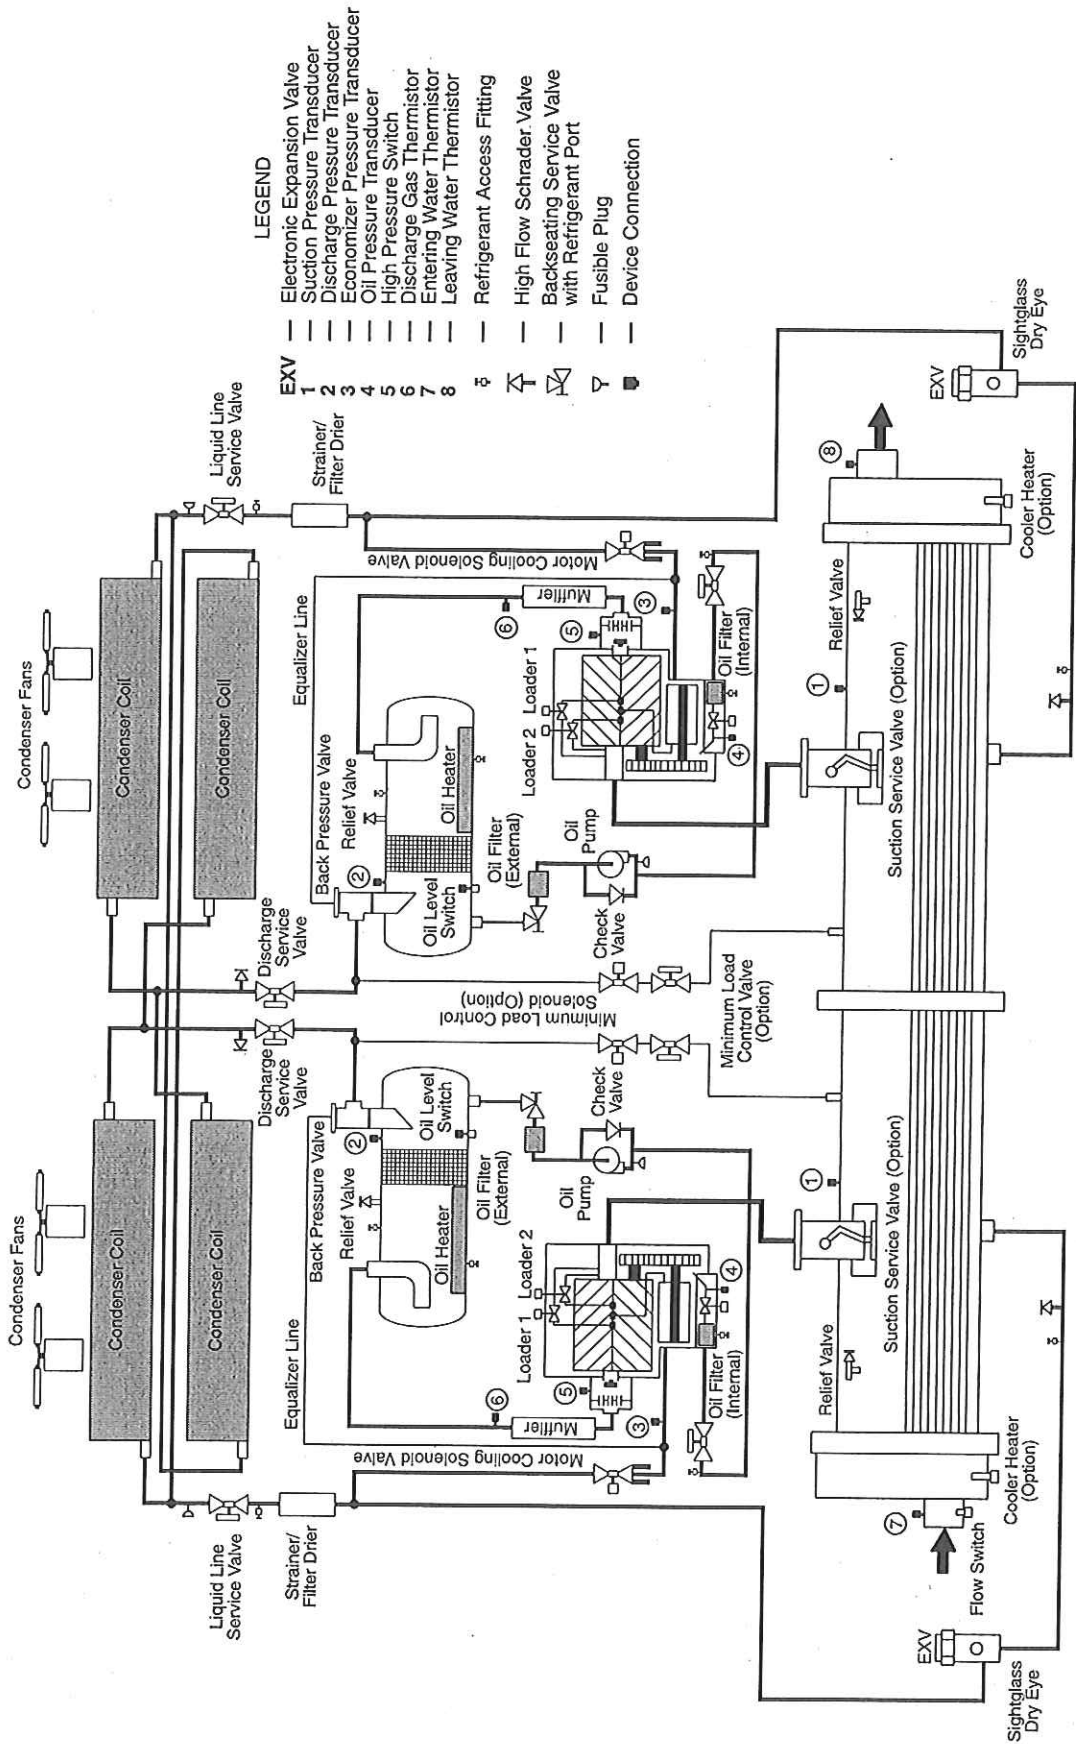

Typical System Components, 30GXN, GXR080-106, 114, Without Economizer


APPENDIX F (cont)

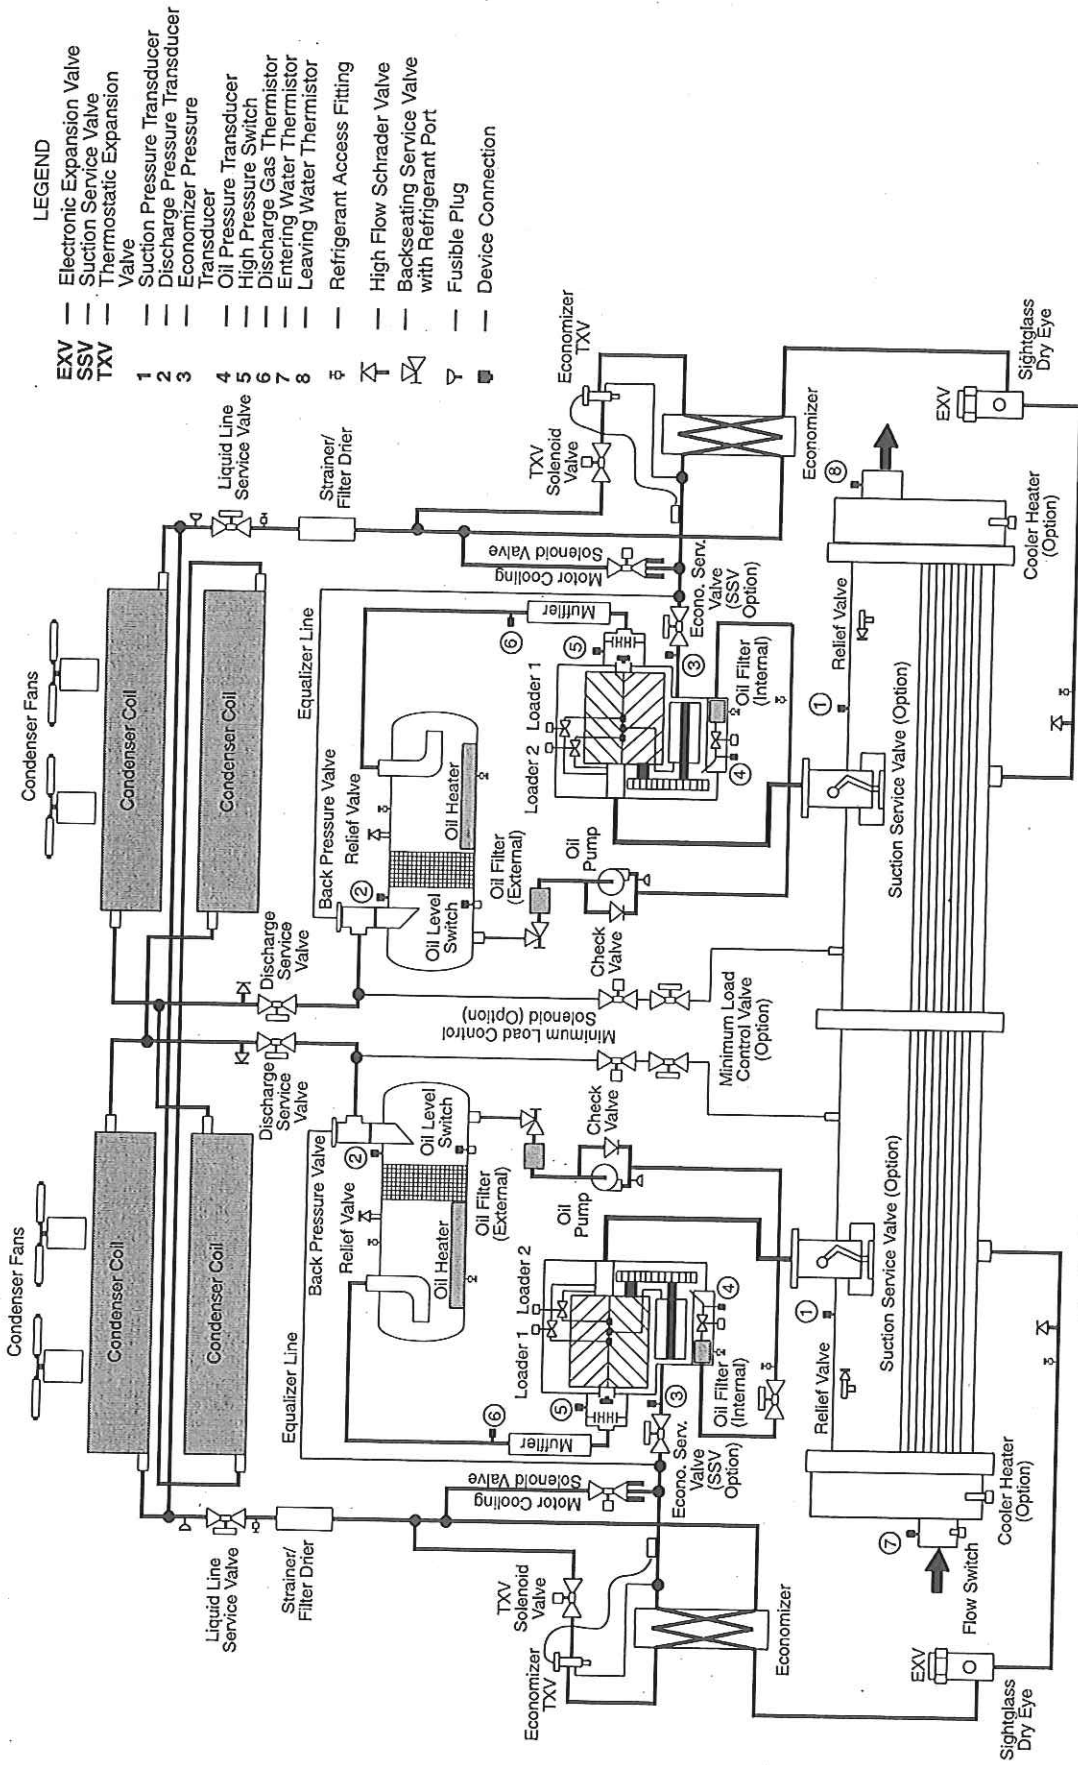

- LEGEND**
- EXV Electronic Expansion Valve
 - SSV Suction Service Valve
 - TXV Thermostatic Expansion Valve
 - 1 Suction Pressure Transducer
 - 2 Discharge Pressure Transducer
 - 3 Economizer Pressure Transducer
 - 4 Oil Pressure Transducer
 - 5 High Pressure Switch
 - 6 Discharge Gas Thermistor
 - 7 Entering Water Thermistor
 - 8 Leaving Water Thermistor
 - ⌀ Refrigerant Access Fitting
 - ↕ High Flow Schrader Valve
 - ⊗ Backseating Service Valve with Refrigerant Port
 - ⊘ Fusible Plug
 - ⊞ Device Connection

Typical System Components, 30GXN,GXR108,125-178, With Economizer

APPENDIX F (cont)

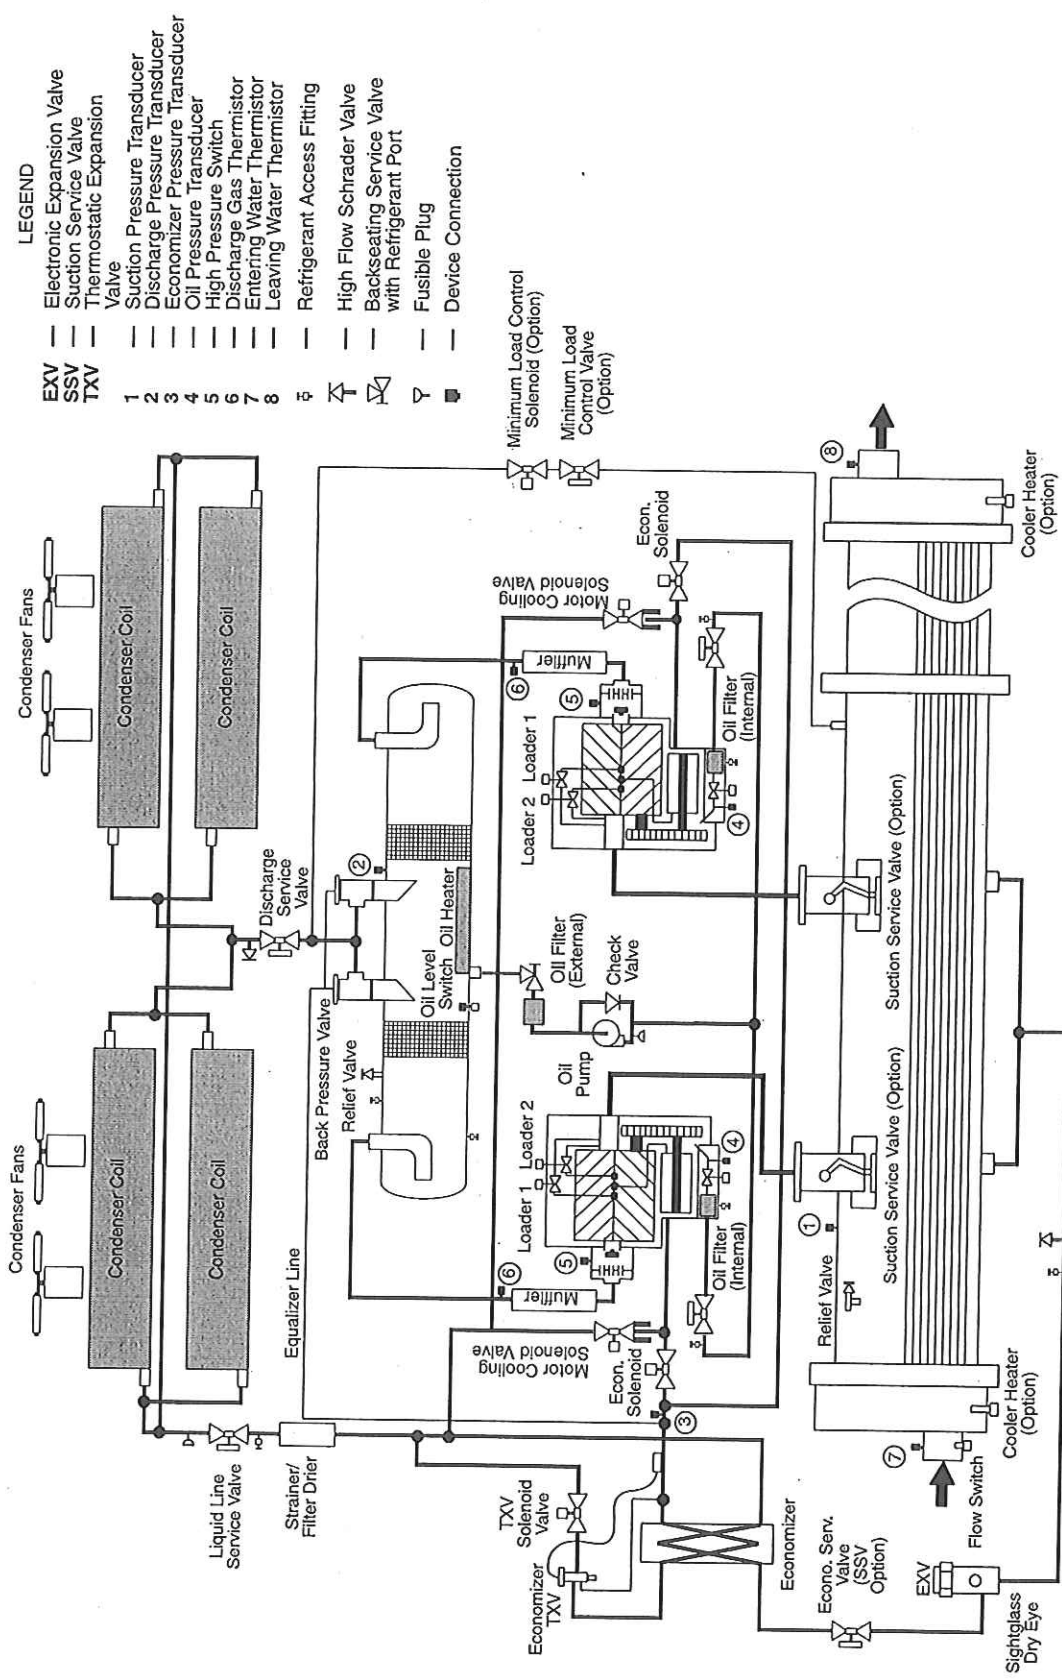


LEGEND

- | | |
|-----|---|
| EXV | Electronic Expansion Valve |
| SSV | Suction Service Valve |
| TXV | Thermostatic Expansion Valve |
| 1 | Suction Pressure Transducer |
| 2 | Discharge Pressure Transducer |
| 3 | Economizer Pressure Transducer |
| 4 | Oil Pressure Transducer |
| 5 | High P Pressure Switch |
| 6 | Discharge Gas Thermistor |
| 7 | Entering Water Thermistor |
| 8 | Leaving Water Thermistor |
| ⊕ | Refrigerant Access Fitting |
| ↗ | High Flow Schrader Valve |
| ↘ | Backseating Service Valve with Refrigerant Port |
| ▽ | Fusible Plug |
| ■ | Device Connection |

Typical System Components, 30GXN, GXR204-268 Circuit A, 30GXN, GXR281-350 Circuit A and B, With Economizer

APPENDIX F (cont)

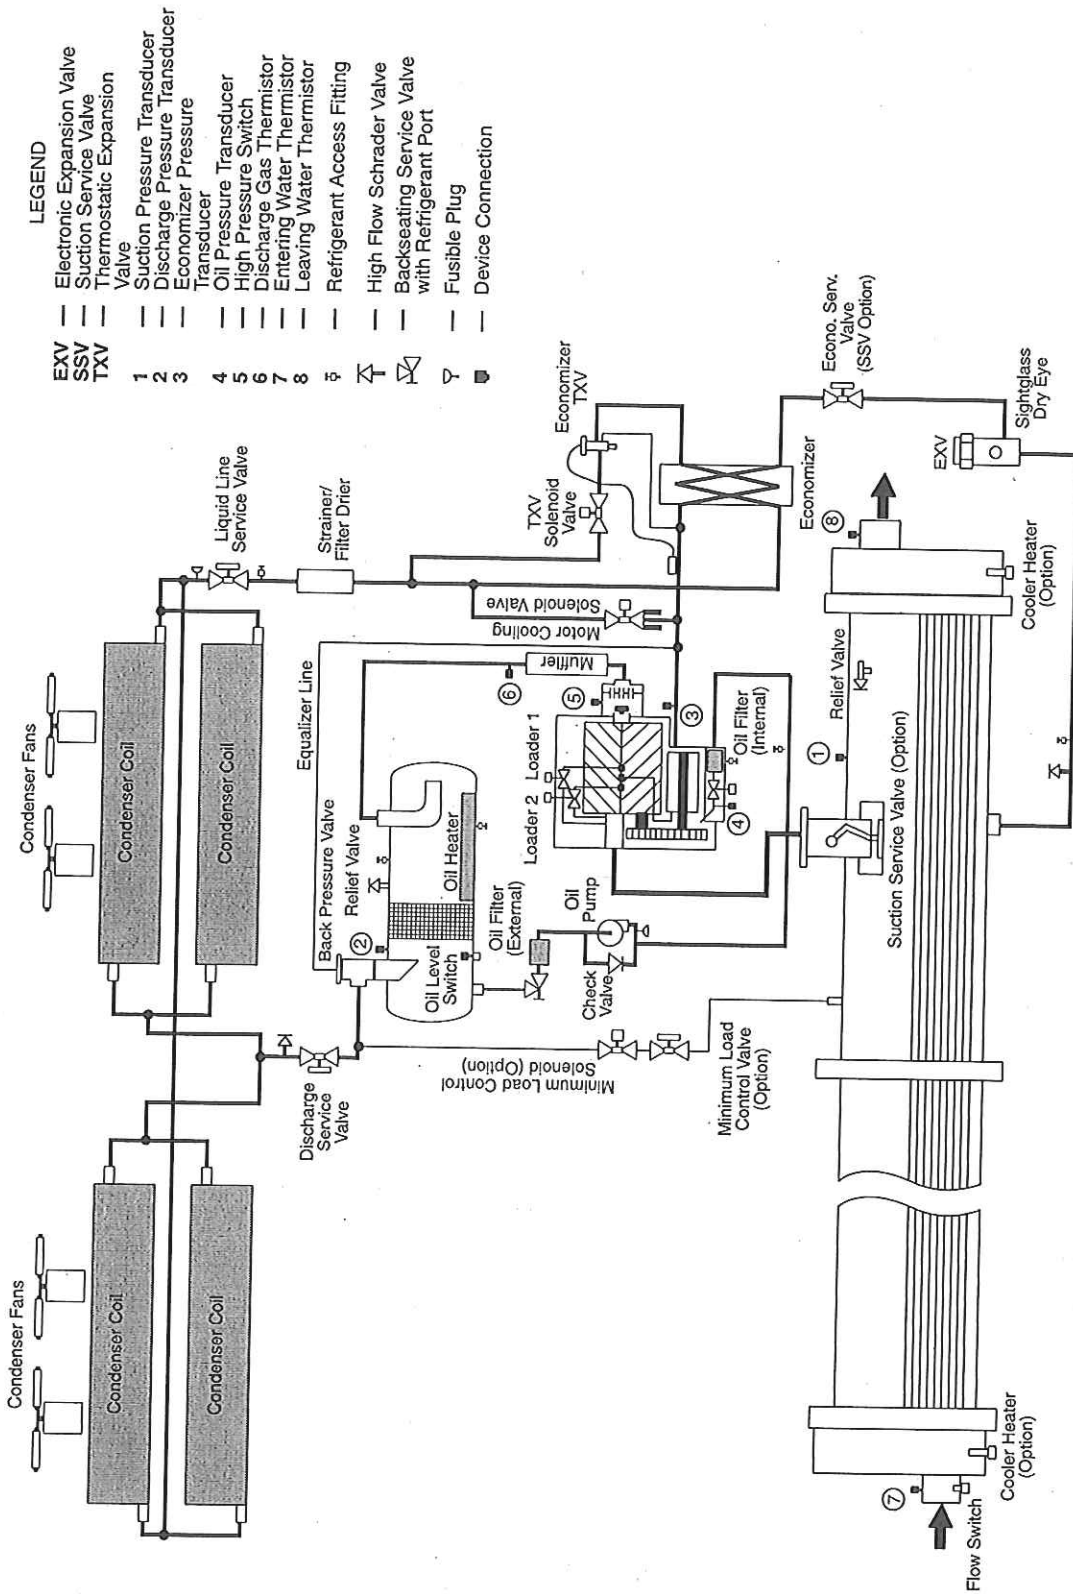


LEGEND

- EXV Electronic Expansion Valve
- SSV Suction Service Valve
- TXV Thermostatic Expansion Valve
- 1 Suction Pressure Transducer
- 2 Discharge Pressure Transducer
- 3 Economizer Pressure Transducer
- 4 Oil Pressure Transducer
- 5 High Pressure Switch
- 6 Discharge Gas Thermistor
- 7 Entering Water Thermistor
- 8 Leaving Water Thermistor
- ⊕ Refrigerant Access Fitting
- ⊕ High Flow Schrader Valve
- ⊕ Backseating Service Valve with Refrigerant Port
- ⊕ Fusible Plug
- ⊕ Device Connection

Typical System Components, 30GXN, GXR204-268 Circuit B, With Economizer

APPENDIX F (cont)

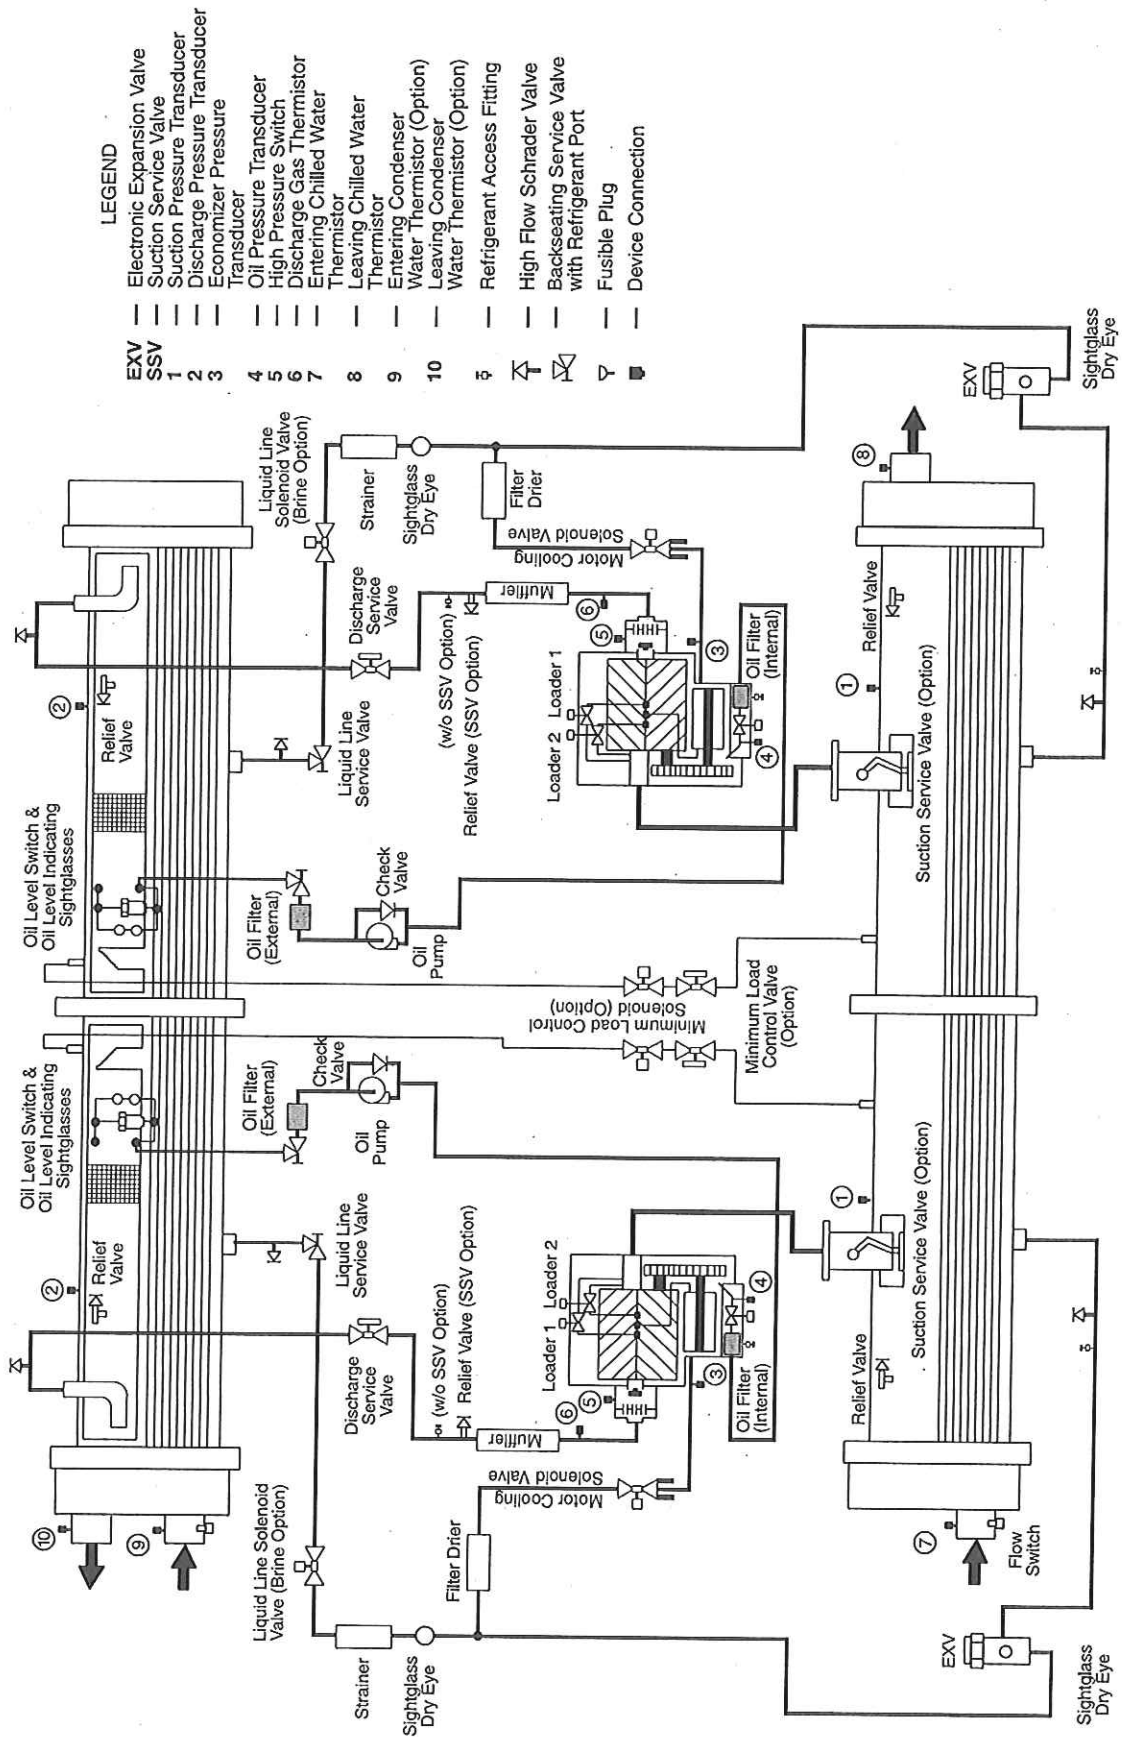


Typical System Components, 30HXC076-146, Without Economizer

APPENDIX F (cont)


LEGEND

EXV	Electronic Expansion Valve
SSV	Suction Service Valve
TXV	Thermostatic Expansion Valve
1	Suction Pressure Transducer
2	Discharge Pressure Transducer
3	Economizer Pressure Transducer
4	Oil Pressure Transducer
5	High Pressure Switch
6	Discharge Gas Thermistor
7	Entering Chilled Water Thermistor
8	Leaving Chilled Water Thermistor
9	Entering Condenser Water Thermistor (Option)
10	Leaving Condenser Water Thermistor (Option)
⊕	Refrigerant Access Fitting
⊕	High Flow Schrader Valve
⊕	Backseating Service Valve with Refrigerant Port
⊕	Fusible Plug
⊕	Device Connection

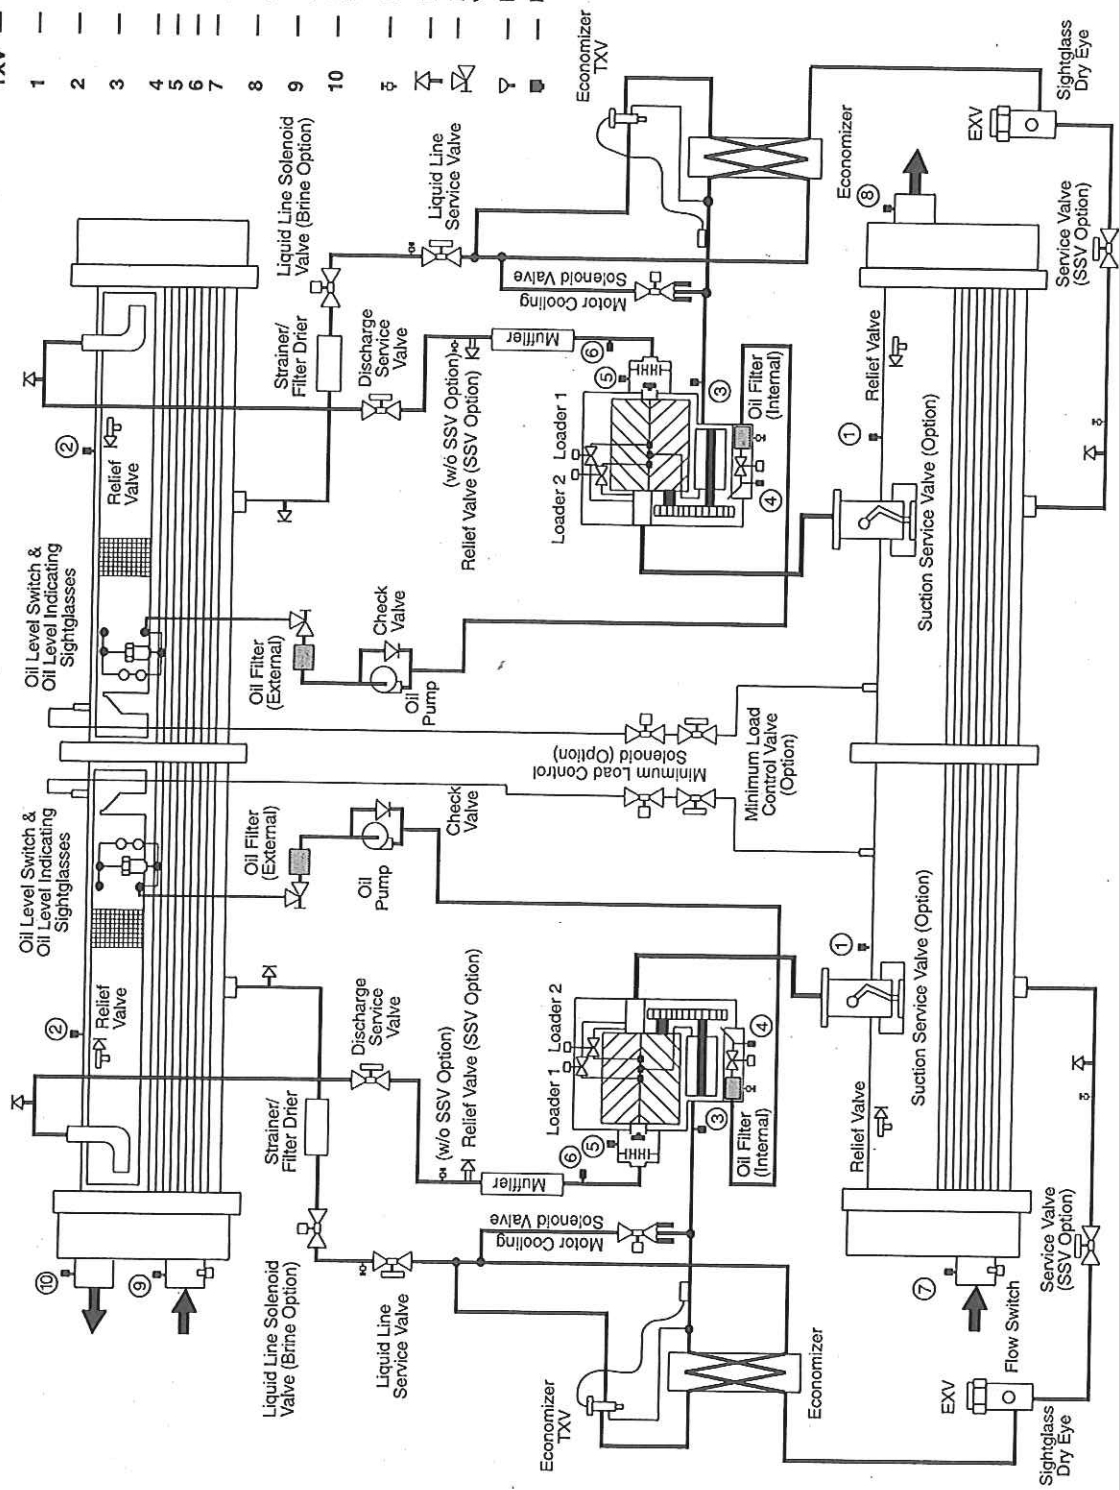

Typical System Components, 30HXC161-186, With Economizer

APPENDIX F (cont)

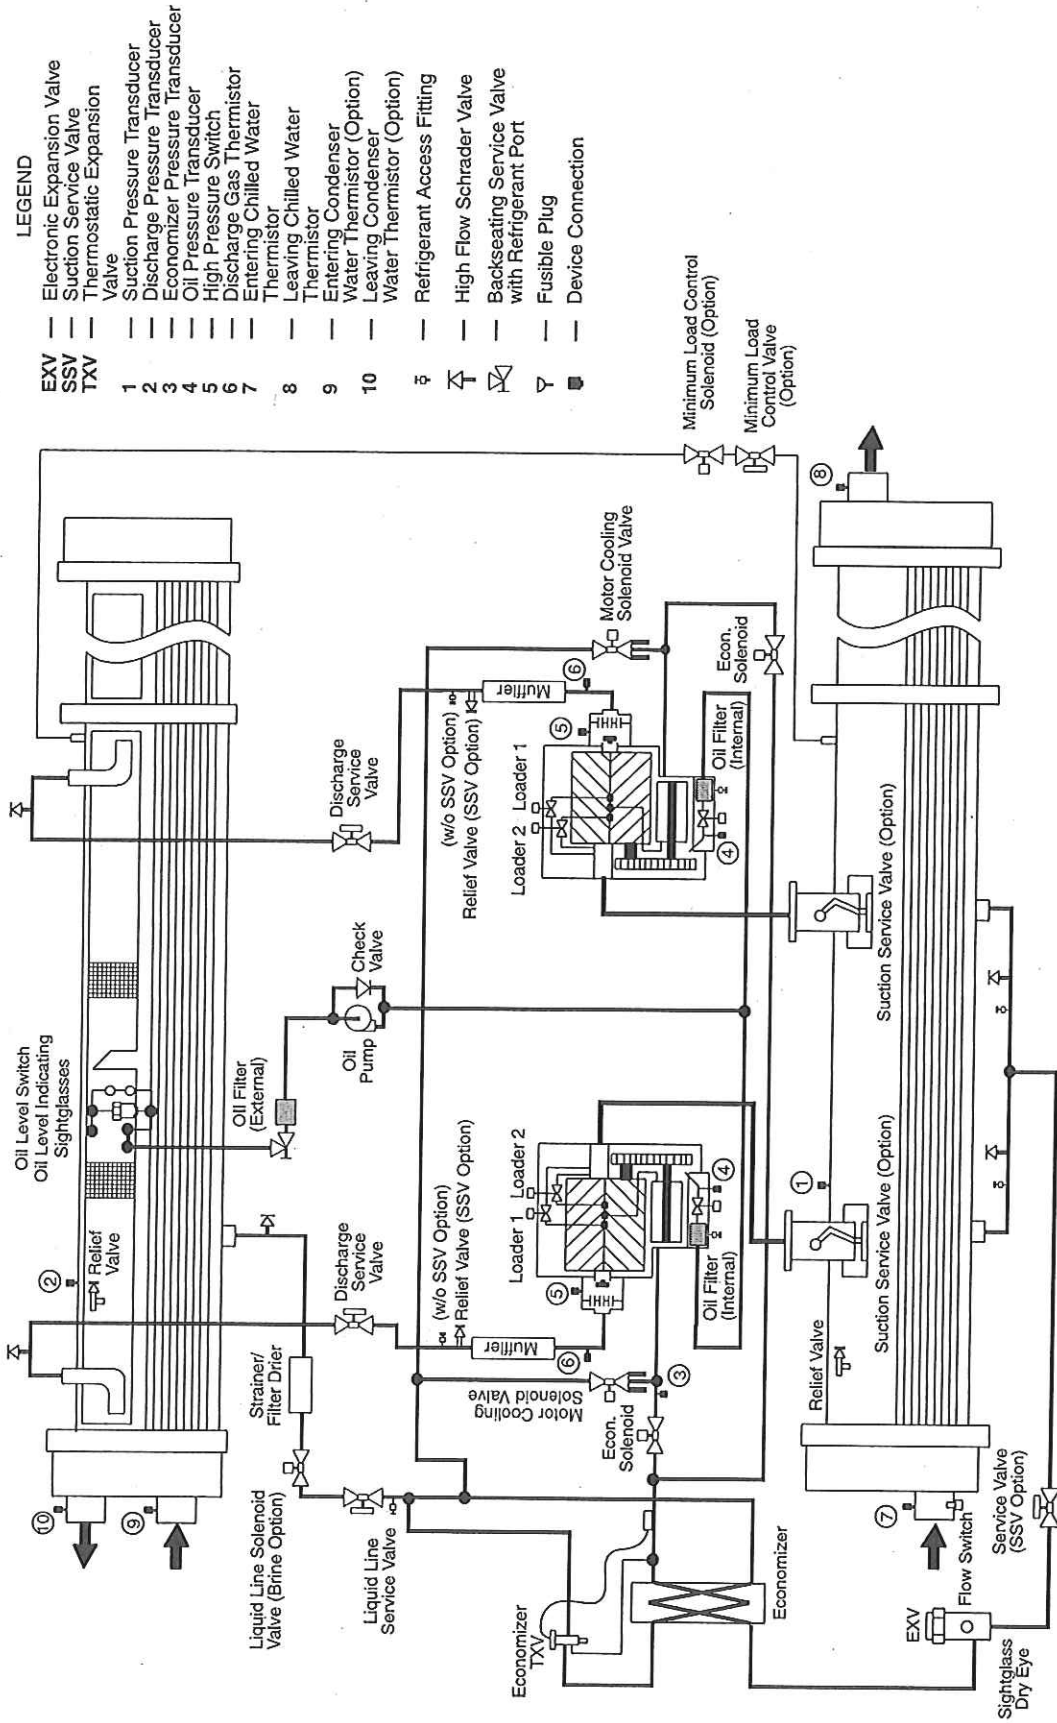

LEGEND

- | | |
|-----|---|
| EXV | Electronic Expansion Valve |
| SSV | Suction Service Valve |
| TXV | Thermostatic Expansion Valve |
| 1 | Suction Pressure Transducer |
| 2 | Discharge Pressure Transducer |
| 3 | Economizer Pressure Transducer |
| 4 | Oil Pressure Transducer |
| 5 | High Pressure Switch |
| 6 | Discharge Gas Thermistor |
| 7 | Entering Chilled Water Thermistor |
| 8 | Leaving Chilled Water Thermistor |
| 9 | Entering Condenser Water Thermistor (Option) |
| 10 | Leaving Condenser Water Thermistor (Option) |
| ⊗ | Refrigerant Access Fitting |
| ⊕ | High Flow Schrader Valve |
| ⊖ | Backseating Service Valve with Refrigerant Port |
| ▽ | Fusible Plug |
| ■ | Device Connection |


Minimum Load Control Solenoid (Option)

Minimum Load Control Valve (Option)

Typical System Components, 30HXC206-271 Circuit A, With Economizer

APPENDIX F (cont)

LEGEND	
EXV	Electronic Expansion Valve
SSV	Suction Service Valve
TXV	Thermostatic Expansion Valve
1	Suction Pressure Transducer
2	Discharge Pressure Transducer
3	Economizer Pressure Transducer
4	Oil Pressure Transducer
5	High Pressure Switch
6	Discharge Gas Thermistor
7	Entering Chilled Water Thermistor
8	Leaving Chilled Water Thermistor
↕	Refrigerant Access Fitting
⊥	High Flow Schrader Valve
⊥	Backseating Service Valve with Refrigerant Port
⊥	Fusible Plug
⊥	Device Connection

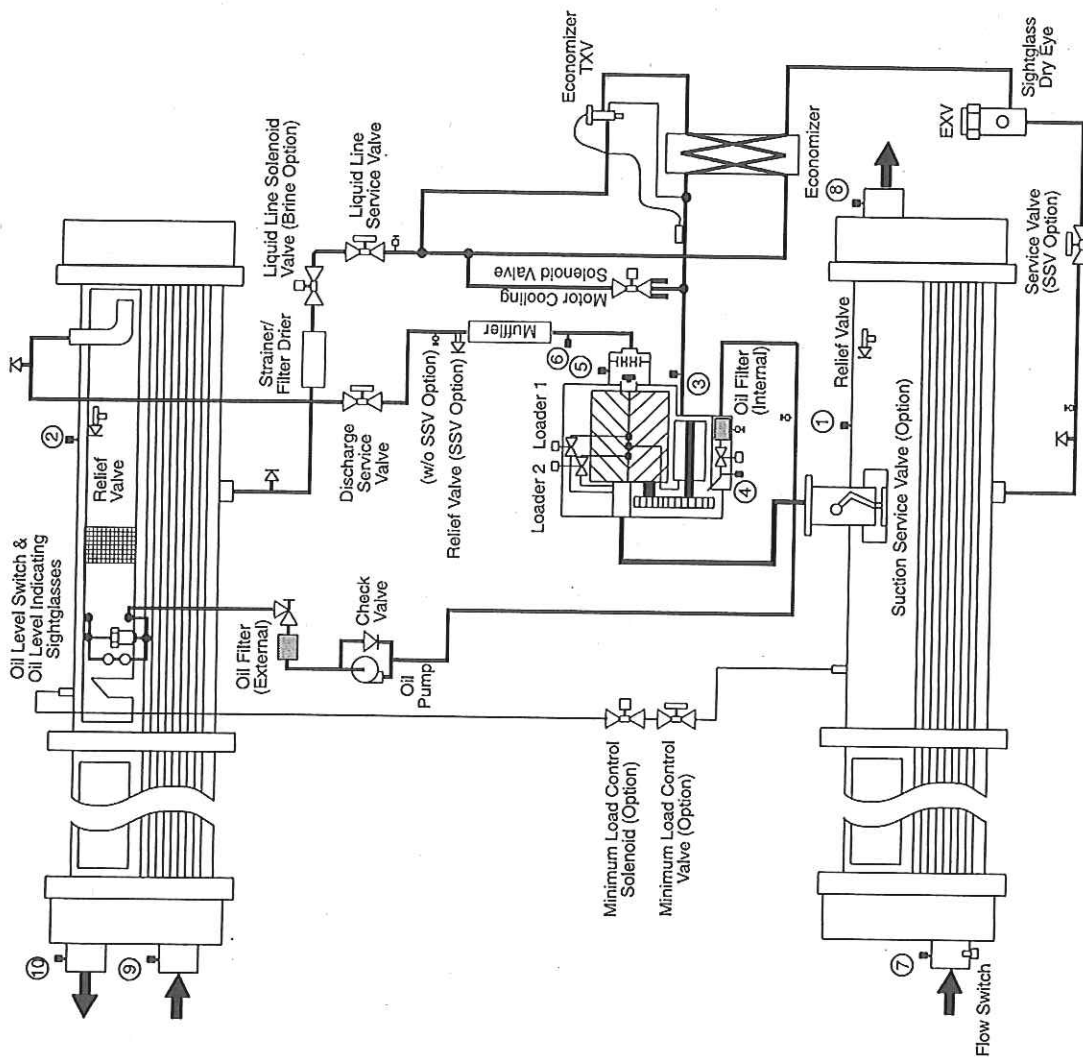


Typical System Components, 30HXC206-271 Circuit B, With Economizer

APPENDIX F (cont)

LEGEND

EXV	Electronic Expansion Valve
SSV	Suction Service Valve
TXV	Thermostatic Expansion Valve
1	Suction Pressure Transducer
2	Discharge Pressure Transducer
3	Economizer Pressure Transducer
4	Oil Pressure Transducer
5	High Pressure Switch
6	Discharge Gas Thermistor
7	Entering Water Thermistor
8	Leaving Water Thermistor
⊗	Refrigerant Access Fitting
⊕	High Flow Schrader Valve
⊖	Backseating Service Valve with Refrigerant Port
⊙	Fusible Plug
■	Device Connection

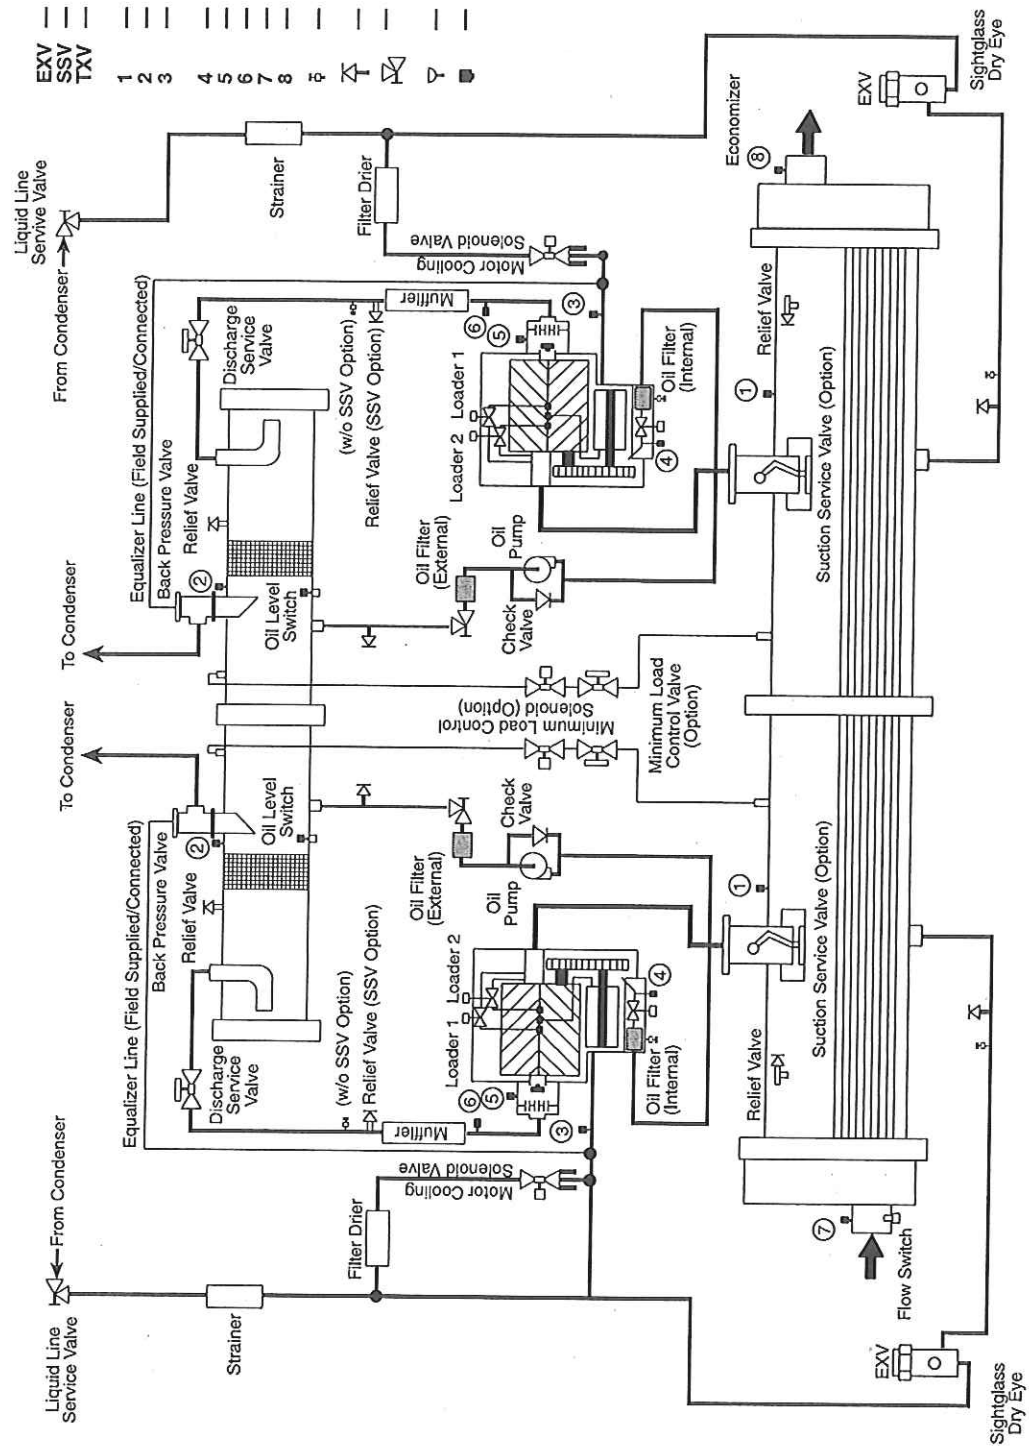


Typical System Components, 30HXA076-146, Without Economizer

APPENDIX F (cont)


LEGEND

EXV	Electronic Expansion Valve
SSV	Suction Service Valve
TXV	Thermostatic Expansion Valve
1	Suction Pressure Transducer
2	Discharge Pressure Transducer
3	Economizer Pressure Transducer
4	Oil Pressure Transducer
5	High Pressure Switch
6	Discharge Gas Thermistor
7	Entering Water Thermistor
8	Leaving Water Thermistor
9	Refrigerant Access Fitting
10	High Flow Schrader Valve
11	Backseating Service Valve with Refrigerant Port
12	Fusible Plug
13	Device Connection

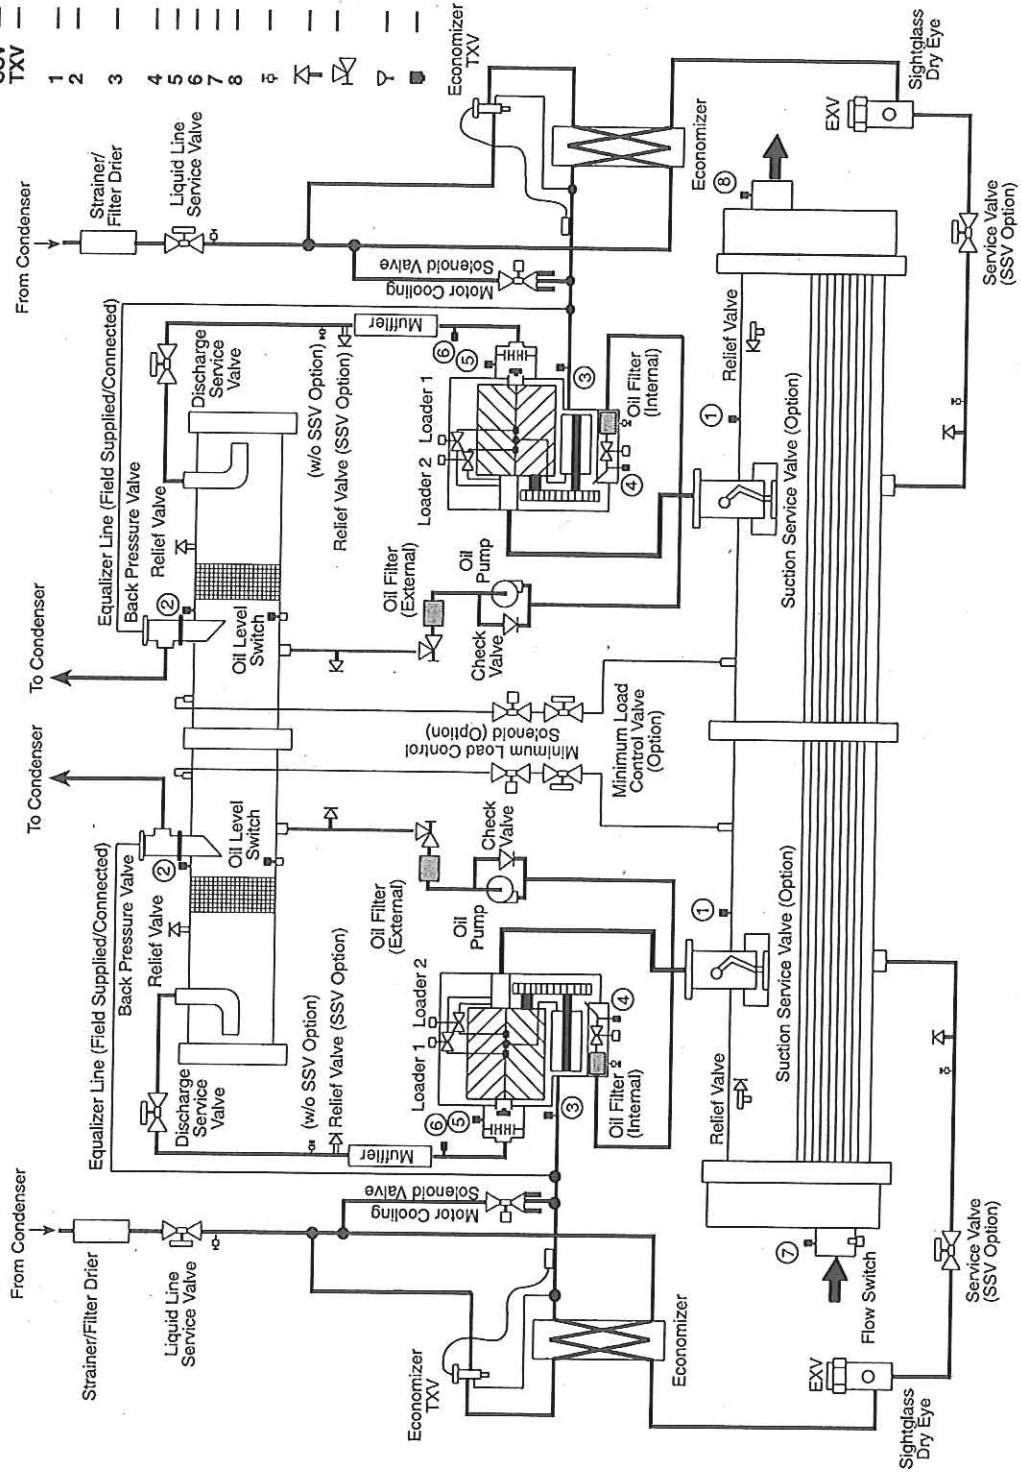

Typical System Components, 30HXA161-186, With Economizer

APPENDIX F (cont)

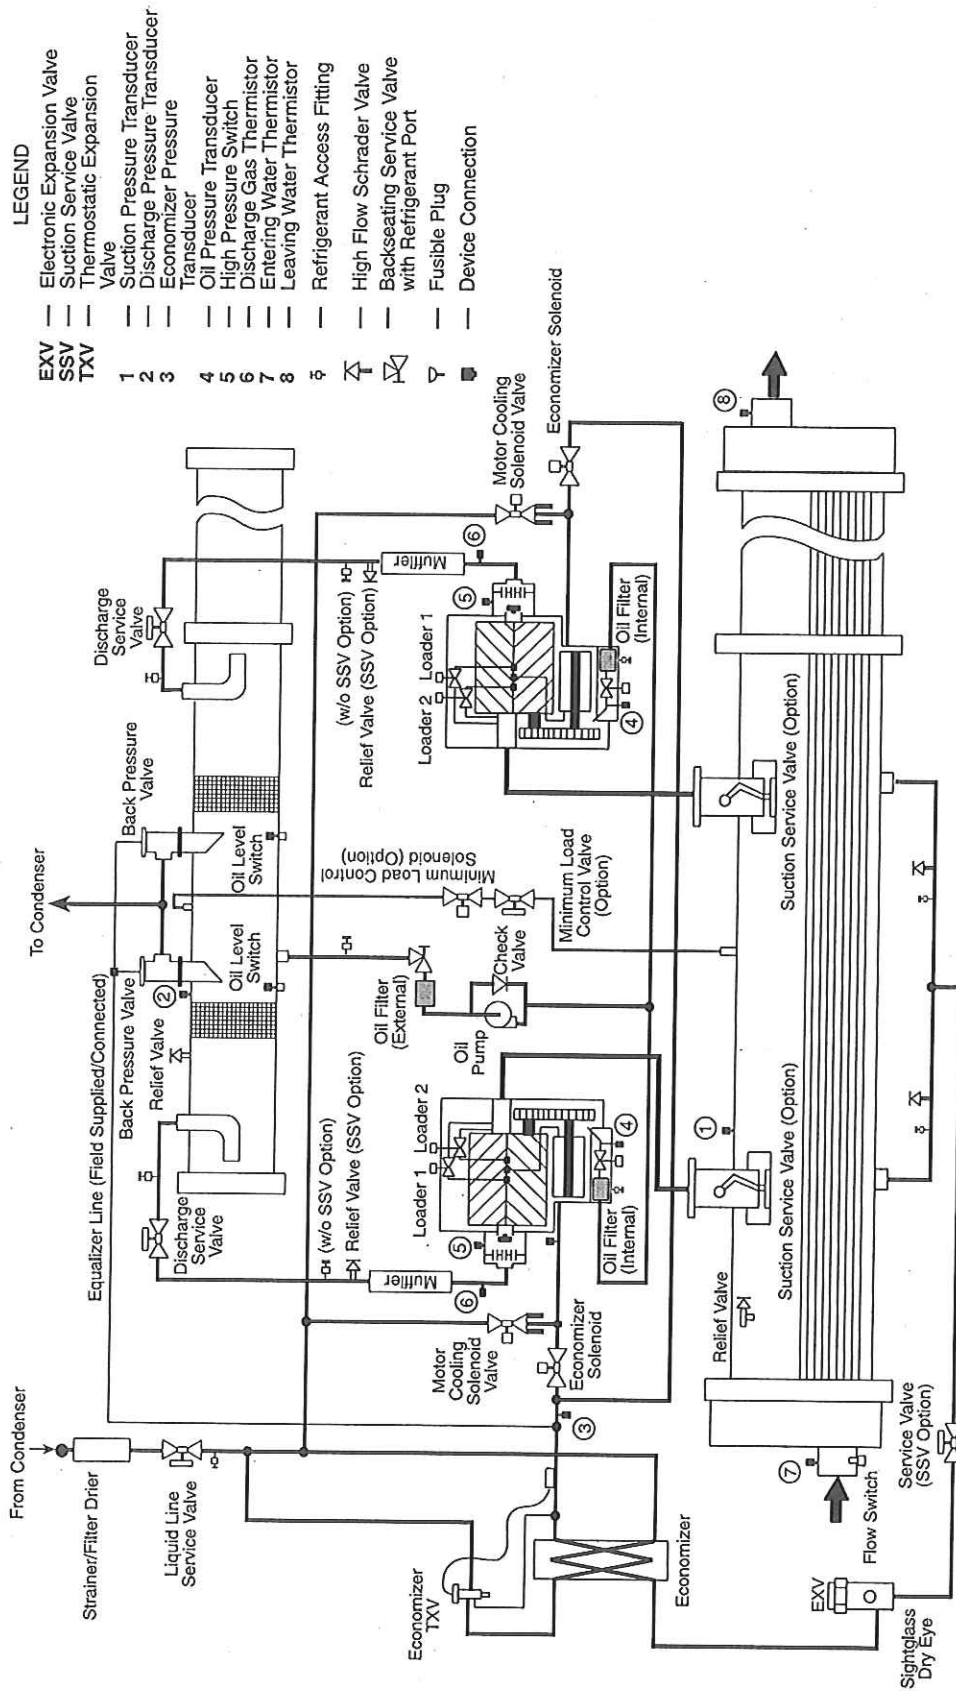


LEGEND

EXV	Electronic Expansion Valve
SSV	Suction Service Valve
TXV	Thermostatic Expansion Valve
1	Suction Pressure Transducer
2	Discharge Pressure Transducer
3	Economizer Pressure Transducer
4	Oil Pressure Transducer
5	High Pressure Switch
6	Discharge Gas Thermistor
7	Entering Water Thermistor
8	Leaving Water Thermistor
⊕	Refrigerant Access Fitting
⊖	High Flow Schrader Valve
⊗	Backseating Service Valve with Refrigerant Port
▽	Fusible Plug
■	Device Connection

Typical System Components, 30HXA206-271 Circuit A, With Economizer

APPENDIX F (cont)

EXV	SSV	TXV	LEGEND
—	—	—	Electronic Expansion Valve
—	—	—	Suction Service Valve
—	—	—	Thermostatic Expansion Valve
—	—	—	Suction Pressure Transducer
—	—	—	Discharge Pressure Transducer
—	—	—	Economizer Pressure Transducer
—	—	—	Oil Pressure Transducer
—	—	—	High Pressure Switch
—	—	—	Discharge Gas Thermistor
—	—	—	Entering Water Thermistor
—	—	—	Leaving Water Thermistor
—	—	—	Refrigerant Access Fitting
—	—	—	High Flow Schrader Valve
—	—	—	Backseating Service Valve with Refrigerant Port
—	—	—	Fusible Plug
—	—	—	Device Connection

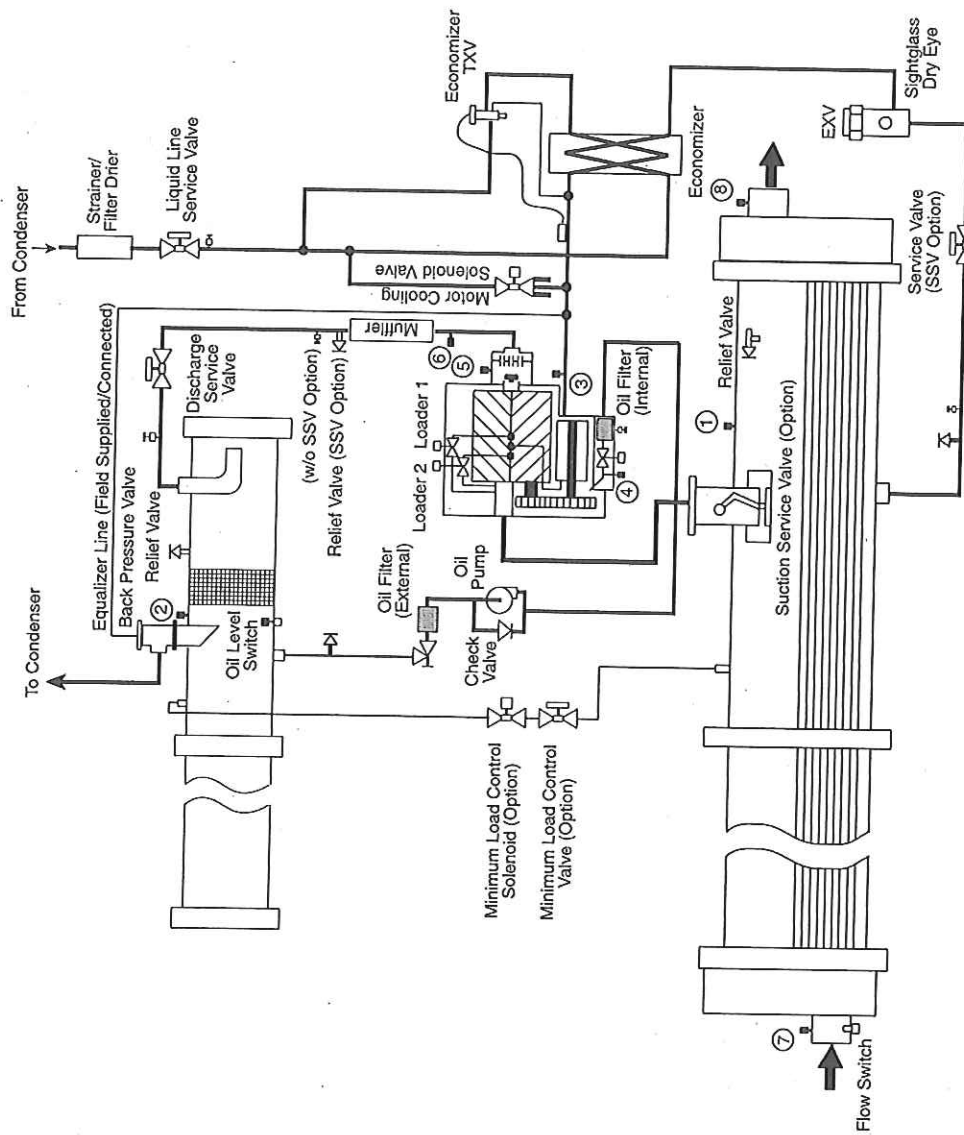

Typical System Components, 30HXA206-271 Circuit B, With Economizer

APPENDIX G

A_UNIT (Unit Operation): Status Display

DESCRIPTION	STATUS	UNITS	POINT	FORCIBLE
Control Mode	0 = Service Test 1 = Off - Local 2 = Off - CCN 3 = Off - Clock 4 = Off Emergency 5 = On - Local 6 = On - CCN 7 = On - Clock		STAT	N
Occupied	Yes/No		OCC	N
CCN Chiller	Start/Stop		CHIL_S_S	Y
Alarm State	0 = Normal 1 = Alarm 2 = Alert		ALM	N
Active Demand Limit	0 - 100	%	DEM_LIM	Y
Override Modes in Effect	Yes/No		MODE	N
Percent Total Capacity	0 - 100	%	CAP_T	N
Active Setpoint	snnn.n	°F	SP	N
Control Point	snn.n	°F	CTRL_PNT	Y
Entering Fluid Temp	snnn.n	°F	EWT	N
Leaving Fluid Temp	snnn.n	°F	LWT	N
Emergency Stop	Enable/Emstop		EMSTOP	Y
Minutes Left for Start	00:00-15:00	min	MIN_LEFT	N
Heat Cool Select	Heat/Cool		HEATCOOL	N

CIRCADIO (Circuit A Discrete Inputs/Outputs): Status Display

DESCRIPTION	STATUS	POINT	FORCIBLE
CIRC. A DISCRETE OUTPUTS			
Compressor A1 Relay	On/Off	K_A1_RLY	N
Compressor A2 Relay	On/Off	K_A2_RLY	N
Loader A1 Relay	On/Off	LOADR_A1	N
Loader A2 Relay	On/Off	LOADR_A2	N
Minimum Load Valve	On/Off	MLV	N
Oil Heater	On/Off	OILA_HTR	N
Motor Cooling A1 Solenoid	On/Off	MTRCL_A1	N
Motor Cooling A2 Solenoid	On/Off	MTRCL_A2	N
Oil Pump	On/Off	OILPMP_A	N
Oil Solenoid A1	On/Off	OILSL_A1	N
Oil Solenoid A2	On/Off	OILSL_A2	N
CIRC. A DISCRETE INPUTS			
Compressor A1 Feedback	On/Off	K_A1_FBK	N
Compressor A2 Feedback	On/Off	K_A2_FBK	N
Oil Level Switch	Close/Open	OILA_SW	N

CIRCA_AN (Circuit A Analog Parameters): Status Display

DESCRIPTION	STATUS	UNITS	POINT	FORCIBLE
CIRCUIT A ANALOG VALUES				
Percent Total Capacity	0 - 100	%	CAPA_T	N
Percent Available Cap	0 - 100	%	CAPA_A	N
Circuit Running Current	0 - 1200	AMPS	A_CURR	N
Discharge Pressure	nnn.n	PSIG	DP_A	N
Suction Pressure	nnn.n	PSIG	SP_A	N
Economizer Pressure	nnn.n	PSIG	ECNP_A	N
Discharge Superheat Temp	snnn.n	°F	SH_A	N
Discharge Gas Temp	nnn.n	°F	DISTMP_A	N
Discharge Gas Temp - A1	nnn.n	°F	DISTMPA1	N
Discharge Gas Temp - A2	nnn.n	°F	DISTMPA2	N
Saturated Condensing Tmp	snnn.n	°F	TMP_SCTA	N
Saturated Suction Temp	snnn.n	°F	TMP_SSTA	N
EXV % Open	0 - 100	%	EXV_A	N
Variable Head Press. PCT	0 - 100	%	VHPA	N
COMP A1 ANALOG VALUES				
A1 Oil Pressure Diff.	nnn.n	PSIG	DOP_A1	N
A1 Oil Pressure	nnn.n	PSIG	OP_A1	N
A1 Motor Temperature	nnn.n	°F	TMTR_A1	N
Comp A1 Running Current	0 - 600	AMPS	A1_CURR	N
Comp A1 % Must Trip Amps	0 - 100	%	A1_MTA	N
COMP A2 ANALOG VALUES				
A2 Oil Pressure Diff.	nnn.n	PSIG	DOP_A2	N
A2 Oil Pressure	nnn.n	PSIG	OP_A2	N
A2 Motor Temperature	nnn.n	°F	TMTR_A2	N
Comp A2 Running Current	0 - 600	AMPS	A2_CURR	N
Comp A2 % Must Trip Amps	0 - 100	%	A2_MTA	N

APPENDIX G (cont)

CIRCB Dio: (Circuit B Discrete Inputs/Outputs) Status Display

DESCRIPTION	STATUS	POINT	FORCIBLE
CIRC. B DISCRETE OUTPUTS			
Compressor B1 Solenoid	On/Off	K_B1_RLY	N
Compressor B2 Solenoid	On/Off	K_B2_RLY	N
Loader B1 Relay	On/Off	LOADR_B1	N
Loader B2 Relay	On/Off	LOADR_B2	N
Minimum Load Valve	On/Off	MLV	N
Oil Heater	On/Off	OILB_HTR	N
Motor Cooling B1 Solenoid	On/Off	MTRCL_B1	N
Motor Cooling B2 Solenoid	On/Off	MTRCL_B2	N
Oil Pump	On/Off	OILPMP_B	N
Oil Solenoid B1	On/Off	OILSL_B1	N
Oil Solenoid B2	On/Off	OILSL_B2	N
CIRC. B DISCRETE INPUTS			
Compressor B1 Feedback	On/Off	K_B1_FBK	N
Compressor B2 Feedback	On/Off	K_B2_FBK	N
Oil Level Switch	Close/Open	OILB_SW	N

CIRCB AN: (Circuit B Analog Parameters) Status Display

DESCRIPTION	STATUS	UNITS	POINT	FORCIBLE
CIRCUIT B ANALOG VALUES				
Percent Total Capacity	0 - 100	%	CAPB_T	N
Percent Available Cap	0 - 100	%	CAPB_A	N
Circuit Running Current	0 - 1200	AMPS	B_CURR	N
Discharge Pressure	nnn.n	PSIG	DP_B	N
Suction Pressure	nnn.n	PSIG	SP_B	N
Economizer Pressure	nnn.n	PSIG	ECNP_B	N
Discharge Superheat Temp	snnn.n	°F	SH_B	N
Discharge Gas Temp	nnn.n	°F	DISTMP_B	N
Discharge Gas Temp - B1	nnn.n	°F	DISTMPB1	N
Discharge Gas Temp - B2	nnn.n	°F	DISTMPB2	N
Saturated Condensing Tmp	snnn.n	°F	TMP_SCTB	N
Saturated Suction Temp	snnn.n	°F	TMP_SSTB	N
EXV % Open	0 - 100	%	EXV_B	N
Variable Head Press. PCT	0 - 100	%	VHPB	N
COMP B1 ANALOG VALUES				
B1 Oil Pressure Diff.	nnn.n	PSIG	DOP_B1	N
B1 Oil Pressure	nnn.n	PSIG	OP_B1	N
B1 Motor Temperature	nnn.n	°F	TMTR_B1	N
Comp B1 Running Current	0 - 600	AMPS	B1_CURR	N
Comp B1 % Must Trip Amps	0 - 100	%	B1_MTA	N
COMP B2 ANALOG VALUES				
B2 Oil Pressure Diff.	nnn.n	PSIG	DOP_B2	N
B2 Oil Pressure	nnn.n	PSIG	OP_B2	N
B2 Motor Temperature	nnn.n	°F	TMTR_B2	N
Comp B2 Running Current	0 - 600	AMPS	B2_CURR	N
Comp B2 % Must Trip Amps	0 - 100	%	B2_MTA	N

APPENDIX G (cont)
OPTIONS: Status Display

DESCRIPTION	STATUS	UNITS	POINT	FORCIBLE
FANS				
Fan 1 Relay	On/Off		FAN_1	N
Fan 2 Relay	On/Off		FAN_2	N
Fan 3 Relay	On/Off		FAN_3	N
Fan 4 Relay	On/Off		FAN_4	N
UNIT ANALOG VALUES				
Cooler Entering Fluid	snnn.n	°F	COOL_EWT	N
Cooler Leaving Fluid	snnn.n	°F	COOL_LWT	N
Condenser Entering Fluid	snnn.n	°F	COND_EWT	N
Condenser Leaving Fluid	snnn.n	°F	COND_LWT	N
Lead/Lag Leaving Fluid	snnn.n	°F	DUAL_LWT	N
TEMPERATURE RESET				
4 - 20 ma Reset Signal	nn.n	ma	RST_MA	N
Outdoor Air Temperature	snnn.n	°F	OAT	Y
Space Temperature	snnn.n	°F	SPT	Y
DEMAND LIMIT				
4 - 20 ma Demand Signal	nn.n	ma	LMT_MA	N
Demand Limit Switch 1	On/Off		DMD_SW1	N
Demand Limit Switch 2	On/Off		DMD_SW2	N
CCN Loadshed Signal	0 = Normal 1 = Redline 2 = Loadshed		DL_STAT	N
PUMPS				
Cooler Pump Relay	On/Off		COOL_PMP	N
Condenser Pump Relay	On/Off		COND_PMP	N
MISCELLANEOUS				
Dual Setpoint Switch	On/Off		DUAL_IN	N
Cooler Flow Switch	On/Off		COOLFLOW	N
Condenser Flow Switch	On/Off		CONDFLOW	N
Ice Done	Yes/No		ICE	N
Cooler Heater	On/Off		COOL_HTR	N
4-20 ma Cooling Setpoint	nn.n	ma	CSP_IN	N
4-20 ma Heating Setpoint	nn.n	ma	HSP_IN	N
Liq. Line Solenoid Valve	Open/Close		LLSV	N
Dual Chiller Size	nnn	Tons	SIZE_DPX	N
Dual Chiller Pct Total Cap	0-100	%	CAPT_DPX	N
Dual Chiller Tons Avail	nnn	Tons	SIZEADPX	N
Dual Chiller Pct Avail Cap	0-100	%	CAPA_DPX	N

7-DAY_OCC: Occupancy Configuration

DESCRIPTION	STATUS	POINT
Monday Occupied Time	00:00	MON_OCC
Monday Unoccupied Time	00:00	MON_UNC
Tuesday Occupied Time	00:00	TUE_OCC
Tuesday Unoccupied Time	00:00	TUE_UNC
Wednesday Occupied Time	00:00	WED_OCC
Wednesday Unoccupied Time	00:00	WED_UNC
Thursday Occupied Time	00:00	THU_OCC
Thursday Unoccupied Time	00:00	THU_UNC
Friday Occupied Time	00:00	FRI_OCC
Friday Unoccupied Time	00:00	FRI_UNC
Saturday Occupied Time	00:00	SAT_OCC
Saturday Unoccupied Time	00:00	SAT_UNC
Sunday Occupied Time	00:00	SUN_OCC
Sunday Unoccupied Time	00:00	SUN_UNC

APPENDIX G (cont)
ALARMDEF: Alarm Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
Alarm Routing Control	00000000	00000000		ALRM_CNT
Equipment Priority	0 to 7	4		EQP_TYPE
Comm Failure Retry Time	1 to 240	10	min	RETRY_TM
Re-alarm Time	1 to 255	30	min	RE-ALARM
Alarm System Name	XXXXXXXX	CHILLER		ALRM_NAM

BRODEFS: Broadcast Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
CCN Time/Date Broadcast	Yes/No	No		CCNBC
CCN OAT Broadcast	Yes/No	No		OATBC
Global Schedule Broadcast	Yes/No	No		GSBC
Broadcast Acknowledger	Yes/No	No		CCNBCACK
Daylight Savings Start:				
Month	1 to 12	4		STARTM
Week	1 to 5	1		STARTW
Day	1 to 7	7		STARTD
Minutes to Add	0 to 99	60	min	MINADD
Daylight Savings Stop:				
Month	1 to 12	10		STOPM
Week	1 to 5	5		STOPW
Day	1 to 7	7		STOPD
Minutes to Subtract	0 to 99	60	min	MINSUB

DISPLAY: Navigator Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
Service Password	nnnn	1111		PASSWORD
Password Enable	Enable/Disable	Enable		PASS_EBL
Metric Display	Off/On	Off		DISPUNIT
Language Selection	0 = ENGLISH 1 = FRANCAIS 2 = ESPANOL 3 = PORTUGUES	0		LANGUAGE

APPENDIX G (cont)
EXV_CONF: Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
EXVA Stepper Type	0=1500 Step 1=15000 Step	1		EXVATYPE
EXVA Steps In Range	Type 0=1500 Type 1=15000	15000	STEPS	EXVARANG
EXVA Steps Per Second	Type 0=30 Type 1=300	300		EXVARATE
EXVA Fail Position in %		0	%	EXVAPOSF
EXVA Minimum Steps		0	STEPS	EXVAMINS
EXVA Maximum Steps	Type 0=1500 Type 1=15000	15000	STEPS	EXVAMAXS
EXVA Overrun Steps	Type 0=100 Type 1=1000	1000	STEPS	EXVAOVRS
EXVB Stepper Type	0=1500 Step 1=15000 Step	1		EXVBTYPE
EXVB Steps in Range	Type 0=1500 Type 1=15000	15000	STEPS	EXVBRANG
EXVB Steps Per Second	Type 0=30 Type 1=300	300		EXVBRATE
EXVB Fail Position in %		0	%	EXVBPOSF
EXVB Minimum Steps		0	STEPS	EXVBMINS
EXVB Maximum Steps	Type 0=1500 Type 1=15000	15000	STEPS	EXVBMAXS
EXVB Overrun Steps	Type 0=100 Type 1=1000	1000	STEPS	EXVBOVRS

OCCPC01S: Occupancy Configuration

DESCRIPTION	STATUS	UNITS	POINT
Timed Override Hours	0	hours	OVR-EXT
Period 1 DOW (MTWTFSSH)	00000000		DOW1
Occupied from	00:00		OCCTOD1
Occupied to	00:00		UNOCTOD1
Period 2 DOW (MTWTFSSH)	00000000		DOW2
Occupied from	00:00		OCCTOD2
Occupied to	00:00		UNOCTOD2
Period 3 DOW (MTWTFSSH)	00000000		DOW3
Occupied from	00:00		OCCTOD3
Occupied to	00:00		UNOCTOD3
Period 4 DOW (MTWTFSSH)	00000000		DOW4
Occupied from	00:00		OCCTOD4
Occupied to	00:00		UNOCTOD4
Period 5 DOW (MTWTFSSH)	00000000		DOW5
Occupied from	00:00		OCCTOD5
Occupied to	00:00		UNOCTOD5
Period 6 DOW (MTWTFSSH)	00000000		DOW6
Occupied from	00:00		OCCTOD6
Occupied to	00:00		UNOCTOD6
Period 7 DOW (MTWTFSSH)	00000000		DOW7
Occupied from	00:00		OCCTOD7
Occupied to	00:00		UNOCTOD7
Period 8 DOW (MTWTFSSH)	00000000		DOW8
Occupied from	00:00		OCCTOD8
Occupied to	00:00		UNOCTOD8

APPENDIX G (cont)
OPTIONS1: Options Configuration

DESCRIPTION	STATUS	DEFAULT	POINT
Cooler Fluid	1 = Water 2 = Med. Brine 3 = Low Brine	1	FLUIDTYP
Min. Load Valve Select	No/Yes	No	MLV_FLG
Head Press. Control Type	0 = None 1 = Air Cooled 2 = Water Cooled 3 = Common Condenser 4 = Independent Condenser	0	HEAD_TYP
Var Head Pressure Select	0 = None 1 = 4-20 mA 2 = 0-20 mA 3 = 20-0 mA	0	VHPTYPE
Pressure Transducers	No/Yes	Yes	PRESS_TY
Cooler Pump Control	Off/On	Off	CPC
Condenser Pump Interlock	Off/On	Off	CND_LOCK
Condenser Pump Control	0 = Not Controlled 1 = On when STATE is On 2 = On when compressors are On	0	CNPC
Condenser Fluid Sensors	No/Yes	No	CD_TEMP
EMM Module Installed	No/Yes	No	EMM_BRD

OPTIONS2: Options Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
Control Method	0 = Switch 1 = 7 day sched. 2 = Occupancy 3 = CCN	0		CONTROL
Loading Sequence Select	1 = Equal loading 2 = Staged loading	1		SEQ_TYPE
Lead/Lag Sequence Select	1 = Automatic 2 = Circuit A leads 3 = Circuit B leads	1		LEAD_TYP
Compressor Sequence	1 = Automatic 2 = Compressor 1 Leads 3 = Compressor 2 Leads	1		COMP_SEQ
Cooling Setpoint Select	0 = Single 1 = Dual, remote switch controlled 2 = Dual, 7 day clock controlled 3 = Dual, CCN occupancy controlled 4 = 4-20 mA input	0		CLSP_TYP
Heating Setpoint Select	0 = Single 1 = Dual, remote switch controlled 2 = Dual, 7 day clock controlled 3 = Dual, CCN occupancy controlled 4 = 4-20 mA input	0		HTSP_TYP
Ramp Load Select	Enable/Disable	Enable		RAMP_EBL
Heat Cool Select	Cool	Cool		HEATCOOL
High LCW Alert Limit	2 to 60	60.0	ΔF	LCW_LMT
Minutes off time	0 to 15	0	min	DELAY
Deadband Multiplier	1.0 to 4.0	2.0		Z_GAIN
Close Control Select	Disable/Enable	Disable		CLS_CTRL
Ice Mode Enable	Disable/Enable	Disable		ICE_CNFG
Current Unbalance SetPnt	10 to 25	10	%	CUR_TRIP
Enable Noflow Detection	Disable/Enable	Enable		NOFLOWEN
Winterize Alert Config	Disable/Enable	Enable		WINTMSC
Alarm Relay Usage	0 = Alerts and Alarms 1 = Alarms Only 2 = Off	0		ALRMCNFG

APPENDIX G (cont)
RESETCON: Options Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
COOLING RESET				
Cooling Reset Type	0 = No Reset 1 = 4 to 20 mA Input 2 = External Temp — OAT 3 = Return Fluid 4 = External Temp — SPT	0		CRST_TYP
4-20 MA RESET				
4-20 — Degrees Reset	-30 to +30	0	^F	C420_DEG
REMOTE RESET				
Remote — No Reset Temp	0 to 125	125	dF	CREM_NO
Remote — Full Reset Temp	0 to 125	0	dF	CREM_FUL
Remote — Degrees Reset	-30 to +30	0	^F	CREM_DEG
RETURN TEMPERATURE RESET				
Return — No Reset Temp	0 to 30	10	^F	CRTN_NO
Return — Full Reset Temp	0 to 10	0	^F	CRTN_FUL
Return — Degrees Reset	-30 to +30	0	^F	CRTN_DEG
HEATING RESET				
Heating Reset Type	0 = No Reset 1 = 4 to 20 mA Input 2 = External Temp — OAT 3 = Return Fluid 4 = External Temp — SPT	0		HRST_TYP
4-20 MA RESET				
4-20 — Degrees Reset	-30 to +30	0	^F	H420_DEG
REMOTE RESET				
Remote — No Reset Temp	0 to 125	50	dF	HREM_NO
Remote — Full Reset Temp	0 to 125	80	dF	HREM_FUL
Remote — Degrees Reset	-30 to +30	0	^F	HREM_DEG
RETURN TEMPERATURE RESET				
Return — No Reset Temp	0 to 10	10	^F	HRTN_NO
Return — Full Reset Temp	0 to 30	0	^F	HRTN_FUL
Return — Degrees Reset	-30 to +30	0	^F	HRTN_DEG
DEMAND LIMIT				
Demand Limit Select	0 = None 1 = External Switch Input 2 = 4 to 20 mA Input 3 = Loadshed	0		DMD_CTRL
Demand Limit at 20 mA	0 to 100	100	%	DMT20MA
Loadshed Group Number	0 to 99	0		SHED_NUM
Loadshed Demand Delta	0 to 60	0	%	SHED_DEL
Maximum Loadshed Time	0 to 120	60	min	SHED_TIM
Demand Limit Switch 1	0 to 100	80	%	DLSWSP1
Demand Limit Switch 2	0 to 100	50	%	DLSWSP2
LEAD/LAG				
Lead/Lag Chiller Enable	Disable/Enable	Disable		LL_ENA
Master/Slave Select	Slave/Master	Master		MS_SEL
Slave Address	0 to 239	2		SLV_ADDR
Lead/Lag Balance Select	0 = Master Leads 1 = Slave Leads 2 = Automatic	0		LL_BAL
Lead/Lag Balance Delta	40 to 400	168	hours	LL_BAL_D
Lag Start Delay	0 to 30	5	min	LL_DELAY
Parallel Configuration	Yes/No	No		PARALLEL

SCHEDOVR: Schedule and Timed Override Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
Schedule Number	0 - 99	0		SCHEDNUM
Override Time Limit	0 - 4	0	hours	OTL
Timed Override Hours	0 - 4	0	hours	OVR_EXT
Timed Override	Yes/No	No		TIMEOVER

APPENDIX G (cont)
SETPOINT: Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
COOLING				
Cool Setpoint 1	-20 to 70	44.0	°F	CSP1
Cool Setpoint 2	-20 to 70	44.0	°F	CSP2
Ice Setpoint	-20 to 32	32.0	°F	CSP3
HEATING				
Heat Setpoint 1	80 to 140	100.0	°F	HSP1
Heat Setpoint 2	80 to 140	100.0	°F	HSP2
RAMP LOADING				
Cooling Ramp Loading	0.2 to 2.0	1.0		CRAMP
Heating Ramp Loading	0.2 to 2.0	1.0		HRAMP
HEAD PRESSURE				
Head Pressure Setpoint A	80 to 140	113	°F	HSP_A
Head Pressure Setpoint B	80 to 140	113	°F	HSP_B
Approach Setpoint	0.1 to 20.0	3.0	°F	APRCH_SP

UNIT: Base Unit Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
Unit Type	1 = Air Cooled 2 = Water Cooled 3 = Split System 4 = Heat Machine 5 = Air Cooled Heat Reclaim	1		UNIT_TYP
Unit Size	76 to 350	76	TONS	SIZE
Circuit A % Capacity	0 to 100	50	%	CIRCACAP
Number Circ A Compressor	1 to 2	1		NUMCA
Number Circ B Compressor	0 to 2	1		NUMCB
Discharge Super. Setpoint	10 to 40	22.0	°F	DSH_SP
EXV Circ. A Min Position	0 to 100	8.0	%	EXVAMINP
EXV Circ. B Min Position	0 to 100	8.0	%	EXVBMINP
Fan Staging Select	1 to 8	1*		FAN_TYPE
Compr. A1 Must Trip Amps	10 to 560	0†		CA1_MTA
Compr. A2 Must Trip Amps	10 to 560	0†		CA2_MTA
Compr. B1 Must Trip Amps	10 to 560	0†		CB1_MTA
Compr. B2 Must Trip Amps	10 to 560	0†		CB2_MTA
Economized?	No/Yes	Yes		ECON_SEL
Number of Evap. Passes	1 to 4	2		EVAPPASS
Circuit with LWT Sensor	A/B	A		LWTCKT

*See Table 7.
†See Appendix A.

SERVICE: Configuration

DESCRIPTION	STATUS	DEFAULT	UNITS	POINT
PID GAINS				
Head Pressure P Gain	-20.0 to +20.0	1.0		HD_PGAIN
Head Pressure I Gain	-20.0 to +20.0	0.1		HD_IGAIN
Head Pressure D Gain	-20.0 to +20.0	0.0		HD_DGAIN
Water Valve Minimum Pos.	0 to 100	20	%	HD_MIN
MISCELLANEOUS				
Motor Temp Setpoint	120.0 to 240.0	200.0	°F	MTR_T_SP
Brine Freeze Point	-20.0 to 34.0	34.0	°F	BRN_FRZ
Max. Cond. Temp Setpoint	100 to Default	*	°F	MCT_SP
EXVA Start Position	0 to 40	20	%	EXVSPOSA
EXVB Start Position	0 to 40	20	%	EXVSPOSB
COMPRESSOR ENABLE				
Enable Compressor A1	Enable/Dsable	Enable		ENABLEA1
Enable Compressor A2	Enable/Dsable	Enable		ENABLEA2
Enable Compressor B1	Enable/Dsable	Enable		ENABLEB1
Enable Compressor B2	Enable/Dsable	Enable		ENABLEB2

* GXN,R, = 152 F, HXA = 145 F, HXC = 118 F

APPENDIX G (cont)
ALARMS: Maintenance Display

DESCRIPTION	STATUS	POINT
Active Alarm #1	Axxx or Txxx	ALARM01C
Active Alarm #2	Axxx or Txxx	ALARM02C
Active Alarm #3	Axxx or Txxx	ALARM03C
Active Alarm #4	Axxx or Txxx	ALARM04C
Active Alarm #5	Axxx or Txxx	ALARM05C
Active Alarm #6	Axxx or Txxx	ALARM06C
Active Alarm #7	Axxx or Txxx	ALARM07C
Active Alarm #8	Axxx or Txxx	ALARM08C
Active Alarm #9	Axxx or Txxx	ALARM09C
Active Alarm #10	Axxx or Txxx	ALARM10C
Active Alarm #11	Axxx or Txxx	ALARM11C
Active Alarm #12	Axxx or Txxx	ALARM12C
Active Alarm #13	Axxx or Txxx	ALARM13C
Active Alarm #14	Axxx or Txxx	ALARM14C
Active Alarm #15	Axxx or Txxx	ALARM15C
Active Alarm #16	Axxx or Txxx	ALARM16C
Active Alarm #17	Axxx or Txxx	ALARM17C
Active Alarm #18	Axxx or Txxx	ALARM18C
Active Alarm #19	Axxx or Txxx	ALARM19C
Active Alarm #20	Axxx or Txxx	ALARM20C
Active Alarm #21	Axxx or Txxx	ALARM21C
Active Alarm #22	Axxx or Txxx	ALARM22C
Active Alarm #23	Axxx or Txxx	ALARM23C
Active Alarm #24	Axxx or Txxx	ALARM24C
Active Alarm #25	Axxx or Txxx	ALARM25C

CURRMODS: Maintenance Display

DESCRIPTION	STATUS	POINT
CSM controlling Chiller	ON/OFF	MODE_1
WSM controlling Chiller	ON/OFF	MODE_2
Master/Slave control	ON/OFF	MODE_3
Low Source Protection	ON/OFF	MODE_4
Ramp Load Limited	ON/OFF	MODE_5
Timed Override in effect	ON/OFF	MODE_6
Low Cooler Suction TempA	ON/OFF	MODE_7
Low Cooler Suction TempB	ON/OFF	MODE_8
Slow Change Override	ON/OFF	MODE_9
Minimum OFF time active	ON/OFF	MODE_10
Low Discharge Superheat A	ON/OFF	MODE_11
Low Discharge Superheat B	ON/OFF	MODE_12
Dual Setpoint	ON/OFF	MODE_13
Temperature Reset	ON/OFF	MODE_14
Demand Limit in effect	ON/OFF	MODE_15
Cooler Freeze Prevention	ON/OFF	MODE_16
Lo Tmp Cool/Hi Tmp Heat	ON/OFF	MODE_17
Hi Tmp Cool/Lo Tmp Heat	ON/OFF	MODE_18
Making ICE	ON/OFF	MODE_19
Storing ICE	ON/OFF	MODE_20
High SCT Circuit A	ON/OFF	MODE_21
High SCT Circuit B	ON/OFF	MODE_22
High Motor Current Cir. A	ON/OFF	MODE_23
High Motor Current Cir. B	ON/OFF	MODE_24
CKT A Off Ref Flow Delay	ON/OFF	MODE_25
CKT B Off Ref Flow Delay	ON/OFF	MODE_26
Circuit A — Pumping out	ON/OFF	MODE_27
Circuit B — Pumpout out	ON/OFF	MODE_28
Unit Off: No Water Flow	ON/OFF	MODE_29

APPENDIX G (cont)
DUALCHIL: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
Dual Chiller Link Good?	Yes/No		DC_LINK
Master Chiller Role	STAND ALONE, Lead Chiller, Lag Chiller		MC_ROLE
Slave Chiller Role	STAND ALONE, Lead Chiller, Lag Chiller		SC_ROLE
Lead Chiller Ctrl Point	snnn.n	dF	LEAD_CP
Lag Chiller Ctrl Point	snnn.n	dF	LAG_CP
Control Point	snnn.n	dF	CTRL_PNT
Cool Entering Fluid-Slave	snnn.n	dF	COOLEWTS
Cool Leaving Fluid-Slave	snnn.n	dF	COOLLWTS
Cooler Entering Fluid	snnn.n	dF	COOL_EWT
Cooler Leaving Fluid	snnn.n	dF	COOL_LWT
Lead/Lag Leaving Fluid	snnn.n	dF	DUAL_LWT
Percent Avail.Capacity	0-100	%	CAP_A
Percent Avail.Cap.Slave	0-100	%	CAP_A_S
Lag Start Delay Time	hh:mm		LAGDELAY
Load/Unload Factor	snnn.n		SMZ
Load/Unload Factor-Slave	snnn.n		SMZSLAVE
Lead SMZ Clear Commanded	Yes/No		LEADSMZC
Lag- SMZ Clear Commanded	Yes/No		LAG_SMZC
Lag Commanded Off?	Yes/No		LAG_OFF
Dual Chill Lead CapLimit	0-100	%	DCLDCAPL
Dual Chill Lag CapLimit	0-100	%	DCLGCAPL

LOADFACT: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
CAPACITY CONTROL			
Load/Unload Factor	snnn.n	%	SMZ
Control Point	snnn.n	°F	CTRL_PNT
Leaving Fluid Temp	snnn.n	°F	LWT
Calculated Z factor	n.n		Z_CALC
Capacity Trans. State	n		CAP_TRAN

MISCDATA: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
MISCELLANEOUS			
Options Temp 1, EXV AN2	snnn.n	°F	OPT_TMP1
Options Temp 2, EXV AN1	snnn.n	°F	OPT_TMP2
Options Temp 3, SCB AN9	snnn.n	°F	OPT_TMP3
Options Temp 4, SCB AN10	snnn.n	°F	OPT_TMP4
Options Current 1	nn.n	ma	OPT_CUR1
Options Current 2	nn.n	ma	OPT_CUR2
Pumpout Failure Count, A	nnn	—	PFAIL_A
Pumpout Failure Count, B	nnn	—	PFAIL_B
HXC Brine Config Lock	No/Yes	—	BRN_LOCK

OCCDEFM: Occupancy Maintenance Display

DESCRIPTION	STATUS	POINT
Current Mode (1=Occup.)	0,1	MODE
Current Occup. Period #	0-8	PER-NO
Timed-Override in Effect	Yes/No	OVERLAST
Time-Override Duration	0-4 hours	OVR_HRS
Current Occupied Time	hh:mm	STRRTIME
Current Unoccupied Time	hh:mm	ENDTIME
Next Occupied Day		NXTOCDAY
Next Occupied Time	hh:mm	NXTOCTIM
Next Unoccupied Day		NXTUNDAY
Next Unoccupied Time	hh:mm	NXTUNTIM
Previous Unoccupied Day		PRVUNDAY
Previous Unoccupied Time	hh:mm	PRVUNTIM

APPENDIX G (cont)
OILPRESS: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
A1 Oil Pressure	snnn.n	PSIG	OP_A1
A2 Oil Pressure	snnn.n	PSIG	OP_A2
B1 Oil Pressure	snnn.n	PSIG	OP_B1
B2 Oil Pressure	snnn.n	PSIG	OP_B2
A1 Oil Filter Diff. Press	nnn.n	PSI	FLTP_A1
A2 Oil Filter Diff. Press	nnn.n	PSI	FLTP_A2
B1 Oil Filter Diff. Press	nnn.n	PSI	FLTP_B1
B2 Oil Filter Diff. Press	nnn.n	PSI	FLTP_B2
OIL PRESSURE SETPOINTS			
Calculated Oil Press A1	nn.n	PSI	OIL_SPA1
Calculated Oil Press A2	nn.n	PSI	OIL_SPA2
Calculated Oil Press B1	nn.n	PSI	OIL_SPB1
Calculated Oil Press B2	nn.n	PSI	OIL_SPB2
MAX OPERATING PRESSURE			
Calculated MOP Circuit A	nn.n	°F	MOP_SPA
Calculated MOP Circuit B	nn.n	°F	MOP_SPB

STR TABS: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
Machine Operating Hours	nnnnnn	hours	ABS_HRM
Machine Starts	nnnnnn		
Circuit A Run Hours	nnnnnn	hours	ABS_CYM
Compressor A1 Run Hours	nnnnnn	hours	ABS_HRA1
Compressor A2 Run Hours	nnnnnn	hours	ABS_HRA2
Circuit B Run Hours	nnnnnn	hours	ABS_HRB
Compressor B1 Run Hours	nnnnnn	hours	ABS_HRB1
Compressor B2 Run Hours	nnnnnn	hours	ABS_HRB2
Circuit A Starts	nnnnnn		ABS_CYA
Compressor A1 Starts	nnnnnn		ABS_CYA1
Compressor A2 Starts	nnnnnn		ABS_CYA2
Circuit B Starts	nnnnnn		ABS_CYB
Compressor B1 Starts	nnnnnn		ABS_CYB1
Compressor B2 Starts	nnnnnn		ABS_CYB2

STR THOUR: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
Machine Operating Hours	nnnnnn	hours	HR_MACH
Machine Starts	nnnnnn		CY_MACH
Circuit A Run Hours	nnnnnn	hours	HR_CIRA
Compressor A1 Run Hours	nnnnnn	hours	HR_A1
Compressor A2 Run Hours	nnnnnn	hours	HR_A2
Circuit B Run Hours	nnnnnn	hours	HR_CIRB
Compressor B1 Run Hours	nnnnnn	hours	HR_B1
Compressor B2 Run Hours	nnnnnn	hours	HR_B2
Circuit A Starts	nnnnnn		CY_CIRA
Compressor A1 Starts	nnnnnn		CY_A1
Compressor A2 Starts	nnnnnn		CY_A2
Circuit B Starts	nnnnnn		CY_CIRB
Compressor B1 Starts	nnnnnn		CY_B1
Compressor B2 Starts	nnnnnn		CY_B2

APPENDIX G (cont)

TESTMODE: Maintenance Display

DESCRIPTION	STATUS	UNITS	POINT
Service Test Mode	On/Off		MAN_CTRL
Manual Control Override	On/Off		FAC_CTRL
Compressor A1 Relay	On/Off		S_A1_RLY
Compressor A2 Relay	On/Off		S_A2_RLY
Compressor B1 Relay	On/Off		S_B1_RLY
Compressor B2 Relay	On/Off		S_B2_RLY
Loader A1 Relay	On/Off		S_LDR_A1
Loader A2 Relay	On/Off		S_LDR_A2
Loader B1 Relay	On/Off		S_LDR_B1
Loader B2 Relay	On/Off		S_LDR_B2
Oil Solenoid A1	On/Off		S_OSL_A1
Oil Solenoid A2	On/Off		S_OSL_A2
Oil Solenoid B1	On/Off		S_OSL_B1
Oil Solenoid B2	On/Off		S_OSL_B2
Motor Cooling A1 Solenoid	On/Off		S_MCS_A1
Motor Cooling A2 Solenoid	On/Off		S_MCS_A2
Motor Cooling B1 Solenoid	On/Off		S_MCS_B1
Motor Cooling B2 Solenoid	On/Off		S_MCS_B2
FAN 1 Relay	On/Off		S_FAN_1
FAN 2 Relay	On/Off		S_FAN_2
FAN 3 Relay	On/Off		S_FAN_3
FAN 4 Relay	On/Off		S_FAN_4
Oil Heater	On/Off		S_OHTR_A
Oil Heater	On/Off		S_OHTR_B
Oil Pump	On/Off		S_OPMP_A
Oil Pump	On/Off		S_OPMP_B
Cooler Pump Relay	On/Off		S_CL_PMP
Condenser Pump Relay	On/Off		S_CN_PMP
Minimum Load Valve	On/Off		S_MLV
Cooler Heater	On/Off		S_CHTR
Remote Alarm Relay	On/Off		S_ALRM
EXV % OPEN	0-100	%	S_EXV_A
EXV % OPEN	0-100	%	S_EXV_B
Var Head Press %	0-100	%	S_VHPA
Var Head Press %	0-100	%	S_VHPB
Liq. Line Solenoid Valve	Open/Close		S_LLSV

VERSIONS: Maintenance Display

DESCRIPTION	VERSION	STATUS
MBB	CESR131344-	nn-nn
EXV	CESR131172-	nn-nn
EMM	CESR131174-	nn-nn
SCB	CESR131226-	nn-nn
TI CCP 1	100233-1R3-	nn-nn
TI CCP 2	100233-1R3-	nn-nn
NAVIGATOR	CESR130227-	nn-nn

APPENDIX G (cont)
WINTLOG: Maintenance Display

DESCRIPTION	STATUS	POINT
Winterization Performed	No	WINTDONE
Date Winterized	00/00/00 00:00	WMSG00
Date Winterized	00/00/00 00:00	WMSG01
Date Winterized	00/00/00 00:00	WMSG02
Date Winterized	00/00/00 00:00	WMSG03
Date Winterized	00/00/00 00:00	WMSG04
Date Winterize Alerted	00/00/00 00:00	WALRT00
Date Winterize Alerted	00/00/00 00:00	WALRT01
Date Winterize Alerted	00/00/00 00:00	WALRT02
Date Winterize Alerted	00/00/00 00:00	WALRT03
Date Winterize Alerted	00/00/00 00:00	WALRT04
Date Winter Configured	00/00/00 00:00	WCONF00
Date Winter Unconfigured	00/00/00 00:00	WUCONF00
Date Winter Configured	00/00/00 00:00	WCONF01
Date Winter Unconfigured	00/00/00 00:00	WUCONF01
Date Winter Configured	00/00/00 00:00	WCONF02
Date Winter Unconfigured	00/00/00 00:00	WUCONF02

WSMDEFME: WSM Maintenance Display

DESCRIPTION	STATUS	POINT
WSM Active?	Yes/No	WSMSTAT
Chilled water temp	snn.n °F	CHWTEMP
Equipment status	On/Off	CHLRST
Commanded state	Enable/Disable/None	CHLRENA
CHW setpoint reset value	nn.n °F	CHWRVAL
Current CHW setpoint	snn.n °F	CHWSTPT

APPENDIX H

30GXN,R Duplex Combinations

SIZE	MODULE A	MODULE B
283	153	138
303	163	138
328	178	153
353	178	178
370	225	150
373	253	138
390	264	135
393	253	153
415	264	160
418	268	153
450	225	225
453	228	228
475	249	225
478	253	228
500	249	249
503	253	253
525	264	264
528	268	268

APPENDIX I: MOTORMASTER® V OPERATION INSTRUCTION

Motormaster V (MMV) is a Variable Frequency Drive (VFD) that varies the condenser fan speed. The speed varies in proportion to a 4 to 20 mA signal produced by the *ComfortLink™* controls. The MMV output speed is displayed in Hz.

Configuration

The MMV is configured for 1 of 12 operation modes based on the inputs to the control terminal block. 30GXN,R units use operating modes 5-8. In these configurations, the MMV follows a 4 to 20 mA speed reference signal present on terminals 25 (+) and 2 (-). One additional jumper is required to configure the drive for 50/60 Hz operation and input voltage. See Table 1 below for proper inputs. Once the drive is powered, it will change to the mode selected according to the inputs. No additional programming is required.

Drive Programming

⚠ CAUTION

It is strongly recommended that the user NOT change any programming without consulting Carrier service personnel. Unit damage may occur from improper programming.



To enter password and change program values:

Press **Mode**.

Upper right decimal point blinks.

Display reads "00".



To enter the PROGRAM mode to access the parameters, press the **Mode** button. This will activate the PASSWORD prompt (if the password has not been disabled). The display will read "00" and the upper right-hand decimal point will be blinking.



Use the  and  buttons to scroll to the password value (the factory default password is "111") and press the **Mode** button. Once the correct password value is entered, the display will read "P01," which indicates that the PROGRAM mode has been accessed at the beginning of the parameter menu (P01 is the first parameter).

NOTE: If the display flashes "Er", the password was incorrect, and the process to enter the password must be repeated.

Press **Mode** to display present parameter setting.

Upper right decimal point blinks.

Use  and  to scroll to the desired parameter number.

Use the  and  buttons to scroll to the desired parameter number.

Once the desired parameter number is found, press the **Mode** button to display the present parameter setting. The upper right-hand decimal point will begin blinking, indicating that the present parameter setting is being displayed, and that it can be changed by using the up and down buttons.

Use  and  to change setting.

Press **Mode** to store new setting.

Pressing the **Mode** will store the new setting and also exit the PROGRAM mode. To change another parameter, press the **Mode** key again to re-enter the PROGRAM mode (the parameter menu will be accessed at the parameter that was last viewed or changed before exiting). If the **Mode** key is pressed within two minutes of exiting the PROGRAM mode, the password is not required access the parameters. After two minutes, the password must be entered in order to access the parameters again.

To change password: first enter the current password then change parameter P44 to the desired password.

To reset factory defaults: change P48 to one of the 4 operating modes (5-8) and then cycle power.

Table 2 shows all program parameters for each of the 4 operating modes.

EPM chip:

This drive uses a removable EPM chip to store program parameters. It should not be removed with power applied to the VFD.

Table 1: Configuration Tables

NOMINAL VOLTAGE	MODE	Hz	CONTROL INPUT (pins 25, 2)	START CONTACTS
208/230/460/575*	5	60	External control 4-20 mA	TB1-TB2
208/380	6	60	External control 4-20 mA	TB13A-TB2
230	7	50	External control 4-20 mA	TB13B-TB2
380/415	8	50	External control 4-20 mA	TB13C-TB2

*208 v can run in mode 5 or 6.

APPENDIX I (cont)

Table 2: Program Parameters for the 4 Operating Modes:

PARAMETER NUMBER	DESCRIPTION	OPERATING MODES			
		Group 5	Group 6	Group 7	Group 8
P01	Line Voltage: 01 = low line, 02 = high line	01	02	01	02
P02	Carrier Freq: 01 = 4 kHz, 02 = 6 kHz, 03 = 8 kHz	01	01	01	01
P03	Startup mode: flying restart	06	06	06	06
P04	Stop mode: coast to stop	01	01	01	01
P05	Standard Speed source: 04 = 4-20 ma, 05 = R22, 06 = R134a	04	04	04	04
P06	TB-14 output: 01 = none	01	01	01	01
P08	TB-30 output: 01 = none	01	01	01	01
P09	TB-31 output: 01 = none	01	01	01	01
P10	TB-13A function sel: 01 = none	01	01	01	01
P11	TB-13B function sel: 01 = none	01	01	01	01
P12	TB-13C function sel: 01 = none	01	01	01	01
P13	TB-15 output: 01 = none	01	01	01	01
P14	Control: 01 = Terminal strip	01	01	01	01
P15	Serial link: 02 = enabled 9600,8,N,2 w/timer	02	02	02	02
P16	Units editing: 02 = whole units	02	02	02	02
P17	Rotation: 01 = forward only, 03 = reverse only	01	01	01	01
P19	Acceleration time: 10 sec	10	10	10	10
P20	Deceleration time: 10 sec	10	10	10	10
P21	Dc brake time: 0	0	0	0	0
P22	DC BRAKE VOLTAGE 0%	0	0	0	0
P23	Min freq = 8 hz ~ 100 – 160 rpm	8	8	8	8
P24	Max freq	60	60	50	50
P25	Current limit:	125	125	110	110
P26	Motor overload: 100	100	100	100	100
P27	Base freq: 60 or 50 Hz	60	60	50	50
P28	Fixed boost: 0.5 % at low frequencies	0.5	0.5	0.5	0.5
P29	Accel boost: 0%	0	0	0	0
P30	Slip compensation: 0%	0	0	0	0
P31	Preset spd #1: 0	57	57	47	47
P32	Preset spd #2: 0	0	0	0	0
P33	Preset spd #3: 0	0	0	0	0
P34	Preset spd 4 default - R22 setpoint, TB12-2 open	18.0	18.0	18.0	18.0
P35	Preset spd 5 default - R134a setpoint, TB12-2 closed	12.6	12.6	12.6	12.6
P36	Preset spd 6 default	0	0	0	0
P37	Preset spd 7 default	0	0	0	0
P38	Skip bandwidth	0	0	0	0
P39	Speed scaling	0	0	0	0
P40	Frequency scaling 50 or 60 Hz	60	60	50	50
P41	Load scaling: default (not used so NA)	200	200	200	200
P42	Accel/decel #2: default (not used so NA)	60	60	60	60
P43	Serial address	1	1	1	1
P44	Password:111	111	111	111	111
P45	Speed at min signal: 8 Hz used when PID disabled and 4-20ma input	8	8	8	8
P46	Speed at max feedback: 60 or 50 Hz. Used when PID disabled and 4-20ma input	60	60	50	50
P47	Clear history? 01 = maintain, (set to 00 to clear)	01	01	01	01
P48	Program selection: Mode 1 - 12	05	06	07	08
P61	PI Mode: 05 = reverse, 0-5V, 01 = no PID	01	01	01	01
P62	Min feedback = 0 (0V *10)	0	0	0	0
P63	Max feedback = 50 (5V * 10)	50	50	50	50
P64	Proportional gain = 4%	4	4	4	4
P65	Integral gain = .2	.2	.2	.2	.2
P66	PI accel/decel (setpoint change filter) = 5	5	5	5	5
P67	Min alarm	0	0	0	0
P68	Max alarm	0	0	0	0

Troubleshooting

Troubleshooting the Motormaster® V control requires a combination of observing system operation and VFD display information. The MMV should follow the 4-20 mA signal from the *ComfortLink™* controls.

The speed command from the *ComfortLink* controls can be monitored in 2 ways:

1. Variables VH.PA, VH.PB in the "outputs" submenu of *ComfortLink* control — given as a percentage of 4 to 20 mA range.

2. P56 in Motormaster V shows 4-20 mA input in percent of maximum input.

Due to the variable definitions of each controller, Table 3 shows a cross-reference:

Table 3: Controller Cross-Reference

CONTROL SIGNAL	VH.PA, VH.PB (<i>ComfortLink</i>)	4-20mA Input (P56, Motormaster V)	VFD Speed (P71, Motormaster V)
4 ma	0%	20%	8Hz
12 ma	50%	60%	26Hz
20 ma	100%	100%	60Hz

The MMV also provides real time monitoring of key inputs and outputs. The collective group is displayed through parameters 50-56 and all values are read only.

- **P50 FAULT HISTORY** — Last 8 faults
- **P51: SOFTWARE version**
- **P52: DC BUS VOLTAGE** — in percent of nominal. Usually rated input voltage x 1.4.
- **P53: MOTOR VOLTAGE** — in percent of rated output voltage
- **P54: LOAD** — in percent of drives rated output current rating
- **P55: VDC INPUT** — in percent of maximum input: 50 will indicate full scale which is 5 v
- **P56: 4-20 mA INPUT** — in percent of maximum input: 20% = 4 mA, 100% = 20 mA



Fault codes

The drive is programmed to automatically restart after a fault and will attempt to restart three times after a fault (the drive will not restart after CF, cF, GF, F1, F2-F9, or Fo faults). If all three restart attempts are unsuccessful, the drive will trip into

FAULT LOCKOUT (LC), which requires a manual reset. See Tables 4 and 5.

To disable external control mode (5-8) and enter manual speed control mode:

Change P05 to '01-key pad'

Push  and  arrow key to set manual speed.

To provide manual start/stop control:

Remove start command jumper and install a switch between the appropriate start terminals.

Loss of CCN communications:

CCN communications with external control systems can be affected by high frequency electrical noise generated by Motormaster V control. Ensure unit is well grounded to eliminate ground currents along communication lines.

If communications are lost only while Motormaster V control is in operation, order a signal isolator/repeater (CEAS420876-2) and power supplies (CEAS221045-01, 2 required) for the CCN communication line.

Table 4: Fault Codes

FAULT CODE	DESCRIPTION	SOLUTION
AF	High Temperature Fault: Ambient temperature is too high; Cooling fan has failed (if equipped).	Check cooling fan operation
CF	Control Fault: A blank EPM, or an EPM with corrupted data has been installed.	Perform a factory reset using Parameter 48 — PROGRAM SELECTION. See Programming Notes (Step 6).
cF	Incompatibility Fault: An EPM with an incompatible parameter version has been installed.	Either remove the EPM or perform a factory reset (Parameter 48) to change the parameter version of the EPM to match the parameter version of the drive.
GF	Data Fault: User data and OEM defaults in the EPM are corrupted.	Restore factory defaults by toggling P48 to another mode. Then set P48 to desired mode to restore all defaults for that mode. See configuration section (Step 2). If that does not work, replace EPM.
HF	High DC Bus Voltage Fault: Line voltage is too high; Deceleration rate is too fast; Overhauling load.	Check line voltage — set P01 appropriately
JF	Serial Fault: The watchdog timer has timed out, indicating that the serial link has been lost.	Check serial connection (computer) Check settings for P15 Check settings in communication software to match P15
LF	Low DC Bus Voltage Fault: Line voltage is too low.	Check line voltage — set P01 appropriately
OF	Output Transistor Fault: Phase to phase or phase to ground short circuit on the output; Failed output transistor; Boost settings are too high; Acceleration rate is too fast.	Reduce boost or increase acceleration values. If unsuccessful, replace drive.
PF	Current Overload Fault: VFD is undersized for the application; Mechanical problem with the driven equipment.	Check line voltage — set P01 appropriately Check for dirty coils Check for motor bearing failure
SF	Single-phase Fault: Single-phase input power has been applied to a three-phase drive.	Check input power phasing
F1	EPM Fault: The EPM is missing or damaged.	
F2-F9, Fo	Internal Faults: The control board has sensed a problem.	Consult factory.
Drive display = '---' even though drive should be running	Start contact is not closed.	Check auxiliary contact for proper operation and configuration. See configuration section (Step 5).
Drive display = 8.0 Hz even though fan should be running faster	Control signal is at 4 mA	Saturated condensing temperature is below setpoint in ComfortLink controls.
VFD flashes 57 (or 47) and LCS	Speed signal lost. Drive will operate at 57 (or 47) Hz until reset or loss of start command. Resetting requires cycling start command (or power).	In stand-alone mode: In external control mode (30GXN,R) check wiring from unit controls J8 for 4-20 mA signal. Drive runs at 57 Hz in modes 5,6 and 47 Hz in modes 7,8.
VFD flashes "LCS and ---"	Start contact is not closed.	Check auxiliary contact for proper operation and configuration. See configuration section (Step 5).
LC	Fault lockout — 3 or more unsuccessful starts	View PSD: Fault History to determine.

Table 5: Status Indication

FAULT CODE	FAULT NAME	DESCRIPTION
CL	CURRENT LIMIT	The output has exceeded the CURRENT LIMIT setting (Parameter 25) and the drive is reducing the output frequency to reduce the output current. If the drive remains in CURRENT LIMIT for too long, it can trip into a CURRENT OVERLOAD fault (PF).
Er	ERROR	Invalid data has been entered.
GE	GE	"GE" will be displayed if an attempt is made to change the OEM default settings when the drive is operating in the OEM mode (see Parameter 48).
LC	FAULT LOCKOUT	Failed three restart attempts. Requires a manual reset.
SP	START PENDING	This is displayed during the first 15 second interval between restart attempts.

START-UP CHECKLIST FOR 30GX,HX LIQUID CHILLER

I. Project Information

Job Name _____

Address _____

City _____ State _____ Zip _____

Installing Contractor _____

Sales Office _____

Start-up Performed By _____

Design Information

	Capacity	EWT	LWT	Fluid Type	Flow Rate	P.D.	Ambient
Cooler							
Condenser							

Equipment

Model _____ Serial _____

Compressors

A1) Model _____ Serial _____

A2) Model _____ Serial _____

B1) Model _____ Serial _____

B2) Model _____ Serial _____

Condenser (30HXA only)

Circuit A

Circuit B

Model _____ Model _____

Serial _____ Serial _____

Model _____ Model _____

Serial _____ Serial _____

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE

II. Preliminary Equipment Check (to be completed by installing contractor)

Is there any physical damage? Yes No

Description _____

1. Unit is installed level as per the installation instructions. Yes No
2. Power supply agrees with the unit nameplate. Yes No
3. Correct control voltage _____ vac. Yes No
4. Electrical power wiring is installed properly. (Branch circuit fused or HACR breaker) Yes No
5. Unit is properly grounded. Yes No
6. Electrical circuit protection has been sized and installed properly. Yes No
7. All terminals are tight. Yes No
8. All plug assemblies are tight. Yes No
9. All cables and thermistors have been inspected for crossed wires. Yes No
10. All thermistors are fully inserted into wells. Yes No
11. Mechanical room maintained above 50 F (10 C) (30HX only). Yes No
12. Relief valve vent piping installed per local codes. Yes No
13. Wind baffles installed (30GX, 09DX). Yes No
 NOTE: Required for unit operation where winds of 5 mph (2.2 m/s) or greater are anticipated at outdoor ambient temperatures below 32 F (0° C).

Chilled Water System Check

1. All chilled water valves are open. Yes No
2. All piping is connected properly. Yes No
3. All air has been purged from the system. Yes No
4. Chilled water pump is operating with the correct rotation. Yes No
5. Chilled water pump starter interlocked with chiller. Yes No
6. Inlet piping to cooler includes a 20 mesh strainer. Yes No
7. Water loop volume greater than 3 gal/ton for air conditioning or 6 gal/ton for process cooling and low ambient operation. Yes No
8. Proper loop freeze protection provided to _____ °F (°C). Yes No
 Antifreeze type _____ Concentration _____ %.
(If antifreeze solution is not utilized on 30GX machines and the minimum outdoor ambient is below 32 F (0° C) then items 9-12 have to be completed to provide cooler freeze protection to 0° F. Refer to Installation Instructions for proper cooler winterization procedure.)
9. Outdoor piping wrapped with electric heater tape. Yes No
10. Cooler heaters installed and operational (30GX Only). Yes No
11. Cooler heads and tube sheets are insulated. Yes No
12. Chilled water pump controlled by chiller. Yes No
 (Chilled water pump will start automatically to circulate water through cooler during potential freezing conditions.)

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE

Condenser Water System Check (30HXC Only)

- 1. All condenser water valves are open. Yes No
- 2. All piping is connected properly. Yes No
- 3. All air has been purged from the system. Yes No
- 4. Condenser water pump is operating with the correct rotation. Yes No
- 5. Condenser water pump controlled by chiller. Yes No
- 6. Inlet piping to condenser includes a 20 mesh strainer. Yes No
- 7. Condenser water flow switch installed. (Required for 30HXC Brine.) Yes No
- 8. Condenser water flow switch configured and operational. Yes No
- 9. Condenser water control valve installed. (Separate control power required.) Yes No

Remote Condenser System Check (30HXA Only)

- 1. All refrigerant piping is connected properly. Yes No
- 2. Equalizer line is installed from motor cooling line to back-pressure valve. Yes No
- 3. Liquid line filter driers installed. Yes No
- 4. Liquid line solenoid valves installed. Yes No
- 5. R-134a fan cycling pressure switches installed (09DK). Yes No
- 6. Refrigerant piping and condenser have been leak checked and evacuated. Yes No

III. Unit Start-Up

- 1. All liquid line valves are open. Yes No
- 2. All discharge valves are open. Yes No
- 3. All suction service valves are open (if equipped). Yes No
- 4. All oil line valves are open. Yes No
- 5. Chilled water flow switch is operational. Yes No
- 6. Leak check unit. Locate, repair and report any refrigerant leaks. Yes No
- 7. Voltage is within unit nameplate range. Yes No

8. Check voltage imbalance: A-B _____ A-C _____ B-C _____

Average voltage = _____ (A-B + A-C + B-C)/3

Maximum deviation from average voltage = _____

Voltage imbalance = _____% (max. deviation/average voltage) x 100

Voltage imbalance less than 2%.

Yes No

(DO NOT start chiller if voltage imbalance is greater than 2%. Contact local Utility for assistance.)

- 9. Verify cooler flow rate (maximum and minimum) Yes No

Pressure entering cooler _____ psig (kpa)

Pressure leaving cooler _____ psig (kpa)

Cooler pressure drop _____ psig (kpa)

Psig x 2.31 ft/psi = _____ ft of water

Kpa x 0.334 m/psi = _____ m of water

Maximum cooler flow rate _____ gpm (l/s) (See Cooler Pressure Drop Curve)

Minimum cooler flow rate _____ gpm (l/s) (See Cooler Pressure Drop Curve)

III. Unit Start-Up (cont)

9. Verify condenser flow rate.

Yes No

Pressure entering condenser _____ psig (kpa)
Pressure leaving condenser _____ psig (kpa)
Condenser pressure drop _____ psig (kpa)
Psig x 2.31 ft/psi = _____ ft of water
Kpa x 0.334 m/psi = _____ m of water
Condenser flow rate _____ gpm (l/s) (See Condenser Pressure Drop Curve)

Start and operate machine. Complete the following:

- 1. Complete component test. Yes No
- 2. Check refrigerant and oil charge. Record charge information. Yes No
- 3. Record compressor motor current. Yes No
- 4. Record two sets of operational log readings. Yes No
- 5. Provide operating instructions to owner's personnel. Instruction time _____ hrs.

Refrigerant Charge

Additional charge required

Circuit A _____ Circuit B _____
_____ _____

Oil Charge

Additional charge required

_____ _____

Comments:

Signatures:

Start-up Technician _____ Customer Representative _____

Date _____

Date _____

Record Software Versions

MODE — RUN STATUS

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION
VERS	MBB		CESR131344-____-____
	EXV		CESR131172-____-____
	EMM		CESR131174-____-____
	CP1		100233-1R3-____-____
	CP2		100233-1R3-____-____
	SCB		CESR131226-____-____
	NAVI		CESR131227-____-____

(Press and simultaneously to obtain software versions)

Record Configuration Information

MODE — CONFIGURATION

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION	ENTRY
DISP	TEST	ON/OFF	TEST DISPLAY LED'S	
	METR	ON/OFF	METRIC DISPLAY	
	LANG	x	LANGUAGE SELECTION	
	PAS.E	ENBL/DSBL	PASSWORD ENABLE	
	PASS	xxxx	SERVICE PASSWORD	
UNIT	TYPE	x	UNIT TYPE	
	TONS	xxx	UNIT SIZE	
	CAP.A	xxx%	CIRCUIT A% CAPACITY	
	CMP.A	x	NUMBER CIRC A COMPRESSOR	
	CMP.B	x	NUMBER CIRC B COMPRESSOR	
	DIS.S	xx.x	DISCHARGE SUPER SETPOINT	
	FAN.S	x	FAN STAGING SELECT	
	CM.A1	xxx AMPS	COMPR. A1 MUST TRIP AMPS	
	CM.A2	xxx AMPS	COMPR. A2 MUST TRIP AMPS	
	CM.B1	xxx AMPS	COMPR. B1 MUST TRIP AMPS	
	CM.B2	xxx AMPS	COMPR. B2 MUST TRIP AMPS	
	OPT1	FLUD	x	COOLER FLUID
MLVS		YES/NO	MIN LOAD VALVE SELECT	
HPCT		x	HEAD PRESSURE CONTROL TYPE	
VHPT		x	VAR HEAD PRESSURE SELECT	
PRTS		YES/NO	PRESSURE TRANSDUCERS	
CPC		ON/OFF	COOLER PUMP CONTROL	
CNP.I		ON/OFF	CONDENSER PUMP INTERLOCK	
CNPC		x	CONDENSER PUMP CONTROL	
CWT.S		YES/NO	CONDENSER FLUID SENSORS	
EMM	YES/NO	EMM MODULE INSTALLED		

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE

Record Configuration Information (cont)

MODE — CONFIGURATION (cont)

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION	ENTRY	
OPT2	CTRL	x	CONTROL METHOD		
	CCNA	xxx	CCN ADDRESS		
	CCNB	xxx	CCN BUS NUMBER		
	BAUD	x	CCN BAUD RATE		
	LOAD	x	LOADING SEQUENCE SELECT		
	LLCS	x	LEAD/LAG SEQUENCE SELECT		
	CP.SQ	x	COMPRESSOR SEQUENCE		
	LCWT	xx.x	HIGH LCW ALERT LIMIT		
	DELY	xx	MINUTES OFF TIME		
	CLS.C	ENBL/DSBL	CLOSE CONTROL SELECT		
	ICE.M	ENBL/DSBL	ICE MODE ENABLE		
	C.UNB	xx%	CURRENT UNBALANCE SETPOINT		
	NO.FL	ENBL/DSBL	NO REFRIGERANT FLOW ALRM ENABLE		
	W.MSG	ENBL/DSBL	WINTERIZE ALERT CONFIG		
	ALR.C	x	ALARM RELAY USAGE		
RSET	CRST	x	COOLING RESET TYPE		
	CRT1	xxx.x	NO COOL RESET TEMP		
	CRT2	xxx.x	FULL COOL RESET TEMP		
	DGRC	xx.x	DEGREES COOL RESET		
	HRST	x	HEATING RESET TYPE		
	HRT1	xxx.x	NO HEAT RESET TEMP		
	HRT2	xxx.x	FULL HEAT RESET TEMP		
	DGRH	xx.x	DEGREES HEAT RESET		
	DMDC	x	DEMAND LIMIT SELECT		
	DM20	xxx%	DEMAND LIMIT AT 20 MA		
	SHNM	xxx	LOADSHED GROUP NUMBER		
	SHDL	xxx%	LOADSHED DEMAND DELTA		
	SHTM	xxx	MAXIMUM LOADSHED TIME		
	DLS1	xxx%	DEMAND LIMIT SWITCH 1		
	DLS2	xxx%	DEMAND LIMIT SWITCH 2		
	LLEN	ENBL/DSBL	LEAD/LAG CHILLER ENABLE		
	MSSL	SLVE/MAST	MASTER/SLAVE SELECT		
	SLVA	xxx	SLAVE ADDRESS		
	LLBL	x	LEAD/LAG BALANCE SELECT		
	LLBD	xxx	LEAD/LAG BALANCE DELTA		
	LLDY	xxx	LAG START DELAY		
	PARA	YES/NO	PARALLEL CONFIGURATION		
	SLCT	CLSP	x	COOLING SETPOINT SELECT	
		HTSP	x	HEATING SETPOINT SELECT	
RL.S		ENBL/DSBL	RAMP LOAD SELECT		
CRMP		x.x	COOLING RAMP LOADING		
HRMP		x.x	HEATING RAMP LOADING		
HCSW		COOL/HEAT	HEAT COOL SELECT		
Z.GN		x.x	DEADBAND MULTIPLIER		
BRN.L		YES/NO	HXC BRINE CONFIG LOCK		

**Record Configuration Information
MODE — CONFIGURATION (cont)**

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION	ENTRY	
SERV	H.PGN	xx.x	HEAD PRESSURE P GAIN		
	H.IGN	xx.x	HEAD PRESSURE I GAIN		
	H.DGN	xx.x	HEAD PRESSURE D GAIN		
	H.MIN	xxx.x	WATER VALVE MINIMUM POS		
	MT.SP	xxx.x	MOTOR TEMP SETPOINT		
	BR.FZ	xxx.x	BRINE FREEZE POINT		
	MC.SP	xxx.x	MAX. COND. TEMP SETPOINT		
	EX.S.A	xx.x	EXVA START POSITION		
	EX.S.B	xx.x	EXVB START POSITION		
	EN.A1	ENBL/DSBL	ENABLE COMPRESSOR A1		
	EN.A2	ENBL/DSBL	ENABLE COMPRESSOR A2		
	EN.B1	ENBL/DSBL	ENABLE COMPRESSOR B1		
	EN.B2	ENBL/DSBL	ENABLE COMPRESSOR B2		
	W.DNE	YES/NO	WINTERIZATION PERFORMED		
	ECON	YES/NO	ECONOMIZED		
	EVPS	x	NUMBER OF EVAP. PASSES		
	LWTC	A/B	CIRCUIT WITH LWT SENSOR		
	AP.SP	xxx.x	APPROACH SETPOINT		
	BCST	TD.B.C	ON/OFF	CCN TIME/DATE BROADCAST	
		OAT.B	ON/OFF	CCN OAT BROADCAST	
GS.B.C		ON/OFF	GLOBAL SCHEDULE BROADCAST		
BC.AK		ON/OFF	BROADCAST ACKNOWLEDGER		

MODE — SETPOINT

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION	ENTRY
COOL	CSP.1	xxx.x	COOLING SETPOINT 1	
	CSP.2	xxx.x	COOLING SETPOINT 2	
	CSP.3	xxx.x	ICE SETPOINT	
HEAT	HSP.1	xxx.x	HEATING SETPOINT 1	
	HSP.2	xxx.x	HEATING SETPOINT 2	
HEAD	HD.PA	xxx.x	HEAD PRESSURE SETPOINT A	
	HD.PB	xxx.x	HEAD PRESSURE SETPOINT B	

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE

Component Test — Complete the following tests to make sure all peripheral components are operational before the compressors are started.

MODE – SERVICE TEST

To Enable Service Test Mode, move Enable/Off/Remote Contact Switch to OFF. Configure TEST to ON. Move Switch to ENABLE.

SUB-MODE	ITEM	DISPLAY	ITEM EXPANSION	ENTRY
TEST		ON/OFF	SERVICE TEST MODE	COMPLETE
OUTS	EXV.A	xxx %	EXV % OPEN	
	VH.PA	xxx %	VAR HEAD PRESS %	
	OL.PA	ON/OFF	OIL PUMP	
	MC.A1	ON/OFF	MOTOR COOLING SOLENOID A1	
	MC.A2	ON/OFF	MOTOR COOLING SOLENOID A2	
	OS.A1	ON/OFF	OIL SOLENOID A1	
	OS.A2	ON/OFF	OIL SOLENOID A2	
	EXV.B	xxx %	EXV % OPEN	
	VH.PB	xxx %	VAR HEAD PRESS %	
	OL.PB	ON/OFF	OIL PUMP	
	MC.B1	ON/OFF	MOTOR COOLING SOLENOID B1	
	MC.B2	ON/OFF	MOTOR COOLING SOLENOID B2	
	OS.B1	ON/OFF	OIL SOLENOID B1	
	OS.B2	ON/OFF	OIL SOLENOID B2	
	FAN1	ON/OFF	FAN 1 RELAY	
	FAN2	ON/OFF	FAN 2 RELAY	
	FAN3	ON/OFF	FAN 3 RELAY	
	FAN4	ON/OFF	FAN 4 RELAY	
	CLR.P	ON/OFF	COOLER PUMP RELAY	
	CLR.H	ON/OFF	COOLER HEATER	
CND.P	ON/OFF	CONDENSER PUMP RELAY		
RMT.A	ON/OFF	REMOTE ALARM RELAY		
COMP	CC.A1	ON/OFF	COMPRESSOR A1 RELAY	
	CC.A2	ON/OFF	COMPRESSOR A2 RELAY	
	LD.A1	ON/OFF	LOADER A1 RELAY	
	LD.A2	ON/OFF	LOADER A2 RELAY	
	MLV	ON/OFF	MINIMUM LOAD VALVE	
	OL.H.A	ON/OFF	OIL HEATER	
	CC.B1	ON/OFF	COMPRESSOR B1 RELAY	
	CC.B2	ON/OFF	COMPRESSOR B2 RELAY	
	LD.B1	ON/OFF	LOADER B1 RELAY	
	LD.B2	ON/OFF	LOADER B2 RELAY	
OL.H.B	ON/OFF	OIL HEATER		

ALL UNITS

Record the following information from the Pressures and Temperatures Modes when machine is in a stable operation condition.

COOLER ENTERING FLUID _____
 COOLER LEAVING FLUID _____
 OUTSIDE AIR TEMPERATURE _____
 SPACE TEMPERATURE _____
 CONDENSER ENTERING FLUID _____
 CONDENSER LEAVING FLUID _____
 LEAD/LAG LEAVING FLUID _____

CIRCUIT A

CIRCUIT B

SATURATED CONDENSING TEMP _____
 SATURATED SUCTION TEMP _____
 DISCHARGE SUPERHEAT TEMP (Comp 1/Comp 2) _____
 MOTOR TEMPERATURE (Comp 1/Comp 2) _____
 DISCHARGE PRESSURE _____
 SUCTION PRESSURE _____
 ECONOMIZER PRESSURE _____
 OIL PRESSURE (Comp 1/Comp 2) _____
 OIL PRESSURE DIFF. (Comp 1/Comp 2) _____
 OIL FILTER DIFF. (Comp 1/Comp 2) _____
 CALCULATED OIL PRESS (Comp 1/Comp 2) _____

Compressor Running Current — All readings taken at full load.

	L1	L2	L3
Compressor A1	_____	_____	_____
Compressor A2	_____	_____	_____
Compressor B1	_____	_____	_____
Compressor B2	_____	_____	_____

Condenser Fan Motor Current

	L1	L2	L3
Fan Motor 1	_____	_____	_____
Fan Motor 2	_____	_____	_____
Fan Motor 3	_____	_____	_____
Fan Motor 4	_____	_____	_____
Fan Motor 5	_____	_____	_____
Fan Motor 6	_____	_____	_____
Fan Motor 7	_____	_____	_____
Fan Motor 8	_____	_____	_____
Fan Motor 9	_____	_____	_____
Fan Motor 10	_____	_____	_____
Fan Motor 11	_____	_____	_____
Fan Motor 12	_____	_____	_____
Fan Motor 13	_____	_____	_____
Fan Motor 14	_____	_____	_____
Fan Motor 15	_____	_____	_____
Fan Motor 16	_____	_____	_____

CUT ALONG DOTTED LINE

CUT ALONG DOTTED LINE

Copyright 2004 Carrier Corporation

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

Book	2
Tab	5c

PC 903

Catalog No. 533-00052

Printed in U.S.A.

Form 30G,H-9T

Pg CL-10

3-04A

1-04

Replaces: New




Product Data

30HXA, HXC076-27 Condenserless and Water-Cooled Liquid Chillers 50/60 Hz

75 to 265 Tons (264 to 931 kW)

Comfort Link™

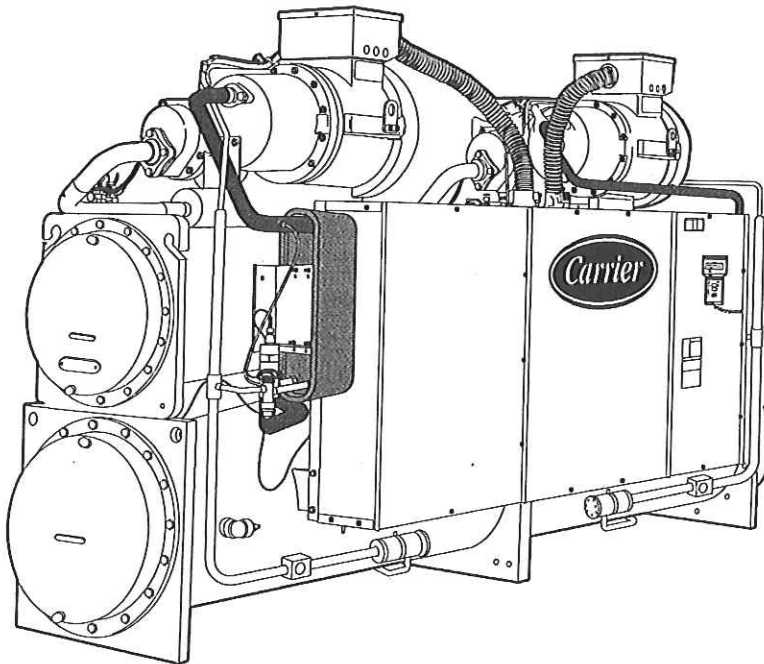

Water-cooled and condenserless chillers designed from the ground up to meet the needs of today and tomorrow:

- Unit fits through a standard door with no disassembly required
- Chlorine-free HFC-134a refrigerant
- Dual independent refrigerant circuits
- Smooth compression using twin screw compressors
- ARI certified efficiencies to 0.53 kW/ton

Features/Benefits

Quality design and construction make the 30HXC (Water-Cooled) and 30HXA (Condenserless) units the preferred choice

Easy installation

The 30HX chiller has a compact design that fits through a standard door opening and requires minimal indoor space. The 30HX chiller is delivered as a complete package for easy installation. There are no extra controls, clocks, starters, or other items to install.

The 30HX unit also provides a single location electrical power entrance (using the accessory field-installed control power transformer) and quick, easy piping (using victaulic-type clamp-on couplings).

The 30HX 208/230-v, 230-v, 460-v and 575-v units are designed in accordance with UL (Underwriters' Laboratory, U.S.A.) and UL, Canada (Underwriters' Laboratory, Canada) standards to minimize electrical inspection time.



A quick start-up is assured once installation is complete, since each 30HX unit is manufactured at an ISO 9001:2000 listed manufacturing facility to guarantee quality. In addition, all 30HXC units are tested under load at the factory to provide reliable start-up.

NOTE: Units shipped with optional nitrogen charge are tested for proper operation of the electrical components but are not run-tested at the factory.

Easy operation

The 30HX units have a quiet, low-vibration design featuring screw compressors.

Efficiency levels of the 30HX units meet or exceed energy efficiency requirements of ASHRAE (American Society of Heating, Refrigeration and

Air Conditioning Engineers) 90.1-2001 and CSA (Canadian Standards Association) for both full-load and part-load operation, thus saving on operating costs through lower electrical costs. All 30HX units are also rated in accordance with ARI (Air Conditioning and Refrigeration Institute, U.S.A.) standards. The 60 Hz 30HXC units are ARI certified.

The 30HX controls are fully automatic. The leaving-fluid temperature is directly controlled to within .5° F (.3° C), and the entering-fluid temperature is continuously monitored to detect load and flow changes.


Dual, independent refrigerant circuits provide reliable, dependable cooling, and the 30HX units use medium-pressure HFC-134a refrigerant to

minimize stress on the compressors and ensure a long life.


From a service standpoint, the 30HX units offer the following features:

- Use of HFC-134a refrigerant, which has no planned phase-out in its future
- Mechanically cleanable cooler and condenser (30HXC units)
- Twin-screw compressors, which require no routine service or maintenance
- Easily accessed service information includes suction and discharge pressure and temperature using standard Navigator™ display module
- All parts are available through Totaline parts stores.


DUAL INDEPENDENT REFRIGERANT CIRCUITS

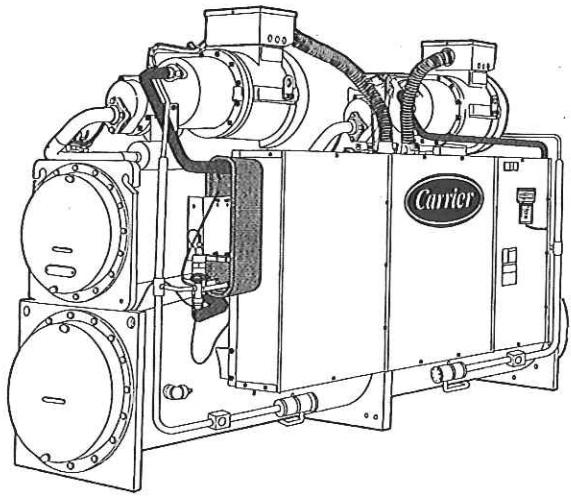

NAVIGATOR IN DISPLAY MODE

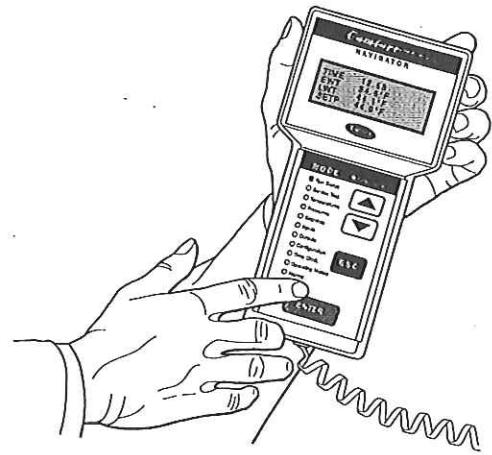

TWIN-SCREW COMPRESSOR DESIGN

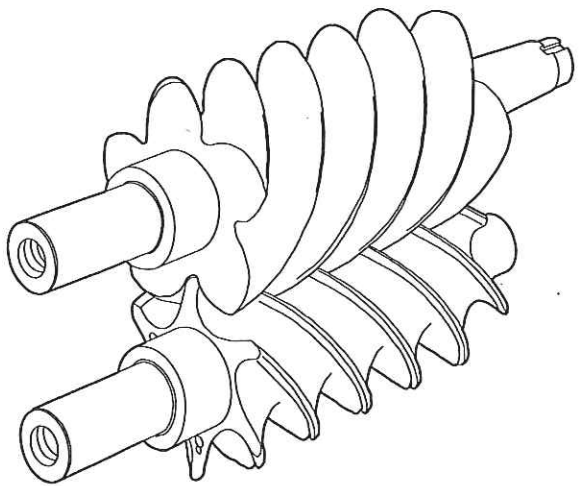

FITS THROUGH STANDARD DOORWAY


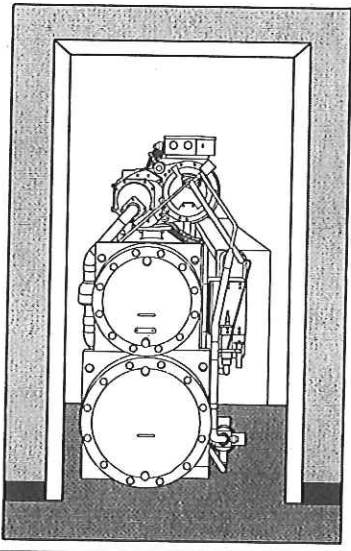


Table of contents



Features/Benefits	1,2
Model Number Nomenclature	3
ARI Capacity Ratings	4,5
Physical Data	6-9
Options and Accessories	10
Dimensions	11-20
Application Data	21-29
Selection Procedure	30
Performance Data	31-56
Typical Piping and Wiring	57,58
Electrical Data	59-70
Controls	71
Guide Specifications	72-74

Model number nomenclatur

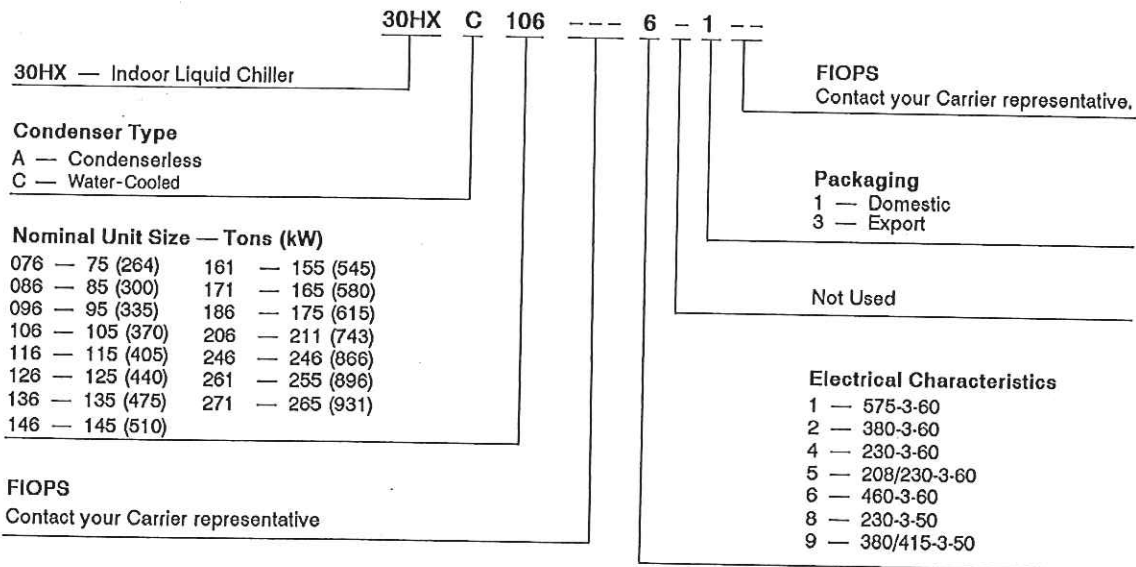

LEGEND
 FIOPS — Factory-Installed Options

Quality Assurance



ARI capacity ratings



30HXC WATER-COOLED CHILLER ARI RATINGS (60 Hz ONLY)

UNIT SIZE 30HXC	CAPACITY		INPUT POWER (kW)	COOLER FLOW		COOLER PRESSURE DROP		CONDENSER FLOW		CONDENSER PRESSURE DROP		FULL-LOAD EFFICIENCY (kW/Ton)	IPLV† (kW/Ton)
	Tons	Output kW		GPM	L/s	Ft of Water	kPa	GPM	L/S	Ft of Water	kPa		
076	75.4	265.2	53.7	181.0	11.4	12.6	37.7	226.2	14.3	8.0	23.9	0.712	0.512
086	83.1	292.3	60.4	199.4	12.6	15.1	44.9	249.3	15.7	9.6	28.6	0.727	0.523
096	94.0	330.5	67.0	225.5	14.2	14.9	44.6	281.9	17.8	9.9	29.4	0.713	0.513
106	104.3	366.8	75.3	250.3	15.8	13.4	40.1	312.9	19.7	12.0	35.7	0.722	0.521
116	113.6	399.4	79.9	272.6	17.2	11.7	34.9	340.7	21.5	15.3	45.5	0.703	0.509
126	123.0	432.6	86.8	295.2	18.6	13.5	40.3	369.0	23.3	17.7	52.7	0.706	0.509
136	136.5	479.9	97.0	327.5	20.7	12.8	38.3	409.4	25.8	16.7	49.9	0.711	0.527
146	145.9	513.2	105.1	350.2	22.1	14.5	43.3	437.8	27.6	19.0	56.5	0.720	0.533
161	156.5	550.6	111.7	375.7	23.7	12.0	35.7	469.6	29.6	19.4	57.9	0.714	0.520
171	165.9	585.3	118.2	398.1	25.1	13.3	39.6	497.6	31.4	15.9	47.4	0.712	0.538
186	177.2	623.1	126.7	426.2	26.8	12.1	36.2	531.6	33.5	18.0	53.7	0.715	0.562
206	211.6	744.0	146.4	507.7	32.0	12.8	38.2	634.7	40.0	19.0	56.7	0.692	0.510
246	248.6	874.1	172.4	596.5	37.6	14.1	42.1	745.7	47.0	20.1	59.9	0.693	0.522
261	257.2	904.6	180.5	617.3	38.9	15.0	44.8	771.6	48.7	21.4	63.9	0.702	0.523
271	267.4	940.3	189.5	641.7	40.5	16.1	48.0	802.1	50.6	23.0	68.7	0.709	0.525

LEGEND

IPLV — Integrated Part-Load Value

*Air Conditioning and Refrigeration Institute (U.S.A.).

†IPLV shown is the lower of Sequence A or Sequence B unloading.

NOTES:

1. Rated (60 Hz only) in accordance with ARI Standard 550/590-98 at standard rating conditions.
2. Standard rating conditions are as follows:
Cooler Conditions:
Leaving Water Temperature: 44 F (6.7 C)
Flow: 2.4 gpm per ton (0.043 L/s per kW)
Condenser Conditions:
Entering Water temperature: 85 F (29.4 C)
Flow: 3.0 gpm per ton (0.054 L/s per kW)
Fouling Factor (Cooler):
0.00010 hr x sq ft x F per Btuh (0.000018 m² x K per W)
Fouling Factor (Condenser):
0.00025 hr x sq ft x F per Btuh (0.000044 m² x K per W)

3. IPLV is a single number part-load efficiency value calculated from the system full-load efficiency values and corrected for a typical building air-conditioning application.
4. All data in this table is rated (60 Hz only) in accordance with ARI Standard 550/590-98 as represented in the ECOLOGIC™ Chiller Selection Program (E-Cat) version 2.80.
5. Contact Carrier for custom ratings.



Rated in accordance with
ARI Standard 550/590-98.

60 Hz only





30HXA CONDENSERLESS CHILLER RATINGS (60 Hz ONLY)

UNIT SIZE 30HXA	CAPACITY		INPUT POWER (kW)	COOLER FLOW		COOLER PRESSURE DROP		FULL-LOAD EFFICIENCY (kW/Ton)
	Tons	Output kW		GPM	L/s	Ft of Water	kPa	
076	67.7	237.9	76.2	162.4	10.2	10.4	31.1	1.127
086	76.0	267.2	84.5	182.3	11.5	12.8	38.2	1.112
096	85.8	301.9	95.1	206.0	13.0	12.6	37.7	1.108
106	96.9	340.9	106.9	232.7	14.7	11.8	35.1	1.103
116	104.9	368.9	115.0	251.8	15.9	10.1	30.3	1.097
126	113.9	400.6	125.3	273.4	17.2	11.8	35.1	1.101
136	127.0	446.5	138.5	304.7	19.2	11.3	33.7	1.091
146	137.2	482.5	150.0	329.3	20.8	13.0	38.7	1.094
161	147.3	518.1	159.9	353.6	22.3	10.7	32.0	1.086
171	159.0	559.3	173.8	381.7	24.1	12.3	36.7	1.093
186	174.3	612.8	192.7	418.2	26.4	11.8	35.1	1.106
206	198.5	698.2	216.4	476.5	30.1	11.4	34.1	1.090
246	231.9	815.4	252.4	556.5	35.1	12.5	37.2	1.089
261	244.1	858.6	267.5	585.9	37.0	13.7	40.8	1.096
271	257.9	907.0	283.9	619.0	39.1	15.1	45.0	1.101

NOTES:

- Rated (60 Hz only) in accordance with ARI Standard 550/590-98 at standard rating conditions.
- Standard rating conditions are as follows:
Cooler Conditions:
Leaving Water Temperature: 44 F (6.7 C)
Flow: 2.4 gpm per ton (0.043 L/s per kW)
Saturated Discharge Temperature: 125 F (52 C)

- Fouling Factor (Cooler):
0.00010 hr x sq ft x F per Btu (0.000018 m² x K per W)
- All data in this table is rated (60 Hz only) in accordance with ARI Standard 550/590-98 as represented in the ECOLOGIC™ Chiller Selection Program (E-Cat) version 2.80.
 - Contact Carrier for custom ratings.



09DK CONDENSER RATINGS (60 Hz ONLY)

UNIT SIZE 09DK	HP	TONS	BTUH	BTUH/HP
044	3.0	56.2	674,400	224,800
054	4.0	65.8	789,600	197,400
074	6.0	95.4	1,144,800	190,800
084	6.0	103.5	1,242,000	207,000
094	6.0	116.3	1,395,600	232,600

NOTE: Rated in accordance with ARI standard 460-2000 at standard rating conditions.

- 125 F (52 C) Condensing Temperature
- R-22 Test Fluid
- 190 F (88 C) Entering Gas Temperature
- 15° F (8.3° C) Subcooling
- 95 F (35 C) Entering Dry Bulb Temperature



Physical data



ENGLISH

UNIT SIZE 30HX	076	086	096	106	116	126	136	146
UNIT OPERATING WEIGHT (lb)								
Water-Cooled (HXC)	5700	5723	5855	6177	6415	6465	6688	6718
Condenserless (HXA)	4717	4744	4835	5151	5163	5205	5309	5333
COMPRESSORS	Semi-Hermetic, Twin Screw							
Quantity	2	2	2	2	2	2	2	2
Nominal Capacity per Compressor (tons)	39/39	46/39	56/39	66/39	66/46	66/56	80/56	80/66
Economizer	No	No	No	No	No	No	No	No
No. Capacity Steps								
Standard	6	6	6	6	6	6	6	6
Optional (maximum)	8	8	8	8	8	8	8	8
Minimum Step Capacity (%)								
Standard	20	20	20	20	20	20	20	20
Optional	10	10	10	10	10	10	10	10
REFRIGERANT	R-134a							
Charge* (lb) Circuit A/Circuit B	75/75	76/75	94/70	110/70	112/89	112/89	124/89	119/100
COOLER	Shell and Tube with Enhanced Copper Tubes							
Part No. 10HX400-	401	401	402	408	406	406	405	405
Net Fluid Volume (gal)	17.0	17.0	19.0	22.6	21.4	21.4	24.0	24.0
Maximum Refrigerant Pressure (psig)	220	220	220	220	220	220	220	220
Maximum Water-Side Pressure (psig)	300	300	300	300	300	300	300	300
Water Connections								
Inlet and Outlet (in.) (Standard Pass)	4	4	4	5	5	5	5	5
Drain (in. NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve								
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220	220
Standard Number of Passes	3	3	3	3	2	2	2	2
30HXA OIL SEPARATOR								
Part No. 09RX400-	217	217	216	216	215	215	215	215
Maximum Refrigerant Pressure (psig)	320	320	320	320	320	320	320	320
Refrigerant Connections (in.)								
Discharge Circuit A/B	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8
Liquid Circuit A/B	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8
Relief Valve								
Connection (in. SAE Flare)	5/8	5/8	5/8	5/8	5/8	5/8	5/8	5/8
Flow Capacity (lb air/min)	21.6	21.6	21.6	21.6	21.6	21.6	21.6	21.6
Relief Setting (psig)	320	320	320	320	320	320	320	320
CONDENSER (HXC)	Shell and Tube with Enhanced Copper Tubes							
Part No. 09RX400-	257	257	258	258	259	259	260	260
Net Fluid Volume (gal)	16.8	16.8	18.3	18.3	23.9	23.9	27.5	27.5
Maximum Refrigerant Pressure (psig)	220	220	220	220	220	220	220	220
Maximum Water-Side Pressure (psig)	300	300	300	300	300	300	300	300
Water Connections								
Inlet and Outlet (Standard Pass)	5	5	5	5	5	5	5	5
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve								
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220	220
Standard Number of Passes	2	2	2	2	2	2	2	2
DISCHARGE LINE†								
Relief Valve								
Connection (in. SAE Flare)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Flow Capacity (lb air/min)	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3
Setting (psig)	350	350	350	350	350	350	350	350

LEGEND

NPTF — National Pipe Thread Female
SAE — Society of Automotive Engineers

*Charges listed are for 30HXC units. The 30HXA units are shipped with a holding charge only. To determine the refrigerant charge requirements for 30HXA units see the System Refrigerant Charge for Start-Up table in the Application Data on page 28.

†Only on units with factory-installed suction service valves.



ENGLISH (cont)

UNIT SIZE 30HX	161	171	186	206	246	261	271
UNIT OPERATING WEIGHT (lb)							
Water-Cooled (HXC)	7452	7660	7854	10,581	10,969	10,992	11,029
Condenserless (HXA)	5752	5777	5946	7,485	7,621	7,621	7,621
COMPRESSORS	Semi-Hermetic, Twin Screw						
Quantity	2	2	2	3	3	3	3
Nominal Capacity per Compressor (tons)	80/56	66/80	80/80	66/39/80	80/56/80	80/66/80	80/80/80
Economizer	Yes	Yes	Yes	Yes	Yes	Yes	Yes
No. Capacity Steps							
Standard	6	6	6	8	8	8	8
Optional (maximum)	8	8	8	11	11	11	11
Minimum Step Capacity (%)							
Standard	20	20	20	13	13	13	13
Optional	10	10	10	7	7	7	7
REFRIGERANT				R-134a			
Charge* (lb) Circuit A/Circuit B	157/110	119/140	135/135	220/135	220/135	220/135	220/135
COOLER TYPE	Shell and Tube with Enhanced Copper Tubes						
Part No. 10HX400-							
Net Fluid Volume (gal)	601	611	621	631	632	632	632
Maximum Refrigerant Pressure (psig)	28.5	28.5	33.4	43.1	47.2	47.2	47.2
Maximum Water-Side Pressure (psig)	220	220	220	220	220	220	220
Water Connections	300	300	300	300	300	300	300
Inlet and Outlet (in.) (Standard Pass)	5	5	5	6	6	6	6
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220
Standard Number of Passes	2	2	2	2	2	2	2
30HXA OIL SEPARATOR							
Part No. 09RX400-							
Maximum Refrigerant Pressure (psig)	215	214	214	213	213	213	213
Refrigerant Connections (in.)	320	320	320	320	320	320	320
Discharge Circuit A/B	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8
Liquid Circuit A/B	1 3/8/1 3/8	1 3/8/1 3/8	1 3/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8
Relief Valve							
Connection (in. SAE Flare)	5/8	5/8	5/8	5/8	5/8	5/8	5/8
Flow Capacity (lb air/min)	21.6	21.6	21.6	21.6	21.6	21.6	21.6
Relief Setting (psig)	320	320	320	320	320	320	320
CONDENSER (HXC)	Shell and Tube with Enhanced Copper Tubes						
Part No. 09RX400-							
Net Fluid Volume (gal)	261	262	262	263	264	264	264
Maximum Refrigerant Pressure (psig)	30.6	37.6	37.6	47.6	55.1	55.1	55.1
Maximum Water-Side Pressure (psig)	220	220	220	220	220	220	220
Water Connections	300	300	300	300	300	300	300
Water Connections (in.)							
Inlet and Outlet (Standard Pass)	6	6	6	8	8	8	8
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (in. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (lb air/min)	31.7	31.7	31.7	31.7	31.7	31.7	31.7
Relief Setting (psig)	220	220	220	220	220	220	220
Standard Number of Passes	2	2	2	2	2	2	2
DISCHARGE LINE†							
Relief Valve							
Connection (in. SAE Flare)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Flow Capacity (lb air/min)	6.3	6.3	6.3	6.3	6.3	6.3	6.3
Setting (psig)	350	350	350	350	350	350	350

LEGEND

NPTF — National Pipe Thread Female
 SAE — Society of Automotive Engineers

*Charges listed are for 30HXC units. The 30HXA units are shipped with a holding charge only. To determine the refrigerant charge requirements for 30HXA units see the System Refrigerant Charge for Start-Up table in the Application Data on page 28.

†Only on units with factory-installed suction service valves.

Physical data (cont)



SI

UNIT SIZE 30HX	076	086	096	106	116	126	136	146
UNIT OPERATING WEIGHT (kg)								
Water-Cooled (HXC)	2586	2597	2657	2803	2911	2933	3034	3048
Condenserless (HXA)	2140	2152	2194	2337	2342	2362	2408	2420
COMPRESSORS								
Quantity	2	2	2	Semi-Hermetic, Twin Screw				
Nominal Capacity per Compressor (kW)	137/137	162/137	197/137	232/137	232/137	232/197	281/197	281/232
Economizer	No	No	No	No	No	No	No	No
No. Capacity Steps								
Standard	6	6	6	6	6	6	6	6
Optional (maximum)	8	8	8	8	8	8	8	8
Minimum Step Capacity (%)								
Standard	20	20	20	20	20	20	20	20
Optional	10	10	10	10	10	10	10	10
REFRIGERANT								
Charge* (kg) Circuit A/Circuit B	34.1/34.1	34.5/34.1	42.7/31.8	49.9/31.8	50.8/40.4	50.8/40.4	56.3/40.4	54.0/45.4
COOLER								
Part No. 10HX400-				Shell and Tube with Enhanced Copper Tubes				
Net Fluid Volume (L)	401	401	402	408	406	406	405	405
Maximum Refrigerant Pressure (kPa)	64.3	64.3	71.9	85.5	81.0	81.0	90.8	90.8
Maximum Water-Side Pressure (kPa)	1517	1517	1517	1517	1517	1517	1517	1517
Maximum Water-Side Pressure (kPa)	2068	2068	2068	2068	2068	2068	2068	2068
Water Connections								
Inlet and Outlet (In.) (Standard Pass)	4	4	4	5	5	5	5	5
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve								
Connection (In. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (kg air/min)	14.38	14.38	14.38	14.38	14.38	14.38	14.38	14.38
Relief Setting (kPa)	1517	1517	1517	1517	1517	1517	1517	1517
Standard Number of Passes	3	3	3	3	2	2	2	2
30HXA OIL SEPARATOR								
Part No. 09RX400-								
Maximum Refrigerant Pressure (kPa)	217	217	216	216	215	215	215	215
Refrigerant Connections (In.)	2205	2205	2205	2205	2205	2205	2205	2205
Discharge A/B	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8
Liquid A/B	1 1/8/2 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8	1 1/8/1 1/8
Relief Valve								
Connection (In. SAE Flare)	5/8	5/8	5/8	5/8	5/8	5/8	5/8	5/8
Flow Capacity (kg air/min)	9.80	9.80	9.80	9.80	9.80	9.80	9.80	9.80
Relief Setting (kPa)	2206	2206	2206	2206	2206	2206	2206	2206
CONDENSER (HXC)								
Part No. 09RX400-				Shell and Tube with Enhanced Copper Tubes				
Net Fluid Volume (L)	257	257	258	258	259	259	260	260
Maximum Refrigerant Pressure (kPa)	63.6	63.6	69.3	69.3	90.5	90.5	104.1	104.1
Maximum Water-Side Pressure (kPa)	1517	1517	1517	1517	1517	1517	1517	1517
Maximum Water-Side Pressure (kPa)	2068	2068	2068	2068	2068	2068	2068	2068
Water Connections								
Inlet and Outlet (Standard Pass)	5	5	5	5	5	5	5	5
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve								
Connection (In. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (kg air/min)	14.38	14.38	14.38	14.38	14.38	14.38	14.38	14.38
Relief Setting (kPa)	1517	1517	1517	1517	1517	1517	1517	1517
Standard Number of Passes	2	2	2	2	2	2	2	2
DISCHARGE LINE†								
Relief Valve								
Connection (In. SAE Flare)	3/8	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Flow Capacity (kg air/min)	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
Relief Pressure (kPa)	2413	2413	2413	2413	2413	2413	2413	2413

LEGEND

NPTF — National Pipe Thread Female
 SAE — Society of Automotive Engineers

*Charges listed are for 30HXC units. The 30HXA units are shipped with a holding charge only. To determine the refrigerant charge requirements for 30HXA units see the System Refrigerant Charge for Start-Up table in the Application Data on page 28.

†Only on units with factory-installed suction service valves.



SI (cont)

UNIT SIZE 30HX	161	171	186	206	246	261	271
UNIT OPERATING WEIGHT (kg)							
Water-Cooled (HXC)	3381	3475	3564	4799	4976	4986	5003
Condenserless (HXA)	2610	2621	2698	3395	3457	3457	3457
COMPRESSORS	Semi-Hermetic, Twin Screw						
Quantity	2	2	2	3	3	3	3
Nominal Capacity per Compressor (kW)	281/197	232/281	281/281	232/137/281	281/197/281	281/232/281	281/281/281
Economizer	Yes	Yes	Yes	Yes	Yes	Yes	Yes
No. Capacity Steps							
Standard	6	6	6	8	8	8	8
Optional (maximum)	8	8	8	11	11	11	11
Minimum Step Capacity (%)							
Standard	20	20	20	13	13	13	13
Optional	10	10	10	7	7	7	7
REFRIGERANT	R-134a						
Charge* (kg) Circuit A/Circuit B	71.3/49.9	54.0/63.6	61.3/61.3	90.8/61.3	99.9/61.3	99.9/61.3	99.9/61.3
COOLER	Shell and Tube with Enhanced Copper Tubes						
Part No. 10HX400-	601	611	621	631	632	632	632
Net Fluid Volume (L)	107.9	107.9	126.4	163.2	178.7	178.8	178.7
Maximum Refrigerant Pressure (kPa)	1517	1517	1517	1517	1517	1517	1517
Maximum Water-Side Pressure (kPa)	2068	2068	2068	2068	2068	2068	2068
Water Connections							
Inlet and Outlet (In.) (Standard Pass)	5	5	5	6	6	6	6
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (In. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (kg air/min)	14.28	14.38	14.38	14.38	14.38	14.38	14.38
Relief Setting (kPa)	1517	1517	1517	1517	1517	1517	1517
Standard Number of Passes	2	2	2	2	2	2	2
30HXA OIL SEPARATOR							
Part No. 09RX400-	215	214	214	213	213	213	213
Maximum Refrigerant Pressure (kPa)	2205	2205	2205	2205	2205	2205	2205
Refrigerant Connections (In.)							
Discharge A/B	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8	2 1/8/2 1/8
Liquid A/B	1 3/8/1 3/8	1 3/8/1 3/8	1 3/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8	1 5/8/1 3/8
Relief Valve							
Connection (In. SAE Flare)	5/8	5/8	5/8	5/8	5/8	5/8	5/8
Flow Capacity (kg air/min)	9.80	9.80	9.80	9.80	9.80	9.80	9.80
Relief Setting (kPa)	2206	2206	2206	2206	2206	2206	2206
CONDENSER (HXC)	Shell and Tube with Enhanced Copper Tubes						
Part No. 09RX400-	261	262	262	263	264	264	264
Net Fluid Volume (L)	115.8	142.3	142.3	177.9	208.6	208.6	208.6
Maximum Refrigerant Pressure (kPa)	1517	1517	1517	1517	1517	1517	1517
Maximum Water-Side Pressure (kPa)	2068	2068	2068	2068	2068	2068	2068
Water Connections (In.)							
Inlet and Outlet (Standard Pass)	6	6	6	8	8	8	8
Drain (NPT) (Standard Pass)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Relief Valve							
Connection (In. NPTF)	3/4	3/4	3/4	3/4	3/4	3/4	3/4
Flow Capacity (kg air/min)	14.38	14.38	14.38	14.38	14.38	14.38	14.38
Relief Setting (kPa)	1517	1517	1517	1517	1517	1517	1517
Standard Number of Passes	2	2	2	2	2	2	2
DISCHARGE LINE†							
Relief Valve							
Connection (In. SAE Flare)	3/8	3/8	3/8	3/8	3/8	3/8	3/8
Flow Capacity (kg air/min)	2.9	2.9	2.9	2.9	2.9	2.9	2.9
Relief Pressure (kPa)	2413	2413	2413	2413	2413	2413	2413

LEGEND

NPTF — National Pipe Thread Female
 SAE — Society of Automotive Engineers

*Charges listed are for 30HXC units. The 30HXA units are shipped with a holding charge only. To determine the refrigerant charge requirements for 30HXA units see the System Refrigerant Charge for Start-Up table in the Application Data on page 28.

†Only on units with factory-installed suction service valves.

Options and accessories



ITEM	FACTORY-INSTALLED OPTION	FIELD-INSTALLED ACCESSORY
Wye-Delta Start	X	
Brine	X	
Minus-One-Pass Cooler Head	X	
Plus-One-Pass Cooler Head	X	
Control Power Transformer		X
Minimum Load Control	X	X
Sound Reduction Enclosure		X
Vibration Isolation		X
Temperature Reset Sensor		X
Chillervisor™ System Manager III		X
Cooler Head Insulation		X
Suction Service Valves	X	
Energy Management Module	X	X

Factory-installed options

Wye-delta start — Generally, Wye-delta start is not required when using multiple compressors since the starting current is generally less than with one larger compressor using Wye-delta start. Wye-delta start is standard on 208/230 v, 60 Hz, 230 v, 60 Hz, and 230 v, 50 Hz units. It is available as a factory-installed option for all other unit voltages.

Brine — The brine option permits supply liquid temperatures to be set below 40 F (4.4 C). Refrigeration circuit components, such as the expansion device, are modified at the factory to correct for the lower refrigeration flow rates. Special installation requirements apply to brine units. See Cooler and Water-Cooled Condenser Freeze Protection section, page 23.

Minus-One-Pass cooler — This factory-installed option reduces pressure drop for high flow applications and/or provides same end inlet and outlet for 076-106 sizes, or opposite end inlet and outlet on 116-271 sizes.

Plus-One-Pass cooler — This factory-installed option improves low temperature brine performance. See Carrier 30HX electronic catalog for performance data.

Minimum load control — This option allows additional capacity reduction for unit operation below the minimum step of unloading (down to 10% of full load capacity). Minimum load control is also available as a field-installed accessory.

Suction service valves — Standard refrigerant discharge isolation and liquid valves enable service personnel to store the refrigerant charge in the cooler or condenser during servicing. This factory-installed option allows further isolation of the compressor from the cooler vessel.

Energy Management Module (EMM) — The EMM is used for 4 to 20 mA leaving fluid temperature reset, cooling point reset, 4 to 20 mA demand limit and two-step demand limit. Temperature reset lets the unit reset the leaving fluid temperature to a higher temperature during low load conditions. Temperature reset can also be accomplished based on return fluid, outdoor air or space temperature. (The EMM option is not required when using

entering-water, outdoor-air, or space temperature for temperature reset. These types of reset are available with the main board. However, an accessory thermistor is required for outdoor air and/or space temperature reset.) Demand limiting allows the unit capacity to be limited during periods of peak energy usage. Demand limit requires an external 4 to 20 mA signal or a 2-step remote pair of dry contacts. Both the 4 to 20 mA and 2-step demand limit percentage values are adjustable. EMM is also available as a field-installed accessory.

Field-installed accessories

Control power transformer — The transformer is sized to supply the needs of the control circuit, sourcing power from the main unit power connection.

Minimum load control — This accessory allows additional capacity reduction for unit operation below the minimum step of unloading (down to 10% of full load capacity). Minimum load control is also available as a factory-installed option.

Sound reduction enclosure — This kit contains a sound enclosure that covers the entire unit to reduce sound levels.

Vibration isolation — Neoprene isolators are field installed to reduce vibration transmission from the compressor through the floor and into the conditioned space.

Temperature reset sensor — This accessory sensor provides temperature reset capability from either the occupied space or outdoor-air temperature.

NOTE: Temperature reset capability using return temperature is standard.

Chillervisor System Manager III — This control can be used to regulate up to eight 30HXA or 30HXC chillers.

Cooler head insulation — This accessory is designed with flexible, 3/4 in. (19 mm) PVC foam (closed-cell) to insulate the cooler heads to minimize heat loss and head sweating.

Energy Management Module (EMM) is used for 4 to 20 mA leaving fluid temperature reset, cooling point reset, 4 to 20 mA demand limit and two-step demand limit. Temperature reset lets the unit reset the leaving fluid temperature to a higher temperature during low load conditions. Temperature reset can also be accomplished based on return fluid, outdoor air or space temperature. (The EMM option is not required when using entering-water, outdoor-air, or space temperature for temperature reset. These types of reset are available with the main board. However, an accessory thermistor is required for outdoor air and/or space temperature reset.) Demand limiting allows the unit capacity to be limited during periods of peak energy usage. Demand limit requires an external 4 to 20 mA signal or a 2-step remote pair of dry contacts. Both the 4 to 20 mA and 2-step demand limit percentage values are adjustable. EMM is also available as a factory-installed option.

Consult factory for other available options not listed here.

Dimensions (cont)







30HXC206-271

NOTES:

1. Operating weight includes weight of water and refrigerant.
2. Denotes center of gravity.
3. Dimensions are in inches (mm).
4. Recommended service clearance around machine is 36 in. (914.4 mm).
5. Victaulic nozzles are standard on all models. Flow switch factory installed in cooler outlet victaulic nozzle.

UNIT	OPERATING WEIGHT - lb (kg)	A	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)					
			1	2	3	4	5	6
30HXC206	10581 (4799)	33.88 (860)	948 (430)	2406 (1091)	1243 (564)	1201 (545)	3133 (1421)	1650 (748)
30HXC246	10969 (4976)	34.38 (873)	985 (447)	2515 (1141)	1306 (592)	1154 (523)	3276 (1486)	1793 (786)
30HXC251	10992 (4986)	34.38 (873)	985 (447)	2520 (1143)	1311 (595)	1154 (523)	3283 (1489)	1739 (789)
30HXC271	11029 (5003)	34.38 (873)	985 (447)	2529 (1147)	1318 (598)	1154 (523)	3294 (1494)	1749 (793)


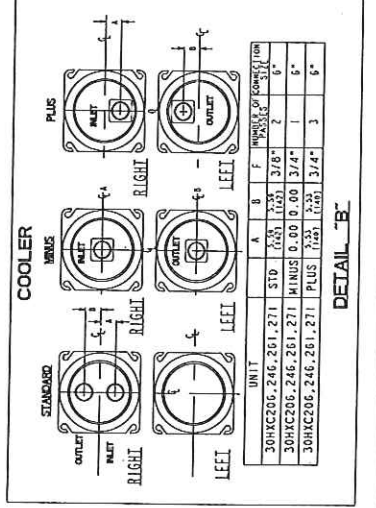
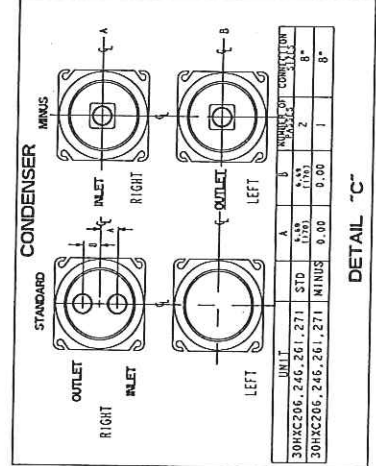
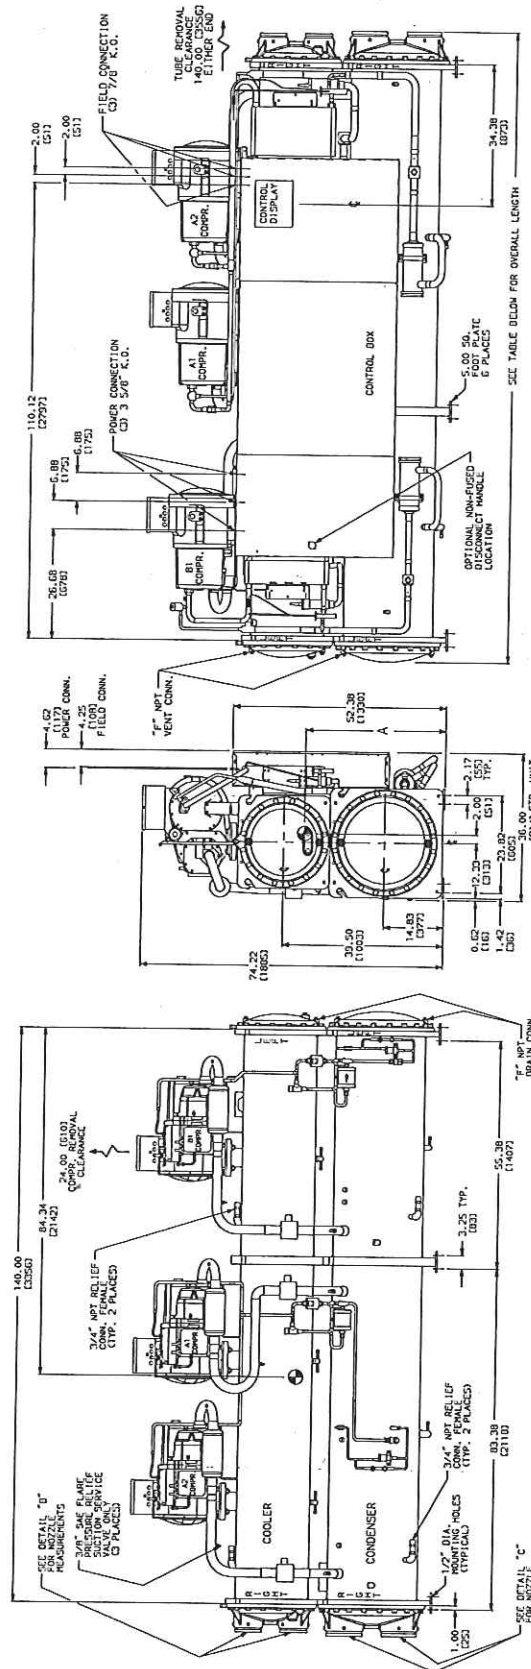


COOLER	CONDENSER	OVERALL LENGTH
STANDARD	STANDARD	152.54 (3815)
MINUS	STANDARD	130.51 (3291)
PLUS	STANDARD	148.64 (3770)
MINUS ONE PASS	STANDARD	160.00 (4064)
PLUS ONE PASS	STANDARD	160.00 (4064)
MINUS ONE	STANDARD	148.64 (3770)
PLUS ONE	STANDARD	148.64 (3770)
MINUS ONE PASS	STANDARD	160.00 (4064)
PLUS ONE PASS	STANDARD	160.00 (4064)

30HX076-106

UNIT	OPERATING WEIGHT - lb (kg)	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)											
		1	2	3	4	5	6						
30HXA076	4717 (2140)	45.87 (1165)	45.87 (1165)	46.25 (232)	46.25 (232)	41.25 (1048)	41.25 (1048)	555 (252)	793 (360)	926 (420)	926 (420)	1326 (601)	899 (317)
30HXA086	4744 (2152)	45.87 (1165)	45.87 (1165)	46.25 (232)	46.25 (232)	41.25 (1048)	41.25 (1048)	555 (252)	798 (362)	928 (421)	928 (421)	1340 (608)	705 (320)
30HXA096	4895 (2194)	54.12 (1375)	37.63 (956)	32.50 (826)	32.50 (826)	6.25 (159)	6.25 (159)	49.50 (1257)	38.00 (965)	509 (231)	848 (385)	1350 (612)	827 (375)
30HXA106	5151 (2337)	54.12 (1375)	37.63 (956)	33.50 (851)	33.50 (851)	6.25 (159)	6.25 (159)	49.50 (1257)	38.00 (965)	555 (252)	869 (394)	1410 (640)	880 (389)

OVERALL LENGTH TABLE		
COOLER	OVERALL LENGTH	OVERALL LENGTH
STANDARD	105.68 (2684)	185.39 (4700)
MINUS ONE PASS	103.20 (2623)	183.40 (4663)
PUMP COOLER	97.00 (2418)	187.00 (4718)

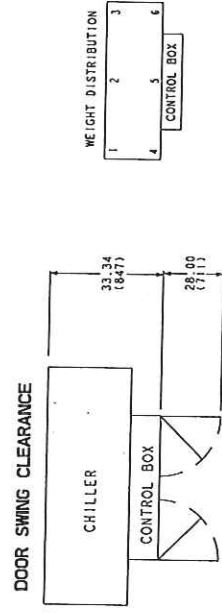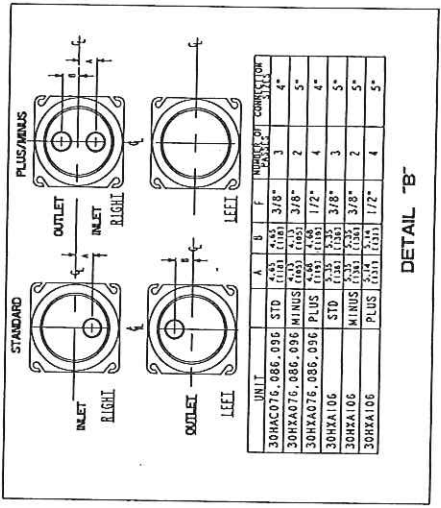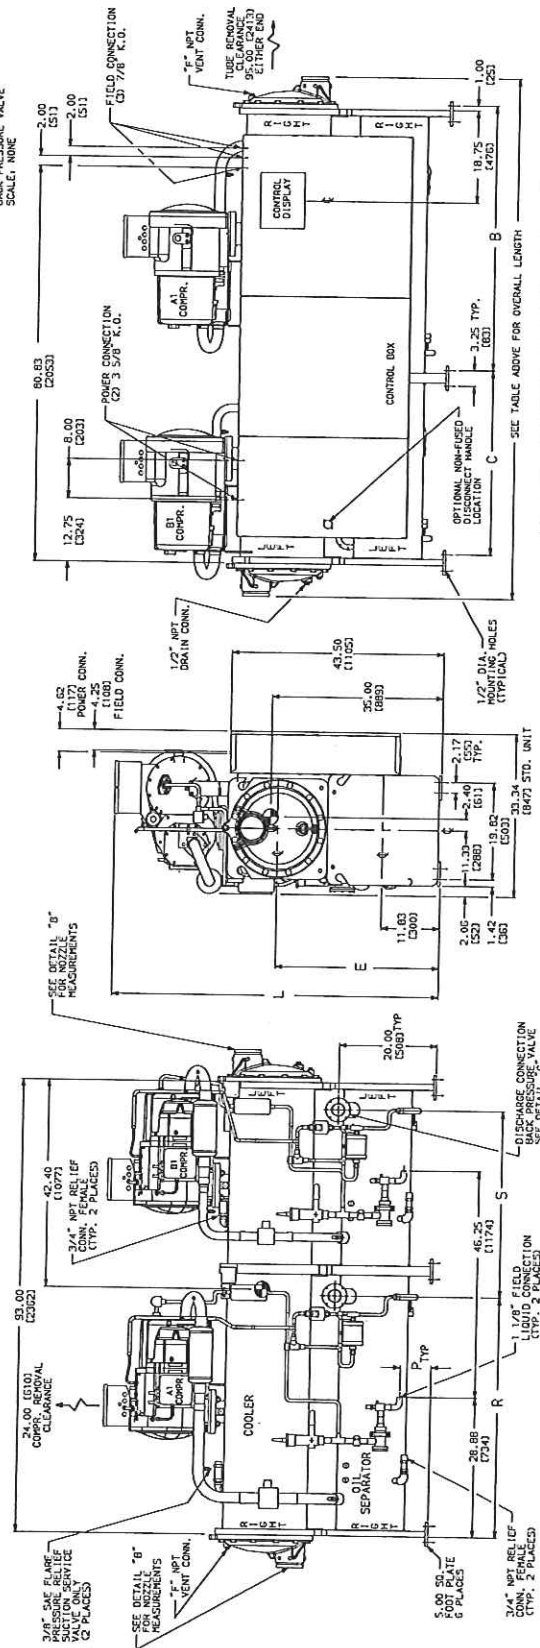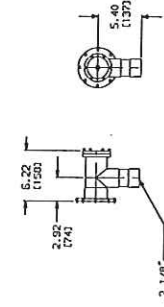

- NOTES:**
- Operating weight includes weight of water and refrigerant.
 - Denotes center of gravity.
 - Dimensions are in inches (mm).
 - Recommended service clearance around machine is 36 in. (914.4 mm).
 - Flow switch factory installed in cooler outlet victaulic nozzle.

Dimensions (cont)





30HXA116-146




UNIT	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)					
	1	2	3	4	5	6
30HXA116	5163 (2342)	895 (406)	540 (245)	855 (388)	1456 (660)	887 (402)
30HXA126	5205 (2362)	905 (410)	541 (245)	864 (392)	1468 (666)	887 (402)
30HXA136	5309 (2408)	926 (420)	555 (252)	874 (396)	1498 (679)	908 (412)
30HXA146	5383 (2420)	930 (422)	555 (252)	883 (400)	1506 (683)	908 (412)

OVERALL LENGTH TABLE

COOLER	OVERALL LENGTH
STANDARD COOLER	134.26 (C411)
MINI COOLER	144.00 (C417)
PLUS ONE PASS COOLER	135.00 (C473)

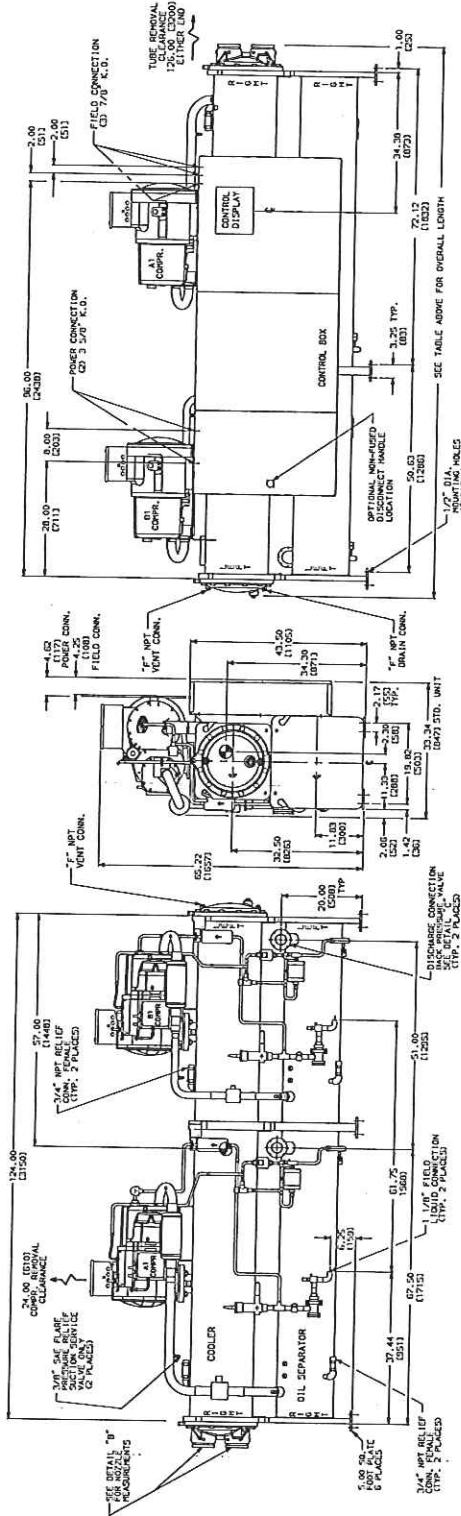

DOOR SWING CLEARANCE


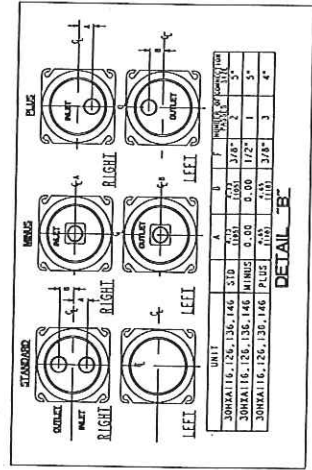

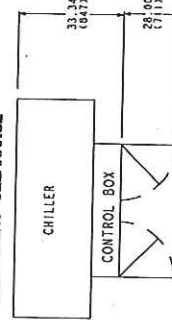


- NOTES:
- Operating weight includes weight of water and refrigerant.
 - Denotes center of gravity.
 - Dimensions are in inches (mm).
 - Recommended service clearance around machine is 36 in. (914.4 mm).
 - Victaulic nozzles are standard on all models. Flow switch factory installed in cooler outlet victaulic nozzle.

30HXA161-186

UNIT	OPERATING WEIGHT - lb (kg)	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)						T	
		1	2	3	4	5	6		
30HXA161	5752 (2610)	72.12 (1832)	50.63 (1286)	67.50 (1715)	51.00 (1298)	965 (254)	598 (433)	1650 (1025)	1025 (465)
30HXA171	5777 (2621)	61.37 (1559)	61.37 (1559)	56.75 (1441)	61.75 (1582)	968 (284)	534 (439)	1072 (486)	1658 (318)
30HXA186	5946 (2698)	61.37 (1559)	61.37 (1559)	56.75 (1441)	61.75 (1582)	1004 (455)	552 (294)	1110 (504)	1703 (426)

OVERALL LENGTH TABLE	
COOLER	OVERALL LENGTH
STANDARD	134.40 (3414)
THINSE ONE PASS	135.00 (3429)
COOLER	137.30 (3487)
COOLER	137.30 (3487)

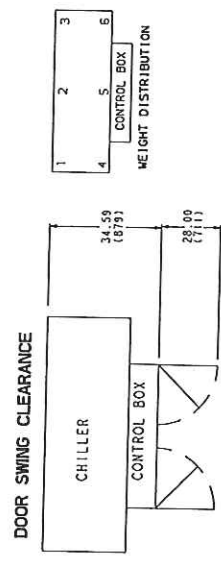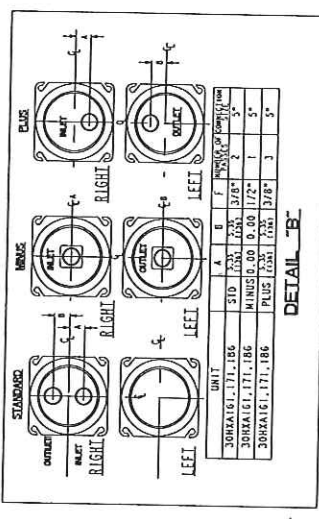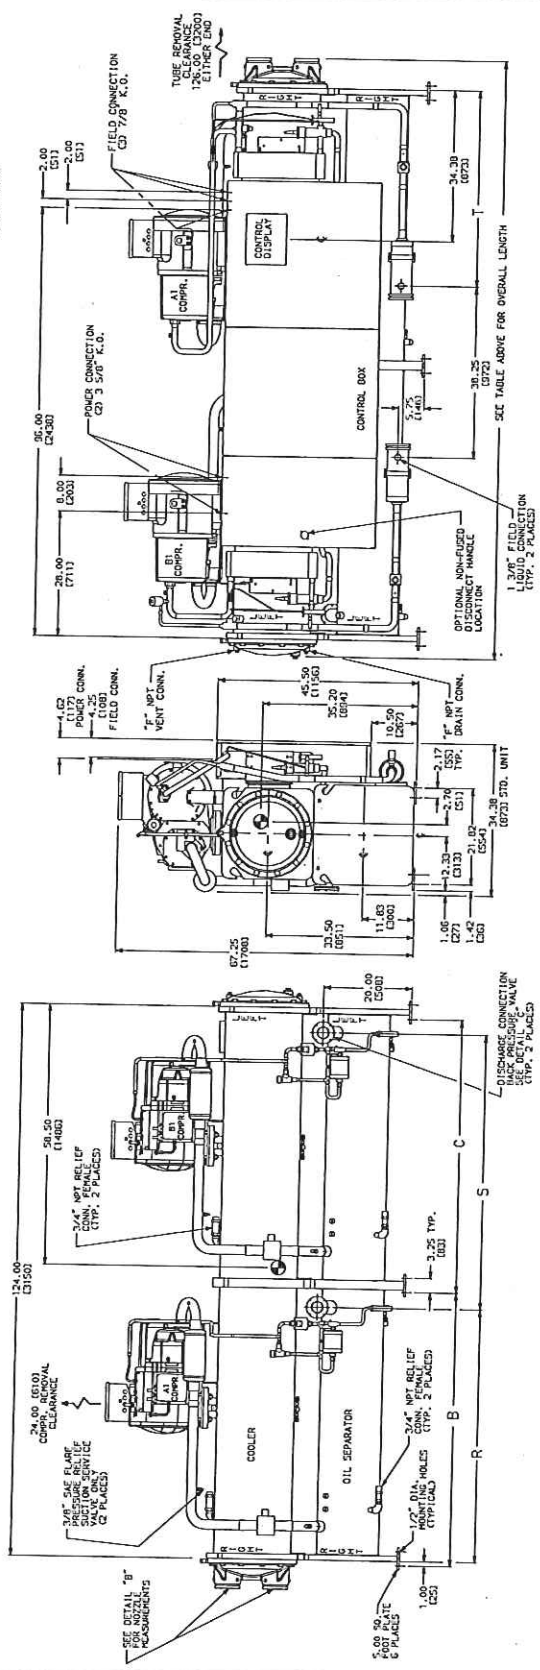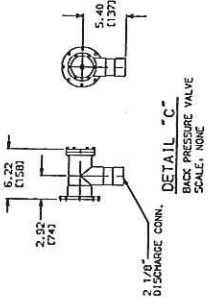

- NOTES:
- Operating weight includes weight of water and refrigerant.
 - Denotes center of gravity.
 - Dimensions are in inches (mm).
 - Recommended service clearance around machine is 36 in. (914.4 mm).
 - Victaulic nozzles are standard on all models. Flow switch factory installed in cooler outlet victaulic nozzle.








Dimensions (cont)



OHXA206-271

UNIT	OPERATING WEIGHT - lb (kg)	WGT DISTRIBUTION AT EACH MTG PLATE - lb (kg)					
		1	2	3	4	5	6
30HXA206	7485 (3395)	671 (304)	1702 (772)	879 (399)	850 (385)	2216 (1005)	1167 (529)
30HXA246	7621 (3457)	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)
30HXA261	7621 (3457)	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)
30HXA271	7621 (3457)	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)


OVERALL LENGTH TABLE	
COOLER	OVERALL LENGTH
STANDARD	150.35 (3804)
MINUS COOLER	150.35 (3804)
PLUS ONE PASS COOLER	160.00 (4064)

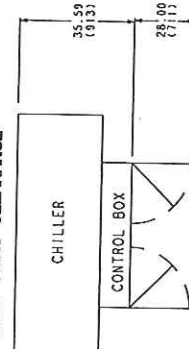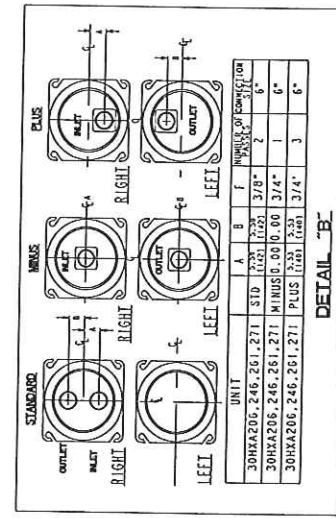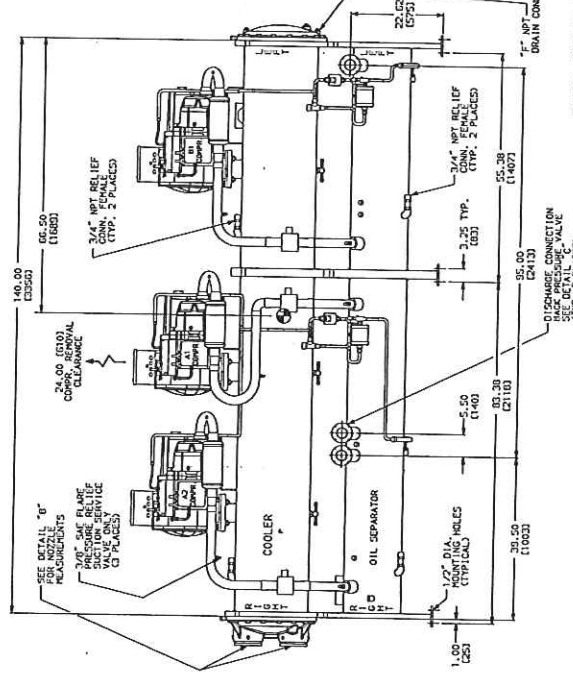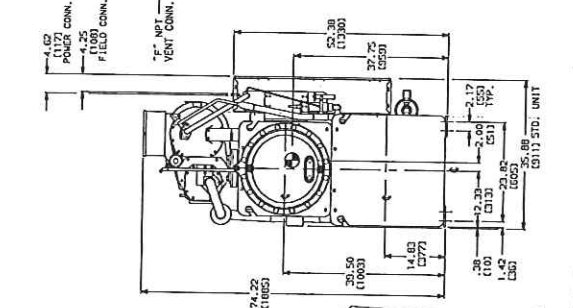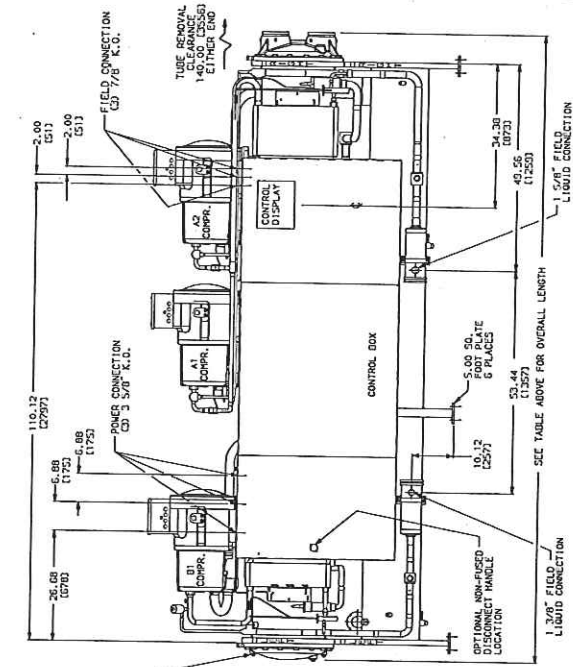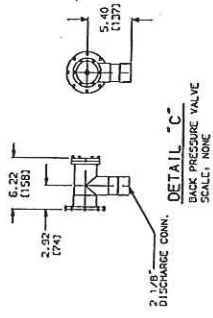



- NOTES:
- Operating weight includes weight of water and refrigerant.
 - Denotes center of gravity.
 - Dimensions are in inches (mm).
 - Recommended service clearance around machine is 36 in. (914.4 mm).
 - Victaulic nozzles are standard on all models. Flow switch factory installed in cooler outlet. Victaulic nozzle.

ACCESSORY SOUND ENCLOSURE

UNIT	'A'	'B'	'C'	'D'
30HX076, 086, 096, 106	20.00 [3048]	36.00 [915]	21.16 [538]	17.84 [453]
30HX116, 126, 136, 146, 161, 171, 186	168.00 [4267]	60.00 [1525]	36.67 [931]	29.84 [758]
30HX206, 246, 261, 271	168.00 [4267]	60.00 [1525]	37.32 [948]	32.68 [830]

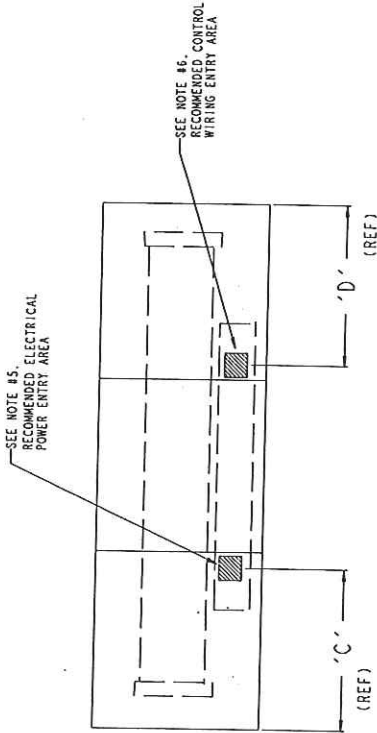

SEE NOTE #6.
RECOMMENDED CONTROL
WIRING ENTRY AREA

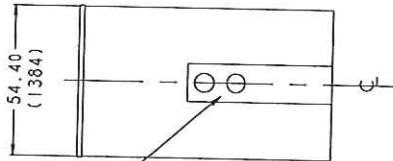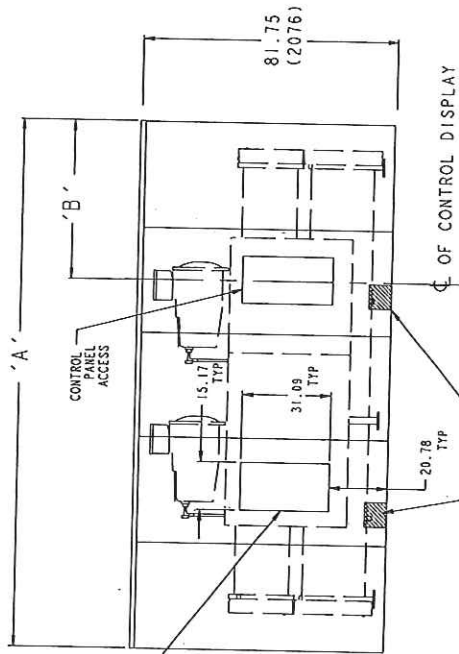


SEE NOTE #3.

- NOTES:**
- Dimensions are in inches (millimeters).
 - Recommended service clearance around machine is 36 in. (914.4).
 - Unused portion of piping openings must be closed and insulated for acoustic purposes. Use filler panel in accessory package.
 - Field-fabricated holes must be closed and insulated for acoustic purposes.
 - Recommended electrical power supply area. Notch to suit and cover/insulate remaining open area for acoustic purposes.
 - Recommended control wiring entry area. Notch to suit and cover/insulate remaining open area for acoustic purposes.
 - Recommended cooler relief valve vent line and 30HXC condenser relief vent line entry area. The 30HXA discharge and liquid line entry areas are on opposite side. Notch enclosure to suit particular installation.
 - Model in drawing is typical and represents 30HX116-146 sizes in the 30HX-900-001 accessory sound enclosure.
 - Sound enclosure accessory should be aligned to the center lines of the control panel access and piping openings.


Dimensions (cont)



WEIGHT DISTRIBUTION AT MOUNTING PLATES



WEIGHT DISTRIBUTION AT EACH MOUNTING PLATE

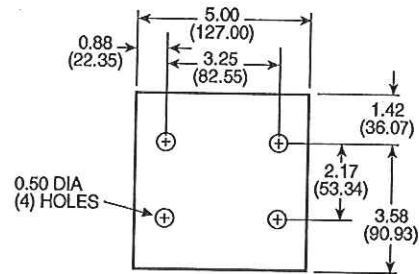

NOTE: Dimensions shown in inches (mm).
30HX FOOT

30HXC UNITS — lb (kg)

UNIT 30HXC	MOUNTING PLATE NO.					
	1	2	3	4	5	6
076	738 (335)	943 (428)	595 (270)	1110 (503)	1418 (643)	896 (406)
086	738 (335)	947 (430)	597 (271)	1112 (504)	1427 (647)	902 (409)
096	686 (311)	968 (439)	693 (314)	1027 (466)	1447 (656)	1034 (469)
106	730 (331)	1028 (466)	744 (337)	1073 (487)	1510 (685)	1092 (495)
116	728 (330)	1114 (505)	777 (352)	1053 (478)	1615 (733)	1127 (511)
126	738 (335)	1127 (511)	780 (354)	1061 (481)	1628 (738)	1131 (513)
136	758 (344)	1176 (533)	811 (368)	1083 (491)	1689 (766)	1171 (531)
146	763 (346)	1182 (536)	815 (370)	1085 (492)	1697 (770)	1172 (532)
161	817 (371)	1272 (577)	908 (412)	1219 (553)	1890 (857)	1346 (610)
171	936 (425)	1318 (598)	840 (381)	1379 (626)	1946 (883)	1241 (563)
186	962 (436)	1361 (617)	860 (390)	1410 (640)	1996 (905)	1265 (574)
206	948 (430)	2406 (1091)	1243 (564)	1201 (545)	3133 (1421)	1650 (748)
246	985 (447)	2515 (1141)	1306 (592)	1154 (523)	3276 (1486)	1733 (786)
261	985 (447)	2520 (1143)	1311 (595)	1154 (523)	3283 (1489)	1739 (789)
271	985 (447)	2529 (1147)	1318 (598)	1154 (523)	3294 (1494)	1749 (793)

30HXA UNITS — lb (kg)

UNIT 30HXA	MOUNTING PLATE NO.					
	1	2	3	4	5	6
076	555 (252)	793 (360)	418 (190)	926 (420)	1326 (601)	699 (317)
086	555 (252)	798 (362)	418 (190)	928 (421)	1340 (608)	705 (320)
096	509 (231)	808 (367)	493 (224)	848 (385)	1350 (612)	827 (375)
106	555 (252)	869 (394)	541 (245)	896 (406)	1410 (640)	880 (399)
116	530 (240)	895 (406)	540 (245)	855 (388)	1456 (660)	887 (402)
126	540 (245)	905 (410)	541 (245)	864 (392)	1468 (666)	887 (402)
136	548 (249)	926 (420)	555 (252)	873 (396)	1498 (679)	908 (412)
146	551 (250)	930 (422)	555 (252)	883 (400)	1506 (683)	908 (412)
161	560 (254)	965 (438)	598 (271)	954 (433)	1650 (748)	1025 (465)
171	627 (284)	968 (439)	534 (242)	1072 (486)	1658 (752)	918 (416)
186	648 (294)	1004 (455)	552 (250)	1110 (504)	1703 (772)	939 (426)
206	671 (304)	1702 (772)	879 (399)	850 (385)	2216 (1005)	1167 (529)
246	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)
261	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)
271	681 (309)	1748 (793)	911 (413)	797 (362)	2276 (1032)	1209 (548)

NOTE: See pages 11-18 for center of gravity details.

Application data



Unit location

Unit should be level (particularly in its major lengthwise dimension) to assure proper oil return.

The unit should be located indoors in an area of temperature greater than 50 F (10 C).

Good acoustic design practice should be followed, i.e., unit should not be located adjacent to sound-sensitive areas unless appropriate consideration has been made.

Cooler fluid temperature

1. *Maximum* leaving water (fluid) temperature (LWT) is 60 F (21 C). Unit can start and pull down with up to 95 F (35 C) entering water (fluid) temperature due to MOP (maximum operating pressure) feature of the expansion valve. For sustained operation, it is recommended that entering fluid temperature not exceed 70 F (21.1 C).
2. *Minimum* LWT is 40 F (4.4 C) for standard units. The brine option is required for operation with leaving fluid temperatures in the range of 39 to 12 F (4 to -9 C). For ratings below 40 F (4.4 C) LWT, contact your local Carrier representative.
3. *Minimum* entering water (fluid) temperature (EWT) is 45 F (7.2 C). *Maximum* EWT is 70 F (21.1 C).

Leaving-fluid temperature reset

The accessory reset sensor can be applied to the chiller to provide reset of in LWT constant fluid flow systems. Reset reduces compressor power usage at part load when design LWT is not necessary. Humidity control should be considered, since higher coil temperatures resulting from reset will reduce latent heat capacity. Three reset applications are offered:

From return-fluid temperature — Increases LWT set point as return (or entering) fluid temperature decreases (indicating load decrease). Reset from return fluid may be used in any application where return fluid provides accurate load indication. Limitation of return-fluid reset is that the LWT may only be reset to value of design return-fluid temperature. No additional hardware is required.

From outdoor-air temperature — Increases LWT as outdoor ambient temperature decreases (indicating load decrease). This reset should be applied only where outdoor ambient temperature is an accurate indication of load. A field-supplied thermistor is required.

From occupied space temperature — Increases LWT as space temperature decreases (indicating load decrease). This reset should be applied only where space temperature is an accurate indication of load. A field-supplied thermistor is required.

Temperature can also be reset using a 4 to 20 mA signal from the control system. This type of reset requires the Energy Management Module Accessory.

Condenser fluid temperature

1. *Maximum* leaving condenser fluid temperature is 105 F (40.5 C) on all 30HXC units.

2. *Standard* 30HXC units will start at entering condenser fluid temperatures above 55 F (12.8 C). In general, however, continuous machine operation with entering condenser fluid temperatures below 70 F (21.1 C) is not recommended. When the entering condenser fluid temperature is expected to drop below 70 F (21.1 C), it is recommended that some form of condenser flow control be used to optimize performance. Tower pump, bypass valves, or flow regulating valves may be controlled by a 4 to 20 mA output from the 30HXC control (60-second open to close time recommended for actuator).

Cooler and water-cooled condenser temperature rise

Ratings and performance data in this publication are for a cooling temperature rise of 10° F (5.6° C). Units may be operated at a different temperature rise, provided flow limits are not exceeded and corrections to capacity, etc., are made. For minimum flow rates, see the Minimum Flow Rates table. High flow rate is limited by pressure drop that can be tolerated.

Minimum cooler flow — Flow (maximum cooler temperature rise) is shown in the Minimum Flow Rates table. Minimum flow rate must be maintained to prevent fouling. When gpm (L/s) required is lower (or rise is higher), follow recommendations below:

1. Multiple smaller chillers can be applied in series, each providing a portion of the design temperature rise.
2. Chilled fluid can be recirculated to raise flow rate. However, mixed temperature entering cooler must be maintained at a minimum of at least 5° F (2.8° C) above the leaving chilled fluid temperature.
3. Special plus one-pass cooler can be used. Contact your Carrier representative for further information.

Maximum cooler flow (> 5 gpm/ton or < 5° F rise [> 0.09 L/s · kW or < 2.7° C rise]) — Maximum flow results in practical maximum pressure drop through cooler. Special minus-one-pass cooler can be used to reduce pressure drop. Contact your Carrier representative.

Return fluid can bypass the cooler to keep pressure drop through cooler within acceptable limits. This permits a higher ΔT with lower fluid flow through cooler and mixing after the cooler. Contact your Carrier representative if pressure drop appears excessive.

Variable cooler flow rates — These variable rates may be applied to standard 30HX series chillers. However, the unit will attempt to maintain a constant leaving chilled-fluid temperature. In such cases, minimum fluid loop volume must be in excess of 3 gal per ton (3.2 L per kW) and flow rate must change in steps of less than 10% per minute. Apply 6 gal per ton (6.5 L per kW) fluid loop volume minimum if flow rate changes more rapidly.

Minimum water-cooled condenser flow — This value (maximum rise) is shown in Minimum Flow Rates table. Ensure leaving-fluid temperature does not exceed 105 F (40.5 C).

Application data (cont)




MINIMUM FLOW RATES

DEVICE	UNIT SIZE 30HX	COOLER		MIN. FLOW RATE*		COOLER TEMP DIFFERENCE	
		No. of Passes	Type	GPM	L/s	F	C
COOLER	076	2	Minus 1	136.0	8.6	13	7.4
		3	Standard	90.0	5.7	20	11.1
		4	Plus 1	68.0	4.3	27	14.8
	086	2	Minus 1	149.0	9.4	13	7.4
		3	Standard	100.0	6.3	20	11.1
		4	Plus 1	75.0	4.7	27	14.8
	096	2	Minus 1	169.0	10.7	13	7.4
		3	Standard	113.0	7.1	20	11.1
		4	Plus 1	85.0	5.3	27	14.8
	106	2	Minus 1	188.0	11.8	13	7.4
		3	Standard	125.0	7.9	20	11.1
		4	Plus 1	94.0	5.9	27	14.8
	116	1	Minus 1	272.0	17.2	10	5.6
		2	Standard	136.0	8.6	20	11.1
		3	Plus 1	91.0	5.7	30	16.7
	126	1	Minus 1	295.0	18.6	10	5.6
		2	Standard	147.0	9.3	20	11.1
		3	Plus 1	98.0	6.2	30	16.7
	136	1	Minus 1	327.0	20.7	10	5.6
		2	Standard	164.0	10.3	20	11.1
		3	Plus 1	109.0	6.9	30	16.7
	146	1	Minus 1	350.0	22.1	10	5.6
		2	Standard	175.0	11.0	20	11.1
		3	Plus 1	117.0	7.4	30	16.7
	161	1	Minus 1	376.0	23.7	10	5.6
		2	Standard	188.0	11.9	20	11.1
		3	Plus 1	125.0	7.9	30	16.7
	171	1	Minus 1	399.0	25.2	10	5.6
2		Standard	199.0	12.6	20	11.1	
3		Plus 1	133.0	8.4	30	16.7	
186	1	Minus 1	426.0	26.9	10	5.6	
	2	Standard	213.0	13.4	20	11.1	
	3	Plus 1	142.0	9.0	30	16.7	
206	1	Minus 1	508.0	32.1	10	5.6	
	2	Standard	254.0	16.0	20	11.1	
	3	Plus 1	169.0	10.7	30	16.7	
246	1	Minus 1	597.0	37.7	10	5.6	
	2	Standard	309.0	18.8	20	11.1	
	3	Plus 1	199.0	12.6	30	16.7	
261	1	Minus 1	618.0	39.0	10	5.6	
	2	Standard	309.0	19.5	20	11.1	
	3	Plus 1	206.0	13.0	30	16.7	
271	1	Minus 1	642.0	40.5	10	5.6	
	2	Standard	321.0	20.3	20	11.1	
	3	Plus 1	214.0	13.5	30	16.7	
CONDENSER	076,086	2	—	105	6.6	—	—
	096,106	2	—	135	8.5	—	—
	116,126	2	—	170	10.7	—	—
	136,146	2	—	195	12.3	—	—
	161	2	—	235	14.8	—	—
	171,186	2	—	255	16.1	—	—
	206	2	—	273	17.2	—	—
	246	2	—	333	21.0	—	—
	261	2	—	333	21.0	—	—
271	2	—	333	21.0	—	—	

*Based on 20 F (11.1 C) temperature difference at ARI conditions.

NOTES:

1. The 30HX units will start with loop temperatures up to 95 F (35 C).
2. Minimum flow rate shown is based on ARI Ratings and is for reference only. 20 F (11.1 C) is the maximum cooler temperature differential that will determine actual minimum flow rate.
3. To obtain proper temperature control, loop fluid volume must be at least 3 gal/ton (3.23 L/kW) of chiller nominal capacity for air conditioning and at least 6 gal/ton (6.5 L/kW) for process applications.

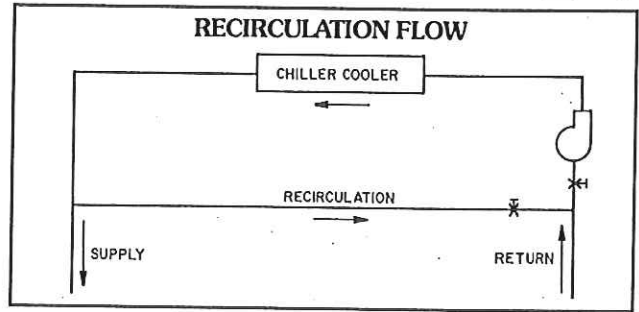

Oversizing chillers

Oversizing chillers by more than 15% at design conditions must be avoided as the system operating efficiency will be adversely affected (resulting in greater and/or excessive electrical demand and cycling of compressors). When future expansion of equipment is anticipated, install a single chiller to meet present load requirements, and install a second chiller to meet the additional load demand.

It is also recommended that the installation of 2 smaller chillers be considered where operation at minimum load is critical. The operation of 2 small chillers at higher loading is preferred to operating a single chiller at or near its minimum recommended value.

The minimum load control accessory should not be used as a means to allow oversizing chillers. Minimum load control should be given consideration where substantial operating time is anticipated below the minimum unloading step.

Parallel chillers

Where chiller capacities greater than can be supplied by a single 30HX chiller are required, or where stand-by capability is desired, chillers may be installed in parallel. Units may be of the same or different sizes. However, cooler and condenser flow rates must be balanced to ensure proper flow to each chiller. The standard 30HX *ComfortLink™* control can be configured to provide lead/lag control for two chillers. The accessory *Chillervisor™* System Manager III control may be used for proper leaving chilled fluid temperature control and to ensure proper staging sequence of up to 8 chillers. Refer to the accessory *Chillervisor* System Manager III installation instructions for further details.

Series chillers

Chillers in series may be used for capacities greater than those supplied by a single 30HX chiller. Using the *Minus-One-Pass Cooler Head* option, fluid pressure drop across the cooler can be held to reasonable levels. The leaving fluid temperature sensors need not be relocated. However, the cooler minimum entering fluid temperature limitations should be considered for the chillers located downstream of other chillers. The standard 30HX control can control two 30HX chillers in series. Condensers should be piped in parallel to maximize capacity and efficiency. This should also minimize condenser pressure drop and saturated condensing temperatures. However, if condensers are piped in series, ensure that the leaving fluid temperature does not exceed 105 F (40.5 C).

Energy management

Demand limiting and load shedding are popular techniques used to reduce peak electric demands typically experienced during hot summer days when air conditioning loads are highest. When utility electricity demands exceed a certain level, electrical loads are turned off to keep the peak demands below a prescribed maximum limit. Compressor unloading reduces electrical demand while allowing the chiller to operate under part-load capacity and to maintain partial chilled fluid cooling.

Electrical demand can be limited through demand limit input to chiller control which unloads the chiller to a predetermined percentage of the load. One stage of unloading can be initiated by a remote signal to significantly reduce the chiller power consumption. This power reduction applies to the full load power at nominal conditions. The demand limit control should not be cycled less than 10 minutes on and 5 minutes off.

Duty cycling

Duty cycling will cycle an electrical load at regular intervals, regardless of electrical demand. This reduces the electrical demand by "fooling" demand measuring devices. Duty cycling of the entire compressor is **NOT** recommended since motor windings and bearings will be damaged by constant cycling.

Wye-delta start

Wye-delta start is standard on 30HX 208/230-v, 60-Hz units and 230-v, 50-Hz units and optional on all other 30HX units. This feature is not always required on 30HX units due to the use of multiple compressors that allow small electrical load increments, but is available if required. Maximum instantaneous current flow (see ICF in Electrical Data tables on pages 59-62) should be used in determining need.

Vibration isolation

External vibration isolators are available as field-installed accessories.


Strainers

A strainer with a minimum screen size of 20 mesh must be installed in both the cooler and condenser fluid lines, within 10 ft (3 m) of the inlets to both the cooler and condenser. For 30HXA units, this requirement applies only to the cooler.

Chilled fluid loop volume

The chilled fluid loop volume in circulation must equal or exceed 3 gal per nominal ton of cooling (3.2 L per kW) for temperature stability and accuracy in normal air conditioning applications. For example, a 30HXC096 with a nominal capacity of 94.0 tons would require 282 gal (1067.4 L) in circulation in the system loop.

For process jobs where accuracy is vital, or for operation at ambient temperatures below 32 F (0° C) with low unit loading conditions, there should be from 6 to 10 gal per ton (6.5 to 10.8 L per kW). To achieve this volume, it is often necessary to install a tank in the loop. Tank should be baffled to ensure there is no stratification, and that water (or brine) entering the tank is adequately mixed with liquid in the tank. See Tank Installation drawing.

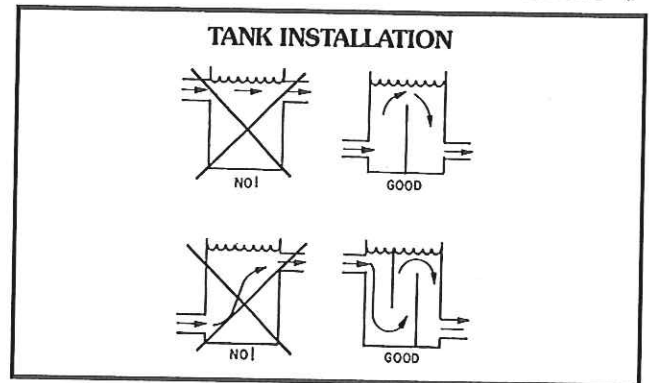

Fouling factor

The factor used to calculate tabulated ratings for the cooler is 0.00010 ft² · hr · F/Btu (0.000018 m² · K/W), and for the condenser is 0.00025 ft² · hr · F/Btu (0.00044 m² · K/W). As fouling factor is increased, unit capacity decreases and compressor power increases. To determine selections at other fouling factors, use the chiller program in the electronic catalog.

Cooler and water-cooled condenser freeze protection

If chiller refrigerant or fluid lines are in an area where ambient conditions fall below 32 F (0° C), it is recommended that an antifreeze solution be added to protect the unit and fluid piping to a temperature 12° F (6.7° C) below the lowest anticipated temperature. For corrections to performance, refer to the chiller program in the electronic catalog.

Use only antifreeze solutions approved for heat exchanger duty. Use of automotive antifreezes is not recommended because of the fouling that can occur once their relatively short-lived inhibitors break down.

If the system will not be used during freezing weather conditions and the chiller and fluid piping are not protected with an antifreeze solution, it is recommended that the chiller and outdoor piping be drained.

Refer to Cooler Fluid Temperature section, page 21, for leaving fluid temperature for brine units. When leaving chilled fluid temperatures will be lower than 40 F (4.4 C), an appropriate antifreeze solution must be used in the cooler. In addition, the following special installation instructions will apply:

1. In addition to the factory-mounted chilled water flow switch, a field-supplied condenser water flow switch must be installed.
2. The chiller must control both the chilled water pump and the condenser pump. The cooler pump must operate for a minimum of 10 minutes after the chiller has shut down and the condenser pump must operate for a minimum of 30 minutes after the chiller has shut down. In the event of a loss of condenser water flow, the flow of chilled fluid to the evaporator must be stopped or the isolation valve must be closed. This is necessary to reduce the possibility of condenser freeze-up.

Application data (cont)



3. Condenser head pressure control valves must not reduce condenser flow below 0.75 gallons per ton (0.4 L/s per kW) or the lowest detectable flow level of the condenser water flow switch. For further information, refer to the 30HX Installation Instructions or contact your Carrier representative.

30HXA remote condenser requirements

1. Do not manifold independent refrigerant circuits into a single condenser circuit.
2. Ensure each refrigerant circuit has its own head pressure control.
3. Condensing pressure control must be provided on condensers used with 30HXA to maintain a minimum 75 F (24 C) saturated discharge temperature at light loads.
4. Condenser must provide 15° F (8.3° C) subcooling, a maximum of 40° F (22.2° C) difference between saturated condensing temperature and outdoor ambient temperature (to prevent overload at high ambient temperatures), and a minimum of 20° F (11.1° C) difference (to assure subcooling).
5. Minimum saturated discharge temperature (SDT) is 90 F (32.2 C). Maximum SDT is 135 F (57.2 C) at full load.
6. Condenser should not be located more than 15 ft (4.6 m) below chiller to maintain subcooling.
7. Design discharge and liquid piping according to Carrier System Design Manual. Piping must be sized for HFC-134a. Refer to the ASHRAE Refrigeration Handbook for R-134a sizing tables. Also see 30HX Installation instructions and the Typical 30HXA Refrigerant Piping to Remote Condenser diagrams on page 29.
8. Maximum interconnecting refrigerant line length is 200 ft (61 m) actual.
9. Liquid line solenoid valves are required.
10. If accessory sound enclosure is installed, run lines along the floor so the sound enclosure can be notched to clear lines.

Refrigerant pipe sizing for 30HXA with Carrier 09D condenser combinations — For refrigerant pipe sizing of the 30HXA follow these directions:


Discharge line:

1. For applications at conditions of 40 F (4.4 C) or higher, use the Refrigerant Line Sizes for 30HXA Chiller/09DK Condenser Combinations tables on pages 25 and 26.
For applications using brine, other condensers, or LWT below 40 F (4.4 C), size lines using the ASHRAE Refrigeration Handbook, or other suitable design guide.
2. Install horizontal lines level or pitched slightly toward the base of discharge riser and the condenser (in the direction of flow).
3. If chiller is below the condenser, loop the discharge line to at least one inch (25.4 mm) above the top of condenser.

4. A double discharge riser (as shown in Refrigerant Line Sizes, Double Discharge Riser Pipe Sizes table on page 26) is required if any of the following conditions exist:
 - a. Unit is equipped with minimum load control.
 - b. Chiller is located below condenser.
 - c. Discharge line size is in shaded area in Refrigerant Line Sizes, Recommended Refrigerant Pipe Sizes table on page 25.
5. Minimize line length and restrictions to minimize pressure drop and refrigerant charge.
6. If accessory sound enclosure is applied, run lines along the floor so sound enclosure may be notched to clear lines.
7. Lines should not be buried underground.

Liquid line:

1. For applications at conditions of 40 F (4.4 C) or higher LWT, use the Refrigerant Line Sizes for 30HXA Chiller/09DK Condenser Combinations tables on pages 25 and 26.
For applications using brine, other condensers, or LWT below 40 F (4.4 C), size lines using the ASHRAE Refrigeration Handbook, or other suitable design guide.
2. If chiller is above condenser, maximum vertical separation is 15 ft (4.6 m).
3. Minimize line length and restrictions to minimize pressure drop and refrigerant charge.
4. Field-supplied liquid line solenoid valves are required. The solenoid valves must be located close to the chiller.
5. If sound enclosure is applied, run lines along floor so sound enclosure may be notched to clear lines.
6. In-line receivers are NOT recommended due to their negative effect on system subcooling. Where the use of a receiver is desired for service purposes, the receiver should be piped in parallel with the main liquid line and equipped with shut-off valves to isolate it during unit operation. See sketch below.
7. Filter driers (field supplied) are required.

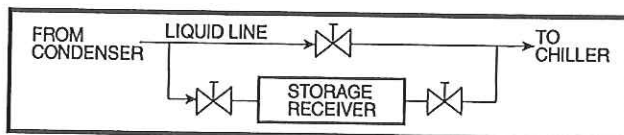

Relief valve vent lines

1. Vent per local code requirements.
2. Each chiller has a minimum of 4 refrigerant relief valves: 2 on the cooler, 2 on the condenser (30HXC) or oil separator (30HXA). Units with factory-installed suction service valves also have one relief valve on each compressor discharge line. See Dimensions section on pages 11-18 for specific locations.
3. If sound enclosure is applied, run lines along floor so sound enclosure may be notched to clear lines.



REFRIGERANT LINE SIZES FOR 30HXA CHILLER/09DK CONDENSER COMBINATIONS
RECOMMENDED REFRIGERANT PIPE SIZES (in. OD)

30HXA UNIT SIZE	CKT	TOTAL LENGTH OF INTERCONNECTING PIPING — FT (M)					
		0-50 (0-15)		50-100 (15-30)		100-200 (30-60)	
		Liquid Line*	Discharge Line†	Liquid Line*	Discharge Line†	Liquid Line*	Discharge Line†
076	A	1 ¹ / ₈	2 ¹ / ₈	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
	B	1 ¹ / ₈	2 ¹ / ₈	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
086	A	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
	B	1 ¹ / ₈	2 ¹ / ₈	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
096	A	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
	B	1 ¹ / ₈	2 ¹ / ₈	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
106	A	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ¹ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
116	A	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈
126	A	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
136	A	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ¹ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
146	A	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
161	A	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ¹ / ₈	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈
171	A	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
186	A	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
206	A	1 ⁵ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
246	A	2 ¹ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ⁵ / ₈	3 ¹ / ₈
261	A	2 ¹ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈
271	A	2 ¹ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈	2 ⁵ / ₈	3 ¹ / ₈
	B	1 ³ / ₈	2 ⁵ / ₈	1 ⁵ / ₈	2 ⁵ / ₈	2 ¹ / ₈	3 ¹ / ₈

LEGEND

OD — Outside Diameter

*Field-supplied liquid line solenoid valve is required.

†Double discharge riser is required on ALL units which have minimum load control installed.

█ Values indicate double discharge riser required on STANDARD unit. See Double Discharge Riser Pipe Sizes table on page 26.

NOTES:

1. Refrigerant and Double Discharge Riser Pipe Sizes tables are based on equal chiller and 09DK condenser sizes — i.e., 30HXA096 with 09DK094.
2. For other system combinations, size lines per ASHRAE (American Society of Heating, Refrigerating, and Air Conditioning Engineers) or other R-134a line sizing guide.
3. Refrigerant and Double Discharge Riser Pipe Sizes tables are based on cooler leaving water temperatures of 40 F (4.4 C) or above.
4. Pipe diameter calculation is based on actual line length plus a 50% allowance for fittings.

Application data (cont)



REFRIGERANT LINE SIZES FOR 30HXA CHILLER/09DK CONDENSER COMBINATIONS (cont) DOUBLE DISCHARGE RISER PIPE SIZES (in. OD)


30HXA UNIT SIZE	CKT	RISER "A"		RISER "B"	
		Total Length of Interconnecting Piping — FT (M)*			
		0-200 (0-60)	0-50 (0-15)	50-100 (15-30)	100-200 (30-60)
076	A	1 1/8	1 5/8	1 5/8	1 5/8
	B	1 1/8	1 5/8	1 5/8	1 5/8
086	A	1 1/8	1 5/8	1 5/8	1 5/8
	B	1 1/8	1 5/8	1 5/8	1 5/8
096	A	1 1/8	1 5/8	1 5/8	2 1/8
	B	1 1/8	1 5/8	1 5/8	1 5/8
106	A	1 5/8	1 5/8	2 1/8	2 1/8
	B	1 3/8	1 3/8	1 3/8	1 3/8
116	A	1 5/8	1 5/8	2 1/8	2 1/8
	B	1 3/8	1 5/8	1 5/8	1 5/8
126	A	1 5/8	2 1/8	2 1/8	2 1/8
	B	1 3/8	1 5/8	1 5/8	2 1/8
136	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 3/8	1 5/8	1 5/8	2 1/8
146	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	1 5/8	2 1/8	2 1/8
161	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	1 5/8	2 1/8	2 1/8
171	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	2 1/8	2 1/8	2 5/8
186	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	2 1/8	2 1/8	2 5/8
206	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	2 1/8	2 1/8	2 5/8
246	A	1 5/8	2 1/8	2 1/8	2 5/8
	B	1 5/8	2 1/8	2 1/8	2 5/8
261	A	1 5/8	2 1/8	2 1/8	3 1/8
	B	1 5/8	2 1/8	2 1/8	2 5/8
271	A	1 5/8	2 1/8	3 1/8	3 1/8
	B	1 5/8	2 1/8	2 1/8	2 5/8

LEGEND

- A — Riser Without Trap
- B — Riser With Trap
- OD — Outside Diameter

*Total Length of Interconnecting Piping refers to actual length, not total equivalent length.

NOTE: Horizontal line sections should be sized according to the Total Length of Interconnecting Piping columns on the Recommended Refrigerant Pipe Sizes table on page 25.

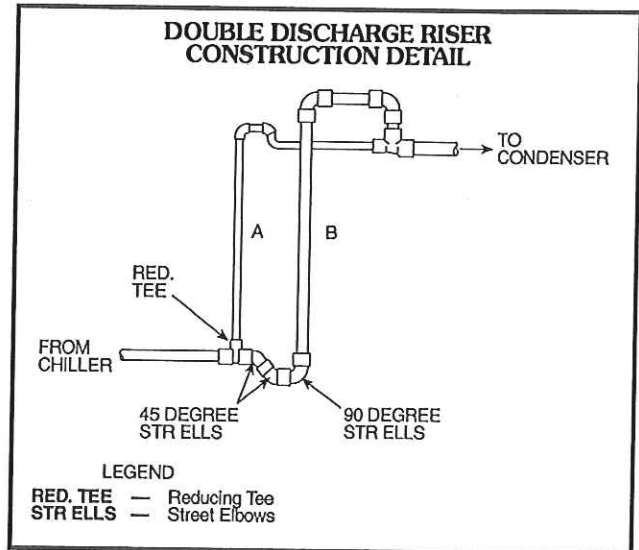



For chillers using brine or those matched with other condensers, the lines must be sized manually using design guides such as ASHRAE, or curves in the 30HXA installation instructions. In many 30HXA sizes, the individual refrigerant circuits have unequal capacities. The Circuit Cooling Capacity table below lists the percentage capacity of each circuit for line sizing purposes. The Circuit Unloading Capacity table below indicates the minimum unloading capacities per circuit as well as a sample calculation of the minimum circuit tonnage for riser design. The example below lists circuit capacity calculations based on the Circuit Cooling and Circuit Unloading Capacity tables.

CIRCUIT COOLING CAPACITY

30HXA UNIT SIZE	PERCENT OF TOTAL UNIT CAPACITY	
	Circuit A %	Circuit B %
076	50	50
086	55	45
096	59	41
106	64	36
116	60	40
126	55	45
136	59	41
146	55	45
161	59	41
171	47	53
186	50	50
206	54	46
246	61	39
261	63	37
271	64	36

CIRCUIT UNLOADING CAPACITY

30HXA UNIT	MINIMUM CIRCUIT CAPACITY — PERCENT OF FULL LOAD	
	Standard Unit	With Minimum Load Control
All Sizes, All Circuits	40%	20%

Example Calculation of Circuit Capacities:

Select (Standard) 30HXA086 Chiller

From Electronic catalog (E-cat) selection or balance diagram:

Total Unit Capacity = 74 tons (from unit selection at design conditions)

Using the Circuit Cooling Capacity table:

Ckt "A" design capacity = $74 \times 0.55 = 40.7$ tons

Using the Circuit Unloading Capacity table:

Ckt "A" minimum capacity = $40.7 \times 0.40 = 16.3$ tons

Ckt "B" design capacity = $74 \times 0.45 = 33.3$ tons

Ckt "B" minimum capacity = $33.3 \times 0.40 = 13.3$ tons

System refrigerant charge — The 30HXA units are shipped from the factory with a small holding charge of R-134a refrigerant. The approximate refrigerant charge required for starting the 30HXA system is listed in the table on next page. This initial charge will allow starting of the unit. Additional refrigerant may be required to accommodate liquid line storage. See the liquid line refrigerant storage capacity table below for liquid line storage information.

LIQUID LINE REFRIGERANT STORAGE CAPACITY

PIPING SIZE (in.)	REFRIGERANT (lb) PER FT OF TUBING LENGTH	REFRIGERANT (kg) PER M OF TUBING LENGTH
1 ¹ / ₈	0.41	0.61
1 ³ / ₈	0.63	0.94
1 ⁵ / ₈	0.89	1.33
2 ¹ / ₈	1.52	2.26
2 ³ / ₈	2.32	3.45

Application data (cont)



SYSTEM REFRIGERANT CHARGE FOR START-UP

30HXA	REFRIGERANT CIRCUIT	COOLER CHARGE		AIR-COOLED CONDENSER TYPE, SIZE (Qty)*	CONDENSER CHARGE		RECOMMENDED REFRIGERANT PIPE SIZES (in. OD)†	PIPING CHARGE		TOTAL REFRIGERANT CHARGE	
		Lb	Kg		Lb	Kg		Lb	Kg	Lb	Kg
076	A	48	22	09DK 084 (1)	62	28	1 ¹ / ₈	10	5	120	55
	B	48	22		62	28	1 ¹ / ₈	10	5	120	55
086	A	61	28	09DK 084 (1)	62	28	1 ¹ / ₈	10	5	133	61
	B	52	24		62	28	1 ¹ / ₈	10	5	124	57
096	A	75	34	09DK 094 (1)	68	31	1 ¹ / ₈	10	5	153	70
	B	56	25		68	31	1 ¹ / ₈	10	5	134	61
106	A	88	40	09DK 074 (1) and 09DK 044 (1)	82	37	1 ³ / ₈	16	7	186	84
	B	56	25		62	28	1 ³ / ₈	16	7	134	60
	A	88	40	09AZ 102FE (1)	24	11	1 ³ / ₈	16	7	128	58
	B	56	25		18	8	1 ³ / ₈	16	7	90	40
116	A	84	38	09DK 074 (1) and 09DK 054 (1)	82	37	1 ³ / ₈	16	7	182	82
	B	61	28		56	25	1 ³ / ₈	16	7	133	60
	A	84	38	09AZ 112FE (1)	42	19	1 ³ / ₈	16	7	142	64
	B	61	28		42	19	1 ³ / ₈	16	7	119	54
126	A	90	41	09DK 074 (2)	82	37	1 ³ / ₈	16	7	188	85
	B	71	32		82	37	1 ³ / ₈	16	7	169	76
	A	90	41	09AZ 122FE (1)	24	11	1 ³ / ₈	16	7	130	59
	B	71	32		24	11	1 ³ / ₈	16	7	112	50
136	A	99	45	09DK 074 (2)	82	37	1 ³ / ₈	16	7	197	89
	B	71	32		82	37	1 ³ / ₈	16	7	169	76
	A	99	45	09AZ 132FE (1)	57	26	1 ³ / ₈	16	7	172	78
	B	71	32		42	19	1 ³ / ₈	16	7	130	58
146	A	95	43	09DK 084 (2)	124	56	1 ³ / ₈	16	7	235	106
	B	80	36		124	56	1 ³ / ₈	16	7	220	99
	A	95	43	09AZ 142FE (1)	57	26	1 ³ / ₈	16	7	168	76
	B	80	36		57	26	1 ³ / ₈	16	7	153	69
161	A	120	54	09DK 084 (2)	124	56	1 ³ / ₈	16	7	260	117
	B	88	40		124	56	1 ³ / ₈	16	7	228	103
	A	120	54	09AZ 162FE (1)	68	31	1 ³ / ₈	16	7	204	92
	B	88	40		68	31	1 ³ / ₈	16	7	172	78
171	A	95	43	09DK 084 (2)	124	56	1 ³ / ₈	16	7	235	106
	B	112	51		124	56	1 ³ / ₈	16	7	252	114
	A	95	43	09AZ 172FE (1)	68	31	1 ³ / ₈	16	7	179	81
	B	112	51		68	31	1 ³ / ₈	16	7	196	89
186	A	108	49	09DK 084 (2)	124	56	1 ³ / ₈	16	7	248	112
	B	108	49		124	56	1 ³ / ₈	16	7	248	112
	A	108	49	09AZ 182FE (1)	68	31	1 ³ / ₈	16	7	192	87
	B	108	49		68	31	1 ³ / ₈	16	7	192	87
206	A	160	73	09DK 084 (2) and 09DK 094 (1)	272	123	1 ⁵ / ₈	22	10	454	206
	B	108	49		124	56	1 ³ / ₈	16	7	248	112
	A	160	73	09AZ 101FA (1) and 09AZ 91FA (1)	49	22	1 ⁵ / ₈	22	10	231	105
	B	108	49		37	17	1 ³ / ₈	16	7	161	73
246	A	176	80	09DK 094 (3)	272	123	2 ¹ / ₈	38	17	486	220
	B	108	49		136	62	1 ³ / ₈	16	7	260	118
	A	176	80	09AZ 151FA (1) and 09AZ 91FA (1)	113	51	2 ¹ / ₈	38	17	327	148
	B	108	49		37	17	1 ³ / ₈	16	7	161	73
261	A	176	80	09DK 094 (3)	272	123	2 ¹ / ₈	38	17	486	220
	B	108	49		136	62	1 ³ / ₈	16	7	260	118
	A	176	80	09AZ 171FA (1) and 09AZ 91FA (1)	136	62	2 ¹ / ₈	38	17	350	159
	B	108	49		37	17	1 ³ / ₈	16	7	161	73
271	A	176	80	09DK 094 (3)	272	123	2 ¹ / ₈	38	17	486	220
	B	108	49		136	62	1 ³ / ₈	16	7	260	118
	A	176	80	09AZ 181FA (1) and 09AZ 91FA (1)	136	62	2 ¹ / ₈	38	17	350	159
	B	108	49		37	17	1 ³ / ₈	16	7	161	73

*Refer to Carrier's electronic catalog for 09AZ/30HX rating data.


†Based on 25 ft (7.6 m) liquid line.

NOTE: Multiply the liquid line length (in feet) by the factor shown on page 27 for the refrigerant/ft of the tubing. Add base unit charge to liquid line charge to determine approximate refrigerant charge.

TYPICAL 30HXA REFRIGERANT PIPING TO REMOTE CONDENSER (076-096 SIZES SHOWN)

NOTES:


1. Piping shown is for general point-of-connection only and is not intended to show details for a specific installation. Certified field wiring and dimensional drawings are available upon request. The 30HXA units should be installed using certified drawings.
2. Refer to Carrier System Design Manual for details regarding piping techniques.
3. Piping and pressure relief devices are field supplied.
4. Relief valve vent piping per local codes.
5. If unit is equipped with accessory sound enclosure, run lines down to floor and notch bottom of enclosure to clear lines.

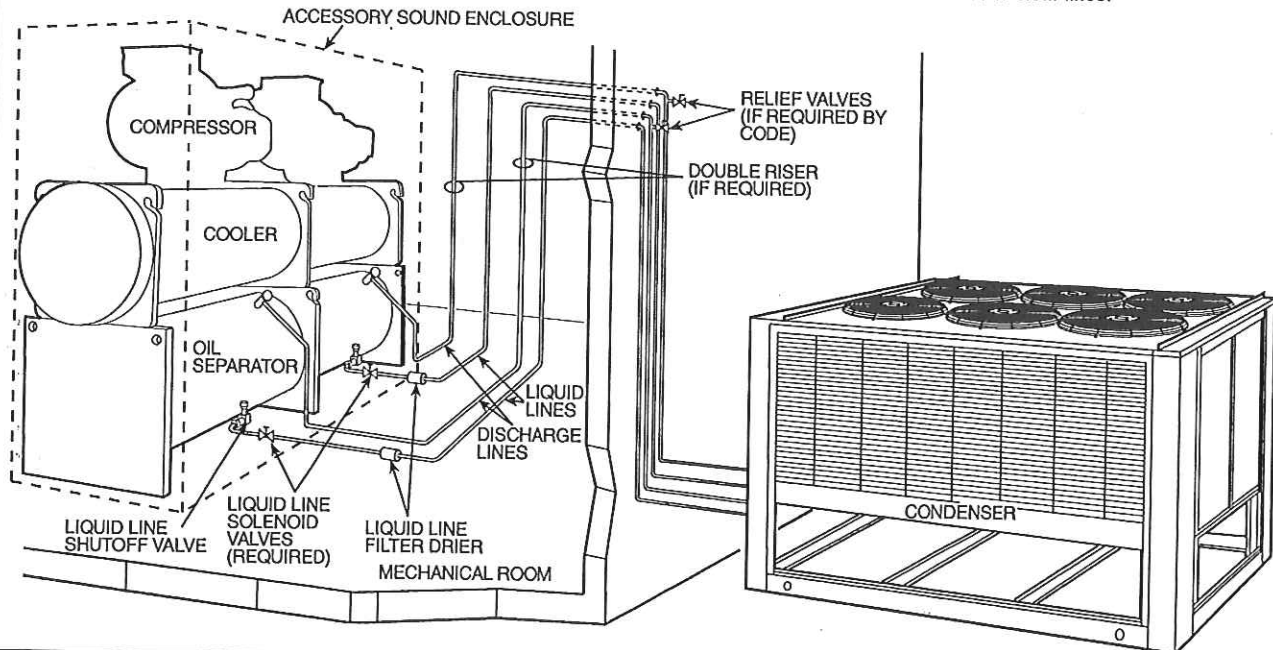

TYPICAL 30HXA REFRIGERANT PIPING TO REMOTE CONDENSER(S) (206-271 SIZES SHOWN)

NOTES:

1. Piping shown is for general point-of-connection only and is not intended to show details for a specific installation. Certified field wiring and dimensional drawings are available upon request. The 30HXA units should be installed using certified drawings.
2. Refer to Carrier System Design Manual for details regarding piping techniques.
3. Piping and pressure relief devices are field supplied.
4. Relief valve vent piping per local codes.
5. If unit is equipped with accessory sound enclosure, run lines down to floor and notch bottom of enclosure to clear lines.

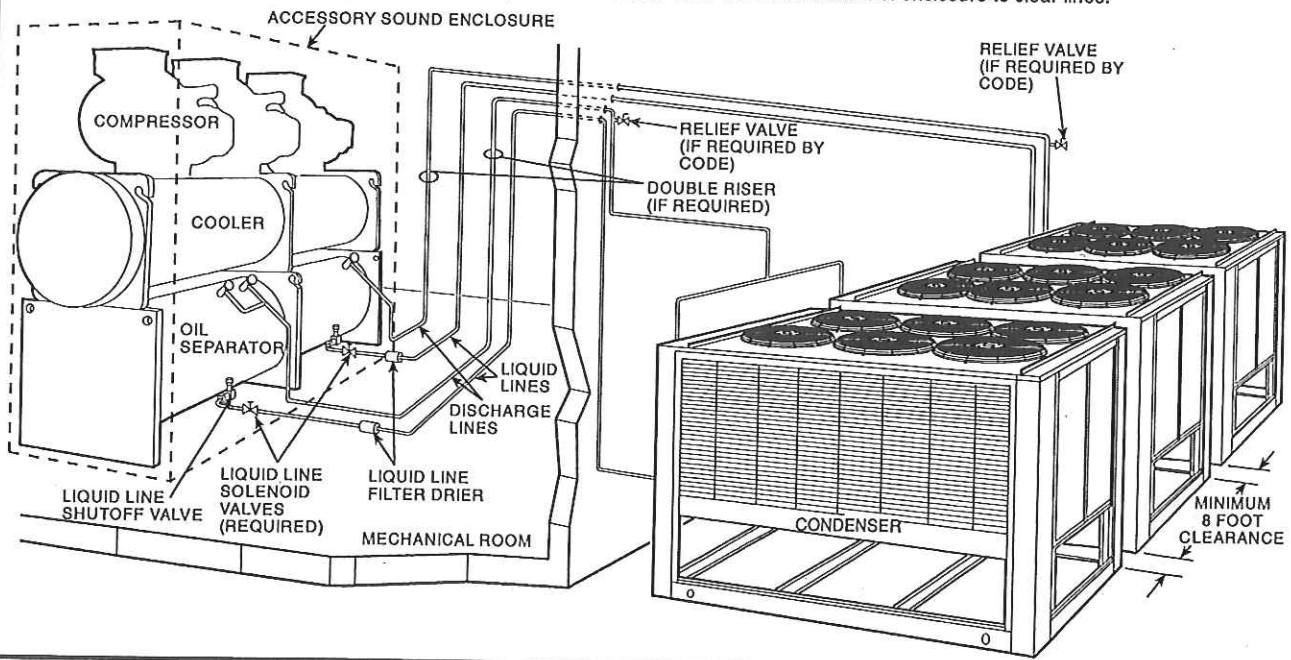

Selection procedure with xample



Carrier's electronic catalog chiller selection program provides quick, easy selection of Carrier chillers. The program considers specific temperature and flow requirements and other factors, such as fouling and altitude correction. It can also select an air-cooled condenser for the condenserless 30HXA unit to match the required conditions. To select a 30HXA unit, use the electronic catalog or contact your Carrier representative. To select a 30HXC chiller, use the electronic catalog or follow one of the procedures below.

ENGLISH (60 Hz)

I Determine 30HXC unit size and operating conditions required to meet given capacity at given conditions.

Given:

Capacity	175 Tons
Leaving Chilled Water Temp (LCWT)	44 F
Cooler Water Temp Rise	10° F
Condenser Entering Water Temp	85 F
Condenser Water Temp Rise	10° F
Cooling Fouling Factor	.00010
Condenser Fouling Factor	.00025

NOTE: For other than 10° F temperature rise, data corrections must be made using the chiller program in the electronic catalog. On some units, a change of controls is also necessary.

II From Cooling Capacities table on page 31 and pressure drop curves on pages 55 and 56, determine operating data for selected unit.

Unit	30HXC186
Capacity	176.9 tons
Compressor Motor Power Input	128.5 kW
Cooler Water Flow	424.2 gpm
Cooler Pressure Drop	12.1 ft of water
Condenser Water Flow	507.7 gpm
Condenser Pressure Drop	16.7 ft of water

SI (50 Hz)

I Determine 30HXC unit size and operating conditions required to meet given capacity at given conditions.

Given:

Capacity	617 kW
Leaving Chilled Water Temp (LCWT)	7 C
Cooler Water Temp Rise	5.6° C
Condenser Entering Water Temp	30 C
Condenser Water Temp Rise	5.6° C
Cooling Fouling Factor	0.01761
Condenser Fouling Factor	0.04403

NOTE: For other than 5.6° C temperature rise, data corrections must be made using the chiller program in the electronic catalog. On some units, a change of controls is also necessary.

II From Cooling Capacities table on page 41 and pressure drop curves on pages 55 and 56, determine operating data for selected unit.

Unit	30HXC186
Capacity	627.0 kW
Compressor Motor Power Input	130.5 kW
Cooler Water Flow	26.9 L/s
Cooler Pressure Drop	36.1 kPa
Condenser Water Flow	32.3 L/s
Condenser Pressure Drop	32.0 kPa

Performance data



30HXC Ratings

All performance data is based on:

1. Cooler water temperature rise of 10° F (5.6° C).
2. Cooler fouling factor of 0.00010 ft² • hr • F/Btu (0.000018 m² • k/W).
3. Condenser fouling factor of 0.00025 ft² • hr • F/Btu (0.000044 m² k/W).
4. 10° F (5.6° C) subcooling.
5. Refrigerant 134a.

30HXC COOLING CAPACITIES

60 Hz, ENGLISH

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
40.0	076	71.5	50.0	171.2	203.8	68.5	52.9	163.9	198.4	65.6	55.7	157.0	193.5	63.3	59.1	151.5	190.2
	086	78.9	56.3	188.8	225.5	75.6	59.4	180.9	219.7	72.6	62.7	173.8	214.8	70.2	66.5	167.9	211.4
	096	89.1	62.5	213.4	254.1	85.4	66.0	204.5	247.6	82.0	69.7	196.3	241.9	79.3	74.1	189.8	238.3
	106	99.0	70.2	237.0	282.7	94.7	74.3	226.7	275.2	90.9	78.7	217.6	269.0	87.9	83.8	210.5	265.3
	116	107.7	74.6	257.7	306.4	103.2	79.1	247.0	298.7	98.8	83.7	236.5	291.2	95.5	89.1	228.7	287.1
	126	116.6	81.0	279.1	331.9	111.8	86.0	267.6	323.8	107.3	91.2	256.8	316.4	103.7	97.0	248.3	311.8
	136	129.3	90.7	309.4	368.6	124.1	95.8	297.1	359.6	119.4	101.1	285.8	351.9	115.7	107.3	276.9	347.2
	146	138.3	98.3	331.0	395.1	132.5	103.8	317.2	385.0	127.7	110.0	305.6	377.5	123.7	117.0	296.2	372.8
	161	147.6	104.3	353.3	421.3	144.9	113.5	346.8	420.9	143.1	123.7	342.5	423.4	142.4	135.5	340.8	429.5
	171	156.4	110.6	374.4	446.5	154.0	120.1	368.6	447.0	152.4	130.7	364.8	450.2	151.6	142.6	362.9	456.3
	186	167.2	119.2	400.1	477.8	164.6	129.2	394.1	478.4	162.9	140.4	390.1	481.8	162.3	153.1	388.5	488.7
	206	199.4	136.1	477.4	566.3	195.8	148.0	468.8	565.5	193.0	161.0	462.1	567.5	191.1	175.4	457.6	572.5
246	234.3	160.7	560.9	665.8	230.3	175.0	551.4	665.7	226.6	190.2	542.5	667.0	225.3	208.2	539.4	675.8	
261	242.6	168.3	580.6	690.4	238.6	182.8	571.3	690.7	235.4	198.3	563.5	693.3	234.4	216.9	561.0	703.1	
271	252.3	176.9	603.9	719.3	248.3	191.9	594.5	719.8	245.2	208.3	587.1	723.3	244.2	227.5	584.6	733.7	
42.0	076	74.9	50.5	179.5	212.4	71.7	53.4	171.8	206.6	68.6	56.3	164.3	201.1	65.9	59.5	157.9	196.9
	086	82.6	56.8	197.9	234.8	79.1	60.0	189.6	228.7	75.8	63.3	181.5	222.8	73.0	67.0	175.0	218.8
	096	93.4	63.0	223.6	264.6	89.4	66.7	214.3	257.7	85.7	70.4	205.2	251.2	82.6	74.6	197.8	246.5
	106	103.7	70.7	248.3	294.3	99.2	75.0	237.7	286.6	94.8	79.3	227.1	278.8	91.5	85.1	219.2	274.8
	116	112.7	75.1	270.1	319.0	108.1	79.8	259.0	311.0	103.4	84.4	247.7	302.8	99.5	90.2	238.3	297.2
	126	122.1	81.5	292.5	345.5	117.1	86.7	280.5	337.0	112.2	91.8	268.7	328.7	107.9	98.1	258.6	322.7
	136	135.4	91.4	324.3	383.8	129.9	96.6	311.1	374.1	124.7	101.8	298.6	365.1	120.4	107.9	288.5	359.1
	146	144.8	99.0	346.9	411.3	138.8	104.8	332.6	400.8	133.2	110.7	319.2	391.4	128.8	117.5	308.5	385.3
	161	153.3	104.0	367.2	434.8	150.5	113.2	360.5	434.3	147.8	123.1	354.1	434.5	146.8	134.8	351.7	439.8
	171	162.3	110.1	388.8	460.5	159.7	119.7	382.7	460.6	157.6	130.0	377.5	462.3	156.3	141.8	374.5	467.2
	186	173.5	118.8	415.5	492.8	170.7	128.8	408.8	492.7	168.2	139.5	403.0	494.0	167.3	152.3	400.7	500.3
	206	207.0	136.5	496.0	584.8	203.4	147.8	487.3	583.7	199.9	160.5	478.9	583.8	197.3	174.7	472.6	586.9
246	243.3	160.0	582.8	686.9	239.1	174.4	572.8	686.6	235.0	189.5	562.9	686.8	232.4	207.3	556.7	692.4	
261	251.7	167.3	603.1	711.9	247.5	181.9	593.0	711.6	243.7	197.4	583.9	712.8	241.6	215.3	578.8	719.7	
271	261.8	176.2	627.1	741.7	257.4	191.3	616.7	741.3	253.6	207.3	607.5	742.8	251.7	226.1	603.0	750.9	
44.0	076	78.4	51.1	187.9	221.1	75.1	53.9	180.1	215.2	71.8	56.9	172.1	209.2	68.7	60.0	164.7	203.8
	086	86.4	57.4	207.1	244.4	82.8	60.7	198.6	238.0	79.3	64.0	190.1	231.7	76.0	67.4	182.3	226.3
	096	97.6	63.7	234.1	275.4	93.6	67.3	224.5	268.3	89.6	71.1	214.9	261.2	85.9	75.0	206.0	254.9
	106	108.4	71.3	259.9	306.1	103.9	75.7	249.2	298.4	99.3	80.1	238.1	290.2	95.2	87.2	228.2	285.0
	116	117.9	75.8	282.6	331.8	113.2	80.4	271.3	323.6	108.3	85.2	259.7	315.3	103.6	90.1	248.3	307.2
	126	127.6	82.3	306.0	359.4	122.5	87.3	293.8	350.5	117.4	92.6	281.5	341.8	112.5	98.1	269.7	333.7
	136	141.6	92.2	339.5	399.3	136.0	97.4	326.0	389.4	130.4	102.8	312.7	379.7	125.3	108.5	300.4	371.3
	146	151.4	99.8	363.0	427.7	145.4	105.6	348.6	417.2	139.2	111.5	333.7	406.4	133.9	119.3	321.1	398.9
	161	159.0	103.6	381.1	448.4	156.3	113.0	374.7	448.2	153.4	123.0	367.7	447.8	151.4	136.0	362.9	451.6
	171	168.2	110.5	403.3	475.0	165.6	119.7	397.1	474.9	163.0	129.9	390.8	475.4	161.2	141.5	386.5	478.9
	186	179.8	118.4	431.0	507.8	176.9	128.5	424.2	507.7	174.2	139.3	417.6	508.4	172.3	151.5	413.1	512.0
	206	214.7	136.9	514.8	603.7	211.2	147.6	506.2	602.3	207.3	160.5	496.9	601.6	204.2	174.6	489.5	603.6
246	252.0	160.0	604.2	708.1	248.2	173.7	594.9	708.0	243.9	189.1	584.6	707.9	239.8	205.7	574.8	709.2	
261	260.8	167.6	625.1	734.0	256.8	181.8	615.6	734.0	252.6	197.5	605.5	734.3	249.0	214.4	597.0	737.1	
271	271.2	175.8	650.0	764.2	267.0	190.8	640.0	764.2	262.7	207.0	629.9	764.8	259.4	224.8	621.7	768.6	

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



30HXC COOLING CAPACITIES (cont) 60 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
45.0	076	80.1	51.5	192.1	225.5	76.9	54.2	184.3	219.5	73.5	57.2	176.2	213.5	70.2	60.2	168.3	207.6
	086	88.3	57.8	211.8	249.2	84.7	60.9	203.2	242.8	81.1	64.3	194.5	236.4	77.6	67.7	186.2	230.3
	096	99.8	64.2	239.3	280.9	95.8	67.6	229.7	273.7	91.7	71.5	219.8	266.4	87.8	75.3	210.4	259.6
	106	110.8	71.6	265.7	312.1	106.3	76.0	255.0	304.3	101.6	80.4	243.7	296.1	97.1	86.5	232.9	289.3
	116	120.5	76.2	288.9	338.4	115.8	80.6	277.6	330.1	110.9	85.5	265.9	321.6	105.9	90.4	254.1	313.1
	126	130.5	82.7	312.9	366.5	125.4	87.6	300.6	357.5	120.2	92.9	288.1	348.7	115.0	98.4	275.8	340.0
	136	144.7	92.9	347.0	407.2	139.1	97.8	333.6	397.2	133.4	103.3	319.8	387.1	128.0	108.9	306.9	378.0
	146	154.8	100.3	371.1	436.1	148.8	106.0	356.7	425.6	142.4	112.0	341.5	414.5	136.8	120.7	328.0	406.7
	161	161.8	103.6	388.1	455.2	159.2	112.8	381.8	455.1	156.3	122.9	374.7	454.7	153.7	135.6	368.6	457.0
	171	171.2	110.6	410.6	482.3	168.7	119.7	404.5	482.3	166.0	130.0	398.0	482.6	163.9	141.5	393.0	485.3
	186	182.9	118.4	438.6	515.3	180.2	128.3	432.0	515.4	177.3	139.2	425.2	515.8	175.0	151.0	419.5	518.1
	206	218.6	137.0	524.3	613.1	215.1	147.8	515.8	612.0	211.2	160.5	506.4	611.1	207.7	174.6	498.1	612.2
	246	256.4	160.2	614.9	718.8	252.8	173.3	606.1	718.8	248.4	188.8	595.6	718.7	244.0	205.4	585.1	719.2
	261	265.3	168.1	636.1	745.1	261.5	181.6	627.1	745.2	257.1	197.4	616.5	745.1	253.2	214.2	607.0	746.9
	271	275.8	176.1	661.3	775.5	271.9	190.4	651.9	775.7	267.4	206.7	641.2	775.9	263.3	224.1	631.5	777.8
46.0	076	81.9	51.9	196.4	230.0	78.7	54.3	188.7	224.0	75.2	57.5	180.3	217.8	71.8	60.6	172.2	211.7
	086	90.3	58.2	216.6	254.2	86.7	61.2	208.0	247.7	83.0	64.6	199.0	241.0	79.3	68.0	190.3	234.7
	096	102.0	64.7	244.6	286.5	98.0	67.9	235.1	279.2	93.8	71.8	224.9	271.6	89.7	75.7	215.3	264.6
	106	113.2	72.1	271.6	318.3	108.7	76.2	260.8	310.3	104.0	80.8	249.5	302.1	99.2	85.3	238.0	293.6
	116	123.1	76.7	295.3	345.0	118.4	80.9	284.0	336.6	113.4	85.9	272.1	328.0	108.4	90.8	259.9	319.2
	126	133.3	83.2	319.8	373.7	128.2	87.8	307.6	364.6	122.9	93.3	294.8	355.5	117.6	98.7	282.0	346.5
	136	147.9	93.6	354.7	415.3	142.3	98.2	341.3	405.0	136.4	103.7	327.2	394.7	130.8	109.4	313.8	385.1
	146	159.2	100.8	379.4	444.6	152.1	106.3	364.9	433.9	145.7	112.5	349.6	422.7	139.7	120.7	335.1	413.8
	161	164.7	103.8	395.0	462.2	162.2	112.6	389.0	462.1	159.2	122.7	381.8	461.7	156.3	134.3	374.9	462.4
	171	174.2	110.7	417.9	489.6	171.8	119.6	412.0	489.7	169.0	130.1	405.3	490.0	166.6	141.4	399.6	491.8
	186	186.0	118.6	446.2	523.0	183.4	128.0	440.0	523.1	180.4	139.0	432.8	523.2	177.8	150.8	426.5	524.8
	206	222.5	137.1	533.8	622.7	219.0	148.1	525.4	621.7	215.1	160.5	516.0	620.6	211.3	174.4	508.9	620.7
	246	260.9	160.3	625.7	729.6	257.4	172.7	617.4	729.7	252.9	188.5	606.7	729.5	248.5	205.1	596.0	729.9
	261	269.8	168.5	647.2	756.4	266.3	181.2	638.7	756.5	261.8	197.2	627.9	756.3	257.7	214.3	618.0	757.9
	271	280.5	176.4	672.8	787.0	276.8	189.9	663.8	787.2	272.1	206.3	652.7	787.0	268.0	224.1	642.8	789.0
48.0	076	85.5	52.6	205.2	239.2	82.2	55.0	197.4	233.0	78.7	58.1	188.9	226.6	75.1	61.2	180.3	220.2
	086	94.2	59.1	226.1	264.3	90.7	61.8	217.6	257.6	86.8	65.3	208.2	250.6	83.0	68.8	199.1	243.9
	096	106.4	65.6	255.4	297.8	102.5	68.5	245.9	290.3	98.1	72.5	235.5	282.6	93.9	76.5	225.2	275.1
	106	118.1	73.1	283.5	330.7	113.7	76.8	272.8	322.6	108.9	81.5	261.3	314.3	103.9	86.1	249.4	305.5
	116	128.5	77.6	308.4	358.6	123.8	81.6	297.0	350.0	118.7	86.5	284.8	341.1	113.5	91.6	272.4	332.1
	126	139.1	84.2	333.9	388.3	134.0	88.7	321.5	379.0	128.5	93.9	308.4	369.5	123.0	99.5	295.3	360.1
	136	154.3	94.9	370.3	431.6	148.8	98.9	357.1	421.2	142.7	104.6	342.5	410.5	136.8	110.4	328.2	400.2
	146	165.0	102.1	396.0	462.0	159.0	107.2	381.6	451.0	152.5	113.4	366.1	439.8	145.9	119.8	350.2	428.2
	161	170.4	104.0	408.9	476.1	168.1	112.1	403.5	476.2	165.2	122.4	396.5	476.1	162.0	133.3	388.9	475.7
	171	180.2	111.1	432.4	504.2	177.9	119.8	426.9	504.5	175.1	129.8	420.2	504.5	172.3	141.1	413.4	505.3
	186	192.3	119.0	461.6	538.4	190.0	127.5	455.9	538.6	186.9	138.6	448.6	538.7	184.0	150.5	441.6	539.7
	206	229.3	137.1	550.3	638.9	227.0	148.2	544.8	641.0	223.1	159.9	535.5	639.6	218.9	174.0	525.5	638.9
	246	269.9	160.3	647.6	751.3	266.5	172.8	639.6	751.7	262.3	187.8	629.5	751.7	257.7	204.6	618.4	751.9
	261	279.0	168.9	669.6	778.8	275.7	181.4	661.6	779.2	271.4	196.9	651.2	779.3	266.9	214.1	640.4	780.0
	271	289.9	176.7	695.8	810.0	286.5	189.4	687.6	810.4	282.0	205.8	676.8	810.6	277.5	223.6	665.9	811.7

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)



30HXC COOLING CAPACITIES (cont)

60 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
50.0	076	89.0	53.1	213.7	248.0	85.9	55.8	206.1	242.3	82.3	58.5	197.7	235.7	78.6	61.8	188.8	229.0
	086	98.2	59.9	235.8	274.3	94.6	62.7	227.2	267.8	90.7	65.9	217.9	260.6	86.7	69.5	208.3	253.5
	096	110.9	66.3	266.2	309.0	106.9	69.6	256.7	301.8	102.6	73.1	246.4	293.9	98.1	77.2	235.5	285.8
	106	123.1	73.8	295.6	343.2	118.6	77.7	284.9	335.2	113.8	82.1	273.4	326.6	108.8	86.9	261.2	317.8
	116	133.7	78.2	320.9	371.4	129.2	82.6	310.2	363.6	124.1	87.0	298.0	354.6	118.8	92.3	285.2	345.4
	126	144.6	84.8	347.2	401.9	139.9	89.5	335.8	393.8	134.4	94.5	322.7	384.1	128.7	100.3	309.0	374.3
	136	160.9	96.0	386.4	448.3	155.3	100.5	372.8	437.9	149.2	105.5	358.4	426.9	142.9	111.4	343.2	415.7
	146	171.9	103.2	412.8	479.3	166.0	108.3	398.5	468.6	159.5	114.3	383.0	457.2	152.6	120.9	366.5	445.1
	161	176.2	104.0	423.0	490.1	174.0	112.4	417.7	490.5	171.3	122.0	411.2	490.4	168.0	133.0	403.5	490.0
	171	185.5	111.1	445.4	517.0	184.1	119.7	442.0	519.4	181.4	129.5	435.5	519.6	178.4	140.9	428.3	520.0
	186	198.6	119.0	476.9	553.6	196.4	127.9	471.7	554.4	193.6	138.3	464.9	554.7	190.4	150.2	457.2	555.0
	206	236.1	136.8	566.9	655.1	235.1	148.2	564.5	660.5	231.3	160.2	555.4	659.5	227.1	173.7	545.2	658.4
	246	277.4	159.4	666.0	768.9	275.6	173.3	661.8	774.1	271.8	186.9	652.7	774.2	267.1	204.0	641.2	774.2
	261	287.1	168.4	689.4	798.1	285.0	182.1	684.3	802.2	281.1	196.1	675.0	802.4	276.3	213.5	663.3	802.4
	271	298.9	176.3	717.6	831.3	296.1	190.2	711.0	834.2	292.1	205.1	701.2	834.5	287.1	223.0	689.3	834.5
55.0	076	93.0	53.6	223.4	257.8	90.6	56.8	217.7	254.3	87.0	59.4	209.2	247.6	83.2	62.6	200.0	240.7
	086	103.7	60.7	249.3	288.2	100.8	64.1	242.3	283.6	96.9	66.9	233.0	276.3	92.8	70.6	223.0	268.7
	096	116.8	67.0	280.6	323.6	113.9	71.1	273.9	319.6	109.6	74.3	263.4	311.5	103.6	78.1	249.0	299.7
	106	130.0	74.5	312.5	360.2	126.4	79.2	303.7	354.7	121.6	83.1	292.2	345.9	116.4	88.1	279.7	336.9
	116	141.9	78.8	341.0	391.5	138.8	84.2	333.6	387.9	133.6	88.6	321.2	378.5	128.2	93.5	308.0	368.8
	126	154.8	85.6	372.2	427.1	151.6	91.6	364.4	423.4	144.4	96.1	347.1	409.4	138.5	101.7	332.9	398.9
	136	170.5	97.0	409.8	472.1	166.8	102.8	400.9	467.1	160.7	107.5	386.2	455.8	154.2	113.1	370.7	444.2
	146	184.3	104.3	443.0	509.9	179.9	110.9	432.5	503.9	173.4	116.2	416.8	492.0	164.5	122.5	395.3	474.8
	161	184.2	102.8	442.8	508.8	184.3	112.7	442.9	515.5	181.9	121.6	437.1	515.8	178.8	132.5	429.8	515.8
	171	194.5	110.2	467.5	538.2	194.7	120.1	468.1	545.5	192.6	129.3	463.0	546.7	189.6	140.2	455.8	546.9
	186	206.4	118.0	496.0	571.7	206.3	128.3	495.9	578.5	203.8	137.7	489.9	579.0	200.6	149.7	482.2	579.3
	206	245.4	135.7	589.8	676.9	245.6	148.4	590.2	685.9	243.0	160.1	584.1	687.8	238.9	173.0	574.1	686.5
	246	287.8	157.2	691.7	792.6	289.1	172.9	694.9	806.5	286.1	187.1	687.6	808.8	281.7	202.8	677.1	809.0
	261	297.7	166.5	715.6	822.4	299.4	182.3	719.6	837.1	295.8	196.4	710.8	838.0	291.3	212.6	700.2	838.3
	271	309.7	174.4	744.4	856.3	310.9	190.5	747.3	870.1	307.2	204.9	738.4	871.0	302.6	222.1	727.2	871.5
60.0	076	93.0	53.6	223.8	258.0	90.7	56.8	218.2	254.6	87.1	59.4	209.6	247.8	83.3	62.6	200.4	240.9
	086	103.8	60.7	249.8	288.5	100.9	64.1	242.8	283.9	97.0	66.9	233.4	276.5	92.9	70.6	223.4	269.0
	096	116.9	67.0	281.1	323.9	112.7	70.8	271.1	316.5	108.4	74.0	260.7	308.3	103.7	78.1	249.5	300.0
	106	130.1	74.5	313.0	360.5	126.5	79.2	304.4	355.1	121.7	83.1	292.7	346.3	115.6	87.9	278.0	334.8
	116	142.0	78.8	341.6	391.9	139.0	84.3	334.3	388.3	132.1	88.3	317.9	374.7	126.7	93.4	304.7	365.1
	126	153.6	85.6	369.5	424.1	150.2	91.5	361.2	419.9	144.6	96.2	347.9	409.8	138.7	101.7	333.6	399.4
	136	170.7	97.0	410.6	472.5	167.0	102.8	401.7	467.6	160.9	107.5	387.1	456.3	152.5	112.8	366.8	439.7
	146	184.5	104.3	443.8	510.4	178.1	110.5	428.5	499.4	171.7	115.7	413.0	487.6	164.7	122.5	396.1	475.3
	161	183.1	103.0	440.6	506.3	182.8	112.6	439.7	512.0	180.4	121.4	433.9	512.1	177.3	132.6	426.5	512.2
	171	193.5	110.4	465.6	536.0	193.7	120.2	466.0	543.1	191.3	129.2	460.3	543.5	188.3	140.3	452.9	543.7
	186	206.5	118.0	496.8	572.0	206.5	128.3	496.7	579.0	204.0	137.7	490.8	579.5	200.8	149.7	483.0	579.8
	206	245.6	135.7	590.7	677.3	245.7	148.4	591.1	686.3	243.2	160.1	585.1	688.3	239.0	173.0	575.0	687.0
	246	288.0	157.1	692.7	793.0	289.3	172.9	696.0	806.9	286.3	187.1	688.8	809.4	278.8	203.1	670.7	802.1
	261	297.9	166.5	716.6	822.8	299.6	182.3	720.6	837.5	296.0	196.4	712.1	838.6	291.6	212.5	701.4	838.9
	271	309.9	174.4	745.5	856.8	311.2	190.5	748.6	870.7	307.5	204.9	739.7	871.7	302.9	222.0	728.5	872.1

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



30HXC COOLING CAPACITIES (cont) 60 Hz, SI

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)												
		25				30				35				
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	
4.0	076	253.3	48.2	10.9	12.8	234.3	53.2	10.1	12.2	219.0	58.9	9.4	11.8	
	086	279.3	54.2	12.0	14.2	258.8	59.8	11.1	13.6	242.8	66.3	10.4	13.1	
	096	315.5	60.1	13.5	16.0	292.4	66.5	12.5	15.3	274.3	73.8	11.8	14.8	
	106	350.4	67.5	15.0	17.8	323.9	74.8	13.9	17.0	304.3	83.6	13.1	16.5	
	116	380.9	71.7	16.3	19.3	352.8	79.7	15.1	18.4	330.6	88.9	14.2	17.9	
	126	412.5	77.8	17.7	20.9	382.6	86.7	16.4	20.0	359.0	96.8	15.4	19.4	
	136	457.2	87.4	19.6	23.2	425.0	96.5	18.2	22.2	400.3	107.0	17.2	21.6	
	146	489.2	94.6	21.0	24.9	454.2	104.7	19.5	23.8	428.3	116.7	18.4	23.2	
	161	516.5	99.2	22.2	26.2	500.1	115.5	21.5	26.2	494.5	135.8	21.2	26.8	
	171	547.2	105.5	23.5	27.8	532.8	122.4	22.9	27.9	526.6	142.9	22.6	28.5	
	186	584.8	113.6	25.1	29.8	569.1	131.4	24.4	29.8	563.8	153.4	24.2	30.5	
	206	697.8	130.3	29.9	35.3	676.3	150.8	29.0	35.2	663.7	175.8	28.5	35.7	
	246	819.9	152.7	35.2	41.5	795.2	178.2	34.1	41.5	782.7	208.6	33.6	42.2	
	261	848.6	160.3	36.4	43.0	824.6	186.1	35.4	43.0	814.2	217.4	34.9	43.9	
	271	882.7	168.4	37.9	44.8	858.2	195.3	36.8	44.9	848.5	228.0	36.4	45.8	
	5.0	076	264.0	48.6	11.3	13.3	244.2	53.7	10.5	12.7	227.2	59.3	9.8	12.2
		086	291.1	54.7	12.5	14.7	269.7	60.4	11.6	14.1	251.8	66.7	10.8	13.6
096		328.8	60.6	14.1	16.6	304.8	67.1	13.1	15.8	284.5	74.3	12.2	15.3	
106		365.2	67.9	15.7	18.5	337.9	75.5	14.5	17.6	315.4	84.1	13.5	17.0	
116		396.9	72.2	17.0	20.0	368.2	80.4	15.8	19.1	342.8	89.4	14.7	18.4	
126		429.7	78.5	18.4	21.7	399.0	87.3	17.1	20.7	372.1	97.3	16.0	20.0	
136		476.5	88.0	20.5	24.1	442.8	97.2	19.0	23.0	415.1	107.6	17.8	22.3	
146		509.7	95.3	21.9	25.8	472.9	105.4	20.3	24.6	443.9	117.3	19.1	23.9	
161		534.4	98.8	22.9	27.0	517.4	115.3	22.2	27.0	508.5	135.2	21.8	27.4	
171		565.5	105.2	24.3	28.6	549.8	121.8	23.6	28.6	541.4	142.1	23.2	29.1	
186		604.6	113.2	26.0	30.6	587.8	131.1	25.2	30.6	579.4	152.8	24.9	31.2	
206		721.6	130.2	31.0	36.3	699.3	150.2	30.0	36.2	683.0	174.9	29.3	36.5	
246		847.2	152.7	36.4	42.6	822.6	177.7	35.3	42.6	804.8	207.6	34.5	43.1	
261		877.0	159.8	37.6	44.2	852.1	185.4	36.6	44.2	836.9	216.1	35.9	44.8	
271		912.2	167.9	39.2	46.0	886.5	194.8	38.1	46.1	872.0	226.9	37.4	46.8	
6.0		076	274.8	49.3	11.8	13.8	254.6	54.2	10.9	13.2	235.6	59.7	10.1	12.6
		086	303.0	55.3	13.0	15.3	281.0	60.9	12.1	14.6	261.1	67.2	11.2	14.0
	096	342.1	61.5	14.7	17.2	317.5	67.7	13.6	16.4	295.0	74.8	12.7	15.8	
	106	380.0	68.6	16.3	19.1	352.4	76.2	15.1	18.3	326.9	86.5	14.0	17.6	
	116	413.0	73.0	17.7	20.7	383.9	81.0	16.5	19.8	355.4	90.5	15.3	19.0	
	126	447.2	79.1	19.2	22.4	415.9	88.0	17.9	21.5	385.7	98.2	16.6	20.6	
	136	495.8	89.2	21.3	24.9	461.3	98.0	19.8	23.8	430.3	108.1	18.5	22.9	
	146	530.4	96.2	22.8	26.7	493.0	106.3	21.2	25.5	460.1	117.8	19.8	24.6	
	161	551.9	98.9	23.7	27.8	535.3	115.1	23.0	27.7	522.7	134.7	22.5	28.0	
	171	584.0	105.3	25.1	29.4	568.2	121.7	24.4	29.4	556.5	141.7	23.9	29.7	
	186	624.0	113.3	26.8	31.4	607.0	130.8	26.1	31.4	595.3	152.0	25.6	31.8	
	206	745.8	130.4	32.0	37.4	723.5	150.2	31.1	37.3	703.4	174.7	30.2	37.4	
	246	874.5	153.0	37.6	43.8	850.6	177.1	36.5	43.8	827.4	207.0	35.5	44.1	
	261	904.8	160.3	38.9	45.4	880.4	184.9	37.8	45.4	860.1	215.0	36.9	45.8	
	271	940.9	168.5	40.4	47.3	915.5	194.2	39.3	47.3	895.9	225.6	38.5	47.8	

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)



30HXC COOLING CAPACITIES (cont)
60 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)											
		25				30				35			
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)
7.0	076	285.8	50.0	12.3	14.3	265.5	54.7	11.4	13.7	244.7	60.1	10.5	13.0
	086	315.0	56.1	13.5	15.8	292.7	61.5	12.6	15.1	270.7	67.6	11.6	14.4
	096	355.7	62.3	15.3	17.8	330.9	68.3	14.2	17.0	305.9	75.2	13.1	16.2
	106	395.0	69.4	17.0	19.8	367.3	76.8	15.8	18.9	338.8	86.9	14.6	18.1
	116	429.4	73.8	18.5	21.5	400.0	81.5	17.2	20.5	369.2	90.3	15.9	19.6
	126	465.0	80.0	20.0	23.3	433.2	88.5	18.6	22.2	400.9	98.3	17.2	21.3
	136	515.5	90.3	22.2	25.8	480.7	98.8	20.7	24.7	446.1	108.7	19.2	23.6
	146	551.5	97.2	23.7	27.7	514.0	107.1	22.1	26.5	477.0	120.3	20.5	25.4
	161	569.5	99.1	24.5	28.5	553.9	114.9	23.8	28.5	537.3	136.0	23.1	28.7
	171	602.5	105.7	25.9	30.2	587.0	121.7	25.2	30.2	572.7	141.5	24.6	30.4
	186	643.4	113.6	27.7	32.3	627.0	130.5	26.9	32.3	611.5	151.2	26.3	32.5
	206	767.9	130.7	33.0	38.3	748.2	150.1	32.2	38.3	725.6	174.6	31.2	38.4
	246	902.1	153.1	38.8	45.0	879.4	176.5	37.8	45.0	852.2	205.5	36.6	45.1
	261	933.1	160.9	40.1	46.7	910.0	184.8	39.1	46.7	884.3	214.3	38.0	46.8
	271	970.1	168.8	41.7	48.6	946.0	193.8	40.7	48.6	920.3	224.4	39.6	48.8
	8.0	076	297.0	50.5	12.8	14.8	276.7	55.1	11.9	14.2	254.9	60.7	11.0
086		327.4	56.9	14.1	16.4	305.0	62.0	13.1	15.7	281.6	68.2	12.1	14.9
096		369.8	63.0	15.9	18.5	344.8	68.8	14.8	17.6	318.5	75.9	13.7	16.8
106		410.5	70.2	17.7	20.5	382.6	77.3	16.5	19.6	352.2	85.5	15.1	18.7
116		446.2	74.5	19.2	22.2	416.7	82.0	17.9	21.3	384.6	90.9	16.5	20.3
126		482.7	80.8	20.8	24.0	451.2	89.0	19.4	23.1	417.2	98.9	17.9	22.0
136		535.7	91.4	23.0	26.8	500.7	99.4	21.5	25.6	464.2	109.6	20.0	24.5
146		573.0	98.2	24.6	28.6	535.4	107.7	23.0	27.4	495.5	120.4	21.3	26.3
161		587.4	99.2	25.3	29.3	572.5	114.5	24.6	29.3	553.3	133.5	23.8	29.3
171		620.0	106.1	26.7	31.0	606.4	121.7	26.1	31.1	589.7	141.4	25.4	31.2
186		663.1	113.8	28.5	33.1	647.6	130.1	27.8	33.2	629.4	150.7	27.1	33.3
206		788.8	130.7	33.9	39.2	773.3	150.4	33.3	39.4	748.2	174.3	32.2	39.3
246		927.6	152.7	39.9	46.1	908.8	175.7	39.1	46.3	880.2	205.0	37.8	46.3
261		961.0	161.1	41.3	47.9	940.1	184.3	40.4	48.0	912.6	214.3	39.2	48.1
271		999.8	168.9	43.0	49.9	977.1	193.0	42.0	49.9	949.1	224.0	40.8	50.0
9.0		076	307.1	50.9	13.2	15.3	288.1	55.6	12.4	14.7	265.4	61.3	11.4
	086	339.3	57.5	14.6	16.9	317.5	62.5	13.7	16.2	293.1	68.9	12.6	15.4
	096	382.7	63.6	16.5	19.0	358.9	69.3	15.4	18.3	331.5	76.6	14.3	17.4
	106	425.6	70.8	18.3	21.2	398.2	77.7	17.1	20.3	367.1	86.2	15.8	19.3
	116	461.5	74.9	19.9	22.9	433.7	82.6	18.7	22.0	401.0	91.7	17.3	21.0
	126	499.3	81.2	21.5	24.8	469.5	89.7	20.2	23.9	434.6	99.6	18.7	22.8
	136	554.9	92.1	23.9	27.6	521.4	100.0	22.4	26.5	483.1	110.5	20.8	25.3
	146	593.6	99.0	25.5	29.6	557.2	108.4	24.0	28.4	515.4	119.9	22.2	27.1
	161	604.3	99.0	26.0	30.0	591.4	114.0	25.4	30.1	571.9	133.3	24.6	30.1
	171	636.5	105.9	27.4	31.7	625.9	121.6	26.9	31.9	607.9	141.1	26.2	31.9
	186	681.5	113.6	29.3	33.9	668.5	129.6	28.8	34.1	649.4	150.5	27.9	34.1
	206	810.0	130.3	34.8	40.1	798.6	150.5	34.4	40.5	772.8	174.0	33.2	40.4
	246	950.1	151.7	40.9	47.0	937.9	175.5	40.3	47.5	909.5	204.6	39.1	47.5
	261	983.6	160.4	42.3	48.8	970.2	184.0	41.7	49.3	941.7	214.0	40.5	49.3
	271	1023.9	168.1	44.1	50.9	1008.4	192.0	43.4	51.2	979.1	223.6	42.1	51.3

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)

Performance data (cont)



30HXC COOLING CAPACITIES (cont) 60 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)											
		25				30				35			
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)
10.0	076	316.8	51.2	13.6	15.7	299.5	56.3	12.9	15.2	276.5	61.8	11.9	14.4
	086	350.6	57.9	15.1	17.4	330.2	63.2	14.2	16.8	305.0	69.5	13.1	16.0
	096	394.6	63.9	17.0	19.6	373.1	70.2	16.1	18.9	345.0	77.2	14.8	18.0
	106	439.6	71.1	18.9	21.8	414.1	78.4	17.8	21.0	382.5	87.0	16.5	20.0
	116	476.2	75.1	20.5	23.5	450.9	83.4	19.4	22.8	417.7	92.3	18.0	21.8
	126	515.7	81.5	22.2	25.5	488.1	90.5	21.0	24.7	452.5	100.4	19.5	23.6
	136	572.0	92.6	24.6	28.4	541.9	101.3	23.3	27.5	502.6	111.4	21.6	26.2
	146	613.8	99.6	26.4	30.5	579.2	109.5	24.9	29.4	536.8	120.9	23.1	28.1
	161	618.4	98.4	26.6	30.6	610.2	114.0	26.3	30.9	590.9	133.0	25.4	30.9
	171	652.7	105.5	28.1	32.4	645.5	121.6	27.8	32.7	627.4	140.9	27.0	32.8
	186	697.0	113.0	30.0	34.6	689.2	129.6	29.7	35.0	669.6	150.2	28.8	35.0
	206	830.5	129.5	35.7	41.0	824.3	150.5	35.5	41.6	798.6	173.7	34.4	41.5
	246	971.5	150.3	41.8	47.9	966.9	175.9	41.6	48.8	939.2	204.0	40.4	48.8
	261	1005.3	159.3	43.3	49.7	999.8	184.7	43.0	50.6	971.6	213.5	41.8	50.6
	271	1046.2	166.9	45.0	51.8	1038.9	192.9	44.7	52.6	1009.6	223.0	43.5	52.6
	13.0	076	333.2	51.5	14.4	16.4	318.8	57.5	13.7	16.1	295.3	62.7	12.7
086		371.6	58.5	16.0	18.4	351.4	64.7	15.1	17.8	322.0	70.4	13.9	16.7
096		414.1	64.3	17.8	20.4	396.1	71.7	17.1	20.0	367.5	78.3	15.8	19.0
106		462.7	71.3	19.9	22.8	441.4	80.0	19.0	22.3	404.1	87.9	17.4	21.0
116		503.0	75.3	21.7	24.7	482.5	85.1	20.8	24.3	444.8	93.3	19.2	23.0
126		549.3	81.8	23.7	27.0	523.1	92.4	22.5	26.3	486.7	101.6	21.0	25.1
136		604.3	93.2	26.0	29.8	580.0	103.7	25.0	29.2	540.2	113.0	23.3	27.9
146		653.5	99.9	28.2	32.2	626.2	111.9	27.0	31.5	577.9	122.5	24.9	29.9
161		644.6	96.7	27.8	31.7	644.8	114.5	27.8	32.4	627.2	132.5	27.0	32.4
171		680.9	104.1	29.3	33.5	683.3	122.1	29.4	34.4	666.1	140.3	28.7	34.4
186		721.9	111.6	31.1	35.6	722.7	130.3	31.1	36.4	704.3	149.7	30.3	36.5
206		867.6	128.6	37.4	42.6	868.0	150.8	37.4	43.5	840.0	173.0	36.2	43.3
246		1005.8	148.1	43.3	49.3	1012.4	176.1	43.6	50.8	986.6	203.0	42.5	50.8
261		1035.5	157.4	44.6	51.0	1040.5	185.1	44.8	52.4	1014.1	212.8	43.7	52.4
271		1085.7	164.3	46.8	53.4	1092.2	193.4	47.1	54.9	1065.4	222.0	45.9	55.0
16.0		076	330.1	51.4	14.2	16.3	315.2	57.3	13.6	15.9	291.7	62.6	12.6
	086	368.2	58.4	15.9	18.2	350.8	64.6	15.1	17.7	325.2	70.5	14.0	16.9
	096	414.4	64.3	17.9	20.4	396.5	71.7	17.1	20.0	363.2	78.1	15.7	18.8
	106	461.4	71.3	19.9	22.8	439.8	79.9	19.0	22.2	408.0	88.0	17.6	21.2
	116	503.5	75.2	21.7	24.7	483.2	85.1	20.8	24.3	449.3	93.5	19.4	23.2
	126	549.5	81.7	23.7	27.0	522.1	92.4	22.5	26.3	485.7	101.6	20.9	25.1
	136	604.9	93.2	26.1	29.8	580.7	103.7	25.0	29.2	540.9	113.0	23.3	27.9
	146	653.8	100.0	28.2	32.2	626.6	111.9	27.0	31.5	576.7	122.4	24.9	29.9
	161	644.7	96.7	27.8	31.7	645.0	114.5	27.8	32.4	627.4	132.5	27.1	32.5
	171	680.8	104.2	29.4	33.5	682.8	122.0	29.4	34.4	665.5	140.3	28.7	34.4
	186	725.8	111.4	31.3	35.8	728.0	130.3	31.4	36.7	703.9	149.7	30.4	36.5
	206	861.0	128.7	37.1	42.3	861.3	150.9	37.1	43.2	837.8	173.1	36.1	43.2
	246	1007.7	148.2	43.5	49.4	1014.1	176.0	43.7	50.9	988.3	202.9	42.6	50.9
	261	1041.2	157.0	44.9	51.2	1048.1	185.2	45.2	52.7	1022.1	212.6	44.1	52.7
	271	1083.0	164.5	46.7	53.3	1088.6	193.4	46.9	54.8	1061.6	222.1	45.8	54.8

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)



30HXC COOLING CAPACITIES (cont)

50 Hz, ENGLISH

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
40.0	076	70.1	48.8	167.8	199.6	67.1	51.6	160.6	194.3	64.3	54.5	153.8	189.5	62.0	57.8	148.4	186.3
	086	78.5	55.9	187.9	224.4	75.5	59.2	180.7	219.3	72.5	62.6	173.6	214.5	70.0	66.3	167.6	211.0
	096	89.4	62.7	214.1	255.0	86.1	66.7	206.2	249.8	82.9	70.6	198.4	244.5	80.0	74.9	191.6	240.6
	106	98.1	69.4	234.8	280.0	93.8	73.6	224.6	272.6	90.1	78.0	215.8	266.8	87.4	83.3	209.3	263.8
	116	107.8	74.6	258.1	306.8	103.6	79.4	247.9	299.8	99.2	84.0	237.5	292.4	96.1	89.6	230.0	288.7
	126	117.7	81.9	281.7	335.1	113.1	87.2	270.7	327.6	108.5	92.4	259.7	320.1	105.0	98.4	251.3	315.7
	136	130.4	91.5	312.2	371.8	125.5	96.9	300.5	363.7	120.8	102.3	289.3	356.2	117.0	108.5	280.1	351.2
	146	138.1	98.0	330.6	394.5	132.3	103.5	316.8	384.4	127.7	109.8	305.6	377.4	124.0	117.0	296.8	373.4
	161	147.7	104.3	353.6	421.5	145.0	113.4	347.1	421.1	143.2	123.7	342.8	423.6	142.5	135.5	341.1	429.7
	171	156.0	110.4	373.3	445.3	153.5	119.8	367.5	445.7	151.9	130.3	363.7	448.9	151.2	142.1	361.9	454.9
	186	167.2	119.2	400.1	477.8	164.6	129.2	394.1	478.4	162.9	140.3	390.1	481.8	162.3	153.1	388.5	488.7
	206	199.4	136.3	477.4	566.4	196.1	148.4	469.4	566.3	193.5	161.6	463.3	569.0	191.9	176.1	459.4	574.8
	246	234.4	160.7	561.2	666.1	230.4	174.9	551.7	666.0	226.7	190.1	542.8	667.2	225.5	208.1	539.7	676.1
	261	242.1	168.0	579.6	689.2	238.2	182.4	570.2	689.4	235.0	197.9	562.5	691.9	233.9	216.2	560.0	701.7
271	252.3	176.9	603.9	719.2	248.3	191.9	594.5	719.8	245.2	208.3	587.1	723.3	244.2	227.5	584.6	733.6	
42.0	076	73.4	49.2	175.9	208.0	70.3	52.1	168.3	202.3	67.2	55.0	161.0	197.0	64.6	58.2	154.7	192.8
	086	82.0	56.3	196.5	233.0	78.9	59.8	189.0	228.0	75.7	63.2	181.4	222.6	73.0	66.9	174.8	218.5
	096	93.4	63.0	223.7	264.7	90.1	67.2	215.7	259.5	86.5	71.2	207.3	253.7	83.4	75.5	199.8	249.1
	106	102.7	69.9	246.0	291.5	98.3	74.2	235.6	283.9	93.9	78.4	225.0	276.1	90.9	84.4	217.7	272.9
	116	112.7	75.0	269.9	318.7	108.4	80.0	259.7	311.9	103.9	84.8	248.8	304.2	99.9	90.6	239.4	298.7
	126	122.9	82.2	294.5	348.0	118.3	87.8	283.5	340.7	113.5	93.2	271.9	332.7	109.2	99.5	261.6	326.6
	136	136.3	92.0	326.4	386.3	131.3	97.6	314.4	378.1	126.2	103.1	302.3	369.7	121.8	109.2	291.9	363.3
	146	144.6	98.7	346.5	410.6	138.7	104.4	332.2	400.2	133.1	110.4	318.9	391.0	128.9	117.5	308.8	385.6
	161	153.4	103.9	367.4	435.0	150.6	113.2	360.8	434.5	148.0	123.0	354.4	434.7	146.9	134.8	352.0	440.1
	171	161.9	110.2	387.8	459.4	159.3	119.6	381.6	459.5	157.1	129.9	376.4	461.2	155.9	141.6	373.4	465.9
	186	173.5	118.8	415.5	492.7	170.7	128.8	408.8	492.7	168.2	139.5	403.0	494.0	167.3	152.3	400.7	500.3
	206	206.9	136.6	495.7	584.6	203.6	148.1	487.7	584.3	200.3	160.9	479.9	585.1	198.0	175.3	474.3	589.0
	246	243.4	159.9	583.1	687.2	239.2	174.3	573.1	686.8	235.1	189.4	563.2	687.0	232.6	207.3	557.3	692.9
	261	251.3	167.4	602.0	710.9	247.1	181.9	591.9	710.5	243.3	197.3	582.8	711.7	241.2	215.1	577.8	718.5
271	261.8	176.1	627.1	741.7	257.4	191.2	616.7	741.3	253.6	207.2	607.5	742.8	251.7	226.1	603.0	750.9	
44.0	076	76.8	49.9	184.2	216.5	73.6	52.6	176.5	210.7	70.4	55.6	168.7	204.9	67.3	58.6	161.3	199.6
	086	85.6	56.6	205.1	241.8	82.5	60.2	197.7	236.8	79.2	63.7	189.8	231.3	76.0	67.3	182.1	226.0
	096	97.4	63.5	233.6	274.8	94.0	67.6	225.3	269.3	90.4	71.8	216.7	263.6	86.8	75.9	208.2	257.7
	106	107.4	70.5	257.5	303.2	103.0	74.8	246.9	295.6	98.4	79.2	235.9	287.5	94.4	86.5	226.3	282.6
	116	117.6	75.5	281.9	330.9	113.3	80.4	271.7	324.0	108.8	85.5	260.7	316.4	104.0	90.4	249.4	308.5
	126	128.2	82.9	307.4	361.2	123.7	88.3	296.6	354.0	118.7	93.9	284.6	345.8	113.8	99.4	272.8	337.7
	136	142.3	92.5	341.0	401.1	137.2	98.3	328.8	392.8	131.9	104.0	316.2	384.0	126.8	109.8	304.1	375.8
	146	151.2	99.5	362.5	427.1	145.2	105.3	348.2	416.6	139.0	111.2	333.3	405.7	134.0	119.1	321.2	398.9
	161	159.1	103.5	381.4	448.6	156.4	113.0	375.0	448.4	153.5	122.9	367.9	448.0	151.9	136.4	364.1	453.1
	171	167.8	110.3	402.1	473.7	165.2	119.4	396.0	473.6	162.5	129.5	389.6	474.0	160.8	140.9	385.4	477.4
	186	179.8	118.4	431.0	507.8	176.9	128.5	424.2	507.7	174.2	139.3	417.6	508.4	172.3	151.4	413.1	512.0
	206	214.5	136.7	514.1	602.9	211.2	147.5	506.4	602.4	207.6	160.5	497.7	602.4	204.8	174.8	490.9	605.2
	246	252.2	159.9	604.5	708.4	248.3	173.7	595.2	703.3	244.0	189.1	584.9	708.2	239.9	205.6	575.1	709.5
	261	260.3	167.5	624.0	732.7	256.4	181.5	614.5	732.7	252.1	197.1	604.4	732.9	248.6	213.8	595.9	735.6
271	271.2	175.8	650.0	764.2	267.0	190.8	640.0	764.2	262.7	207.0	629.9	764.8	259.4	224.8	621.7	768.5	

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



30HXC COOLING CAPACITIES (cont) 50 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
45.0	076	78.5	50.3	188.3	220.9	75.3	52.8	180.7	215.0	72.0	55.8	172.6	209.0	68.8	58.9	164.9	203.4
	086	87.4	56.8	209.5	246.3	84.2	60.3	202.0	241.2	80.9	64.0	194.1	235.7	77.6	67.5	186.1	230.1
	096	99.5	64.0	238.6	280.0	96.0	67.8	230.2	274.3	92.4	72.1	221.6	268.6	88.7	76.2	212.6	262.3
	106	109.8	70.8	263.3	309.2	105.3	75.1	252.6	301.4	100.7	79.6	241.5	293.3	96.3	85.7	230.9	286.7
	116	120.1	75.8	288.0	337.1	115.8	80.5	277.8	330.1	111.3	85.7	266.8	322.7	106.4	90.7	255.2	314.4
	126	131.0	83.1	314.0	367.9	126.4	88.5	303.1	360.7	121.4	94.2	291.2	352.6	116.4	99.8	279.0	344.2
	136	145.3	93.2	348.4	408.8	140.2	98.6	336.2	400.2	134.8	104.4	323.4	391.4	129.6	110.3	310.7	382.7
	146	154.6	100.0	370.7	435.5	148.6	105.6	356.3	424.9	142.3	111.7	341.1	413.8	136.8	120.4	327.9	406.5
	161	161.9	103.6	388.3	455.5	159.3	112.8	382.1	455.4	156.4	122.8	375.0	454.9	154.3	136.2	369.9	458.7
	171	170.7	110.3	409.4	480.9	168.2	119.2	403.4	480.8	165.5	129.4	396.8	481.1	163.4	140.7	391.9	483.7
	186	182.9	118.4	438.6	515.3	180.2	128.3	432.0	515.4	177.3	139.2	425.2	515.8	175.0	151.0	419.5	518.1
	206	218.3	136.6	523.5	612.1	215.1	147.6	515.8	611.8	211.5	160.4	507.1	611.7	208.3	174.6	499.5	613.5
	246	256.6	160.1	615.2	719.1	252.9	173.2	606.4	719.1	248.5	188.8	595.9	718.9	244.1	205.3	585.4	719.5
	261	264.8	167.8	635.0	743.8	261.1	181.1	626.0	743.8	256.6	196.8	615.4	743.6	252.7	213.5	606.0	745.4
	271	275.8	176.1	661.3	775.5	271.9	190.4	651.9	775.7	267.4	206.7	641.2	775.8	263.3	224.1	631.5	777.8
	46.0	076	80.3	50.6	192.5	225.3	77.1	53.0	184.9	219.4	73.7	56.1	176.7	213.3	70.4	59.2	168.8
086		89.2	57.2	214.0	251.0	86.1	60.5	206.5	245.7	82.7	64.2	198.5	240.2	79.3	67.8	190.2	234.4
096		101.6	64.4	243.6	285.3	98.1	67.9	235.3	279.3	94.4	72.4	226.5	273.6	90.6	76.6	217.4	267.3
106		112.2	71.3	269.1	315.3	107.8	75.4	258.5	307.4	103.1	79.9	247.2	299.2	98.3	84.4	235.8	290.8
116		122.6	76.2	294.2	343.5	118.4	80.6	283.9	336.3	113.8	86.0	272.9	328.9	108.9	91.0	261.1	320.5
126		133.7	83.5	320.7	374.8	129.1	88.6	309.7	367.3	124.2	94.5	297.8	359.3	119.0	100.2	285.3	350.7
136		148.3	93.8	355.8	416.6	143.3	98.8	343.6	407.8	137.8	104.8	330.6	398.9	132.4	110.7	317.6	389.8
146		158.0	100.5	378.9	443.9	152.0	106.0	364.5	433.3	145.6	112.1	349.2	422.1	139.6	120.4	334.9	413.3
161		164.8	103.8	395.2	462.4	162.3	112.5	389.3	462.3	159.3	122.6	382.1	461.9	156.6	134.6	375.7	463.4
171		173.7	110.3	416.7	488.1	171.3	119.0	410.8	488.1	168.5	129.4	404.2	488.3	166.1	140.5	398.5	490.1
186		186.0	118.6	446.2	523.0	183.4	128.0	440.0	523.1	180.4	139.0	432.8	523.2	177.8	150.8	426.5	524.8
206		222.2	136.6	532.9	621.4	219.0	147.7	525.3	621.3	215.4	160.2	516.6	621.0	211.8	174.2	508.1	621.9
246		261.0	160.3	626.1	729.9	257.5	172.7	617.7	730.0	253.1	188.4	607.0	729.8	248.6	205.0	596.3	730.2
261		269.3	168.1	646.0	754.9	265.8	180.7	637.6	755.0	261.3	196.5	626.7	754.7	257.2	213.4	616.9	756.2
271		280.5	176.4	672.8	787.0	276.8	189.9	663.8	787.2	272.1	206.3	652.7	787.0	268.0	224.0	642.8	789.0
48.0		076	83.8	51.3	201.1	234.3	80.6	53.7	193.4	228.2	77.2	56.6	185.2	222.0	73.6	59.8	176.7
	086	93.0	58.0	223.1	260.5	89.8	60.8	215.4	254.8	86.4	64.7	207.4	249.4	82.8	68.4	198.8	243.4
	096	105.8	65.2	254.0	296.1	102.3	68.3	245.5	289.8	98.5	72.8	236.4	283.8	94.7	77.2	227.2	277.5
	106	117.0	72.3	280.9	327.6	112.6	76.0	270.3	319.6	107.9	80.6	258.9	311.3	103.0	85.2	247.1	302.6
	116	127.8	76.9	306.8	356.5	123.5	81.1	296.3	348.9	118.9	86.4	285.3	341.5	113.9	91.7	273.4	333.2
	126	139.3	84.3	334.4	388.9	134.6	89.3	323.1	381.0	129.7	95.1	311.3	373.1	124.4	100.9	298.6	364.3
	136	154.6	95.0	371.1	432.5	149.5	99.3	358.7	423.2	144.0	105.6	345.5	414.2	138.3	111.7	331.9	404.7
	146	164.8	101.8	395.5	461.3	158.8	106.8	381.1	450.4	152.4	113.1	365.7	439.1	145.7	119.4	349.7	427.5
	161	170.5	104.0	409.2	476.4	168.2	112.1	403.7	476.4	165.3	122.3	396.8	476.3	162.2	133.2	389.1	475.9
	171	179.7	110.6	431.2	502.7	177.4	119.1	425.7	502.9	174.6	129.0	419.0	502.8	171.8	140.1	412.2	503.5
	186	192.3	118.9	461.6	538.4	190.0	127.5	455.9	538.6	186.9	138.6	448.6	538.7	184.0	150.5	441.6	539.7
	206	228.7	136.5	548.8	637.1	226.8	147.7	544.3	640.2	223.3	159.6	535.9	639.7	219.4	173.8	526.5	639.8
	246	270.0	160.3	648.0	751.6	266.6	172.7	639.9	752.0	262.4	187.7	629.8	752.0	257.8	204.5	618.7	752.1
	261	278.5	168.4	668.4	777.3	275.2	180.7	660.4	777.6	270.9	196.1	650.0	777.6	266.4	213.1	639.2	778.2
	271	289.9	176.7	695.8	810.0	286.5	189.3	687.6	810.4	282.0	205.8	676.8	810.6	277.5	223.6	665.9	811.6

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)



30HXC COOLING CAPACITIES (cont)
50 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (F)															
		80.0				85.0				90.0				95.0			
		Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cond Flow Rate (Gpm)
50.0	076	87.2	51.9	209.3	242.8	84.1	54.5	202.0	237.3	80.7	57.1	193.8	230.9	77.1	60.3	185.0	224.3
	086	96.7	58.6	232.2	270.0	93.5	61.6	224.6	264.4	90.1	65.1	216.4	258.6	86.5	69.0	207.7	252.6
	096	110.1	65.8	264.4	306.8	106.5	69.3	255.8	300.6	102.7	73.1	246.7	294.1	98.8	77.8	237.2	287.9
	106	121.9	73.0	292.8	339.9	117.6	76.9	282.3	332.0	112.8	81.2	270.9	323.6	107.8	86.0	258.8	314.8
	116	132.8	77.4	318.9	368.9	128.7	82.0	309.0	362.1	124.1	86.7	297.9	354.3	119.1	92.4	286.0	346.2
	126	144.6	84.9	347.2	402.0	140.3	89.9	336.9	395.1	135.3	95.4	325.0	387.0	130.0	101.7	312.2	378.4
	136	161.1	95.9	386.7	448.6	155.8	100.7	374.0	439.2	150.2	106.2	360.8	429.7	144.4	112.6	346.8	420.1
	146	171.7	102.9	412.3	478.6	165.8	108.0	398.0	467.9	159.3	113.9	382.5	456.5	152.4	120.5	366.0	444.5
	161	176.3	104.0	423.3	490.3	174.1	112.3	418.0	490.7	171.4	122.0	411.5	490.7	168.2	132.9	403.7	490.3
	171	184.9	110.6	444.0	515.3	183.5	119.1	440.7	517.8	180.9	128.7	434.3	517.9	177.9	140.0	427.1	518.2
	186	198.6	119.0	476.9	553.6	196.4	127.9	471.7	554.4	193.6	138.2	464.9	554.6	190.4	150.2	457.2	554.9
	206	235.3	136.1	564.9	652.8	234.8	147.7	563.7	659.3	231.3	159.8	555.4	659.3	227.4	173.5	546.0	659.1
	246	277.5	159.4	666.4	769.3	275.8	173.2	662.2	774.4	272.0	186.8	653.0	774.5	267.2	203.9	641.5	774.4
	261	286.6	167.9	688.1	796.5	284.5	181.5	683.1	800.6	280.6	195.4	673.8	800.8	275.8	212.6	662.2	800.7
	271	298.9	176.3	717.6	831.3	296.1	190.2	711.0	834.1	292.1	205.0	701.2	834.4	287.1	222.9	689.3	834.5
	55.0	076	91.0	52.3	218.8	252.4	88.8	55.5	213.4	249.2	85.3	58.0	205.0	242.6	81.6	61.1	196.1
086		102.0	59.3	245.2	283.2	99.4	62.8	239.0	279.4	95.9	65.8	230.5	273.1	92.2	69.8	221.7	267.0
096		115.9	66.5	278.6	321.2	113.2	70.5	272.2	317.6	109.3	74.1	262.8	310.7	105.2	78.5	252.9	303.9
106		128.8	73.7	309.5	356.8	125.2	78.3	301.0	351.4	120.5	82.2	289.5	342.7	114.4	87.0	275.0	331.4
116		140.9	77.8	338.6	388.5	137.9	83.4	331.6	385.3	133.1	87.9	320.0	376.9	128.1	93.2	307.9	368.5
126		154.7	85.5	371.9	426.7	150.0	91.5	360.5	419.4	144.8	96.4	348.1	410.5	139.4	102.5	335.1	401.7
136		170.6	97.0	410.1	472.3	167.0	102.7	401.3	467.5	161.3	107.7	387.6	457.3	155.3	113.8	373.3	447.2
146		184.1	104.0	442.4	509.1	179.7	110.5	431.9	503.1	173.2	115.8	416.3	491.3	164.3	122.1	394.8	474.1
161		184.4	102.8	443.1	509.1	184.4	112.6	443.2	515.8	182.0	121.5	437.5	516.1	179.0	132.4	430.1	516.1
171		192.8	110.0	463.5	534.0	194.2	119.6	466.7	543.7	192.1	128.7	461.7	545.0	187.6	139.5	450.8	541.4
186		206.4	118.0	496.0	571.7	206.3	128.3	495.9	578.5	203.8	137.7	489.9	579.0	200.6	149.6	482.2	579.3
206		244.4	135.0	587.4	674.0	245.0	147.8	588.8	684.2	242.9	159.7	583.8	687.2	239.1	172.8	574.6	686.9
246		287.9	157.1	692.1	793.0	289.3	172.9	695.3	806.8	286.2	187.1	688.0	809.1	281.9	202.8	677.5	809.3
261		297.1	166.1	714.2	820.8	298.8	181.8	718.2	835.3	295.2	195.7	709.6	836.3	290.8	211.7	698.9	836.5
271		309.7	174.4	744.4	856.3	310.9	190.4	747.3	870.1	307.2	204.9	738.4	871.0	302.6	222.0	727.2	871.5
60.0		076	91.1	52.3	219.2	252.6	88.9	55.5	213.9	249.4	85.4	58.0	205.4	242.8	81.7	61.1	196.5
	086	102.1	59.3	245.6	283.4	99.5	62.8	239.5	279.7	96.0	65.8	231.0	273.3	92.3	69.8	222.1	267.3
	096	116.0	66.5	279.1	321.5	113.4	70.6	272.7	317.9	108.2	73.8	260.2	307.7	104.1	78.4	250.4	301.1
	106	128.9	73.7	310.1	357.1	125.4	78.3	301.5	351.8	119.7	82.0	287.9	340.7	114.6	87.0	275.6	331.8
	116	141.0	77.8	339.2	388.9	138.1	83.4	332.3	385.7	131.6	87.6	316.7	373.1	126.6	93.1	304.6	364.8
	126	153.5	85.5	369.2	423.8	150.2	91.5	361.2	419.9	145.0	96.5	348.8	410.9	139.6	102.6	335.8	402.1
	136	170.8	97.0	410.9	472.8	167.2	102.8	402.1	468.0	161.5	107.8	388.4	457.8	153.5	113.6	369.4	442.8
	146	184.2	104.0	443.2	509.6	177.9	110.2	428.0	498.6	171.5	115.4	412.4	486.8	164.5	122.1	395.6	474.6
	161	183.3	102.9	440.9	506.6	182.9	112.6	440.1	512.3	180.5	121.3	434.3	512.4	177.4	132.5	426.8	512.5
	171	193.0	110.0	464.2	534.4	193.2	119.7	464.7	541.4	190.8	128.6	459.0	541.8	187.8	139.5	451.7	541.9
	186	206.5	118.0	496.8	572.0	206.5	128.3	496.7	579.0	204.0	137.7	490.8	579.5	200.8	149.6	483.0	579.8
	206	244.5	134.9	588.2	674.3	245.1	147.8	589.7	684.5	243.1	159.7	584.7	687.6	239.2	172.7	575.5	687.3
	246	288.1	157.1	693.1	793.4	289.5	172.9	696.3	807.3	286.5	187.1	689.1	809.7	279.0	203.1	671.1	802.4
	261	297.3	166.1	715.3	821.2	299.0	181.7	719.3	835.8	295.5	195.7	710.8	836.9	291.1	211.7	700.1	837.1
	271	309.9	174.3	745.5	856.8	311.2	190.5	748.6	870.7	307.5	204.9	739.7	871.7	302.9	222.0	728.5	872.1

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



30HXC COOLING CAPACITIES (cont)

50 Hz, SI

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)											
		25				30				35			
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)
4.0	076	248.2	47.0	10.6	12.6	229.6	52.0	9.8	12.0	214.4	57.7	9.2	11.6
	086	277.4	53.6	11.9	14.1	258.6	59.6	11.1	13.5	242.2	66.0	10.4	13.1
	096	315.8	60.2	13.5	16.0	295.2	67.2	12.7	15.4	276.8	74.6	11.9	15.0
	106	347.2	66.7	14.9	17.6	320.9	74.0	13.8	16.8	302.7	83.2	13.0	16.4
	116	380.9	71.5	16.3	19.3	354.4	80.0	15.2	18.5	332.6	89.3	14.3	18.0
	126	415.6	78.5	17.8	21.1	387.2	88.0	16.6	20.2	363.4	98.2	15.6	19.6
	136	460.4	88.0	19.7	23.4	430.2	97.6	18.5	22.5	404.8	108.2	17.4	21.8
	146	488.6	94.3	21.0	24.8	453.8	104.4	19.5	23.8	429.2	116.8	18.4	23.2
	161	516.9	99.1	22.2	26.2	500.4	115.4	21.5	26.2	494.8	135.7	21.2	26.8
	171	545.6	105.1	23.4	27.7	531.2	122.0	22.8	27.8	525.1	142.2	22.5	28.4
	186	584.8	113.6	25.1	29.8	569.1	131.4	24.4	29.8	563.8	153.3	24.2	30.5
	206	697.4	130.3	29.9	35.3	677.5	151.0	29.1	35.3	666.5	176.4	28.6	35.9
	246	820.3	152.7	35.2	41.5	795.6	178.1	34.1	41.5	783.2	208.5	33.6	42.2
	261	847.1	159.8	36.3	42.9	823.2	185.5	35.3	43.0	812.7	216.6	34.9	43.8
	271	882.6	168.4	37.9	44.8	858.2	195.3	36.8	44.9	848.5	227.9	36.4	45.8
5.0	076	258.7	47.4	11.1	13.1	239.3	52.4	10.3	12.4	222.5	58.0	9.6	11.9
	086	288.4	54.0	12.4	14.6	269.2	60.2	11.6	14.0	251.4	66.6	10.8	13.5
	096	328.3	60.5	14.1	16.6	307.4	67.8	13.2	16.0	287.3	75.2	12.3	15.4
	106	361.8	67.2	15.5	18.3	334.8	74.7	14.4	17.4	313.5	83.5	13.5	16.9
	116	396.1	72.0	17.0	20.0	369.6	80.6	15.9	19.2	344.7	89.8	14.8	18.5
	126	432.0	79.0	18.5	21.8	403.4	88.6	17.3	21.0	376.6	98.6	16.2	20.2
	136	479.0	88.4	20.6	24.2	447.9	98.4	19.2	23.3	419.9	108.8	18.0	22.5
	146	509.1	95.0	21.9	25.7	472.3	105.1	20.3	24.6	444.6	117.3	19.1	23.9
	161	534.8	98.7	23.0	27.0	517.8	115.3	22.2	27.0	508.8	135.1	21.8	27.4
	171	563.8	105.3	24.2	28.5	548.2	121.6	23.5	28.5	539.8	141.9	23.2	29.0
	186	604.6	113.2	26.0	30.6	587.8	131.1	25.2	30.6	579.4	152.8	24.9	31.2
	206	720.7	130.4	30.9	36.3	700.2	150.7	30.1	36.3	685.5	175.8	29.4	36.7
	246	847.7	152.6	36.4	42.7	823.0	177.6	35.3	42.6	805.3	207.5	34.6	43.1
	261	875.4	159.8	37.6	44.1	850.5	185.2	36.5	44.1	835.4	215.7	35.9	44.8
	271	912.2	167.9	39.2	46.0	886.5	194.8	38.1	46.1	872.0	226.9	37.4	46.8
6.0	076	269.3	48.2	11.6	13.5	249.5	52.9	10.7	12.9	230.8	58.4	9.9	12.3
	086	299.6	54.5	12.9	15.1	280.2	60.7	12.0	14.5	260.7	67.1	11.2	14.0
	096	341.0	61.2	14.6	17.2	319.8	68.2	13.7	16.5	298.1	75.7	12.8	15.9
	106	376.5	67.8	16.2	18.9	349.2	75.3	15.0	18.1	324.5	85.9	13.9	17.5
	116	411.6	72.6	17.7	20.7	385.1	81.2	16.5	19.9	357.0	90.8	15.3	19.1
	126	448.7	79.5	19.3	22.5	420.2	89.1	18.0	21.7	390.0	99.4	16.8	20.8
	136	497.6	89.4	21.4	25.0	466.2	99.0	20.0	24.1	435.5	109.5	18.7	23.2
	146	529.8	95.9	22.8	26.7	492.5	105.9	21.2	25.5	460.4	117.7	19.8	24.6
	161	552.3	98.8	23.7	27.8	535.7	115.0	23.0	27.7	523.3	134.7	22.5	28.0
	171	582.4	105.3	25.0	29.3	566.6	121.5	24.3	29.3	554.9	141.3	23.8	29.7
	186	624.0	113.3	26.8	31.4	607.0	130.8	26.1	31.4	595.3	152.0	25.6	31.8
	206	744.6	130.3	32.0	37.3	724.2	150.4	31.1	37.3	705.6	175.1	30.3	37.5
	246	874.9	152.9	37.6	43.8	851.0	177.1	36.6	43.8	828.3	207.0	35.6	44.1
	261	903.2	160.3	38.8	45.4	878.8	184.8	37.7	45.3	858.5	214.6	36.9	45.7
	271	940.9	168.5	40.4	47.3	915.5	194.2	39.3	47.3	895.9	225.6	38.5	47.8

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)



30HXC COOLING CAPACITIES (cont)

50 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)											
		25				30				35			
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)
7.0	076	280.1	48.8	12.0	14.0	260.2	53.4	11.2	13.4	239.7	58.8	10.3	12.7
	086	311.0	55.2	13.4	15.6	291.5	61.0	12.5	15.0	270.6	67.4	11.6	14.4
	096	354.0	62.0	15.2	17.7	332.3	68.6	14.3	17.1	309.1	76.1	13.3	16.4
	106	391.5	68.7	16.8	19.6	364.0	75.9	15.6	18.8	336.0	86.1	14.4	18.0
	116	427.5	73.3	18.4	21.4	400.7	81.6	17.2	20.6	370.8	90.6	15.9	19.7
	126	465.9	80.3	20.0	23.3	437.3	89.6	18.8	22.5	405.5	99.7	17.4	21.5
	136	516.8	90.4	22.2	25.9	485.1	99.7	20.8	24.9	451.7	110.1	19.4	23.9
	146	550.9	96.9	23.7	27.6	513.4	106.7	22.1	26.4	477.0	120.1	20.5	25.4
	161	569.9	99.1	24.5	28.5	554.3	114.8	23.8	28.5	539.3	136.4	23.2	28.8
	171	600.8	105.5	25.8	30.1	585.3	121.3	25.2	30.1	571.0	140.8	24.5	30.3
	186	643.4	113.6	27.7	32.3	627.0	130.5	26.9	32.3	611.5	151.2	26.3	32.5
	206	766.1	130.3	32.9	38.2	748.5	150.0	32.2	38.3	727.6	174.7	31.3	38.5
	246	902.6	153.0	38.8	45.0	879.8	176.5	37.8	45.1	852.6	205.4	36.6	45.1
	261	931.4	160.7	40.0	46.6	908.4	184.4	39.0	46.6	882.7	213.6	37.9	46.7
	271	970.1	168.8	41.7	48.6	946.0	193.8	40.7	48.6	920.3	224.3	39.6	48.8
8.0	076	291.0	49.3	12.5	14.5	271.2	53.7	11.7	13.9	249.8	59.3	10.7	13.2
	086	322.8	55.7	13.9	16.1	303.0	61.3	13.0	15.5	281.3	67.9	12.1	14.9
	096	367.4	62.6	15.8	18.3	345.3	68.9	14.8	17.7	321.5	76.7	13.8	17.0
	106	406.7	69.4	17.5	20.3	379.1	76.4	16.3	19.4	348.9	84.6	15.0	18.5
	116	443.7	73.8	19.1	22.1	416.7	81.8	17.9	21.3	386.3	91.2	16.6	20.4
	126	483.1	80.9	20.8	24.1	454.6	89.9	19.5	23.2	422.1	100.3	18.2	22.3
	136	536.5	91.4	23.1	26.8	504.3	100.1	21.7	25.8	469.7	110.9	20.2	24.8
	146	572.3	97.9	24.6	28.6	534.8	107.4	23.0	27.4	495.0	120.1	21.3	26.2
	161	587.9	99.2	25.3	29.3	572.9	114.4	24.6	29.3	553.8	133.5	23.8	29.3
	171	618.0	105.6	26.6	30.9	604.7	121.0	26.0	31.0	588.0	140.4	25.3	31.1
	186	663.1	113.8	28.5	33.1	647.6	130.1	27.8	33.2	629.4	150.7	27.1	33.3
	206	786.3	130.1	33.8	39.1	773.2	150.0	33.2	39.4	750.0	174.1	32.2	39.4
	246	928.1	152.6	39.9	46.1	909.2	175.6	39.1	46.3	880.7	205.0	37.9	46.3
	261	959.2	160.7	41.2	47.8	938.4	183.7	40.4	47.9	910.9	213.4	39.2	47.9
	271	999.8	168.9	43.0	49.9	977.1	193.0	42.0	49.9	949.1	224.0	40.8	50.0
9.0	076	300.8	49.7	12.9	15.0	282.4	54.2	12.1	14.4	260.2	59.8	11.2	13.7
	086	334.1	56.2	14.4	16.7	314.7	61.6	13.5	16.1	292.6	68.5	12.6	15.4
	096	379.9	63.1	16.3	18.9	358.6	69.1	15.4	18.3	334.3	77.3	14.4	17.6
	106	421.6	70.0	18.1	21.0	394.6	76.9	17.0	20.1	363.7	85.3	15.6	19.1
	116	458.4	74.1	19.7	22.7	432.9	82.1	18.6	22.0	402.5	91.8	17.3	21.1
	126	499.1	81.2	21.5	24.8	472.1	90.4	20.3	24.0	439.5	101.0	18.9	23.1
	136	555.4	92.1	23.9	27.6	524.1	100.5	22.5	26.7	488.5	111.8	21.0	25.6
	146	592.8	98.7	25.5	29.5	556.6	108.0	23.9	28.4	514.8	119.5	22.1	27.1
	161	604.7	99.0	26.0	30.0	591.8	114.0	25.5	30.1	572.3	133.2	24.6	30.1
	171	634.5	105.5	27.3	31.6	624.1	121.0	26.9	31.8	606.1	140.1	26.1	31.8
	186	681.5	113.6	29.3	33.9	668.5	129.5	28.8	34.1	649.4	150.5	27.9	34.1
	206	806.9	129.6	34.7	40.0	798.1	150.1	34.3	40.5	774.3	173.8	33.3	40.5
	246	950.6	151.6	40.9	47.1	938.3	175.4	40.4	47.5	909.9	204.5	39.1	47.6
	261	981.7	160.0	42.2	48.7	968.5	183.3	41.7	49.2	940.0	213.0	40.4	49.2
	271	1023.9	168.1	44.1	50.9	1008.4	192.0	43.4	51.2	979.1	223.6	42.1	51.3

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)

Performance data (cont)



30HXC COOLING CAPACITIES (cont) 50 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXC	CONDENSER ENTERING WATER TEMPERATURE (C)											
		25				30				35			
		Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cond Flow Rate (L/s)
10.0	076	310.3	50.0	13.4	15.4	293.6	55.0	12.6	14.9	271.0	60.3	11.7	14.1
	086	344.9	56.5	14.8	17.1	326.6	62.1	14.1	16.6	304.2	69.0	13.1	15.9
	096	391.7	63.4	16.9	19.4	372.1	70.0	16.0	18.9	347.5	77.8	15.0	18.1
	106	435.4	70.3	18.7	21.6	410.3	77.6	17.7	20.8	379.0	86.0	16.3	19.8
	116	472.8	74.2	20.4	23.4	449.4	82.8	19.3	22.7	418.9	92.4	18.0	21.8
	126	515.3	81.4	22.2	25.5	489.9	90.9	21.1	24.8	457.2	101.7	19.7	23.9
	136	572.4	92.5	24.6	28.4	544.0	101.6	23.4	27.6	507.9	112.6	21.9	26.5
	146	613.0	99.3	26.4	30.4	578.5	109.1	24.9	29.4	536.1	120.5	23.1	28.0
	161	618.9	98.3	26.6	30.6	610.7	114.0	26.3	30.9	591.4	133.0	25.5	30.9
	171	650.8	105.2	28.0	32.3	643.7	121.0	27.7	32.6	625.6	140.0	26.9	32.7
	186	697.0	113.0	30.0	34.6	689.2	129.6	29.7	35.0	669.6	150.2	28.8	35.0
	206	826.8	128.8	35.6	40.8	823.3	150.0	35.4	41.6	799.7	173.5	34.4	41.5
	246	972.0	150.3	41.8	47.9	967.4	175.8	41.6	48.8	939.6	203.9	40.4	48.8
	261	1003.4	158.8	43.2	49.6	998.0	184.1	43.0	50.5	969.9	212.6	41.7	50.5
	271	1046.2	166.9	45.0	51.8	1038.9	192.8	44.7	52.6	1009.6	223.0	43.5	52.6
	13.0	076	326.3	50.2	14.1	16.1	312.5	56.2	13.5	15.7	289.5	61.2	12.5
086		362.7	57.0	15.6	17.9	346.7	63.4	14.9	17.5	320.4	69.7	13.8	16.7
096		411.1	63.8	17.7	20.3	394.1	71.2	17.0	19.9	368.7	78.5	15.9	19.1
106		458.4	70.5	19.7	22.6	437.4	79.1	18.8	22.1	400.4	86.9	17.3	20.8
116		499.4	74.4	21.5	24.5	479.8	84.3	20.7	24.1	445.0	93.1	19.2	23.0
126		548.8	81.7	23.6	26.9	523.5	92.5	22.6	26.3	490.1	102.6	21.1	25.3
136		604.8	93.1	26.1	29.8	580.8	103.6	25.0	29.2	543.8	113.7	23.4	28.1
146		652.6	99.6	28.1	32.1	619.9	111.2	26.7	31.2	577.2	122.1	24.9	29.9
161		645.1	96.6	27.8	31.7	645.3	114.4	27.8	32.5	627.7	132.4	27.0	32.5
171		678.9	103.9	29.3	33.4	681.4	121.6	29.4	34.3	664.2	139.5	28.6	34.3
186		721.9	111.6	31.1	35.6	722.7	130.3	31.1	36.4	704.3	149.7	30.3	36.5
206		863.2	127.9	37.2	42.3	866.1	150.3	37.3	43.4	840.7	172.7	36.2	43.3
246		1006.3	148.0	43.4	49.3	1012.9	176.0	43.6	50.8	987.1	202.9	42.5	50.8
261		1033.5	157.0	44.5	50.9	1044.3	184.6	45.0	52.5	1012.3	212.0	43.6	52.3
271		1085.7	164.3	46.8	53.4	1092.2	193.4	47.1	54.9	1065.4	222.0	45.9	55.0
16.0		076	323.3	50.2	13.9	16.0	308.9	56.0	13.3	15.6	286.0	61.0	12.3
	086	362.2	57.0	15.6	17.9	346.3	63.4	14.9	17.5	323.5	69.8	14.0	16.8
	096	411.5	63.8	17.7	20.3	394.4	71.2	17.0	19.9	369.0	78.5	15.9	19.1
	106	457.1	70.5	19.7	22.5	435.8	79.1	18.8	22.0	404.4	87.0	17.4	21.0
	116	500.0	74.3	21.6	24.5	480.5	84.3	20.7	24.1	449.3	93.2	19.4	23.2
	126	549.0	81.6	23.7	26.9	522.5	92.5	22.5	26.3	489.0	102.5	21.1	25.3
	136	605.3	93.1	26.1	29.8	581.7	103.7	25.1	29.3	544.7	113.8	23.5	28.1
	146	652.9	99.6	28.2	32.1	625.8	111.5	27.0	31.5	576.0	122.0	24.8	29.8
	161	645.2	96.7	27.8	31.7	645.5	114.4	27.8	32.5	627.9	132.4	27.1	32.5
	171	678.9	103.9	29.3	33.4	680.8	121.5	29.4	34.3	663.6	139.5	28.6	34.3
	186	725.8	111.4	31.3	35.8	728.0	130.3	31.4	36.7	703.9	149.7	30.4	36.5
	206	856.8	128.0	36.9	42.1	859.6	150.3	37.1	43.2	838.5	172.8	36.2	43.2
	246	1008.3	148.1	43.5	49.4	1014.6	175.9	43.8	50.9	988.9	202.8	42.6	50.9
	261	1039.3	156.7	44.8	51.1	1046.2	184.6	45.1	52.6	1020.2	211.8	44.0	52.6
	271	1083.0	164.5	46.7	53.3	1088.6	193.4	46.9	54.8	1061.6	222.1	45.8	54.8
	261	1034.8	147.1	44.6	50.9	1041.5	173.3	44.9	53.4	1026.5	198.7	44.2	52.3
271	1087.7	154.0	46.9	53.5	1094.3	181.4	47.1	54.9	1080.1	208.3	46.5	55.0	

LEGEND

- Cap. — Capacity, kW
- Cond — Condenser
- kW — Compressor Motor Input Power at Rated Voltage
- LCWT — Leaving Chilled-Water Temperature (C)



30HXA Ratings

All performance data is based on:

1. Cooler water temperature rise of 10° F (5.6° C).
2. Cooler fouling factor of 0.00010 ft² • hr • F/Btu (0.000018 m² • k/W).
3. 10° F (5.6° C) subcooling.
4. Refrigerant 134a.

5. Combining 30HXA units with remote condensers that have subcooling greater than the 10° F (5.6° C) subcooling on which the ratings are based will increase system capacity. Combining 30HXA units with remote condensers that have less than the 10° F (5.6° C) subcooling on which the ratings are based will decrease system capacity. To adjust capacity, multiply capacity ratings by 0.96; then adjust this result upward by 0.4% for each degree F (0.7% for each degree C) of available subcooling.

COMBINATION RATINGS 60 Hz, ENGLISH

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)	CONDENSER ENTERING AIR TEMPERATURE (F)															
			85			95			105			115			125			
			Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	
40	076	084	(1)	67.4	69.3	161.4	62.4	73.5	149.3	56.9	77.8	136.3	51.3	83.7	122.8	46.7	91.3	111.7
	086	084	(1)	73.9	78.6	177.0	68.3	83.3	163.5	62.3	88.6	149.1	56.4	95.6	134.9	51.0	103.4	122.2
	096	094	(1)	82.7	89.2	198.1	76.5	94.3	183.1	69.7	101.0	166.9	63.4	108.7	151.7	57.4	116.9	137.5
	106	074 (1) and 044	(1)	94.9	99.0	227.2	88.0	104.8	210.6	80.5	111.4	192.8	73.2	120.0	175.3	66.6	129.9	159.5
	116	074 (1) and 054	(1)	101.8	107.4	243.7	94.3	113.7	225.7	86.5	121.0	207.0	78.7	130.7	188.3	71.4	140.7	170.8
	126	074	(2)	112.2	115.2	268.5	104.2	122.1	249.5	95.7	129.8	229.1	87.2	140.1	208.9	79.2	151.5	189.7
	136	074	(2)	121.9	130.2	291.8	113.0	137.5	270.6	103.8	146.7	248.4	94.9	158.2	227.1	86.3	170.5	206.6
	146	084	(2)	135.5	137.8	324.4	126.2	145.5	302.1	116.2	154.2	278.1	106.2	166.2	254.3	96.9	179.5	232.0
	161	084	(2)	140.8	145.8	336.5	134.3	159.4	321.5	127.5	174.4	305.2	121.0	192.3	289.6	109.8	213.7	262.9
	171	084	(2)	150.8	161.0	361.0	143.9	175.5	344.5	136.7	191.8	327.2	129.6	212.2	310.2	120.4	236.7	288.3
	186	084	(2)	163.8	182.4	392.1	154.8	198.6	370.5	147.7	216.5	353.6	139.9	239.9	334.9	124.6	266.6	298.3
	206	084 (2) and 094	(1)	192.2	189.9	460.2	184.9	208.0	442.5	176.0	227.7	421.4	166.5	250.7	398.6	157.3	278.9	376.5
	246	094	(3)	223.3	225.8	534.6	214.7	246.4	514.1	203.0	269.1	485.8	192.9	295.9	461.9	182.1	329.4	436.0
	261	094	(3)	234.1	242.2	560.3	224.3	264.2	536.8	212.4	288.2	508.6	201.9	317.8	483.3	190.6	353.4	456.3
271	094	(3)	246.1	260.7	589.2	234.6	283.8	561.6	223.0	309.0	533.8	211.8	341.6	507.1	199.9	380.1	478.5	
42	076	084	(1)	70.1	70.8	167.8	65.0	75.1	155.8	59.4	79.4	142.3	53.6	85.0	128.5	48.6	92.9	116.5
	086	084	(1)	76.7	80.3	183.8	71.0	85.1	170.2	64.9	90.4	155.5	58.7	97.0	140.6	53.1	104.7	127.3
	096	094	(1)	86.0	91.2	206.0	79.5	96.5	190.4	72.6	102.8	174.0	66.0	110.4	158.0	59.0	118.2	141.3
	106	074 (1) and 044	(1)	98.5	101.1	236.0	91.6	106.9	219.5	84.0	113.3	201.2	76.4	121.7	183.0	69.4	131.5	166.2
	116	074 (1) and 054	(1)	105.6	109.6	253.1	98.2	115.9	235.4	90.1	123.0	215.8	82.0	132.4	196.4	74.3	142.7	178.1
	126	074	(2)	116.4	117.5	278.9	108.5	124.6	259.9	99.7	132.0	238.8	90.8	142.1	217.5	82.6	153.4	197.9
	136	074	(2)	126.6	132.8	303.3	117.6	140.2	281.6	108.0	149.2	258.7	98.6	160.6	236.3	88.8	172.2	212.7
	146	084	(2)	140.7	140.5	337.1	131.4	148.4	314.7	121.0	156.7	289.9	110.5	168.5	264.7	101.0	181.8	241.8
	161	084	(2)	145.2	148.3	347.7	139.0	162.1	333.0	132.1	177.0	316.4	125.2	195.0	299.8	111.6	214.4	267.3
	171	084	(2)	156.1	163.3	373.9	149.0	178.4	357.0	141.4	194.8	338.8	134.2	214.7	321.4	122.5	237.7	293.4
	186	084	(2)	169.3	185.6	405.6	160.4	202.1	384.2	152.9	219.7	366.3	144.9	243.4	347.1	124.7	266.4	298.8
	206	084 (2) and 094	(1)	198.6	192.8	475.7	191.3	211.1	458.3	182.7	231.1	437.7	172.5	254.3	413.2	162.9	281.3	390.2
	246	094	(3)	230.5	229.4	552.3	222.3	250.3	532.5	210.4	273.4	504.1	199.8	299.4	478.6	188.6	332.7	451.9
	261	094	(3)	241.8	245.8	579.2	232.8	268.0	557.6	219.9	292.9	526.7	209.0	321.6	500.6	197.4	357.2	472.8
271	094	(3)	254.1	265.1	608.7	243.4	288.2	583.1	230.6	314.3	552.5	219.2	346.2	525.2	207.0	383.7	495.8	
44	076	084	(1)	72.9	72.5	174.7	67.5	76.8	161.9	61.9	81.1	148.5	56.1	86.4	134.4	50.6	93.5	121.2
	086	084	(1)	79.6	82.2	190.9	73.9	86.9	177.1	67.6	92.0	162.0	61.2	98.4	146.6	55.2	106.1	132.4
	096	094	(1)	89.2	93.4	213.8	82.6	98.6	198.0	75.7	104.7	181.5	68.7	112.1	164.7	60.1	118.7	144.0
	106	074 (1) and 044	(1)	102.3	103.3	245.3	95.2	109.2	228.3	87.4	115.4	209.6	79.6	123.5	190.7	72.2	133.3	173.0
	116	074 (1) and 054	(1)	109.7	111.9	262.9	102.1	118.4	244.8	93.8	125.0	224.8	85.2	134.4	204.3	77.4	144.5	185.7
	126	074	(2)	120.9	119.9	289.9	112.8	127.1	270.4	103.9	134.4	249.0	94.5	144.2	226.6	86.0	155.4	206.0
	136	074	(2)	131.4	135.8	314.9	122.1	143.3	292.8	112.4	152.1	269.4	102.7	163.0	246.2	89.4	172.3	214.3
	146	084	(2)	146.0	143.4	350.0	136.6	151.3	327.5	126.1	159.5	302.4	115.1	170.9	276.0	105.0	184.4	251.7
	161	084	(2)	149.8	150.9	359.2	143.8	164.8	344.8	136.8	179.9	327.9	129.5	197.9	310.4	113.3	215.2	271.6
	171	084	(2)	161.0	166.1	386.0	154.5	181.5	370.3	146.3	198.2	350.7	138.7	217.6	332.5	124.5	239.0	298.6
	186	084	(2)	174.7	189.2	418.9	166.3	205.8	398.6	158.0	223.9	378.7	149.8	247.1	359.2	124.8	266.7	299.1
	206	084 (2) and 094	(1)	205.1	195.6	491.7	197.9	214.1	474.5	189.4	234.6	454.1	178.6	257.9	428.2	168.7	284.2	404.4
	246	094	(3)	237.9	233.0	570.4	229.9	254.3	551.1	218.2	277.9	523.0	206.7	304.1	495.5	195.3	336.8	468.1
	261	094	(3)	249.6	249.7	598.3	241.0	272.5	577.7	227.7	297.9	545.9	216.2	325.5	518.3	204.2	361.7	489.6
271	094	(3)	262.4	269.4	629.1	252.4	292.9	605.1	238.4	319.8	571.6	226.8	350.6	543.7	214.1	388.9	513.3	

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



COMBINATION RATINGS (cont) 60 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER		CONDENSER ENTERING AIR TEMPERATURE (F)														
				85			95			105			115			125		
				Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)
45	076	084	(1)	74.3	73.3	178.1	68.9	77.6	165.2	63.3	81.9	151.8	57.3	87.0	137.4	51.6	93.8	123.8
	086	084	(1)	81.1	83.1	194.6	75.3	87.8	180.6	69.0	92.8	165.6	62.4	99.2	149.7	56.4	106.7	135.1
	096	094	(1)	90.8	94.4	217.7	84.2	99.7	202.0	77.3	105.7	185.3	70.2	112.9	168.2	60.5	119.1	145.1
	106	074 (1) and 044	(1)	104.3	104.4	250.0	97.1	110.4	232.8	89.3	116.5	214.2	81.2	124.5	194.8	73.7	133.9	176.8
	116	074 (1) and 054	(1)	111.8	112.9	268.1	104.1	119.5	249.7	95.7	128.3	229.4	87.0	135.4	208.6	79.0	145.5	189.4
	126	074	(2)	123.2	121.2	295.4	115.0	128.4	275.7	105.9	135.8	254.0	96.5	145.3	231.5	87.7	156.4	210.3
	136	074	(2)	133.7	137.4	320.7	124.4	144.9	298.3	114.7	153.5	275.0	104.8	164.2	251.2	90.2	172.7	216.3
	146	084	(2)	148.8	144.8	356.8	139.2	152.9	333.7	128.6	161.2	308.4	117.6	172.2	281.9	107.2	185.6	257.0
	161	084	(2)	152.3	152.1	365.1	146.3	166.1	350.8	139.2	181.4	333.8	131.7	199.3	315.9	114.2	215.6	273.8
	171	084	(2)	163.6	167.6	392.2	157.1	183.1	376.6	148.8	199.9	356.9	141.1	219.2	338.3	125.6	239.7	301.1
	186	084	(2)	177.5	191.0	425.6	169.4	207.5	406.1	160.6	225.8	385.2	152.4	248.7	365.4	124.8	266.6	299.3
	206	084 (2) and 094	(1)	208.4	196.9	499.8	201.4	215.5	482.8	192.9	236.4	462.5	181.7	259.7	435.8	171.6	285.8	411.5
	246	094	(3)	241.7	234.7	579.6	233.8	256.3	560.7	222.1	280.0	532.7	210.2	306.3	504.2	198.6	338.8	476.3
261	094	(3)	253.5	251.7	607.9	245.0	274.7	587.5	231.8	300.4	555.9	219.9	328.0	527.4	207.7	364.1	498.0	
271	094	(3)	266.6	271.6	639.4	257.0	295.1	616.3	242.4	322.5	581.3	230.6	352.8	553.1	217.7	391.8	522.0	
46	076	084	(1)	75.6	74.2	181.4	70.3	78.4	168.6	64.6	82.8	154.9	58.5	87.8	140.2	52.7	94.3	126.4
	086	084	(1)	82.7	84.0	198.3	76.7	88.8	184.0	70.4	93.7	168.7	63.8	99.9	152.9	57.6	107.2	138.1
	096	094	(1)	92.4	95.5	221.7	85.8	100.7	205.9	78.7	106.7	188.9	71.6	113.8	171.7	61.1	119.3	146.5
	106	074 (1) and 044	(1)	106.2	105.5	254.6	99.0	111.5	237.4	91.0	117.8	218.4	82.8	125.6	198.7	75.1	134.9	180.2
	116	074 (1) and 054	(1)	113.8	114.1	272.9	106.1	120.8	254.5	97.5	127.7	233.9	88.8	136.4	213.1	80.6	146.5	193.2
	126	074	(2)	125.5	122.5	301.0	117.1	129.7	280.9	108.2	137.1	259.5	98.6	146.4	238.5	89.5	157.5	214.6
	136	074	(2)	136.2	138.9	326.6	126.8	146.4	304.1	116.9	155.0	280.3	106.8	165.5	256.2	91.0	173.2	218.3
	146	084	(2)	151.6	146.3	363.5	141.8	154.4	340.1	131.2	162.9	314.7	120.0	173.5	287.9	109.3	186.7	262.2
	161	084	(2)	154.7	153.3	371.0	148.7	167.4	356.8	141.6	183.0	339.6	134.0	200.6	321.4	115.1	215.9	276.1
	171	084	(2)	166.1	169.1	398.5	159.7	184.7	383.0	151.5	201.6	363.3	143.4	220.9	344.1	126.6	240.3	303.7
	186	084	(2)	180.4	192.6	432.6	172.3	209.4	413.4	163.2	228.0	391.5	154.9	250.4	371.6	124.9	266.6	299.5
	206	084 (2) and 094	(1)	211.8	198.3	507.9	204.7	217.2	491.1	196.0	238.2	470.2	185.0	261.5	443.8	174.6	287.5	418.7
	246	094	(3)	245.5	236.5	588.9	237.7	258.2	570.3	226.1	282.1	542.4	213.8	308.6	512.9	200.9	340.0	481.8
261	094	(3)	257.4	253.9	617.4	249.1	276.9	597.4	235.9	303.1	565.8	223.6	330.6	536.4	210.0	365.4	503.8	
271	094	(3)	270.9	273.7	649.8	261.6	297.3	627.5	246.5	325.4	591.2	234.6	354.9	562.6	217.7	391.9	522.3	
48	076	084	(1)	78.5	75.9	188.4	73.0	80.0	175.3	67.3	84.4	161.4	61.0	89.1	146.4	54.7	95.7	131.3
	086	084	(1)	85.7	85.8	205.7	79.7	90.6	191.3	73.2	95.6	175.6	66.4	101.4	159.4	59.8	108.7	143.5
	096	094	(1)	95.8	97.6	229.9	89.1	102.9	213.8	81.9	108.6	196.6	74.4	115.7	178.7	62.1	120.0	149.1
	106	074 (1) and 044	(1)	110.1	107.7	264.2	102.7	113.9	246.5	94.7	120.2	227.4	86.3	127.6	207.0	78.1	136.7	187.4
	116	074 (1) and 054	(1)	118.0	116.4	283.1	110.0	123.5	264.0	101.4	130.3	243.4	92.5	138.5	221.9	83.7	148.6	200.9
	126	074	(2)	130.0	125.2	312.0	121.6	132.4	291.9	112.3	140.0	269.6	102.6	148.7	246.2	93.1	159.6	223.4
	136	074	(2)	141.1	142.0	338.6	131.6	149.4	315.9	121.5	157.8	291.7	111.0	168.0	266.4	92.7	174.0	222.5
	146	084	(2)	157.1	149.4	376.9	147.2	157.6	353.2	136.4	166.2	327.4	125.0	176.3	299.9	113.6	189.4	272.7
	161	084	(2)	159.5	155.8	382.9	153.8	170.0	369.1	146.5	185.8	351.5	138.4	203.5	332.2	116.9	216.7	280.6
	171	084	(2)	171.4	172.0	411.3	165.1	187.7	396.1	156.7	205.1	376.0	148.2	224.3	355.7	128.8	241.3	309.1
	186	084	(2)	186.0	196.0	446.5	178.4	213.0	428.1	168.6	232.2	404.6	160.0	254.0	383.9	124.9	266.6	299.8
	206	084 (2) and 094	(1)	218.6	201.1	524.7	211.6	220.5	507.8	202.4	242.0	485.8	191.8	264.9	460.2	178.2	289.9	427.6
	246	094	(3)	253.2	239.9	607.7	245.5	262.1	589.3	234.3	286.6	562.4	221.0	313.3	530.5	205.3	342.2	492.6
261	094	(3)	265.4	257.8	637.0	257.2	281.5	617.1	244.5	308.0	586.7	231.1	336.0	554.6	214.7	368.1	515.2	
271	094	(3)	279.3	278.1	670.3	270.1	302.7	648.1	255.4	331.0	613.0	242.3	360.5	581.6	217.9	391.7	522.9	

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (F)



COMBINATION RATINGS (cont)
60 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (F)														
				85			95			105			115			125		
				Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)
50	076	084	(1)	81.3	77.7	195.1	75.8	81.7	181.9	69.9	86.1	167.9	63.6	90.8	152.6	57.1	97.2	137.1
	086	084	(1)	88.8	87.7	213.1	82.6	92.6	198.4	76.1	97.6	182.7	69.1	103.2	165.8	60.9	109.5	146.3
	096	094	(1)	99.3	99.7	238.4	92.4	105.1	221.9	85.0	110.8	204.2	77.3	117.8	185.7	63.4	120.8	152.3
	106	074 (1) and 044	(1)	114.0	110.3	273.8	106.5	116.3	255.7	98.5	122.7	236.4	89.8	129.8	215.7	81.2	138.8	194.9
	116	074 (1) and 054	(1)	122.1	119.3	293.1	114.0	126.2	273.7	105.4	133.1	253.0	96.1	140.8	230.8	87.0	150.6	208.9
	126	074	(2)	134.7	128.0	323.3	126.0	135.2	302.6	116.8	142.8	280.5	106.8	151.0	256.4	96.7	161.9	232.2
	136	074	(2)	146.1	145.2	350.7	136.4	152.6	327.6	126.2	160.7	303.0	115.3	170.8	276.8	94.4	175.1	226.6
	146	084	(2)	162.8	152.8	390.8	152.6	160.8	366.5	141.7	169.6	340.3	130.0	179.1	312.1	118.0	192.0	283.4
	161	084	(2)	164.5	158.3	395.0	158.8	172.7	381.4	151.2	189.0	363.0	143.0	206.6	343.4	117.6	217.4	282.5
	171	084	(2)	176.7	174.9	424.2	170.4	190.9	409.2	161.9	208.8	388.8	153.1	227.6	367.5	129.9	241.9	311.9
	186	084	(2)	191.8	199.6	460.5	184.6	216.7	443.3	173.9	236.5	417.6	165.3	257.3	396.8	123.9	266.7	297.6
	206	084 (2) and 094	(1)	225.5	204.2	541.5	218.2	224.2	523.9	209.1	245.8	502.1	198.6	269.0	478.9	181.8	292.5	436.5
	246	094	(3)	260.9	243.3	626.5	253.2	266.4	607.9	242.7	291.1	582.6	228.4	318.7	548.4	209.8	344.7	503.8
	261	094	(3)	273.5	261.7	656.6	265.2	286.3	636.7	253.2	313.0	608.0	238.6	341.9	573.0	219.4	370.7	526.8
271	094	(3)	287.5	282.7	690.4	278.5	308.4	668.7	264.6	336.6	635.3	250.2	367.2	600.7	217.9	392.0	523.2	
55	076	084	(1)	85.1	79.8	204.6	79.3	83.8	190.7	73.3	88.5	176.1	66.8	93.3	160.6	60.2	99.1	144.6
	086	084	(1)	93.6	90.7	224.9	87.1	95.6	209.5	79.7	100.1	191.6	72.6	105.5	174.6	62.1	110.4	149.4
	096	094	(1)	103.6	102.3	248.9	96.6	107.9	232.1	88.9	113.8	213.8	81.2	120.4	195.1	65.4	121.9	157.1
	106	074 (1) and 044	(1)	120.2	114.0	289.0	111.6	119.6	268.3	103.4	126.2	248.8	93.5	132.1	224.6	83.4	140.3	200.5
	116	074 (1) and 054	(1)	129.5	124.0	311.3	119.9	129.8	288.1	111.0	137.0	266.8	101.5	144.1	243.8	90.0	152.6	216.2
	126	074	(2)	142.9	132.6	343.4	133.8	139.9	321.5	124.2	147.8	298.6	113.0	155.2	271.5	101.3	164.6	243.4
	136	074	(2)	153.5	149.5	368.9	143.6	157.2	345.1	132.9	165.4	319.4	121.6	175.6	292.4	97.5	176.6	234.2
	146	084	(2)	172.6	158.2	414.9	162.0	166.3	389.4	150.8	175.5	362.5	138.7	184.7	333.5	125.1	196.1	300.7
	161	084	(2)	173.2	162.5	416.2	167.4	177.6	402.3	158.1	193.2	380.1	150.1	211.0	360.8	124.4	220.0	291.8
	171	084	(2)	184.9	179.5	444.5	178.7	196.1	429.6	170.4	214.5	409.5	160.6	233.7	386.0	129.0	241.9	310.0
	186	084	(2)	200.5	204.8	482.0	193.6	222.8	465.3	182.9	243.2	439.6	171.8	263.1	413.0	124.1	266.5	298.4
	206	084 (2) and 094	(1)	235.4	208.5	565.7	227.9	229.5	547.7	219.0	251.4	526.4	208.2	275.6	500.4	184.4	294.1	443.1
	246	094	(3)	270.2	247.4	649.5	262.4	271.7	630.7	252.1	297.1	606.0	237.8	325.1	571.5	214.4	348.3	515.4
	261	094	(3)	285.8	267.4	687.0	277.5	293.4	666.9	266.6	320.7	640.8	247.8	348.9	595.7	222.0	372.3	533.5
271	094	(3)	300.4	289.1	722.0	291.5	316.6	700.6	278.6	345.2	669.7	262.3	377.2	630.4	218.1	391.9	524.3	
60	076	084	(1)	85.2	79.9	204.9	79.4	83.9	190.9	73.4	88.5	176.5	66.9	93.3	161.0	59.8	98.8	143.3
	086	084	(1)	93.6	90.8	225.1	86.4	95.1	208.0	79.7	100.2	191.8	72.0	105.1	173.3	62.3	110.3	149.8
	096	094	(1)	103.7	102.4	249.4	96.5	108.1	232.2	89.0	113.8	214.2	81.2	120.5	195.4	65.4	121.9	157.3
	106	074 (1) and 044	(1)	119.6	113.7	287.6	111.7	119.7	268.7	102.3	125.5	246.1	93.5	132.2	225.0	83.5	140.4	200.8
	116	074 (1) and 054	(1)	128.3	123.3	308.7	120.0	129.9	288.6	111.1	137.0	267.2	100.8	143.6	242.4	90.0	152.6	216.5
	126	074	(2)	143.0	132.7	344.1	133.9	139.9	322.2	124.4	147.9	299.1	113.1	155.2	272.0	101.4	164.6	243.8
	136	074	(2)	153.7	149.5	369.7	143.8	157.2	345.9	133.1	165.4	320.1	121.8	175.6	293.0	98.6	177.4	237.1
	146	084	(2)	172.8	158.3	415.7	162.2	166.4	390.1	151.0	175.5	363.6	137.8	184.0	331.4	125.2	196.1	301.2
	161	084	(2)	171.9	161.7	413.5	166.1	176.7	399.6	158.3	193.3	380.8	150.2	211.1	361.4	120.6	219.3	290.0
	171	084	(2)	185.1	179.6	445.2	178.9	196.1	430.4	170.5	214.6	410.2	160.7	233.8	386.6	130.1	241.8	313.0
	186	084	(2)	200.7	205.0	482.8	193.7	223.1	465.9	181.5	242.2	436.7	171.9	263.3	413.6	124.2	266.6	298.7
	206	084 (2) and 094	(1)	235.5	208.6	566.6	228.0	229.5	548.6	219.2	251.5	527.2	208.3	275.7	501.2	184.5	294.1	443.9
	246	094	(3)	270.4	247.6	650.5	262.6	271.9	631.6	252.3	297.2	607.0	238.0	325.2	572.4	214.6	348.5	516.2
	261	094	(3)	286.0	267.5	688.0	277.7	293.5	668.0	264.0	319.3	635.1	248.0	349.0	596.5	222.1	372.5	534.3
271	094	(3)	300.6	289.2	723.1	291.7	316.7	701.7	278.9	345.4	670.8	262.5	377.3	631.5	218.2	392.3	524.9	

LEGEND

Cap. — Capacity, Tons of Refrigeration
 kW — Compressor Motor Input Power at Rated Voltages
 LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



COMBINATION RATINGS (cont) 60 Hz, SI

LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (C)														
				30			35			40			45			50		
				Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)
4	076	084	(1)	231.7	69.2	9.9	216.1	72.9	9.2	198.6	76.7	8.5	181.2	81.9	7.7	166.4	88.5	7.1
	086	084	(1)	254.3	78.4	10.8	236.2	82.6	10.1	217.3	87.5	9.3	198.8	93.6	8.5	182.0	100.5	7.8
	096	094	(1)	284.3	89.1	12.1	264.7	93.6	11.3	243.5	99.6	10.4	223.3	106.5	9.5	204.7	114.1	8.7
	106	074 (1) and 044	(1)	326.4	98.8	13.9	304.5	103.9	13.0	281.1	109.9	12.0	258.4	117.4	11.0	237.3	126.2	10.1
	116	074 (1) and 054	(1)	350.2	107.1	14.9	326.4	112.7	13.9	301.7	119.4	12.8	277.4	127.9	11.8	254.4	137.0	10.8
	126	074	(2)	386.0	114.9	16.4	360.7	121.2	15.4	333.7	128.2	14.2	307.5	137.1	13.1	282.6	147.2	12.0
	136	074	(2)	418.9	130.0	17.8	391.3	136.5	16.7	362.0	144.8	15.4	334.2	154.9	14.2	307.2	165.9	13.1
	146	084	(2)	466.3	137.5	19.9	436.6	144.4	18.6	405.3	152.1	17.3	373.9	162.7	15.9	345.0	174.5	14.7
	161	084	(2)	485.5	146.3	20.7	465.8	158.5	19.8	444.4	171.7	18.9	424.1	187.5	18.1	402.9	206.8	17.2
	171	084	(2)	521.1	161.4	22.2	498.8	174.5	21.2	476.3	189.0	20.3	454.6	206.6	19.4	432.3	228.5	18.4
	186	084	(2)	564.4	182.9	24.0	536.9	197.1	22.9	514.8	213.2	21.9	490.5	233.9	20.9	465.6	258.3	19.8
	206	084 (2) and 094	(1)	665.3	190.3	28.3	641.2	206.8	27.3	613.6	224.2	26.1	583.6	244.7	24.9	555.1	268.7	23.6
	246	094	(3)	772.8	226.4	32.9	743.9	245.0	31.7	707.4	265.1	30.1	676.2	288.4	28.8	643.0	317.4	27.4
	261	094	(3)	810.1	242.7	34.5	777.0	262.6	33.1	740.5	283.8	31.5	707.8	309.5	30.1	673.0	340.6	28.7
	271	094	(3)	851.7	260.9	36.3	812.7	282.1	34.6	777.3	304.2	33.1	742.6	333.0	31.6	705.9	365.4	30.1
5	076	084	(1)	240.0	70.5	10.2	224.4	74.2	9.6	206.6	78.2	8.8	188.7	83.1	8.0	172.7	89.4	7.4
	086	084	(1)	263.1	79.9	11.2	245.1	84.1	10.4	225.6	89.0	9.6	206.4	94.9	8.8	188.7	101.7	8.0
	096	094	(1)	294.6	90.7	12.6	274.0	95.5	11.7	252.7	101.2	10.8	232.1	107.9	9.9	212.1	115.6	9.0
	106	074 (1) and 044	(1)	337.9	100.6	14.4	315.8	105.8	13.5	292.1	111.5	12.5	268.2	119.0	11.4	246.2	127.7	10.5
	116	074 (1) and 054	(1)	362.3	109.1	15.4	338.4	114.8	14.4	313.1	121.2	13.3	287.7	129.6	12.3	264.2	138.6	11.3
	126	074	(2)	399.2	117.1	17.0	373.8	123.4	15.9	346.8	129.9	14.8	318.8	138.9	13.6	293.0	149.0	12.5
	136	074	(2)	433.6	132.3	18.5	405.4	138.8	17.3	375.4	147.0	16.0	346.6	157.0	14.8	318.5	168.0	13.6
	146	084	(2)	482.3	140.0	20.6	453.2	146.9	19.3	420.8	154.3	17.9	387.9	164.7	16.5	357.9	176.6	15.3
	161	084	(2)	500.7	148.2	21.3	480.3	160.8	20.5	458.9	174.0	19.6	437.5	189.8	18.6	415.5	208.6	17.7
	171	084	(2)	537.5	163.6	22.9	515.1	176.9	22.0	491.5	191.4	20.9	469.0	208.9	20.0	445.7	230.1	19.0
	186	084	(2)	583.3	185.5	24.9	553.9	200.3	23.6	531.2	215.9	22.6	506.4	236.8	21.6	480.2	260.1	20.5
	206	084 (2) and 094	(1)	685.0	193.1	29.2	661.5	209.5	28.2	634.3	227.3	27.0	602.6	247.8	25.7	573.0	270.7	24.4
	246	094	(3)	795.7	229.6	33.9	768.7	248.3	32.8	730.8	268.9	31.1	697.8	291.8	29.7	663.6	320.5	28.3
	261	094	(3)	834.1	246.1	35.5	803.7	266.1	34.3	763.9	288.0	32.6	730.3	312.9	31.1	694.4	344.2	29.6
	271	094	(3)	876.6	265.1	37.4	840.2	286.1	35.8	801.4	309.0	34.2	766.4	336.7	32.7	728.4	369.5	31.0
6	076	084	(1)	248.7	71.8	10.6	232.3	75.7	9.9	214.3	79.7	9.1	196.1	84.3	8.4	179.0	90.4	7.6
	086	084	(1)	272.2	81.5	11.6	253.8	85.8	10.8	234.3	90.4	10.0	214.5	96.1	9.1	196.0	102.7	8.4
	096	094	(1)	304.7	92.6	13.0	283.9	97.4	12.1	262.2	103.0	11.2	240.4	109.5	10.3	219.7	117.0	9.4
	106	074 (1) and 044	(1)	349.7	102.5	14.9	327.3	107.9	14.0	302.8	113.5	12.9	278.2	120.6	11.9	255.4	129.1	10.9
	116	074 (1) and 054	(1)	374.6	111.2	16.0	350.9	116.9	15.0	324.9	122.9	13.9	298.2	131.2	12.7	273.9	140.3	11.7
	126	074	(2)	413.1	119.2	17.6	387.7	125.6	16.5	359.6	132.0	15.3	330.6	140.8	14.1	303.9	150.8	13.0
	136	074	(2)	448.7	134.7	19.1	419.9	141.4	17.9	389.2	149.5	16.6	359.2	159.1	15.3	330.0	170.2	14.1
	146	084	(2)	499.0	142.5	21.3	469.4	149.5	20.0	436.3	156.9	18.6	402.3	167.0	17.2	371.1	178.7	15.8
	161	084	(2)	515.5	150.5	22.0	495.6	163.1	21.1	473.6	176.7	20.2	451.2	192.3	19.2	428.7	210.7	18.3
	171	084	(2)	554.1	165.8	23.6	531.9	179.6	22.7	506.7	194.4	21.6	483.4	211.4	20.6	459.2	232.3	19.6
	186	084	(2)	601.2	188.5	25.6	572.4	203.5	24.4	547.4	219.6	23.3	522.4	239.9	22.3	495.6	262.9	21.1
	206	084 (2) and 094	(1)	705.3	195.7	30.1	682.2	212.3	29.1	655.5	230.4	28.0	621.8	251.0	26.5	591.4	273.4	25.2
	246	094	(3)	818.3	232.9	34.9	792.6	251.9	33.8	755.2	272.8	32.2	719.8	295.8	30.7	684.8	324.0	29.2
	261	094	(3)	858.6	249.6	36.6	830.9	269.6	35.4	788.3	292.3	33.6	753.2	316.6	32.1	716.4	347.9	30.6
	271	094	(3)	902.4	269.1	38.5	868.5	290.2	37.0	825.8	313.8	35.2	790.1	340.6	33.7	751.3	374.1	32.0

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)



COMBINATION RATINGS (cont)
60 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER		CONDENSER ENTERING AIR TEMPERATURE (C)														
				30			35			40			45			50		
				Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)
7	076	084	(1)	257.3	73.4	11.0	240.4	77.3	10.3	222.6	81.2	9.5	204.0	85.5	8.7	185.3	91.3	7.9
	086	084	(1)	281.2	83.2	12.0	262.8	87.5	11.2	243.1	91.9	10.4	222.5	97.4	9.5	202.9	103.9	8.7
	096	094	(1)	314.9	94.5	13.4	293.7	99.3	12.5	272.3	104.6	11.6	249.7	110.9	10.7	227.8	118.3	9.7
	106	074 (1) and 044	(1)	361.6	104.5	15.4	338.7	109.9	14.5	314.4	115.4	13.4	288.8	122.4	12.3	264.7	130.6	11.3
	116	074 (1) and 054	(1)	387.5	113.2	16.5	363.4	119.1	15.5	336.6	125.2	14.4	309.3	133.2	13.2	283.7	142.1	12.1
	126	074	(2)	427.4	121.3	18.2	401.3	127.9	17.1	372.7	134.6	15.9	343.2	142.8	14.6	315.1	152.6	13.4
	136	074	(2)	464.0	137.4	19.8	434.3	144.2	18.5	403.5	152.0	17.2	372.3	161.3	15.9	341.9	172.3	14.6
	146	084	(2)	516.2	144.9	22.0	485.8	152.3	20.7	452.5	159.8	19.3	417.7	169.3	17.8	384.5	180.9	16.4
	161	084	(2)	530.3	152.9	22.6	511.1	165.5	21.8	488.9	179.2	20.9	465.0	195.0	19.8	433.5	211.2	18.5
	171	084	(2)	569.9	168.3	24.3	548.7	182.4	23.4	522.9	197.5	22.3	498.1	214.6	21.3	473.4	234.9	20.2
	186	084	(2)	618.9	191.7	26.4	591.2	206.9	25.2	564.0	223.1	24.1	538.3	243.0	23.0	498.3	263.3	21.3
	206	084 (2) and 094	(1)	725.9	198.3	31.0	703.4	214.9	30.0	676.6	233.5	28.9	642.4	254.0	27.4	610.2	276.6	26.0
	246	094	(3)	842.4	236.1	35.9	816.8	255.5	34.9	780.1	276.7	33.3	742.3	299.7	31.7	706.3	327.5	30.1
	261	094	(3)	883.5	253.1	37.7	856.0	273.8	36.5	814.0	296.9	34.7	776.4	321.1	33.1	738.8	351.8	31.5
271	094	(3)	928.9	273.1	39.6	897.4	294.3	38.3	850.9	318.6	36.3	814.4	344.5	34.8	774.3	378.9	33.0	
8	076	084	(1)	266.1	74.9	11.4	249.0	78.7	10.6	231.1	82.6	9.9	211.8	86.7	9.0	192.3	92.4	8.2
	086	084	(1)	290.7	84.8	12.4	272.2	89.1	11.6	251.7	93.6	10.7	230.7	98.9	9.8	210.1	105.3	9.0
	096	094	(1)	325.4	96.4	13.9	304.2	101.2	13.0	281.9	106.3	12.0	258.6	112.7	11.0	236.2	119.9	10.1
	106	074 (1) and 044	(1)	373.6	106.6	16.0	350.5	112.0	15.0	325.7	117.6	13.9	299.8	124.2	12.8	274.2	132.3	11.7
	116	074 (1) and 054	(1)	400.4	115.3	17.1	375.8	121.3	16.0	348.8	127.5	14.9	321.1	135.0	13.7	294.2	143.8	12.6
	126	074	(2)	441.4	123.7	18.8	415.2	130.2	17.7	386.4	137.0	16.5	356.3	144.8	15.2	326.5	154.4	13.9
	136	074	(2)	479.9	140.2	20.5	449.4	147.0	19.2	417.9	154.5	17.8	385.3	163.6	16.5	350.2	173.8	14.9
	146	084	(2)	533.4	147.7	22.8	502.7	155.0	21.5	468.9	162.7	20.0	433.4	171.7	18.5	398.3	183.1	17.0
	161	084	(2)	545.7	155.2	23.3	526.7	167.9	22.5	504.1	181.9	21.5	479.4	197.3	20.5	442.7	212.7	18.9
	171	084	(2)	586.2	171.0	25.0	565.6	185.1	24.1	539.3	200.6	23.0	513.6	217.4	21.9	479.5	235.7	20.5
	186	084	(2)	636.2	194.8	27.2	610.4	210.1	26.1	580.6	226.9	24.8	554.6	246.0	23.7	505.2	264.9	21.6
	206	084 (2) and 094	(1)	747.2	200.8	31.9	724.7	217.9	30.9	696.5	236.9	29.7	663.6	257.1	28.3	629.3	280.3	26.9
	246	094	(3)	866.5	239.4	37.0	841.8	258.9	35.9	805.9	280.4	34.4	765.1	303.8	32.7	728.3	330.9	31.1
	261	094	(3)	908.4	256.8	38.8	881.8	277.8	37.6	840.6	301.3	35.9	800.1	325.9	34.2	761.5	355.8	32.5
271	094	(3)	955.8	277.1	40.8	926.2	298.3	39.5	878.7	323.6	37.5	839.2	349.4	35.8	798.3	383.3	34.1	
9	076	084	(1)	275.1	76.5	11.7	257.6	80.2	11.0	239.9	84.1	10.2	219.8	88.3	9.4	199.6	93.9	8.5
	086	084	(1)	300.5	86.5	12.8	281.4	90.8	12.0	260.8	95.3	11.1	239.2	100.4	10.2	217.9	106.7	9.3
	096	094	(1)	335.9	98.4	14.3	314.5	103.1	13.4	291.8	108.2	12.5	267.8	114.5	11.4	239.6	120.5	10.2
	106	074 (1) and 044	(1)	386.0	108.6	16.5	362.6	114.1	15.5	337.6	119.8	14.4	310.8	126.2	13.3	284.1	134.1	12.1
	116	074 (1) and 054	(1)	431.7	117.4	17.7	388.2	123.8	16.6	361.0	130.0	15.4	332.7	136.9	14.2	304.2	145.7	13.0
	126	074	(2)	456.1	126.1	19.5	429.0	132.7	18.3	400.3	139.5	17.1	369.4	146.8	15.8	338.3	156.4	14.5
	136	074	(2)	494.5	143.1	21.1	464.7	149.8	19.8	432.5	157.1	18.5	399.1	165.9	17.0	355.2	174.5	15.2
	146	084	(2)	551.0	150.4	23.5	519.5	157.9	22.2	485.5	165.7	20.7	449.4	174.1	19.2	412.8	185.5	17.6
	161	084	(2)	561.1	157.4	24.0	542.7	170.2	23.2	519.4	184.5	22.2	494.3	199.8	21.1	447.6	213.5	19.1
	171	084	(2)	602.7	173.7	25.7	582.3	188.0	24.9	556.0	203.6	23.7	528.9	220.3	22.6	489.7	237.6	20.9
	186	084	(2)	654.2	198.0	27.9	629.7	213.4	26.9	597.5	230.8	25.5	571.1	248.8	24.4	503.8	264.6	21.5
	206	084 (2) and 094	(1)	768.8	203.3	32.8	746.5	220.8	31.9	717.4	240.3	30.6	685.2	260.6	29.3	648.6	283.8	27.7
	246	094	(3)	890.8	242.6	38.0	866.2	262.6	37.0	832.1	284.4	35.5	788.5	308.4	33.7	750.2	334.7	32.0
	261	094	(3)	933.8	260.5	39.9	907.2	282.0	38.7	868.2	305.7	37.1	824.0	331.0	35.2	784.1	359.5	33.5
271	094	(3)	982.8	281.0	42.0	952.7	303.3	40.7	907.4	328.6	38.8	863.9	355.2	36.9	821.9	387.3	35.1	

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)

Performance data (cont)



COMBINATION RATINGS (cont) 60 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (C)														
				30			35			40			45			50		
				Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)
10	076	084	(1)	284.2	78.1	12.1	266.5	81.7	11.4	248.0	85.7	10.6	227.8	90.0	9.7	207.6	95.1	8.9
	086	084	(1)	310.3	88.2	13.3	290.6	92.6	12.4	269.7	97.2	11.5	248.1	101.9	10.6	225.6	108.1	9.6
	096	094	(1)	346.9	100.3	14.8	325.0	105.1	13.9	301.7	110.3	12.9	277.7	116.4	11.9	243.2	121.0	10.4
	106	074 (1) and 044	(1)	398.6	110.7	17.0	374.6	116.3	16.0	349.0	122.2	14.9	322.0	128.2	13.8	294.5	135.9	12.6
	116	074 (1) and 054	(1)	426.7	119.8	18.2	401.1	126.1	17.1	373.7	132.4	16.0	344.7	138.8	14.7	315.0	147.5	13.5
	126	074	(2)	470.7	128.6	20.1	443.3	135.2	18.9	414.1	142.1	17.7	382.6	149.2	16.3	350.5	158.5	15.0
	136	074	(2)	510.4	145.9	21.8	479.9	152.7	20.5	447.3	159.8	19.1	413.0	168.8	17.6	368.9	176.1	15.6
	146	084	(2)	568.7	153.5	24.3	536.8	160.8	22.9	502.6	168.7	21.5	465.4	176.9	19.9	427.5	188.0	18.3
	161	084	(2)	576.7	159.8	24.6	558.7	172.7	23.9	534.3	187.5	22.8	509.3	202.8	21.8	452.6	214.5	19.3
	171	084	(2)	619.3	176.5	26.5	599.3	190.9	25.6	572.6	206.9	24.5	544.3	223.4	23.3	496.1	238.4	21.2
	186	084	(2)	672.1	201.3	28.7	649.3	216.8	27.7	615.1	234.6	26.3	587.5	252.8	25.1	502.1	264.2	21.5
	206	084 (2) and 094	(1)	790.8	206.1	33.8	767.5	224.1	32.8	738.9	243.5	31.6	707.1	264.3	30.2	668.2	287.4	28.6
	246	094	(3)	915.2	245.7	39.1	895.2	266.4	38.1	857.3	288.7	36.6	813.3	313.2	34.8	772.5	339.3	33.0
261	094	(3)	959.2	264.2	41.0	932.5	286.4	39.8	895.9	310.3	38.3	848.2	336.1	36.2	807.4	363.4	34.5	
271	094	(3)	1008.9	285.2	43.1	979.6	308.3	41.9	936.4	333.6	40.0	889.2	361.0	38.0	846.1	391.7	36.2	
13	076	084	(1)	299.4	80.6	12.8	281.1	84.2	12.0	259.5	88.0	11.1	237.1	91.7	10.1	216.0	96.5	9.2
	086	084	(1)	323.6	90.6	13.8	303.6	94.9	13.0	282.4	99.6	12.1	259.8	104.2	11.1	237.0	110.1	10.1
	096	094	(1)	364.2	103.4	15.6	341.7	108.5	14.6	318.0	113.6	13.6	290.2	118.8	12.4	249.7	122.1	10.7
	106	074 (1) and 044	(1)	415.6	113.9	17.8	391.0	119.3	16.7	365.1	125.3	15.6	337.3	131.1	14.4	308.7	138.6	13.2
	116	074 (1) and 054	(1)	448.0	123.8	19.2	421.5	129.9	18.0	393.7	136.3	16.8	363.7	142.5	15.6	332.9	150.8	14.2
	126	074	(2)	498.9	133.3	21.3	470.1	139.8	20.1	440.1	147.0	18.8	404.0	153.1	17.3	370.4	161.8	15.8
	136	074	(2)	540.0	150.9	23.1	508.5	157.9	21.8	474.5	165.3	20.3	439.8	173.9	18.8	373.2	177.4	16.0
	146	084	(2)	607.6	159.7	26.0	569.3	166.2	24.4	534.3	174.4	22.9	496.5	182.7	21.2	452.0	191.9	19.3
	161	084	(2)	602.0	163.2	25.8	583.5	176.8	25.0	559.2	191.6	23.9	534.0	207.4	22.8	461.6	216.1	19.7
	171	084	(2)	652.2	181.8	27.9	632.3	196.8	27.0	606.9	213.3	26.0	575.2	230.6	24.6	503.4	240.1	21.5
	186	084	(2)	702.1	206.4	30.0	679.4	222.8	29.1	646.0	241.0	27.6	614.6	259.8	26.3	501.8	264.1	21.5
	206	084 (2) and 094	(1)	830.4	211.1	35.5	799.3	229.4	34.2	766.7	247.9	32.8	733.9	269.3	31.4	688.8	291.1	29.5
	246	094	(3)	953.4	250.6	40.8	928.3	272.6	39.7	896.6	295.3	38.4	852.3	320.3	36.5	798.6	344.8	34.2
261	094	(3)	994.1	268.9	42.5	967.6	291.9	41.4	933.4	316.3	39.9	883.4	343.1	37.8	834.6	369.6	35.7	
271	094	(3)	1054.9	292.0	45.1	1016.3	315.0	43.5	976.4	340.4	41.8	923.8	368.7	39.5	866.1	395.5	37.0	
16	076	084	(1)	296.7	80.1	12.7	278.3	83.7	11.9	259.3	87.9	11.1	239.2	92.1	10.2	217.9	96.9	9.3
	086	084	(1)	326.1	91.0	14.0	305.8	95.4	13.1	282.0	99.5	12.1	259.5	104.2	11.1	236.8	109.9	10.1
	096	094	(1)	360.9	102.8	15.5	338.7	107.8	14.5	315.0	112.9	13.5	290.4	118.8	12.4	249.6	121.9	10.7
	106	074 (1) and 044	(1)	419.2	114.4	17.9	394.1	119.9	16.9	368.4	125.8	15.8	333.8	130.4	14.3	305.7	137.9	13.1
	116	074 (1) and 054	(1)	451.6	124.4	19.3	420.8	129.6	18.0	392.6	136.1	16.8	362.5	142.3	15.5	331.9	150.6	14.2
	126	074	(2)	498.3	133.1	21.3	469.5	139.6	20.1	439.4	146.8	18.8	407.2	153.9	17.4	373.7	162.4	16.0
	136	074	(2)	535.3	150.1	22.9	503.9	156.9	21.6	470.3	164.3	20.1	435.1	173.1	18.6	376.2	178.0	16.1
	146	084	(2)	602.2	158.7	25.8	568.5	166.1	24.3	533.4	174.3	22.8	495.7	182.5	21.2	456.0	192.5	19.5
	161	084	(2)	605.9	163.9	25.9	587.4	177.6	25.2	558.1	191.2	23.9	532.9	207.2	22.8	465.0	216.8	19.9
	171	084	(2)	647.1	181.0	27.7	627.5	195.8	26.9	601.7	212.3	25.8	570.0	229.7	24.4	503.0	240.1	21.5
	186	084	(2)	701.7	206.4	30.0	679.4	222.5	29.1	646.1	240.7	27.7	609.4	258.7	26.1	501.3	264.1	21.5
	206	084 (2) and 094	(1)	823.5	210.4	35.3	799.7	229.2	34.2	772.2	248.6	33.1	739.4	270.0	31.7	689.3	291.2	29.5
	246	094	(3)	954.7	250.5	40.9	920.9	271.4	39.4	888.8	294.2	38.1	844.4	319.0	36.2	791.6	343.3	33.9
261	094	(3)	1000.6	269.7	42.8	973.9	293.1	41.7	939.9	317.5	40.2	890.2	344.2	38.1	827.6	367.9	35.4	
271	094	(3)	1051.8	291.5	45.0	1023.1	316.2	43.8	983.7	341.6	42.1	930.1	370.1	39.8	867.7	396.1	37.2	

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)



COMBINATION RATINGS (cont)
50 Hz, ENGLISH

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (F)														
				85			95			105			115			125		
				Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)
40	076	084	(1)	67.9	68.0	162.4	62.8	72.0	150.5	57.2	76.3	137.0	51.6	82.0	123.6	47.1	89.3	112.7
	086	084	(1)	74.4	78.3	178.2	68.8	82.9	164.6	62.7	88.3	150.1	56.8	95.2	135.9	51.4	103.2	123.1
	096	094	(1)	83.1	88.1	198.9	76.8	93.2	183.7	70.0	99.7	167.6	63.6	107.4	152.3	57.7	115.5	138.1
	106	074 (1) and 044	(1)	94.8	97.2	226.9	87.9	102.9	210.4	80.5	109.4	192.6	73.1	117.8	175.1	66.6	127.4	159.4
	116	074 (1) and 054	(1)	101.8	106.5	243.7	94.3	112.9	225.7	86.4	120.3	206.8	78.6	129.9	188.3	71.3	139.9	170.7
	126	074	(2)	111.9	113.7	267.9	104.0	120.6	249.1	95.5	128.2	228.6	87.1	138.4	208.5	79.1	149.4	189.5
	136	074	(2)	121.0	127.9	289.6	112.4	135.1	269.0	103.3	144.1	247.2	94.6	155.2	226.5	86.4	166.4	206.7
	146	084	(2)	133.9	134.8	320.5	124.9	142.6	299.0	115.2	151.0	275.7	105.4	162.7	252.4	96.3	175.6	230.6
	161	084	(2)	139.4	145.3	333.7	132.9	159.0	318.2	126.1	174.1	301.8	119.0	191.3	284.9	110.5	211.8	264.6
	171	084	(2)	149.3	159.6	357.5	142.1	174.4	340.2	135.0	190.6	323.1	127.4	209.9	305.1	119.8	233.3	286.8
	186	084	(2)	161.3	180.5	386.2	151.8	196.8	363.5	144.8	215.2	346.5	136.0	236.6	325.5	125.9	261.7	301.5
	206	084 (2) and 094	(1)	190.2	188.1	455.4	182.8	206.2	437.5	174.0	226.0	416.5	164.1	248.0	392.9	154.4	274.9	369.7
	246	094	(3)	221.0	224.7	529.1	212.1	245.3	507.8	200.0	268.4	478.8	189.6	294.8	453.8	177.8	326.1	425.5
	261	094	(3)	231.3	240.4	553.6	221.3	262.2	529.7	209.2	286.7	500.8	198.1	315.1	474.3	185.9	348.4	444.9
271	094	(3)	242.4	258.4	580.2	230.5	281.6	551.7	218.7	307.5	523.5	206.4	338.4	494.1	193.0	372.9	462.1	
42	076	084	(1)	70.5	69.4	168.9	65.4	73.6	156.6	59.8	77.9	143.2	54.0	83.3	129.3	48.9	90.5	117.2
	086	084	(1)	77.3	80.0	185.2	71.5	84.7	171.3	65.4	89.9	156.6	59.1	96.6	141.6	53.5	104.5	128.3
	096	094	(1)	86.3	90.2	206.6	79.8	95.3	191.1	72.9	101.6	174.7	66.3	109.1	158.7	59.3	116.8	141.9
	106	074 (1) and 044	(1)	98.4	99.3	235.7	91.5	105.0	219.2	83.9	111.3	201.1	76.3	119.5	182.8	69.3	129.1	166.0
	116	074 (1) and 054	(1)	105.7	108.8	253.1	98.2	115.2	235.2	90.1	122.2	215.8	82.0	131.5	196.3	74.3	141.8	178.0
	126	074	(2)	116.3	115.9	278.6	108.3	123.0	259.4	99.5	130.3	238.4	90.6	140.3	217.1	82.5	151.4	197.5
	136	074	(2)	125.7	130.5	301.1	116.9	137.8	280.1	107.5	146.6	257.6	98.4	157.5	235.8	89.7	169.1	214.8
	146	084	(2)	139.0	137.5	333.1	130.1	145.3	311.6	119.9	153.5	287.3	109.7	164.9	262.9	100.4	177.8	240.5
	161	084	(2)	143.9	147.8	344.7	137.6	161.6	329.6	130.5	176.9	312.7	123.2	194.1	295.1	111.2	212.3	266.4
	171	084	(2)	154.3	162.3	369.7	147.3	177.3	352.9	139.7	193.6	334.6	131.9	212.6	316.1	122.9	234.8	294.4
	186	084	(2)	166.6	184.0	399.0	157.4	200.5	377.2	149.8	218.7	358.8	140.8	240.4	337.4	126.0	267.3	301.9
	206	084 (2) and 094	(1)	196.5	191.0	470.7	189.2	209.1	453.2	180.5	229.2	432.4	170.0	251.7	407.3	160.0	277.3	383.2
	246	094	(3)	228.1	228.2	546.5	219.5	249.1	525.9	207.4	272.5	496.7	196.4	298.6	470.5	184.1	329.9	441.1
	261	094	(3)	238.9	243.9	572.2	229.6	266.1	550.1	216.3	291.0	518.3	205.2	319.2	491.6	192.5	352.5	461.2
271	094	(3)	250.3	262.6	599.7	239.2	286.0	572.9	226.0	312.3	541.3	213.9	343.0	512.4	199.9	377.4	478.9	
44	076	084	(1)	73.3	71.0	175.7	68.0	75.3	162.9	62.3	79.5	149.4	56.4	84.7	135.1	50.9	91.6	122.0
	086	084	(1)	80.2	81.8	192.3	74.3	86.6	178.2	68.0	91.7	163.1	61.7	98.1	147.8	55.7	105.8	133.5
	096	094	(1)	89.5	92.2	214.6	82.9	97.5	198.8	76.0	103.5	182.2	69.0	110.8	165.3	60.3	117.4	144.5
	106	074 (1) and 044	(1)	102.2	101.4	245.0	95.1	107.3	228.0	87.3	113.4	209.4	79.5	121.3	190.5	72.2	130.8	173.0
	116	074 (1) and 054	(1)	109.7	111.0	262.9	102.1	117.6	244.8	93.8	124.2	224.8	85.2	133.5	204.3	77.4	143.7	185.5
	126	074	(2)	120.7	118.4	289.4	112.6	125.5	269.9	103.7	132.7	248.5	94.3	142.4	226.1	85.8	153.4	205.7
	136	074	(2)	130.4	133.5	312.5	121.5	140.9	291.2	112.0	149.3	268.5	102.5	159.9	245.6	90.4	169.0	216.8
	146	084	(2)	144.4	140.3	346.0	135.1	148.3	323.9	124.9	156.5	299.5	114.4	167.3	274.3	104.5	180.2	250.5
	161	084	(2)	148.5	150.4	356.0	142.4	164.2	341.3	135.1	179.7	323.9	127.5	197.1	305.7	114.0	213.6	273.2
	171	084	(2)	159.2	165.1	381.7	152.6	180.2	365.8	144.4	197.0	346.1	136.5	215.5	327.1	125.0	236.1	299.6
	186	084	(2)	171.8	187.6	411.9	163.3	203.9	391.4	154.7	222.5	370.7	145.8	244.3	349.5	126.1	261.8	302.3
	206	084 (2) and 094	(1)	202.9	193.7	486.5	195.7	212.1	469.2	187.0	232.5	448.4	176.1	255.3	422.2	165.7	280.5	397.2
	246	094	(3)	235.4	231.8	564.2	227.0	253.2	544.2	214.9	276.8	515.1	203.2	303.1	487.1	190.7	334.4	457.2
	261	094	(3)	246.5	247.8	590.9	237.6	270.5	569.6	224.0	295.9	536.9	212.4	323.5	509.3	199.3	357.5	477.7
271	094	(3)	258.4	267.0	619.4	248.0	290.5	594.5	233.3	317.2	559.4	221.5	347.8	530.9	207.0	383.2	496.3	

LEGEND

Cap. — Capacity, Tons of Refrigeration
 kW — Compressor Motor Input Power at Rated Voltages
 LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



COMBINATION RATINGS (cont) 50 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER		CONDENSER ENTERING AIR TEMPERATURE (F)														
				85			95			105			115			125		
				Unit	Qty	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.
45	076	084	(1)	74.8	71.8	179.3	69.3	76.1	166.2	63.7	80.3	152.8	57.7	85.3	138.3	52.0	92.0	124.6
	086	084	(1)	81.7	82.7	195.9	75.8	87.5	181.9	69.5	92.4	166.7	63.0	98.8	151.1	56.7	106.5	136.1
	096	094	(1)	91.2	93.3	218.6	84.5	98.5	202.7	77.5	104.5	186.0	70.4	111.6	168.9	60.8	117.6	145.8
	106	074 (1) and 044	(1)	104.1	102.5	249.7	97.0	108.4	232.5	89.2	114.5	213.9	81.1	122.3	194.6	73.6	131.6	176.5
	116	074 (1) and 054	(1)	111.8	112.1	268.0	104.1	118.7	249.7	95.6	125.4	229.4	87.0	134.5	208.7	79.0	144.6	189.4
	126	074	(2)	123.0	119.6	294.9	114.8	126.8	275.2	105.7	134.2	253.5	96.3	143.5	231.0	87.5	154.5	209.9
	136	074	(2)	132.8	135.0	318.4	123.8	142.4	296.8	114.2	150.7	274.0	104.4	161.2	250.5	91.1	169.5	218.6
	146	084	(2)	147.1	141.8	352.7	137.7	149.8	330.3	127.5	158.1	305.8	116.8	168.7	280.0	106.6	181.3	255.7
	161	084	(2)	150.8	151.7	361.7	144.8	165.6	347.1	137.4	181.1	329.5	129.7	198.7	311.0	114.9	214.0	275.4
	171	084	(2)	161.7	166.6	387.8	155.2	181.6	372.2	146.9	198.6	352.3	138.8	217.3	332.8	126.0	236.6	302.2
	186	084	(2)	174.5	189.4	418.5	166.2	205.7	398.5	157.1	224.3	376.8	148.3	246.1	355.7	126.2	261.7	302.5
	206	084 (2) and 094	(1)	206.2	195.2	494.4	199.0	213.6	477.3	190.3	234.1	456.4	179.2	257.2	429.7	168.6	282.2	404.2
	246	094	(3)	239.1	233.5	573.3	230.8	255.1	553.5	218.7	278.9	524.5	206.7	305.4	495.6	194.1	336.5	465.5
	261	094	(3)	250.4	249.8	600.3	241.6	272.7	579.2	228.0	298.1	546.7	216.1	326.0	518.1	202.8	359.8	486.3
	271	094	(3)	262.5	269.0	629.5	252.5	292.7	605.4	237.0	319.7	568.3	225.4	350.2	540.4	210.7	385.9	505.2
46	076	084	(1)	76.1	72.7	182.5	70.7	76.8	169.6	65.0	81.1	155.8	58.9	86.0	141.2	53.0	92.5	127.2
	086	084	(1)	83.2	83.7	199.6	77.2	88.4	185.3	70.9	93.2	170.0	64.2	99.6	154.0	58.0	107.0	139.0
	096	094	(1)	92.8	94.3	222.7	86.1	99.6	206.6	79.1	105.4	189.7	71.9	112.4	172.4	61.3	117.9	147.1
	106	074 (1) and 044	(1)	106.0	103.6	254.3	98.8	109.6	237.1	90.9	115.8	218.1	82.7	123.3	198.5	75.0	132.5	180.0
	116	074 (1) and 054	(1)	113.8	113.3	272.9	106.1	120.0	254.5	97.6	126.7	234.0	88.7	135.6	212.9	80.5	145.7	193.0
	126	074	(2)	125.2	120.9	300.4	116.9	128.1	280.4	107.9	135.5	258.8	98.4	144.6	236.1	89.3	155.5	214.1
	136	074	(2)	135.2	136.5	324.2	126.1	143.9	302.5	116.4	152.2	279.2	106.6	162.3	255.7	91.9	170.0	220.5
	146	084	(2)	149.8	143.2	359.4	140.3	151.4	336.6	130.1	159.7	312.1	119.2	170.0	286.0	108.8	182.5	260.9
	161	084	(2)	153.2	152.9	367.5	147.2	166.9	353.0	139.7	182.5	335.2	132.0	200.1	316.5	115.7	214.4	277.6
	171	084	(2)	164.3	168.0	394.0	157.8	183.2	378.5	149.4	200.3	358.4	141.2	219.0	338.6	127.1	237.3	304.8
	186	084	(2)	177.3	190.9	425.3	169.2	207.4	405.8	159.6	226.2	382.8	150.9	247.9	361.9	126.2	261.8	302.7
	206	084 (2) and 094	(1)	209.5	196.4	502.6	202.4	215.3	485.4	193.4	235.8	463.9	182.5	259.0	437.9	171.5	283.9	411.4
	246	094	(3)	242.8	235.2	582.5	234.7	257.0	562.9	222.6	280.9	533.9	210.1	307.7	504.1	197.6	338.6	473.9
	261	094	(3)	254.2	251.8	609.8	245.5	275.0	588.8	232.1	300.4	556.6	219.7	328.4	527.1	206.3	362.2	494.9
	271	094	(3)	266.7	271.1	639.6	256.8	295.2	615.9	241.2	322.4	578.5	229.3	352.7	549.9	214.4	388.8	514.2
48	076	084	(1)	78.9	74.4	189.5	73.5	78.4	176.3	67.7	82.8	162.4	61.4	87.4	147.3	55.0	93.8	132.1
	086	084	(1)	86.3	85.4	207.2	80.3	90.2	192.6	73.7	95.2	177.0	66.9	101.2	160.5	60.2	108.5	144.5
	096	094	(1)	96.2	96.5	230.8	89.4	101.7	214.6	82.2	107.4	197.4	74.7	114.3	179.3	62.5	118.5	150.0
	106	074 (1) and 044	(1)	110.0	105.8	263.9	102.6	111.9	246.2	94.7	118.1	227.2	86.2	125.3	207.0	78.0	134.3	187.2
	116	074 (1) and 054	(1)	118.0	115.6	283.1	110.0	122.7	263.9	101.4	129.5	243.3	92.4	137.8	221.7	83.6	147.8	200.7
	126	074	(2)	129.8	123.6	311.4	121.4	130.8	291.3	112.2	138.3	269.3	102.5	146.8	245.9	92.8	157.7	222.8
	136	074	(2)	140.1	139.6	336.3	131.0	146.9	314.3	121.1	154.9	290.6	110.8	164.7	266.0	93.6	170.9	224.5
	146	084	(2)	155.3	146.5	372.6	145.6	154.5	349.5	135.3	162.9	324.8	124.2	172.6	298.0	113.1	185.0	271.4
	161	084	(2)	158.0	155.3	379.2	152.2	169.4	365.2	144.5	185.2	346.7	136.4	203.1	327.3	116.5	214.7	279.7
	171	084	(2)	169.4	170.9	406.5	163.0	186.2	391.2	154.5	203.5	370.7	146.0	222.3	350.3	128.2	238.0	307.6
	186	084	(2)	182.9	194.2	438.8	175.0	211.1	420.0	164.6	229.9	395.0	156.0	251.4	374.4	126.3	261.8	303.1
	206	084 (2) and 094	(1)	216.3	199.2	519.0	209.0	218.7	501.6	199.7	239.5	479.4	189.3	262.6	454.2	177.5	288.0	425.9
	246	094	(3)	250.4	238.5	600.8	242.2	261.2	581.2	230.7	285.2	553.7	217.0	312.3	520.8	203.1	341.9	487.5
	261	094	(3)	262.0	255.8	628.8	253.2	279.7	607.8	240.5	305.3	577.1	226.9	333.7	544.5	212.1	365.5	509.1
	271	094	(3)	274.7	275.5	659.2	264.8	300.7	635.5	249.9	327.8	599.8	236.5	358.6	567.6	218.0	391.2	523.3

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (F)



COMBINATION RATINGS (cont)
50 Hz, ENGLISH (cont)

LCWT (F)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (F)														
				85			95			105			115			125		
				Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)	Cap.	Input kW	Cooler Flow Rate (Gpm)
50	076	084	(1)	81.8	76.1	196.3	76.2	80.0	183.0	70.4	84.4	169.0	63.9	89.1	153.5	57.4	95.4	137.9
	086	084	(1)	89.3	87.3	214.5	83.2	92.2	199.7	76.6	97.2	183.9	69.5	103.1	166.9	60.7	109.0	145.9
	096	094	(1)	99.6	98.6	239.2	92.7	103.9	222.6	85.4	109.5	205.0	77.6	116.4	186.4	63.7	119.4	152.9
	106	074 (1) and 044	(1)	113.9	108.3	273.5	106.4	114.3	255.4	98.3	120.6	236.1	89.8	127.5	215.5	81.1	136.4	194.6
	116	074 (1) and 054	(1)	122.1	118.5	293.1	114.1	125.2	273.9	105.4	132.2	253.0	96.1	139.9	230.8	86.9	150.0	208.6
	126	074	(2)	134.4	126.5	322.7	125.8	133.5	302.1	116.6	141.1	279.9	106.6	149.2	256.0	96.5	159.9	231.8
	136	074	(2)	145.2	142.6	348.5	135.8	150.0	326.0	125.8	157.8	302.0	115.1	167.5	276.4	95.3	171.8	228.8
	146	084	(2)	160.9	149.8	386.3	151.1	157.6	362.8	140.6	166.3	337.6	129.2	175.4	310.1	117.6	187.5	282.3
	161	084	(2)	162.9	157.7	391.1	157.1	172.1	377.2	149.2	188.3	358.2	141.0	206.3	338.4	118.4	215.4	284.3
	171	084	(2)	174.6	173.6	419.3	168.3	189.4	404.0	159.6	206.7	383.1	150.7	225.8	361.9	130.4	239.0	313.0
	186	084	(2)	188.4	197.7	452.4	181.0	214.7	434.6	169.7	234.0	407.6	161.1	255.5	386.7	126.4	261.8	303.4
	206	084 (2) and 094	(1)	223.0	202.3	535.4	215.6	222.0	517.6	206.4	243.2	495.5	195.8	266.6	470.1	181.1	290.4	434.9
	246	094	(3)	257.9	241.8	619.2	249.7	265.2	599.6	238.8	289.8	573.3	224.2	317.3	538.4	207.7	344.7	498.7
	261	094	(3)	269.9	259.6	647.9	261.1	284.2	627.0	249.0	310.3	597.9	234.0	339.2	561.8	216.8	368.5	520.5
271	094	(3)	282.7	280.1	678.9	273.0	306.0	655.5	258.8	333.4	621.4	243.8	364.4	585.4	218.1	391.3	523.6	
55	076	084	(1)	85.6	78.2	205.7	79.9	82.1	191.9	73.7	86.8	177.2	67.2	91.5	161.6	60.5	97.2	145.5
	086	084	(1)	94.2	90.2	226.4	87.7	95.1	210.9	80.2	99.8	192.8	73.1	105.4	175.7	62.0	109.7	149.1
	096	094	(1)	103.9	101.1	249.8	96.9	106.8	232.8	89.3	112.4	214.7	81.4	119.1	195.7	65.7	120.4	157.8
	106	074 (1) and 044	(1)	120.0	112.1	288.5	111.5	117.5	268.0	103.3	124.0	248.3	93.4	129.8	224.4	84.2	138.5	202.4
	116	074 (1) and 054	(1)	129.5	123.2	311.3	119.8	129.0	288.0	111.0	136.1	268.8	101.4	143.3	243.8	90.9	152.7	218.5
	126	074	(2)	142.6	131.0	342.8	133.5	138.2	321.0	124.0	146.1	298.1	112.7	153.3	270.9	101.1	162.6	243.0
	136	074	(2)	152.5	146.9	366.6	143.0	154.4	343.6	132.5	162.6	318.5	121.6	172.1	292.3	98.4	173.3	236.5
	146	084	(2)	170.7	155.1	410.3	160.5	163.1	385.7	149.6	172.0	359.7	137.9	180.9	331.4	124.6	191.5	299.5
	161	084	(2)	171.3	162.0	411.8	164.0	176.1	394.1	156.1	192.4	375.2	147.3	224.5	354.0	122.1	218.1	293.5
	171	084	(2)	182.7	178.3	439.0	176.3	194.4	423.7	167.9	212.5	403.5	157.0	255.2	377.3	130.4	239.1	313.5
	186	084	(2)	196.8	203.0	473.1	189.4	220.7	455.2	177.2	239.2	425.9	166.1	286.4	399.3	125.5	261.4	301.6
	206	084 (2) and 094	(1)	232.7	206.5	559.2	225.0	227.3	540.9	216.1	248.5	519.4	204.8	279.9	492.1	183.7	292.1	441.4
	246	094	(3)	267.2	245.8	642.1	258.7	270.5	621.8	248.0	295.6	596.1	233.0	329.5	559.9	211.5	365.7	508.4
	261	094	(3)	282.0	265.2	677.8	273.2	291.1	656.6	261.9	317.7	629.4	242.5	352.8	582.8	219.3	370.2	527.1
271	094	(3)	295.3	286.3	709.7	285.6	314.0	686.6	272.4	341.5	654.8	254.4	391.2	611.4	218.3	391.3	524.7	
60	076	084	(1)	85.7	78.3	206.1	79.8	82.2	192.0	73.8	86.8	177.6	67.3	91.5	161.9	59.9	96.9	144.2
	086	084	(1)	94.2	90.3	226.7	87.0	94.6	209.3	80.2	99.9	192.9	72.5	104.9	174.5	62.1	109.8	149.3
	096	094	(1)	104.0	101.2	250.3	96.9	106.9	233.0	89.4	112.4	215.1	81.6	119.1	196.2	65.7	120.5	158.1
	106	074 (1) and 044	(1)	120.2	112.1	289.1	111.6	117.6	268.4	102.2	123.3	246.0	93.4	129.8	224.8	84.3	138.6	202.7
	116	074 (1) and 054	(1)	128.3	122.4	308.7	119.9	129.1	288.5	111.1	136.2	267.2	101.5	143.3	244.3	90.0	152.0	216.5
	126	074	(2)	142.7	131.1	343.4	133.7	138.2	321.6	124.2	146.2	298.7	112.9	153.4	271.5	101.2	162.6	243.5
	136	074	(2)	152.7	147.0	367.3	143.0	154.6	344.1	132.7	162.6	319.2	121.7	172.1	292.8	99.3	174.3	238.8
	146	084	(2)	170.9	155.2	411.1	160.6	163.2	386.4	149.8	172.1	360.4	136.9	180.2	329.3	124.7	191.6	300.0
	161	084	(2)	170.2	161.2	409.3	164.1	176.1	394.8	156.2	192.5	375.8	147.3	226.2	354.4	122.2	218.1	294.0
	171	084	(2)	182.8	178.4	439.8	176.4	194.5	424.4	168.1	212.5	404.3	157.0	258.0	377.7	130.6	239.0	314.1
	186	084	(2)	196.9	203.3	473.7	188.2	219.8	452.6	177.3	239.3	426.6	166.2	289.1	399.7	125.5	261.5	302.0
	206	084 (2) and 094	(1)	232.9	206.5	560.1	225.2	227.3	541.7	216.2	248.6	520.1	204.9	279.9	492.9	184.9	293.0	444.9
	246	094	(3)	267.3	246.0	643.1	258.8	270.7	622.7	248.2	295.6	597.1	233.1	329.8	560.8	211.6	367.0	509.0
	261	094	(3)	282.3	265.2	679.0	273.4	291.2	657.6	259.6	316.1	624.5	242.6	353.1	583.7	219.5	370.2	527.9
271	094	(3)	295.5	286.3	710.9	285.9	314.1	687.7	272.7	341.6	655.9	252.4	382.0	607.1	218.4	391.5	525.3	

LEGEND

- Cap. — Capacity, Tons of Refrigeration
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (F)

Performance data (cont)



COMBINATION RATINGS (cont)

50 Hz, SI

LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER Unit (Qty)		CONDENSER ENTERING AIR TEMPERATURE (C)														
				30			35			40			45			50		
				Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)
4	076	084	(1)	233.3	67.8	9.9	217.4	71.4	9.3	199.8	75.2	8.5	182.1	80.2	7.8	167.5	86.7	7.1
	086	084	(1)	256.1	78.0	10.9	238.1	82.2	10.1	218.8	87.1	9.3	200.2	93.2	8.5	183.4	100.2	7.8
	096	094	(1)	285.3	88.0	12.2	265.5	92.5	11.3	244.3	98.4	10.4	224.3	105.2	9.6	205.6	112.7	8.8
	106	074 (1) and 044	(1)	325.9	97.0	13.9	304.1	102.0	13.0	280.8	107.9	12.0	258.1	115.3	11.0	237.0	123.9	10.1
	116	074 (1) and 054	(1)	350.4	106.2	14.9	326.5	111.9	13.9	301.7	118.6	12.9	277.5	127.1	11.8	254.3	136.1	10.8
	126	074	(2)	385.3	113.4	16.4	360.0	119.6	15.3	333.1	126.5	14.2	306.7	135.5	13.1	282.1	145.3	12.0
	136	074	(2)	416.0	127.7	17.7	388.8	134.1	16.6	360.3	142.2	15.3	333.2	152.1	14.2	307.1	162.4	13.1
	146	084	(2)	460.8	134.6	19.6	432.1	141.5	18.4	401.7	148.9	17.1	371.0	159.3	15.8	342.9	170.7	14.6
	161	084	(2)	481.6	145.8	20.5	460.8	158.0	19.6	439.6	171.5	18.7	417.6	186.6	17.8	394.8	204.7	16.8
	171	084	(2)	515.7	160.1	22.0	492.8	173.4	21.0	470.4	187.9	20.0	447.3	204.6	19.1	423.6	225.0	18.0
	186	084	(2)	555.7	181.1	23.7	526.6	195.6	22.4	504.7	211.9	21.5	477.4	231.0	20.3	449.9	252.6	19.2
	206	084 (2) and 094	(1)	658.2	188.5	28.0	634.0	204.9	27.0	606.5	222.6	25.8	575.5	242.1	24.5	545.6	264.7	23.2
	246	094	(3)	764.7	225.3	32.6	735.0	243.8	31.3	697.4	264.3	29.7	665.3	287.4	28.3	628.6	314.6	26.8
	261	094	(3)	800.1	240.9	34.1	766.7	260.6	32.7	729.4	282.3	31.1	695.2	307.3	29.6	657.3	336.1	28.0
	271	094	(3)	838.6	258.7	35.7	799.0	279.6	34.0	762.6	302.8	32.5	725.0	330.0	30.9	683.3	359.5	29.1
5	076	084	(1)	241.6	69.1	10.3	225.5	72.8	9.6	207.6	76.7	8.8	189.8	81.4	8.1	173.9	87.6	7.4
	086	084	(1)	265.0	79.6	11.3	246.8	83.8	10.5	227.4	88.5	9.7	207.9	94.4	8.9	190.3	101.3	8.1
	096	084	(1)	295.6	89.6	12.6	275.2	94.3	11.7	253.6	100.1	10.8	232.7	106.7	9.9	213.0	114.2	9.1
	106	074 (1) and 044	(1)	337.4	98.8	14.4	315.4	104.0	13.4	291.7	109.6	12.4	267.9	116.9	11.4	246.2	125.3	10.5
	116	074 (1) and 054	(1)	362.4	108.3	15.4	338.4	114.0	14.4	313.1	120.3	13.3	287.8	128.6	12.3	264.3	137.7	11.3
	126	074	(2)	398.6	115.5	17.0	373.4	121.8	15.9	346.0	128.3	14.7	318.2	137.1	13.6	292.5	147.1	12.5
	136	074	(2)	430.8	130.0	18.4	403.3	136.3	17.2	373.7	144.4	15.9	345.7	154.1	14.7	318.4	164.6	13.6
	146	084	(2)	476.7	137.0	20.3	448.3	144.0	19.1	417.0	151.2	17.8	384.8	161.3	16.4	355.6	172.8	15.2
	161	084	(2)	496.4	147.8	21.2	475.6	160.4	20.3	453.8	173.9	19.3	430.8	189.2	18.4	407.4	206.6	17.4
	171	084	(2)	531.8	162.5	22.7	508.7	175.7	21.7	485.6	190.3	20.7	461.6	207.0	19.7	436.8	226.9	18.6
	186	084	(2)	574.1	183.7	24.5	543.9	198.7	23.2	520.9	214.8	22.2	493.0	234.1	21.0	463.7	255.1	19.8
	206	084 (2) and 094	(1)	677.7	191.2	28.9	654.0	207.7	27.9	626.7	225.5	26.7	594.2	245.3	25.3	563.2	267.3	24.0
	246	094	(3)	787.3	228.4	33.6	759.2	247.1	32.4	720.4	268.1	30.7	686.6	291.0	29.3	649.2	318.2	27.7
	261	094	(3)	823.8	244.3	35.1	792.9	264.1	33.8	751.8	286.2	32.0	717.6	310.8	30.6	678.6	340.2	28.9
	271	094	(3)	863.3	262.7	36.8	826.2	283.7	35.2	785.5	307.1	33.5	748.5	334.0	31.9	705.6	364.2	30.1
6	076	084	(1)	250.3	70.3	10.7	233.6	74.2	10.0	215.8	78.1	9.2	197.2	82.7	8.4	180.1	88.6	7.7
	086	084	(1)	274.2	81.1	11.7	255.7	85.4	10.9	236.0	90.0	10.1	216.1	95.7	9.2	196.9	102.6	8.4
	096	094	(1)	305.8	91.4	13.0	284.8	96.2	12.1	263.2	101.8	11.2	241.7	108.1	10.3	220.9	115.5	9.4
	106	074 (1) and 044	(1)	349.2	100.6	14.9	326.9	105.9	13.9	302.7	111.4	12.9	278.1	118.5	11.9	255.0	126.9	10.9
	116	074 (1) and 054	(1)	374.7	110.3	16.0	350.9	116.1	15.0	324.9	122.1	13.9	298.0	130.3	12.7	273.7	139.5	11.7
	126	074	(2)	412.2	117.6	17.6	387.0	124.0	16.5	358.9	130.4	15.3	330.1	139.0	14.1	303.4	148.8	12.9
	136	074	(2)	445.7	132.4	19.0	417.5	139.0	17.8	387.7	146.8	16.5	358.3	156.2	15.3	330.0	166.7	14.1
	146	084	(2)	493.3	139.4	21.0	464.6	146.5	19.8	432.5	153.8	18.4	399.5	163.6	17.0	368.8	174.9	15.7
	161	084	(2)	510.8	150.1	21.8	490.6	162.7	20.9	468.1	176.4	20.0	444.7	191.7	19.0	420.2	209.2	17.9
	171	084	(2)	547.8	164.7	23.4	525.6	178.4	22.4	500.2	193.3	21.3	475.9	209.6	20.3	450.4	229.1	19.2
	186	084	(2)	591.1	186.9	25.2	561.9	201.9	24.0	536.1	218.4	22.9	508.8	237.4	21.7	478.8	258.0	20.4
	206	084 (2) and 094	(1)	697.8	193.9	29.8	674.3	210.4	28.8	647.5	228.5	27.6	613.6	248.4	26.2	581.5	270.0	24.8
	246	094	(3)	809.9	231.7	34.5	782.6	250.8	33.4	744.2	271.8	31.7	708.0	295.0	30.2	670.2	322.0	28.6
	261	094	(3)	848.0	247.7	36.2	819.2	267.7	34.9	775.7	290.4	33.1	740.5	314.6	31.6	700.4	344.2	29.9
	271	094	(3)	888.3	266.7	37.9	853.6	287.7	36.4	808.8	311.5	34.5	772.6	338.1	32.9	728.4	369.0	31.1

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)



COMBINATION RATINGS (cont)

50 Hz, SI (cont)

LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER		CONDENSER ENTERING AIR TEMPERATURE (C)															
				30			35			40			45			50			
				Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	
7	076	084	(1)	258.9	71.9	11.0	241.9	75.7	10.3	224.0	79.6	9.6	205.4	83.8	8.8	186.6	89.5	8.0	
	086	084	(1)	283.3	82.8	12.1	264.6	87.1	11.3	244.8	91.5	10.4	224.1	97.1	9.6	204.3	103.7	8.7	
	096	094	(1)	316.1	93.3	13.5	294.8	98.1	12.6	273.4	103.3	11.7	250.8	109.6	10.7	228.7	116.9	9.8	
	106	074 (1) and 044	(1)	361.1	102.6	15.4	338.4	108.0	14.4	314.0	113.4	13.4	288.5	120.3	12.3	264.2	128.4	11.3	
	116	074 (1) and 054	(1)	387.5	112.4	16.5	363.3	118.2	15.5	336.6	124.3	14.4	309.1	132.3	13.2	283.5	141.3	12.1	
	126	074	(2)	426.5	119.8	18.2	400.5	126.3	17.1	372.0	132.9	15.9	342.8	141.0	14.6	314.5	150.7	13.4	
	136	074	(2)	460.7	135.0	19.7	432.1	141.8	18.4	402.0	149.3	17.2	371.5	158.3	15.9	341.9	168.7	14.6	
	146	084	(2)	510.3	141.9	21.8	480.8	149.2	20.5	448.7	156.6	19.1	415.0	165.7	17.7	382.5	176.9	16.3	
	161	084	(2)	525.4	152.5	22.4	505.9	165.0	21.6	482.7	178.9	20.6	458.7	194.3	19.6	433.5	211.7	18.5	
	171	084	(2)	563.5	167.3	24.0	542.0	181.2	23.1	515.9	196.3	22.0	490.9	212.5	20.9	464.2	232.0	19.8	
	186	084	(2)	607.7	190.2	25.9	580.5	205.0	24.8	551.8	221.6	23.5	525.1	240.6	22.4	493.9	261.9	21.1	
	206	084 (2) and 094	(1)	718.2	196.5	30.6	695.3	213.1	29.7	667.8	231.3	28.5	634.1	251.6	27.1	600.1	273.4	25.6	
	246	094	(3)	833.1	234.9	35.6	806.5	254.3	34.4	768.3	275.5	32.8	730.0	298.8	31.2	691.8	325.7	29.5	
	261	094	(3)	872.4	251.2	37.2	844.0	271.8	36.0	800.9	294.6	34.2	763.3	319.1	32.6	722.6	348.3	30.8	
	271	094	(3)	914.2	270.6	39.0	881.7	291.8	37.6	833.0	315.8	35.5	796.9	342.5	34.0	751.4	374.0	32.1	
	8	076	084	(1)	267.6	73.5	11.4	250.8	77.1	10.7	232.5	81.0	9.9	213.0	85.0	9.1	193.5	90.6	8.3
		086	084	(1)	292.9	84.4	12.5	273.9	88.7	11.7	253.4	93.1	10.8	232.2	98.6	9.9	211.6	105.0	9.0
096		094	(1)	326.6	95.3	13.9	305.4	100.0	13.0	283.0	105.1	12.1	259.6	111.3	11.1	237.2	118.5	10.1	
106		074 (1) and 044	(1)	373.0	104.7	15.9	350.2	110.0	15.0	325.4	115.6	13.9	299.5	122.0	12.8	273.7	130.0	11.7	
116		074 (1) and 054	(1)	400.4	114.5	17.1	375.9	120.5	16.0	348.6	126.7	14.9	321.2	134.1	13.7	293.9	143.0	12.5	
126		074	(2)	440.6	122.1	18.8	414.3	128.6	17.7	385.7	135.3	16.5	355.5	143.0	15.2	325.8	152.5	13.9	
136		074	(2)	475.8	137.8	20.3	446.9	144.5	19.1	416.4	151.7	17.8	384.7	160.4	16.4	354.0	170.9	15.1	
146		084	(2)	527.3	144.6	22.5	497.2	152.0	21.2	464.9	159.5	19.8	430.3	168.2	18.4	396.2	179.1	16.9	
161		084	(2)	579.4	170.0	24.7	558.6	183.8	23.8	531.9	199.1	22.7	505.7	215.8	21.6	478.5	234.8	20.4	
171		084	(2)	625.1	193.2	26.7	598.8	208.3	25.6	567.5	224.9	24.2	541.3	243.9	23.1	505.0	264.7	21.6	
186		084 (2) and 094	(1)	739.2	198.9	31.6	716.4	215.9	30.6	687.5	234.4	29.4	655.1	254.9	28.0	619.1	277.1	26.4	
206		094	(3)	856.8	238.0	36.6	830.8	257.8	35.5	793.9	279.1	33.9	751.9	302.9	32.1	713.8	329.5	30.5	
246		094	(3)	896.9	254.8	38.3	869.0	275.8	37.1	827.4	298.8	35.3	786.1	323.8	33.6	745.5	352.4	31.8	
261		094	(3)	940.5	274.4	40.2	908.6	296.4	38.8	860.1	320.7	36.7	820.0	347.6	35.0	775.3	378.8	33.1	
9		076	084	(1)	276.7	75.0	11.8	259.2	78.6	11.1	241.1	82.5	10.3	221.2	86.6	9.4	201.1	92.0	8.6
		086	084	(1)	302.6	86.1	12.9	283.3	90.4	12.1	262.6	94.9	11.2	240.9	100.1	10.3	219.4	106.5	9.4
		096	094	(1)	337.5	97.2	14.4	315.5	102.0	13.5	292.9	106.9	12.5	269.0	113.2	11.5	240.6	119.0	10.3
	106	074 (1) and 044	(1)	385.5	106.6	16.5	362.1	112.2	15.5	337.2	117.7	14.4	310.5	123.9	13.3	283.8	131.8	12.1	
	116	074 (1) and 054	(1)	413.6	116.5	17.7	388.4	122.9	16.6	360.9	129.1	15.4	332.4	136.1	14.2	304.0	144.9	13.0	
	126	074	(2)	455.2	124.5	19.4	428.3	131.1	18.3	399.5	137.8	17.1	368.7	145.0	15.7	337.6	154.5	14.4	
	136	074	(2)	491.5	140.6	21.0	462.3	147.2	19.7	431.1	154.2	18.4	398.0	162.9	17.0	358.8	171.6	15.3	
	146	084	(2)	544.7	147.5	23.3	514.2	154.8	22.0	481.7	162.4	20.6	446.5	170.6	19.1	410.4	181.4	17.5	
	161	084	(2)	555.6	156.9	23.7	536.9	169.6	22.9	512.5	183.7	21.9	487.3	199.7	20.8	447.6	214.1	19.1	
	171	084	(2)	595.7	172.6	25.4	575.1	186.6	24.6	548.0	201.9	23.4	521.2	218.7	22.3	488.6	236.7	20.9	
	186	084	(2)	642.6	196.3	27.4	617.7	211.5	26.4	583.4	228.2	24.9	557.5	247.2	23.8	503.5	264.3	21.5	
	206	084 (2) and 094	(1)	760.5	201.4	32.5	737.3	219.0	31.5	708.1	237.8	30.2	675.9	258.3	28.9	638.1	280.8	27.3	
	246	094	(3)	880.7	241.1	37.6	854.4	261.5	36.5	819.9	283.0	35.0	774.6	307.3	33.1	735.3	333.4	31.4	
	261	094	(3)	921.6	258.5	39.4	893.4	280.1	38.2	854.2	303.1	36.5	808.6	328.5	34.5	767.8	356.3	32.8	
	271	094	(3)	966.2	278.5	41.3	934.2	301.2	39.9	888.1	325.5	37.9	843.0	352.7	36.0	798.1	383.2	34.1	

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)

Performance data (cont)



COMBINATION RATINGS (cont)

50 Hz, SI (cont)


LCWT (C)	UNIT SIZE 30HXA	09DK AIR-COOLED CONDENSER		CONDENSER ENTERING AIR TEMPERATURE (C)														
				30			35			40			45			50		
				Unit	Qty	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.	Input kW	Cooler Flow Rate (L/s)	Cap.
10	076	084	(1)	285.8	76.5	12.2	268.1	80.1	11.5	249.4	84.1	10.7	229.2	88.2	9.8	208.7	93.4	8.9
	086	084	(1)	312.4	87.8	13.3	292.3	92.2	12.5	271.8	96.7	11.6	249.6	101.8	10.7	227.3	108.0	9.7
	096	094	(1)	348.1	99.1	14.9	326.1	103.9	13.9	302.8	109.0	12.9	278.6	115.0	11.9	244.1	119.6	10.4
	106	074 (1) and 044	(1)	398.1	108.8	17.0	374.1	114.3	16.0	348.6	120.0	14.9	321.7	125.9	13.7	294.0	133.6	12.6
	116	074 (1) and 054	(1)	426.8	119.0	18.2	401.2	125.3	17.1	373.6	131.5	16.0	344.5	138.1	14.7	315.1	146.8	13.5
	126	074	(2)	469.9	127.1	20.1	442.5	133.5	18.9	413.4	140.4	17.7	381.8	147.4	16.3	349.9	156.6	15.0
	136	074	(2)	507.2	143.4	21.7	477.6	150.0	20.4	445.8	157.0	19.1	412.4	165.6	17.6	363.9	172.4	15.6
	146	084	(2)	562.5	150.5	24.0	531.5	157.6	22.7	498.5	165.4	21.3	462.4	173.3	19.8	425.5	183.8	18.2
	161	084	(2)	570.9	159.2	24.4	552.6	172.0	23.6	527.5	186.7	22.5	501.8	202.6	21.4	452.7	215.0	19.3
	171	084	(2)	612.1	175.2	26.2	591.8	189.3	25.3	564.5	205.0	24.1	536.0	222.0	22.9	494.8	237.5	21.5
	186	084	(2)	660.2	199.5	28.2	636.5	214.7	27.2	601.1	232.1	25.7	572.7	251.2	24.5	502.0	263.9	21.5
	206	084 (2) and 094	(1)	781.9	204.2	33.4	758.1	222.1	32.4	729.3	240.9	31.2	697.0	261.8	29.8	657.5	284.3	28.1
	246	094	(3)	904.6	244.2	38.7	878.4	265.2	37.5	843.8	287.4	36.1	798.8	311.6	34.1	756.7	337.9	32.3
	261	094	(3)	946.5	262.1	40.4	918.3	284.2	39.2	881.3	307.5	37.7	831.8	333.2	35.5	790.5	360.6	33.8
	271	094	(3)	991.6	282.7	42.4	960.3	305.9	41.0	916.2	330.5	39.2	866.3	357.8	37.0	822.1	388.0	35.1
13	076	084	(1)	301.0	79.0	12.9	282.8	82.5	12.1	258.8	85.8	11.1	238.6	89.9	10.2	217.2	94.8	9.3
	086	084	(1)	325.8	90.1	13.9	305.6	94.5	13.1	284.2	99.2	12.2	261.4	104.1	11.2	238.4	110.1	10.2
	096	094	(1)	365.6	102.2	15.6	342.9	107.3	14.7	319.1	112.3	13.7	291.3	117.4	12.5	250.7	120.7	10.7
	106	074 (1) and 044	(1)	415.1	111.9	17.8	390.6	117.3	16.7	364.7	123.1	15.6	337.4	128.8	14.4	308.4	136.2	13.2
	116	074 (1) and 054	(1)	448.1	122.9	19.2	421.4	129.0	18.0	393.6	135.4	16.8	363.7	141.8	15.6	332.8	150.1	14.2
	126	074	(2)	501.9	132.3	21.5	469.3	138.1	20.1	439.6	145.2	18.8	403.2	151.3	17.2	369.9	159.8	15.8
	136	074	(2)	536.7	148.3	23.0	506.2	155.2	21.7	473.1	162.5	20.2	439.0	170.7	18.8	377.1	174.4	16.1
	146	084	(2)	601.1	156.5	25.7	563.7	163.0	24.1	530.0	171.0	22.7	493.3	179.1	21.1	450.1	187.5	19.3
	161	084	(2)	595.9	162.6	25.5	576.5	176.2	24.7	552.0	190.8	23.6	523.4	222.3	22.4	461.5	216.8	19.7
	171	084	(2)	644.1	180.5	27.6	623.5	195.1	26.7	598.2	211.2	25.6	560.7	231.8	24.0	502.2	239.1	21.5
	186	084	(2)	689.4	204.5	29.5	665.0	220.6	28.4	631.1	238.2	27.0	593.9	286.1	25.4	501.6	263.8	21.5
	206	084 (2) and 094	(1)	813.4	208.5	34.8	784.4	226.3	33.6	756.6	245.1	32.4	722.8	267.0	30.9	678.2	288.2	29.0
	246	094	(3)	942.1	249.0	40.3	915.2	271.4	39.2	882.0	293.9	37.7	831.4	318.3	35.6	780.6	355.4	33.4
	261	094	(3)	980.7	266.7	42.0	952.7	289.6	40.8	917.2	313.5	39.2	866.0	340.5	37.0	814.5	386.4	34.8
	271	094	(3)	1027.0	287.8	43.9	996.0	312.4	42.6	955.0	336.8	40.9	898.5	365.5	38.4	841.9	392.4	36.0
16	076	084	(1)	298.2	78.5	12.8	279.8	82.0	12.0	260.8	86.2	11.2	240.6	90.3	10.3	219.1	95.1	9.4
	086	084	(1)	328.3	90.6	14.1	307.8	95.0	13.2	283.8	99.1	12.2	261.4	104.0	11.2	238.4	109.9	10.2
	096	094	(1)	362.2	101.6	15.5	339.9	106.6	14.6	316.0	111.7	13.5	291.6	117.4	12.5	250.5	120.5	10.7
	106	074 (1) and 044	(1)	418.6	112.4	17.9	393.6	117.8	16.9	367.9	123.7	15.8	333.4	128.1	14.3	305.4	135.5	13.1
	116	074 (1) and 054	(1)	451.6	123.6	19.3	420.5	128.8	18.0	392.7	135.2	16.8	362.3	141.6	15.5	331.8	150.0	14.2
	126	074	(2)	497.5	131.5	21.3	468.7	137.9	20.1	438.7	145.0	18.8	406.6	152.0	17.4	373.0	160.5	16.0
	136	074	(2)	532.0	147.5	22.8	501.6	154.2	21.5	468.9	161.5	20.1	434.5	169.8	18.6	376.2	174.3	16.1
	146	084	(2)	595.7	155.6	25.5	563.0	162.9	24.1	529.4	170.8	22.7	492.5	178.9	21.1	453.9	188.2	19.4
	161	084	(2)	599.7	163.3	25.7	580.4	176.8	24.9	550.9	190.5	23.6	524.0	213.0	22.4	465.0	217.4	19.9
	171	084	(2)	639.3	179.7	27.4	618.9	194.1	26.5	593.2	210.2	25.4	559.5	238.2	24.0	501.9	239.0	21.5
	186	084	(2)	689.0	204.6	29.5	664.8	220.5	28.5	631.1	238.0	27.0	591.7	267.0	25.3	501.1	263.7	21.5
	206	084 (2) and 094	(1)	814.0	208.4	34.9	789.7	227.0	33.8	761.8	245.9	32.6	728.2	267.2	31.2	683.3	289.5	29.3
	246	094	(3)	943.4	249.0	40.4	907.8	270.3	38.9	874.6	292.6	37.4	828.4	317.9	35.5	778.9	350.0	33.3
	261	094	(3)	987.1	267.6	42.3	958.9	290.7	41.1	923.5	314.6	39.5	862.8	339.7	36.9	813.5	374.1	34.8
	271	094	(3)	1033.6	288.8	44.3	1002.6	313.6	42.9	962.2	338.0	41.2	905.2	366.1	38.8	—	—	—

LEGEND

- Cap. — Capacity, kW
- kW — Compressor Motor Input Power at Rated Voltages
- LCWT — Leaving Chilled-Water Temperature (C)


COOLER PRESSURE DROP

ENGLISH

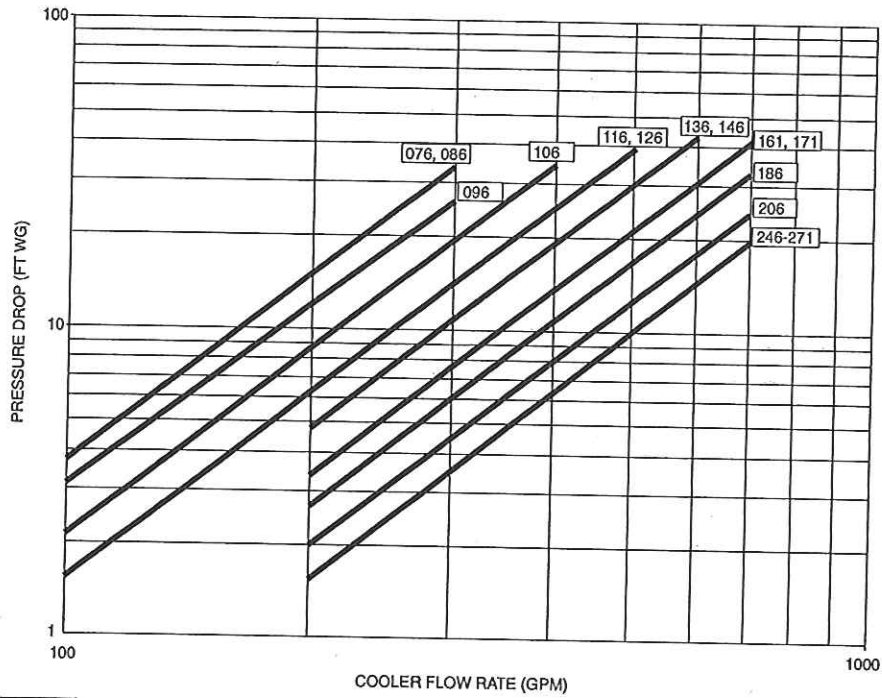

076, 088 — Unit size range
 NOTE: Ft of water = 2.31 x change in psig.

SI

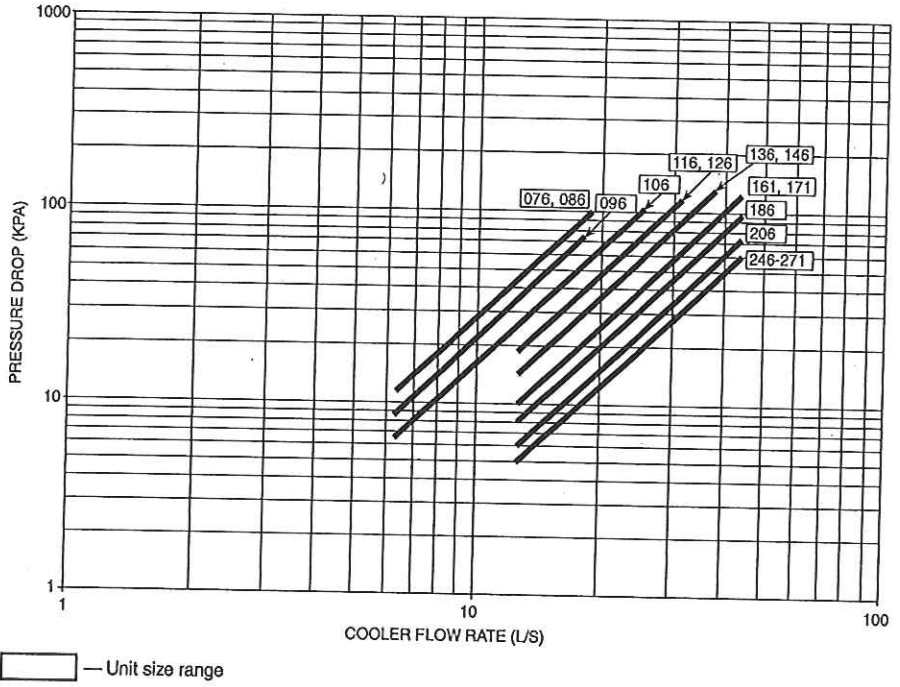


076, 088 — Unit size range

Performance data (cont)




30HXC CONDENSER PRESSURE DROP

ENGLISH

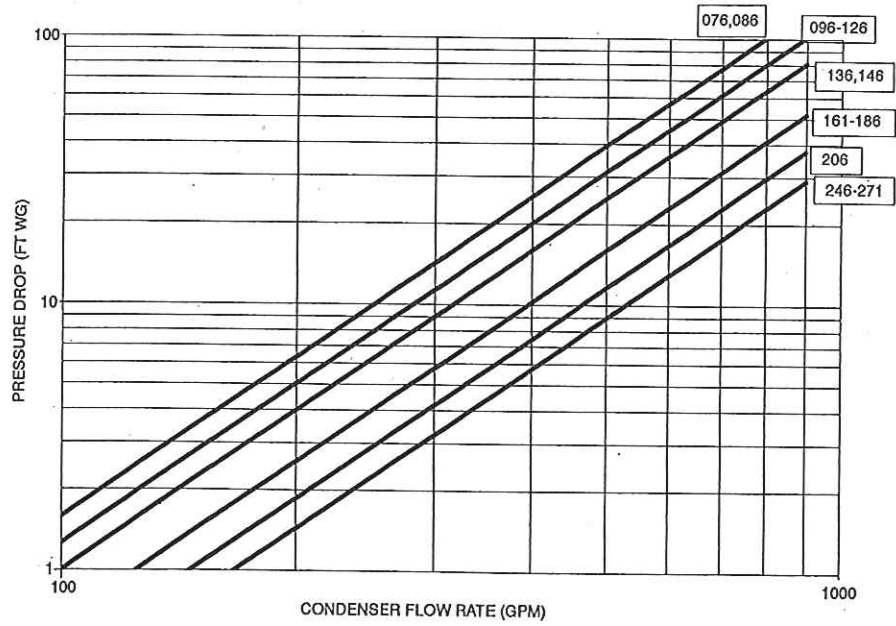

— Unit size range
 NOTE: Ft of water = 2.31 x change in psig.


SI

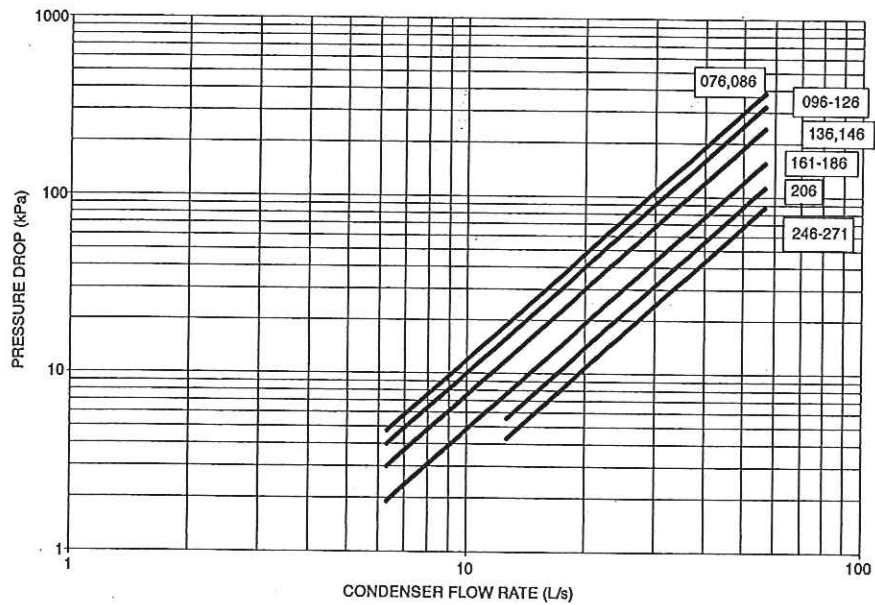

— Unit size range

Typical piping and wiring

Cooler (30HXA, HXC) and condenser (30HXC only)

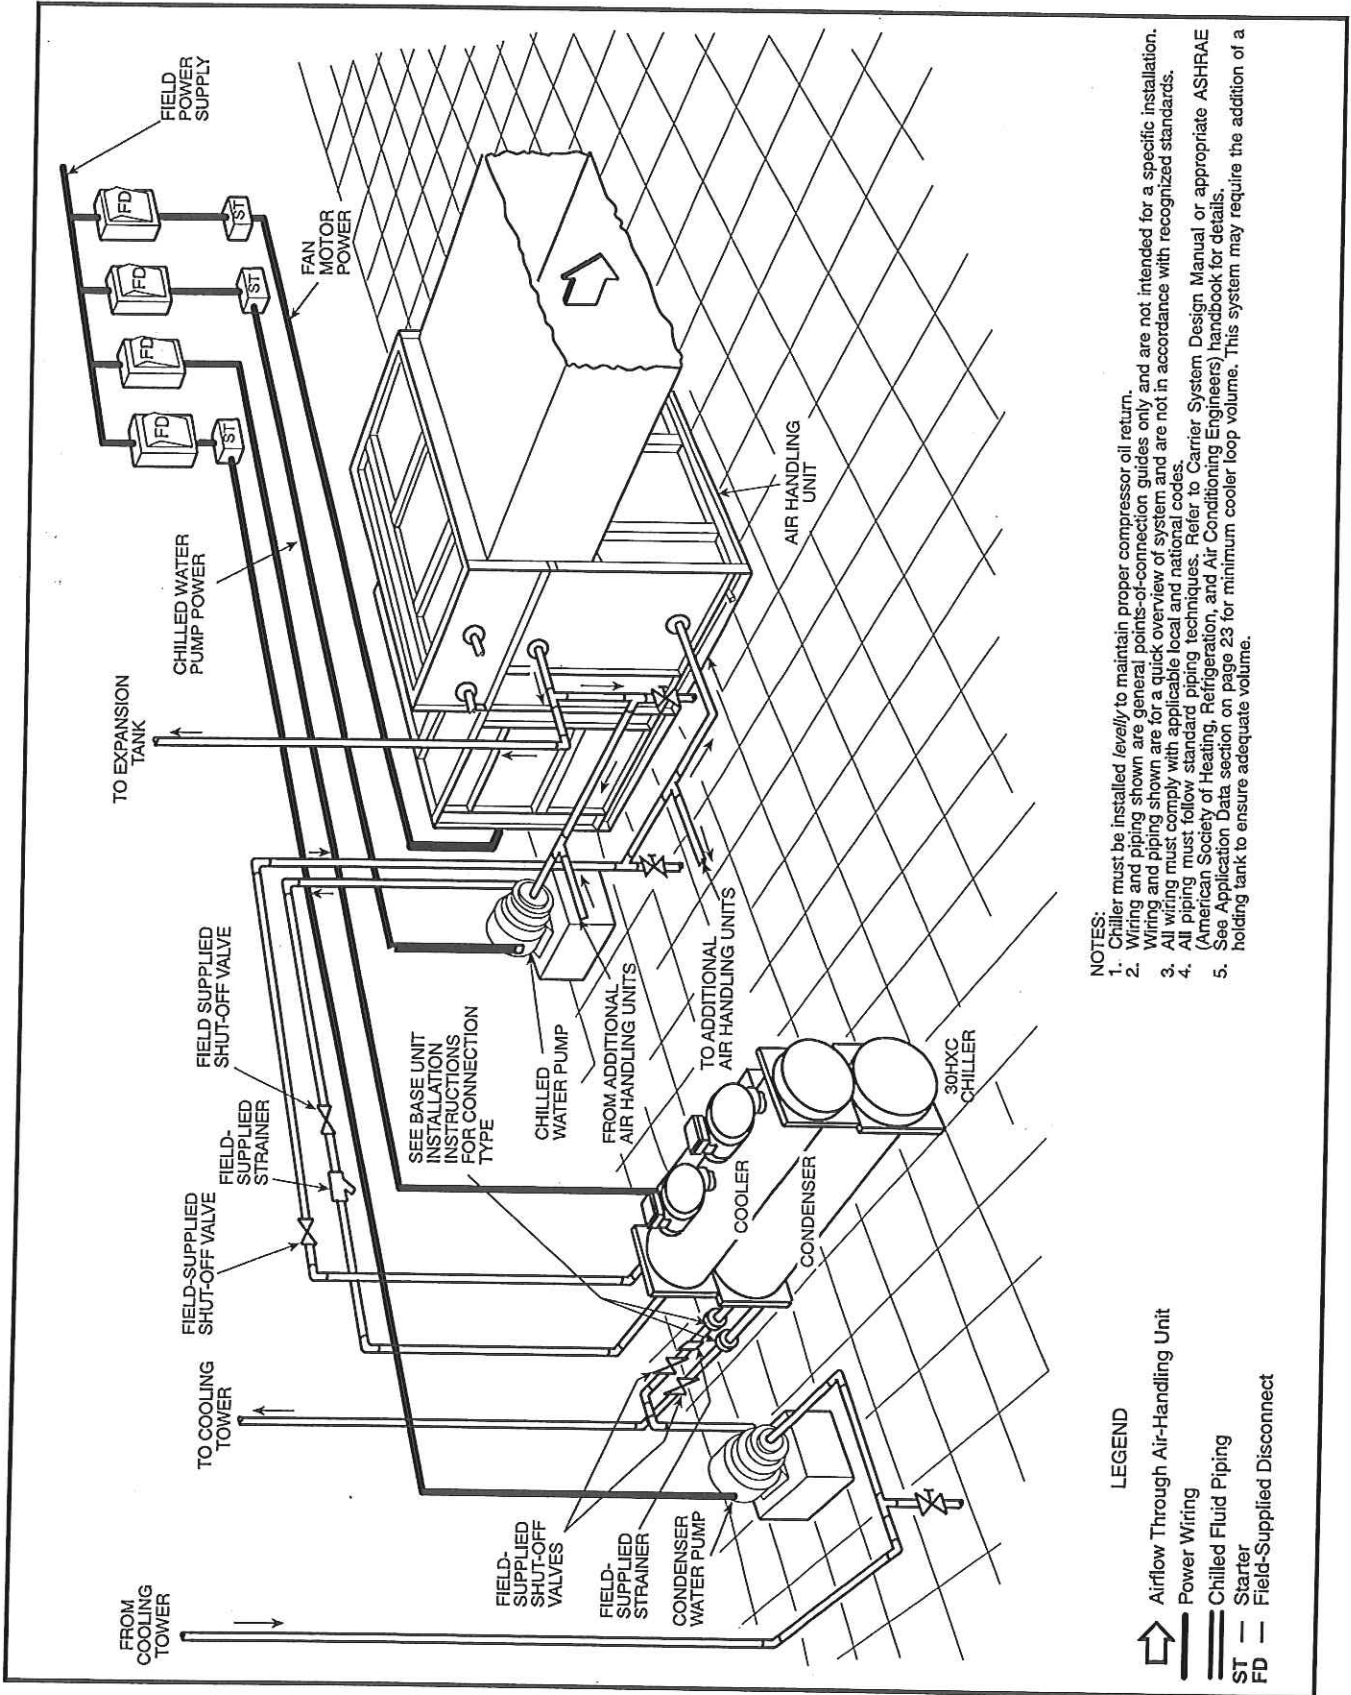

- NOTES:**
1. Chiller must be installed level to maintain proper compressor oil return.
 2. Wiring and piping shown are general points-of-connection guides only and are not intended for a specific installation. Wiring and piping shown are for a quick overview of system and are not in accordance with recognized standards.
 3. All wiring must comply with applicable local and national codes.
 4. All piping must follow standard piping techniques. Refer to Carrier System Design Manual or appropriate ASHRAE (American Society of Heating, Refrigeration, and Air Conditioning Engineers) handbook for details.
 5. See Application Data section on page 23 for minimum cooler loop volume. This system may require the addition of a holding tank to ensure adequate volume.

LEGEND


- Airflow Through Air-Handling Unit
- Power Wiring
- Chilled Fluid Piping
- Starter
- Field-Supplied Disconnect

Typical piping and wiring (cont)




POWER AND CONTROL WIRING

NON-FUSED DISCONNECT OPTION

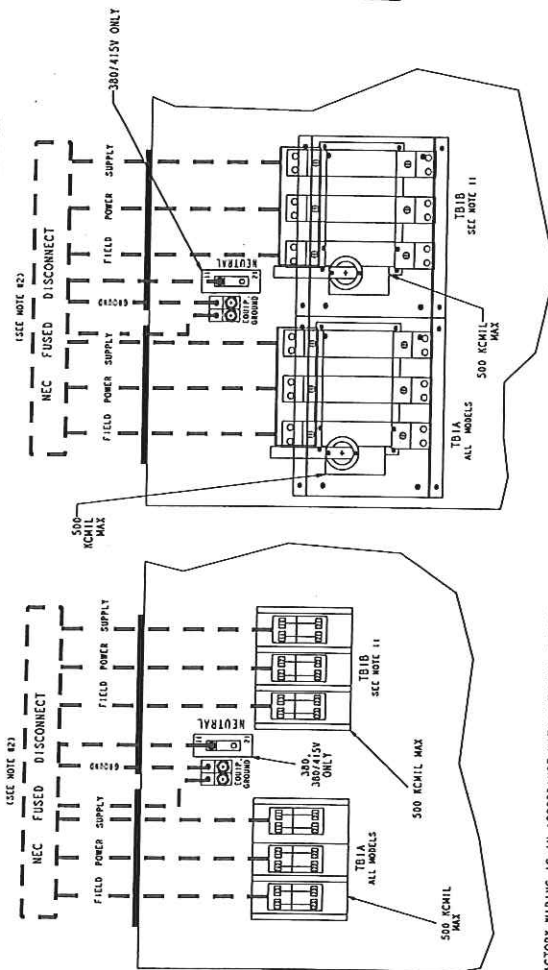


- FACTORY WIRING IS IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (NEC). FIELD MODIFICATIONS OR ADDITIONS MUST BE IN COMPLIANCE WITH ALL APPLICABLE CODES.
- WIRING FOR MAIN FIELD SUPPLY MUST BE RATED TO THE MINIMUM USE COPPER FOR ALL UNITS.
- MAXIMUM INCOMING WIRE SIZE FOR EACH TERMINAL BLOCK IS 3000 KCMIL.
- POWER FOR CONTROL CIRCUIT SHOULD BE SUPPLIED FROM A SEPARATE SOURCE (EXCEPT 380/415V UNITS) THROUGH A FIELD SUPPLIED DISCONNECT WITH 15 AMP MAXIMUM PROTECTION FOR 230 VOLT CONTROL CIRCUIT. CONNECT CONTROL CIRCUIT POWER TO TERMINALS 13 AND 14. TERMINALS 13 AND 14 OF TBS ARE FOR FIELD EXTERNAL CONNECTION FOR REMOTE ON-OFF. THE CONTACTS MUST BE RATED FOR DRY CIRCUIT APPLICATION CAPABLE OF HANDLING A 24V AC LOAD UP TO 50 MA.
- TERMINALS 1 & 2 OF TBS ARE FOR CHILLED WATER PUMP INTERLOCK (CWPI) FUNCTIONS. IF ADDED, CHILLED WATER PUMP INTERLOCK CONTACTS MUST BE RATED FOR DRY CIRCUIT APPLICATION CAPABLE OF HANDLING A SERIES WITH FLOW SWITCH CONTACTS. THE CONTACTS MUST BE RATED FOR DRY CIRCUIT APPLICATION CAPABLE OF HANDLING A 24V AC TO 50 MA LOAD. CHILLED WATER FLOW SWITCH (CWFS) IS FACTORY INSTALLED.
- TERMINALS 10 & 12 OF TBS ARE FOR CONTROL OF CHILLED WATER PUMP STARTER. THE MAXIMUM LOAD ALLOWED FOR THE CHILLED WATER PUMP RELAY IS 75 VA SEALED, 360 VA INRUSH AT 115 OR 230 VOLT. FIELD POWER SUPPLY IS NOT REQUIRED.
- TERMINALS 11 & 12 OF TBS ARE FOR ALARM RELAY. THE MAXIMUM LOAD ALLOWED FOR THE ALARM RELAY IS 75 VA SEALED, 360 VA INRUSH AT 115 OR 230 VOLT. FIELD POWER SUPPLY IS NOT REQUIRED.
- TERMINAL 7 & 9 OF TBE ARE FOR CONDENSER WATER PUMP (CWP) CIRCUIT A CONDENSER FAN CONTACTOR (CFA) ONLY. TERMINALS 8 & 9 OF TBE ARE FOR CIRCUIT B CONDENSER FAN CONTACTOR (CFB) ONLY. CIRCUIT A OR CIRCUIT B IS NOT REQUIRED. LIQUID LINE SOLENOID VALVES (FACTORY WIRED 30KHZ BRINE). THE MAXIMUM LOAD ALLOWED IS 75VA SEALED 360VA INRUSH AT 115 OR 230 VOLT. FIELD POWER SUPPLY IS NOT REQUIRED. LIQUID LINE SOLENOID VALVES (30KHZ ONLY) MUST BE CONNECTED IN PARALLEL WITH CONDENSER FAN CONTACTORS AS SHOWN.
- TERMINALS 5 & 6 OF TBE ARE FOR CONDENSER FLOW SWITCH (CFS) OF CONDENSER PUMP INTERLOCK (CPI).
- TERMINALS 3 & 4 OF TBE ARE FOR CONDENSER FLOW SWITCH (CFS) OF CONDENSER PUMP INTERLOCK (CPI).
- MAKE APPROPRIATE CONNECTIONS TO TBE AS SHOWN FOR ENERGY MANAGEMENT BOARD OPTIONS. THE CONTACTS FOR DEMAND LIMIT AND ICE DOME OPTIONS MUST BE RATED FOR DRY CIRCUIT APPLICATION CAPABLE OF HANDLING A 24V AC LOAD UP TO 50 MA.
- TBE18 SUPPLIED ON 30KHZ/230V T-BETA, 30KHZ/230V Y-BETA, AND BY SPECIAL ORDER.

STANDARD POWER

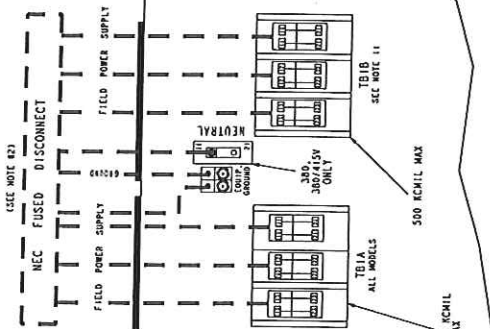

POWER AND CONTROL WIRING

NON-FUSED DISCONNECT OPTION

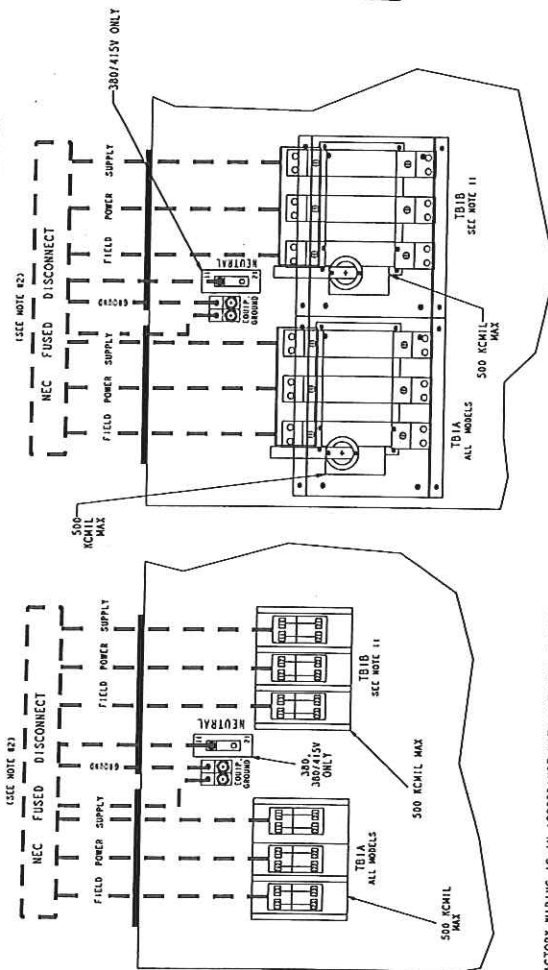

- LEGEND**
- CWPI — Chilled Water Pump Interlock
 - EMM — Energy Management Module
 - EWT — Entering Water Temperature
 - FLOP — Factory-installed Option
 - LLSV — Liquid Line Solenoid Valve
 - LWT — Leaving Water Temperature
 - NEC — National Electrical Code

- A — Alarm
- CFR — Condenser Fan Relay
- CNFS — Condenser Flow Switch
- CNPI — Condenser Pump Interlock
- CWFS — Chilled Water Flow Switch
- CWP — Chilled Water Pump

- OAT — Outdoor Air Temperature
- SPT — Space Temperature
- TB — Terminal Block
- — Factory-installed Wiring
- — Field Control Wiring
- — Field Power Wiring

Electrical data



ELECTRICAL DATA, 30HXC UNITS

UNIT 30HXC	UNIT VOLTAGE			POWER SUPPLY QTY. REQD.	NO. POWER SUPPLY CONDUCTORS	UNIT VOLTAGE						CONTROL CIRCUIT			
	V-Hz (3 Ph)	Supplied				MCA	MOCP	ICF		Rec Fuse Size		V-Hz (Single Ph)	Supplied		MCA and MOCP
		Min	Max					XL	WD	XL	WD		Min	Max	
076	230-60	207	253	1	3	198.7	250	—	297.3	—	225	115-60	104	127	15
	208/230-60	187	253	1	3	220.7	300	—	307.1	—	250	115-60	104	127	15
	460-60	414	506	1	3	99.7	125	374.3	148.3	125	125	115-60	104	127	15
	575-60	518	633	1	3	79.7	110	299.4	118.4	90	90	115-60	104	127	15
	380-60	342	418	1	3	120.8	150	418.7	168.7	150	150	230-60	207	254	15
	380/415-50	342	440	1	3	125.6	175	399.8	164.8	150	150	230-50	198	254	15
230-50	207	253	1	3	207.2	250	—	266.1	—	250	230-50	207	254	15	
086	230-60	207	253	1	3	221.7	300	—	297.3	—	250	115-60	104	127	15
	208/230-60	187	253	1	3	246.4	350	—	307.1	—	300	115-60	104	127	15
	460-60	414	506	1	3	111.3	150	374.3	148.3	125	125	115-60	104	127	15
	575-60	518	633	1	3	88.9	125	299.4	118.4	100	100	115-60	104	127	15
	380-60	342	418	1	3	134.8	175	418.7	168.7	175	175	230-60	207	254	15
	380/415-50	342	440	1	3	140.4	200	478.8	189.8	175	175	230-50	198	254	15
230-50	207	253	1	3	231.9	300	—	305.1	—	300	230-50	207	254	15	
096	230-60	207	253	1	3	251.3	350	—	344.3	—	300	115-60	104	127	15
	208/230-60	187	253	1	3	279.2	400	—	354.1	—	350	115-60	104	127	15
	460-60	414	506	1	3	126.2	175	449.3	172.3	150	150	115-60	104	127	15
	575-60	518	633	1	3	100.8	150	359.4	137.4	125	125	115-60	104	127	15
	380-60	342	418	1	3	152.7	225	501.7	194.7	175	175	230-60	207	254	15
	380/415-50	342	440	1	3	157.9	225	561.8	215.8	200	200	230-50	198	254	15
230-50	207	253	1	3	260.7	350	—	347.1	—	300	230-50	207	254	15	
106	230-60	207	253	1	3	285.6	400	—	395.3	—	350	115-60	104	127	15
	208/230-60	187	253	1	3	317.4	450	—	405.1	—	400	115-60	104	127	15
	460-60	414	506	1	3	143.3	200	529.3	197.3	175	175	115-60	104	127	15
	575-60	518	633	1	3	114.5	175	423.4	158.4	150	150	115-60	104	127	15
	380-60	342	418	1	3	173.6	250	589.7	222.7	200	200	230-60	207	254	15
	380/415-50	342	440	1	3	178.1	250	660.8	246.8	225	225	230-50	198	254	15
230-50	207	253	1	3	294.2	450	—	397.1	—	350	230-50	207	254	15	
116	230-60	207	253	1	3	304.1	450	—	413.7	—	350	115-60	104	127	15
	208/230-60	187	253	1	3	337.9	500	—	425.6	—	400	115-60	104	127	15
	460-60	414	506	1	3	152.6	225	538.6	206.6	175	175	115-60	104	127	15
	575-60	518	633	1	3	121.9	175	430.8	165.8	150	150	115-60	104	127	15
	380-60	342	418	1	3	184.8	250	600.9	233.9	225	225	230-60	207	254	15
	380/415-50	342	440	1	3	190.0	250	672.7	258.7	225	225	230-50	198	254	15
230-50	207	253	1	3	313.9	450	—	416.8	—	400	230-50	207	254	15	
126	230-60	207	253	1	3	327.7	450	—	437.4	—	400	115-60	104	127	15
	208/230-60	187	253	1	3	364.2	500	—	451.9	—	450	115-60	104	127	15
	460-60	414	506	1	3	164.5	225	550.5	218.5	200	200	115-60	104	127	15
	575-60	518	633	1	3	131.4	175	440.3	175.3	150	150	115-60	104	127	15
	380-60	342	418	1	3	199.1	250	615.2	248.2	225	225	230-60	207	254	15
	380/415-50	342	440	1	3	204.0	300	686.7	272.7	250	250	230-50	198	254	15
230-50	207	253	1	3	337.0	450	—	439.9	—	400	230-50	207	254	15	
136	230-60	207	253	1	3	366.7	500	—	497.4	—	450	115-60	104	127	15
	208/230-60	187	253	1	6	407.4	600	—	511.9	—	500	115-60	104	127	15
	460-60	414	506	1	3	183.8	250	645.5	248.5	225	225	115-60	104	127	15
	575-60	518	633	1	3	147.1	200	536.3	199.3	175	175	115-60	104	127	15
	380-60	342	418	1	3	222.8	300	720.2	282.2	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	230.2	300	796.7	307.7	300	300	230-50	198	254	15
230-50	207	253	1	6	380.3	500	—	495.9	—	450	230-50	207	254	15	
146	230-60	207	253	1	6	394.1	500	—	524.9	—	450	115-60	104	127	15
	208/230-60	187	253	1	6	437.9	600	—	542.4	—	500	115-60	104	127	15
	460-60	414	506	1	3	197.5	250	659.2	262.2	225	225	115-60	104	127	15
	575-60	518	633	1	3	158.1	225	547.3	210.3	200	200	115-60	104	127	15
	380-60	342	418	1	3	239.5	350	736.9	298.9	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	246.3	350	812.8	323.8	300	300	230-50	198	254	15
230-50	207	253	1	6	407.1	600	—	522.7	—	500	230-50	207	254	15	
161	230-60	207	253	1	6	398.7	600	—	574.8	—	500	115-60	104	127	15
	208/230-60	187	253	1	6	443.0	600	—	590.6	—	600	115-60	104	127	15
	460-60	414	506	1	3	200.1	300	756.2	287.2	250	250	115-60	104	127	15
	575-60	518	633	1	3	159.9	225	604.9	229.9	200	200	115-60	104	127	15
	380-60	342	418	1	3	242.2	350	843.2	325.2	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	249.0	350	944.2	358.2	300	300	230-50	198	254	15
230-50	207	253	1	6	411.3	600	—	577.7	—	500	230-50	207	254	15	

Electrical data (cont)



ELECTRICAL DATA, 30HXC UNITS (cont)

UNIT 30HXC	UNIT VOLTAGE			POWER SUPPLY QTY. REQD.	NO. POWER SUPPLY CONDUCTORS	UNIT VOLTAGE						CONTROL CIRCUIT			
	V-Hz (3 Ph)	Supplied				MCA	MOCP	ICF		Rec Fuse Size		V-Hz (Single Ph)	Supplied		MCA and MOCP
		Min	Max					XL	WD	XL	WD		Min	Max	
171	230-60	207	253	1	6	428.4	600	—	604.5	—	500	115-60	104	127	15
	208/230-60	187	253	1	6	476.0	700	—	623.6	—	600	115-60	104	127	15
	460-60	414	506	1	3	215.0	300	771.1	302.1	250	250	115-60	104	127	15
	575-60	518	633	1	3	171.8	250	616.8	241.8	200	200	115-60	104	127	15
	380-60	342	418	1	3	260.2	350	861.2	343.2	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	266.6	350	961.8	375.8	300	300	230-50	198	254	15
	230-50	207	253	1	6	440.4	600	—	606.8	—	500	230-50	207	254	15
186	230-60	207	253	1	6	462.3	600	—	638.5	—	600	115-60	104	127	15
	208/230-60	187	253	1	6	513.7	700	—	661.3	—	600	115-60	104	127	15
	460-60	414	506	1	3	232.0	300	788.1	319.1	300	300	115-60	104	127	15
	575-60	518	633	1	3	185.4	250	630.4	255.4	225	225	115-60	104	127	15
	380-60	342	418	1	3	280.8	400	881.8	363.8	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	289.4	400	984.6	398.6	350	350	230-50	198	254	15
	230-50	207	253	1	6	478.1	600	—	644.5	—	600	230-50	207	254	15
206	230-60	207	253	1	6	524.5	700	—	700.7	—	600	115-60	104	127	15
	208/230-60	187	253	1	6	582.8	800	—	730.4	—	700	115-60	104	127	15
	460-60	414	506	1	3	263.2	350	819.3	350.3	300	300	115-60	104	127	15
	575-60	518	633	1	3	210.4	250	655.4	280.4	250	250	115-60	104	127	15
	380-60	342	418	1	3	318.6	400	919.6	401.6	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	326.8	450	1022.0	436.0	400	400	230-50	198	254	15
	230-50	207	253	1	6	539.8	700	—	706.2	—	600	230-50	207	254	15
246	230-60	207	253	1	6	604.1	800	—	780.3	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	671.3	800	—	818.9	—	800	115-60	104	127	15
	460-60	414	506	1	3	303.2	400	859.3	390.3	350	350	115-60	104	127	15
	575-60	518	633	1	3	242.3	300	687.3	312.3	300	300	115-60	104	127	15
	380-60	342	418	1	3	367.0	450	968.0	450.0	400	400	230-60	207	254	15
	380/415-50	342	440	1	3	377.6	500	1072.8	486.8	450	450	230-50	198	254	15
	230-50	207	253	1	6	623.8	800	—	790.2	—	700	230-50	207	254	15
261	230-60	207	253	1	6	633.8	800	—	810.0	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	704.3	800	—	851.9	—	800	115-60	104	127	15
	460-60	414	506	1	3	318.1	400	874.2	405.2	350	350	115-60	104	127	15
	575-60	518	633	1	3	254.2	300	699.2	324.2	300	300	115-60	104	127	15
	380-60	342	418	1	6	385.0	500	986.0	468.0	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	395.2	500	1090.4	504.4	450	450	230-50	198	254	15
	230-50	207	253	1	6	652.9	800	—	819.3	—	800	230-50	207	254	15
271	230-60	207	253	1	6	667.8	800	—	843.9	—	800	115-60	104	127	15
	208/230-60	187	253	1	6	742.0	800	—	889.6	—	800	115-60	104	127	15
	460-60	414	506	1	3	335.1	400	891.2	422.2	400	400	115-60	104	127	15
	575-60	518	633	1	3	267.8	350	712.8	337.8	300	300	115-60	104	127	15
	380-60	342	418	1	6	405.6	500	1006.6	488.6	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	418.0	500	1113.2	527.2	500	500	230-50	198	254	15
	230-50	207	253	1	6	690.6	800	—	857.0	—	800	230-50	207	254	15

LEGEND

- ICF — Maximum Instantaneous Current Flow during start-up (the point in the starting sequence where the sum of the LRA for the start-up compressor, plus the total RLA for all running compressors is at a maximum)
- LRA — Locked Rotor Amps
- MCA — Minimum Circuit Ampacity (for wire sizing)
- MOCP — Maximum Overcurrent Protection
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

3. Maximum incoming wire size for each terminal block is 500 kcmil.
4. Maximum allowable phase imbalance is: voltage, 2%; amps, 5%.
5. Use copper conductors only.
6. The MOCP is calculated as follows:

MOCP = (2.25) (largest RLA) + the sum of the other RLAs. Size the fuse one size down from the result. The RLAs are listed on the nameplate.

The recommended fuse size in amps (RFA) is calculated as follows:

RFA = (1.50) (largest RLA) + the sum of the other RLAs. Size the fuse one size up from the result. The RLAs are listed on the nameplate.

NOTES:

- Each main power source must be supplied from a field-supplied fused electrical service with a (factory-installed or field-installed) disconnect located in sight from the unit.
- Control circuit power must be supplied from a separate source through a field-supplied disconnect (except for 380/415-50 units). An accessory control transformer may be used to provide control circuit power from the main unit power supply.





ELECTRICAL DATA, 30HX-A UNITS

UNIT 30HX-A	UNIT VOLTAGE			POWER SUPPLY QTY. REQD.	NO. POWER SUPPLY CONDUCTORS	UNIT VOLTAGE						CONTROL CIRCUIT			
	V-Hz (3 Ph)	Supplied				MCA	MOCP	ICF		Rec Fuse Size		V-Hz (Single Ph)	Supplied		MCA and MOCP
		Min	Max					XL	WD	XL	WD		Min	Max	
076	230-60	207	253	1	3	291.2	400	—	436.4	—	350	115-60	104	127	15
	208/230-60	187	253	1	3	323.6	450	—	450.8	—	400	115-60	104	127	15
	460-60	414	506	1	3	146.0	200	549.9	217.9	175	175	115-60	104	127	15
	575-60	518	633	1	3	116.8	150	439.9	174.9	150	150	115-60	104	127	15
	380-60	342	418	1	3	177.1	250	614.7	247.7	200	200	230-60	207	254	15
	380/415-50	342	440	1	3	183.4	250	686.5	272.5	225	225	230-50	198	254	15
230-50	207	253	1	3	303.3	400	—	439.8	—	350	230-50	207	254	15	
086	230-60	207	253	1	3	322.8	450	—	496.4	—	400	115-60	104	127	15
	208/230-60	187	253	1	3	358.7	500	—	510.8	—	450	115-60	104	127	15
	460-60	414	506	1	3	161.9	225	644.9	247.9	200	200	115-60	104	127	15
	575-60	518	633	1	3	129.5	175	535.9	198.9	150	150	115-60	104	127	15
	380-60	342	418	1	3	196.2	250	719.7	281.7	225	225	230-60	207	254	15
	380/415-50	342	440	1	3	205.5	300	796.5	307.5	250	250	230-50	198	254	15
230-50	207	253	1	3	339.7	500	—	495.8	—	400	230-50	207	254	15	
096	230-60	207	253	1	3	365.4	500	—	562.4	—	450	115-60	104	127	15
	208/230-60	187	253	1	6	406.1	600	—	576.8	—	500	115-60	104	127	15
	460-60	414	506	1	3	183.4	250	749.9	280.9	225	225	115-60	104	127	15
	575-60	518	633	1	3	146.5	200	599.9	224.9	175	175	115-60	104	127	15
	380-60	342	418	1	3	222.1	300	835.7	317.7	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	231.4	350	937.5	351.5	300	300	230-50	198	254	15
230-50	207	253	1	6	382.6	500	—	566.8	—	450	230-50	207	254	15	
106	230-60	207	253	1	6	416.9	600	—	647.4	—	500	115-60	104	127	15
	208/230-60	187	253	1	6	463.2	700	—	661.8	—	600	115-60	104	127	15
	460-60	414	506	1	3	209.2	300	884.9	323.9	250	250	115-60	104	127	15
	575-60	518	633	1	3	167.2	250	707.9	258.9	200	200	115-60	104	127	15
	380-60	342	418	1	3	253.3	350	984.7	364.7	300	300	230-60	207	254	15
	380/415-50	342	440	1	3	263.3	400	1041.5	384.5	300	300	230-50	198	254	15
230-50	207	253	1	6	435.1	600	—	619.8	—	500	230-50	207	254	15	
116	230-60	207	253	1	6	442.1	600	—	672.7	—	500	115-60	104	127	15
	208/230-60	187	253	1	6	491.3	700	—	689.9	—	600	115-60	104	127	15
	460-60	414	506	1	3	221.9	300	897.6	336.6	300	300	115-60	104	127	15
	575-60	518	633	1	3	177.4	250	718.1	269.1	225	225	115-60	104	127	15
	380-60	342	418	1	3	268.6	400	1000.0	380.0	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	281.0	400	1059.2	402.2	350	350	230-50	198	254	15
230-50	207	253	1	6	464.2	700	—	648.9	—	600	230-50	207	254	15	
126	230-60	207	253	1	6	476.3	700	—	706.8	—	600	115-60	104	127	15
	208/230-60	187	253	1	6	529.2	700	—	727.8	—	600	115-60	104	127	15
	460-60	414	506	1	3	239.1	350	914.8	353.8	300	300	115-60	104	127	15
	575-60	518	633	1	3	191.0	250	731.7	282.7	225	225	115-60	104	127	15
	380-60	342	418	1	3	289.3	400	1020.7	400.7	350	350	230-60	207	254	15
	380/415-50	342	440	1	3	301.7	400	1079.9	422.9	350	350	230-50	198	254	15
230-50	207	253	1	6	498.5	700	—	683.2	—	600	230-50	207	254	15	
136	230-60	207	253	1	6	539.1	800	—	769.8	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	599.1	800	—	790.8	—	700	115-60	104	127	15
	460-60	414	506	1	3	270.4	400	1014.8	385.8	350	350	115-60	104	127	15
	575-60	518	633	1	3	216.2	300	811.7	308.7	250	250	115-60	104	127	15
	380-60	342	418	1	3	327.5	450	1131.7	435.7	400	400	230-60	207	254	15
	380/415-50	342	440	1	3	343.4	500	1345.9	506.9	400	400	230-50	198	254	15
230-50	207	253	1	6	567.3	800	—	817.2	—	700	230-50	207	254	15	
146	230-60	207	253	1	6	580.3	800	—	811.0	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	644.8	800	—	836.5	—	800	115-60	104	127	15
	460-60	414	506	1	3	291.3	400	1035.4	406.4	350	350	115-60	104	127	15
	575-60	518	633	1	3	232.7	300	828.2	325.2	300	300	115-60	104	127	15
	380-60	342	418	1	3	352.5	500	1156.7	460.7	400	400	230-60	207	254	15
	380/415-50	342	440	1	3	368.9	500	1371.4	532.4	450	450	230-50	198	254	15
230-50	207	253	1	6	609.3	800	—	859.2	—	700	230-50	207	254	15	
161	230-60	207	253	1	6	605.6	800	—	955.3	—	700	115-60	104	127	15
	208/230-60	187	253	1	6	672.9	1000	—	978.9	—	800	115-60	104	127	15
	460-60	414	506	1	3	304.0	450	1281.6	477.6	350	350	115-60	104	127	15
	575-60	518	633	1	3	242.9	350	1025.1	382.1	300	300	115-60	104	127	15
	380-60	342	418	1	3	368.0	500	1428.0	539.0	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	384.9	500	1398.4	533.4	450	450	230-50	198	254	15
230-50	207	253	1	6	635.7	800	—	858.3	—	800	230-50	207	254	15	
171	230-60	207	253	1	6	651.5	800	—	1001.2	—	800	115-60	104	127	15
	208/230-60	187	253	1	6	723.9	1000	—	1029.9	—	1000	115-60	104	127	15
	460-60	414	506	1	3	327.0	450	1304.6	500.6	400	400	115-60	104	127	15
	575-60	518	633	1	3	261.4	350	1043.6	400.6	300	300	115-60	104	127	15
	380-60	342	418	1	6	395.9	500	1455.9	566.9	450	450	230-60	207	254	15
	380/415-50	342	440	1	6	413.2	600	1426.7	561.7	500	500	230-50	198	254	15
230-50	207	253	1	6	682.6	1000	—	905.2	—	800	230-50	207	254	15	

Electrical data (cont)



ELECTRICAL DATA, 30HX A UNITS (cont)

UNIT 30HX A	UNIT VOLTAGE			POWER SUPPLY QTY. REQD.	NO. POWER SUPPLY CONDUCTORS	UNIT VOLTAGE						CONTROL CIRCUIT			
	V-Hz (3 Ph)	Supplied				MCA	MOCP	ICF		Rec Fuse Size		V-Hz (Single Ph)	Supplied		MCA and MOCP
		Min	Max					XL	WD	XL	WD		Min	Max	
186	230-60	207	253	1	6	707.9	1000	—	1057.6	—	800	115-60	104	127	15
	208/230-60	187	253	1	6	437.0	700	—	743.0	—	600	115-60	104	127	15
	Ckt A	187	253	1	6	437.0	700	—	743.0	—	600				
	Ckt B	187	253	1	6	437.0	700	—	743.0	—	600				
	460-60	414	506	1	3	355.3	500	1332.9	528.9	400	400	115-60	104	127	15
	575-60	518	633	1	3	284.0	400	1066.2	423.2	350	350	115-60	104	127	15
	380-60	342	418	1	6	430.2	600	1490.2	601.2	500	500	230-60	207	254	15
	380/415-50	342	440	1	6	452.7	600	1466.2	601.2	600	600	230-50	198	254	15
230-50	207	253	1	6	747.7	1000	—	970.3	—	1000	230-50	207	254	15	
206	230-60	207	253	1	6	468.6	700.0	—	726.8	—	600	115-60	104	127	15
	Ckt A	207	253	1	6	468.6	700.0	—	726.8	—	600				
	Ckt B	207	253	1	3	379.8	600.0	—	743.0	—	500				
	208/230-60	187	253	1	6	520.6	800.0	—	743.0	—	600	115-60	104	127	15
	Ckt A	187	253	1	6	520.6	800.0	—	743.0	—	600				
	Ckt B	187	253	1	6	422.0	700.0	—	743.0	—	600				
	460-60	414	506	1	6	400.1	500.0	1377.7	573.7	450	450	115-60	104	127	15
	575-60	518	633	1	3	319.9	400.0	1102.1	459.1	400	400	115-60	104	127	15
	380-60	342	418	1	6	484.4	600.0	1544.4	655.4	600	600	230-60	207	254	15
	380/415-50	342	440	1	6	505.2	700.0	1518.7	653.7	600	600	230-50	198	254	15
	230-50	207	253	1	6	486.0	700.0	—	771.0	—	600	230-50	207	254	15
Ckt A	207	253	1	6	486.0	700.0	—	771.0	—	600					
Ckt B	207	253	1	6	415.4	700.0	—	638.0	—	500					
246	230-60	207	253	1	6	592.1	800.0	—	955.3	—	700	115-60	104	127	15
	Ckt A	207	253	1	6	592.1	800.0	—	955.3	—	700				
	Ckt B	207	253	1	3	379.8	600.0	—	743.0	—	500				
	208/230-60	187	253	1	6	657.9	800.0	—	978.9	—	800	115-60	104	127	15
	Ckt A	187	253	1	6	657.9	800.0	—	978.9	—	800				
	Ckt B	187	253	1	6	422.0	700.0	—	743.0	—	600				
	460-60	414	506	1	6	461.9	600.0	1439.5	635.5	600	600	115-60	104	127	15
	575-60	518	633	1	3	369.1	450.0	1151.3	508.3	450	450	115-60	104	127	15
	380-60	342	418	1	6	559.2	700.0	1619.2	730.2	700	700	230-60	207	254	15
	380/415-50	342	440	1	6	586.1	700.0	1599.6	734.6	700	700	230-50	198	254	15
	230-50	207	253	1	6	635.7	800.0	—	858.3	—	800	230-50	207	254	15
Ckt A	207	253	1	6	635.7	800.0	—	858.3	—	800					
Ckt B	207	253	1	6	415.4	700.0	—	638.0	—	500					
261	230-60	207	253	1	6	638.0	800.0	—	1001.2	—	800	115-60	104	127	15
	Ckt A	207	253	1	6	638.0	800.0	—	1001.2	—	800				
	Ckt B	207	253	1	3	379.8	600.0	—	743.0	—	500				
	208/230-60	187	253	1	6	708.9	1000.0	—	1029.9	—	800	115-60	104	127	15
	Ckt A	187	253	1	6	708.9	1000.0	—	1029.9	—	800				
	Ckt B	187	253	1	6	422.0	700.0	—	743.0	—	600				
	460-60	414	506	1	6	484.9	600.0	1462.5	658.5	600	600	115-60	104	127	15
	575-60	518	633	1	6	387.6	500.0	1169.8	526.8	450	450	115-60	104	127	15
	380-60	342	418	1	6	587.1	700.0	1647.1	758.1	700	700	230-60	207	254	15
	380/415-50	342	440	1	6	614.4	800.0	1627.9	762.9	700	700	230-50	198	254	15
	230-50	207	253	1	6	682.6	1000.0	—	905.2	—	800	230-50	207	254	15
Ckt A	207	253	1	6	682.6	1000.0	—	905.2	—	800					
Ckt B	207	253	1	6	415.4	700.0	—	638.0	—	500					
271	230-60	207	253	1	6	683.6	800.0	—	1046.8	—	800	115-60	104	127	15
	Ckt A	207	253	1	6	683.6	800.0	—	1046.8	—	800				
	Ckt B	207	253	1	3	379.8	600.0	—	743.0	—	500				
	208/230-60	187	253	1	6	759.6	1000.0	—	1080.6	—	1000	115-60	104	127	15
	Ckt A	187	253	1	6	759.6	1000.0	—	1080.6	—	1000				
	Ckt B	187	253	1	6	422.0	700.0	—	743.0	—	600				
	460-60	414	506	1	6	513.2	600.0	1490.8	686.8	600	600	115-60	104	127	15
	575-60	518	633	1	6	410.2	500.0	1192.4	549.4	450	450	115-60	104	127	15
	380-60	342	418	1	6	621.4	800.0	1681.4	792.4	700	700	230-60	207	254	15
	380/415-50	342	440	1	6	653.9	800.0	1667.4	802.4	800	800	230-50	198	254	15
	230-50	207	253	1	6	747.7	1000.0	—	970.3	—	1000	230-50	207	254	15
Ckt A	207	253	1	6	747.7	1000.0	—	970.3	—	1000					
Ckt B	207	253	1	6	415.4	700.0	—	638.0	—	500					

LEGEND

- ICF — Maximum Instantaneous Current Flow during start-up (the point in the starting sequence where the sum of the LRA for the start-up compressor, plus the total RLA for all running compressors is at a maximum)
- LRA — Locked Rotor Amps
- MCA — Minimum Circuit Ampacity (for wire sizing)
- MOCP — Maximum Overcurrent Protection
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

NOTES:

- Each main power source must be supplied from a field-supplied fused electrical service with a (factory-installed or field-installed) disconnect located in sight from the unit.
- Control circuit power must be supplied from a separate source through a field-supplied disconnect (except for 380/415-50 units). An accessory

control transformer may be used to provide control circuit power from the main unit power supply.

- Maximum incoming wire size for each terminal block is 500 kcmil.
- Maximum allowable phase imbalance is: voltage, 2%; amps, 5%.
- Use copper conductors only.
- The MOCP is calculated as follows:

MOCP = (2.25) (largest RLA) + the sum of the other RLAs. Size the fuse one size down from the result. The RLAs are listed on the nameplate.

The recommended fuse size in amps (RFA) is calculated as follows:

RFA = (1.50) (largest RLA) + the sum of the other RLAs. Size the fuse one size up from the result. The RLAs are listed on the nameplate.





COMPRESSOR ELECTRICAL DATA, 30HXC UNITS

UNIT SIZE 30HXC	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
076-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	44.3	330	44.3	330
	575-60	35.4	264	35.4	264
	380-60	53.7	365	53.7	365
	230-50	*	*	*	*
076-WD	380/415-50	55.8	344	55.8	344
	208/230-60	98.1	209	98.1	209
	230-60	88.3	209	88.3	209
	460-60	44.3	104	44.3	104
	575-60	35.4	83	35.4	83
	380-60	53.7	115	53.7	115
086-XL	230-50	92.1	174	92.1	174
	380/415-50	55.8	109	55.8	109
	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	53.6	330	44.3	330
	575-60	42.8	264	35.4	264
086-WD	380-60	64.9	365	53.7	365
	230-50	*	*	*	*
	380/415-50	67.7	423	55.8	344
	208/230-60	118.6	209	98.1	209
	230-60	106.7	209	88.3	209
	460-60	53.6	104	44.3	104
096-XL	575-60	42.8	83	35.4	83
	380-60	64.9	115	53.7	115
	230-50	111.8	213	92.1	174
	380/415-50	67.7	134	55.8	109
	208/230-60	*	*	*	*
	230-60	*	*	*	*
096-WD	460-60	65.5	405	44.3	330
	575-60	52.3	324	35.4	264
	380-60	79.2	448	53.7	365
	230-50	*	*	*	*
	380/415-50	81.7	506	55.8	344
	208/230-60	144.9	256	98.1	209
106-XL	230-60	130.4	256	88.3	209
	460-60	65.5	128	44.3	104
	575-60	52.3	102	35.4	83
	380-60	79.2	141	53.7	115
	230-50	134.9	255	92.1	174
	380/415-50	81.7	160	55.8	109
106-WD	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	79.2	485	44.3	330
	575-60	63.3	388	35.4	264
	380-60	95.9	536	53.7	365
	230-50	*	*	*	*
106-XL	380/415-50	97.8	605	55.8	344
	208/230-60	175.4	307	98.1	209
	230-60	157.9	307	88.3	209
	460-60	79.2	153	44.3	104
	575-60	63.3	123	35.4	83
	380-60	95.9	169	53.7	115
106-WD	230-50	161.7	305	92.1	174
	380/415-50	97.8	191	55.8	109

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.

Electrical data (cont)



COMPRESSOR ELECTRICAL DATA, 30HXC UNITS (cont)

UNIT SIZE 30HXC	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
116-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	79.2	485	53.6	330
	575-60	63.3	388	42.8	264
	380-60	95.9	536	64.9	365
	230-50	*	*	*	*
	380/415-50	97.8	605	67.7	423
116-WD	208/230-60	175.4	307	118.6	209
	230-60	157.9	307	106.7	209
	460-60	79.2	153	53.6	104
	575-60	63.3	123	42.8	83
	380-60	95.9	169	64.9	115
	230-50	161.7	305	111.8	213
	380/415-50	97.8	191	67.7	134
126-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	79.2	485	65.5	405
	575-60	63.3	388	52.3	324
	380-60	95.9	536	79.2	448
	230-50	*	*	*	*
	380/415-50	97.8	605	81.7	506
126-WD	208/230-60	175.4	307	144.9	256
	230-60	157.9	307	130.4	256
	460-60	79.2	153	65.5	128
	575-60	63.3	123	52.3	102
	380-60	95.9	169	79.2	141
	230-50	161.7	305	134.9	255
	380/415-50	97.8	191	81.7	160
136-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	94.6	580	65.5	405
	575-60	75.8	484	52.3	324
	380-60	114.9	641	79.2	448
	230-50	*	*	*	*
	380/415-50	118.8	715	81.7	506
136-WD	208/230-60	210.0	367	144.9	256
	230-60	189.0	367	130.4	256
	460-60	94.6	183	65.5	128
	575-60	75.8	147	52.3	102
	380-60	114.9	203	79.2	141
	230-50	196.3	361	134.9	255
	380/415-50	118.8	226	81.7	160
146-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	94.6	580	79.2	485
	575-60	75.8	484	63.3	388
	380-60	114.9	641	95.9	536
	230-50	*	*	*	*
	380/415-50	118.8	715	97.8	605
146-WD	208/230-60	210.0	367	175.4	307
	230-60	189.0	367	157.9	307
	460-60	94.6	183	79.2	153
	575-60	75.8	147	63.3	123
	380-60	114.9	203	95.9	169
	230-50	196.3	361	161.7	305
	380/415-50	118.8	226	97.8	191

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.



COMPRESSOR ELECTRICAL DATA, 30HXC UNITS (cont)

UNIT SIZE 30HXC	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
161-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	103.1	685	71.2	525
	575-60	82.4	548	56.9	420
	380-60	124.8	757	86.2	580
	230-50	*	*	*	*
	380/415-50	128.6	856	88.2	600
161-WD	208/230-60	228.8	433	157.6	350
	230-60	205.5	433	141.8	350
	460-60	103.1	216	71.2	175
	575-60	82.4	173	56.9	140
	380-60	124.8	239	86.2	193
	230-50	212.5	432	145.7	348
	380/415-50	128.6	270	88.2	200
171-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	86.1	580	103.1	685
	575-60	68.8	484	82.4	548
	380-60	104.2	641	124.8	757
	230-50	*	*	*	*
	380/415-50	105.8	715	128.6	856
171-WD	208/230-60	190.6	367	228.8	433
	230-60	171.5	367	205.5	433
	460-60	86.1	183	103.1	216
	575-60	68.8	147	82.4	173
	380-60	104.2	203	124.8	239
	230-50	174.8	361	212.5	432
	380/415-50	105.8	233	128.6	270
186-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	103.1	685	103.1	685
	575-60	82.4	548	82.4	548
	380-60	124.8	757	124.8	757
	230-50	*	*	*	*
	380/415-50	128.6	856	128.6	856
186-WD	208/230-60	228.8	433	228.8	433
	230-60	205.5	433	205.5	433
	460-60	103.1	216	103.1	216
	575-60	82.4	173	82.4	173
	380-60	124.8	239	124.8	239
	230-50	212.5	432	212.5	432
	380/415-50	128.6	270	128.6	270

LEGEND

- LRA** — Locked Rotor Amps
- RLA** — Rated Load Amps
- WD** — Wye-Delta Start
- XL** — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.

Electrical data (cont)



COMPRESSOR ELECTRICAL DATA, 30HXC UNITS (cont)

UNIT SIZE 30HXC	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS					
		A1		A2		B1	
		RLA	LRA	RLA	LRA	RLA	LRA
206-XL	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	86.1	580	48.2	350	103.1	685
	575-60	68.8	484	38.6	280	82.4	548
	380-60	104.2	641	58.4	390	124.8	757
	230-50	*	*	*	*	*	*
206-WD	380/415-50	105.8	715	55.8	344	128.6	856
	208/230-60	190.6	367	106.8	233	228.8	433
	230-60	171.5	367	96.1	233	205.5	433
	460-60	86.1	183	48.2	117	103.1	216
	575-60	68.8	147	38.6	93	82.4	173
	380-60	104.2	203	58.4	130	124.8	239
246-XL	230-50	174.8	361	99.4	260	212.5	432
	380/415-50	105.8	226	60.2	150	128.6	270
	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	103.1	685	71.2	485	103.1	685
	575-60	82.4	548	56.9	388	82.4	548
246-WD	380-60	124.8	757	86.2	536	124.8	757
	230-50	*	*	*	*	*	*
	380/415-50	128.6	856	88.2	605	128.6	856
	208/230-60	228.8	433	157.6	307	228.8	433
	230-60	205.5	433	141.8	307	205.5	433
	460-60	103.1	216	71.2	153	103.1	216
261-XL	575-60	82.4	173	56.9	123	82.4	173
	380-60	124.8	239	86.2	169	124.8	239
	230-50	212.5	432	145.7	305	212.5	432
	380/415-50	128.6	270	88.2	191	128.6	270
	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
261-WD	460-60	103.1	685	86.1	580	103.1	685
	575-60	82.4	548	68.8	484	82.4	548
	380-60	124.8	757	104.2	641	124.8	757
	230-50	*	*	*	*	*	*
	380/415-50	128.6	856	105.8	715	128.6	856
	208/230-60	228.8	433	190.6	367	228.8	433
271-XL	230-60	205.5	433	171.5	367	205.5	433
	460-60	103.1	216	86.1	183	103.1	216
	575-60	82.4	173	68.8	147	82.4	173
	380-60	124.8	239	104.2	203	124.8	239
	230-50	212.5	432	174.8	361	212.5	432
	380/415-50	128.6	270	105.8	226	128.6	270
271-WD	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	103.1	685	103.1	685	103.1	685
	575-60	82.4	548	82.4	548	82.4	548
	380-60	124.8	757	124.8	757	124.8	757
	230-50	*	*	*	*	*	*
271-XL	380/415-50	128.6	856	128.6	856	128.6	856
	208/230-60	228.8	433	228.8	433	228.8	433
	230-60	205.5	433	205.5	433	205.5	433
	460-60	103.1	216	103.1	216	103.1	216
	575-60	82.4	173	82.4	173	82.4	173
	380-60	124.8	239	124.8	239	124.8	239
271-WD	230-50	212.5	432	212.5	432	212.5	432
	380/415-50	128.6	270	128.6	270	128.6	270

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.



COMPRESSOR ELECTRICAL DATA, 30HXA UNITS

UNIT SIZE 30HXA	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
076-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	64.9	485	64.9	485
	575-60	51.9	388	51.9	388
	380-60	78.7	536	78.7	536
	230-50	*	*	*	*
076-WD	380/415-50	81.5	605	81.5	605
	208/230-60	143.8	307	143.8	307
	230-60	129.4	307	129.4	307
	460-60	64.9	153	64.9	153
	575-60	51.9	123	51.9	123
	380-60	78.7	169	78.7	169
086-XL	230-50	134.8	305	134.8	305
	380/415-50	81.5	191	81.5	191
	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	77.6	580	64.9	485
	575-60	62.1	484	51.9	388
086-WD	380-60	94.0	641	78.7	536
	230-50	*	*	*	*
	380/415-50	99.2	715	81.5	605
	208/230-60	171.9	367	143.8	307
	230-60	154.7	367	129.4	307
	460-60	77.6	183	64.9	153
096-XL	575-60	62.1	147	51.9	123
	380-60	94.0	203	78.7	169
	230-50	163.9	361	134.8	305
	380/415-50	99.2	226	81.5	191
	208/230-60	*	*	*	*
	230-60	*	*	*	*
096-WD	460-60	94.8	685	64.9	485
	575-60	75.7	548	51.9	388
	380-60	114.7	757	78.7	536
	230-50	*	*	*	*
	380/415-50	119.9	856	81.5	605
	208/230-60	209.8	433	143.8	307
106-XL	230-60	188.8	433	129.4	307
	460-60	94.8	216	64.9	153
	575-60	75.7	173	51.9	123
	380-60	114.7	239	78.7	169
	230-50	198.2	432	134.8	305
	380/415-50	119.9	270	81.5	191
106-WD	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	115.4	820	64.9	485
	575-60	92.2	656	51.9	388
	380-60	139.7	906	78.7	536
	230-50	*	*	*	*
106-XL	380/415-50	145.4	960	81.5	605
	208/230-60	255.5	518	143.8	307
	230-60	230.0	518	129.4	307
	460-60	115.4	259	64.9	153
	575-60	92.2	207	51.9	123
	380-60	139.7	286	78.7	169
106-WD	230-50	240.2	485	134.8	305
	380/415-50	145.4	303	81.5	191

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.

Electrical data (cont)



COMPRESSOR ELECTRICAL DATA, 30HXA UNITS (cont)

UNIT SIZE 30HXA	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
116-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	115.4	820	77.6	580
	575-60	92.2	656	62.1	484
	380-60	139.7	906	94.0	641
	230-50	*	*	*	*
	380/415-50	145.4	960	99.2	715
116-WD	208/230-60	255.5	518	171.9	367
	230-60	230.0	518	154.7	367
	460-60	115.4	259	77.6	183
	575-60	92.2	207	62.1	147
	380-60	139.7	286	94.0	203
	230-50	240.2	485	163.9	361
	380/415-50	145.4	303	99.2	226
126-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	115.4	820	94.8	685
	575-60	92.2	656	75.7	548
	380-60	139.7	906	114.7	757
	230-50	*	*	*	*
	380/415-50	145.4	960	119.9	856
126-WD	208/230-60	255.5	518	209.8	433
	230-60	230.0	518	188.8	433
	460-60	115.4	259	94.8	216
	575-60	92.2	207	75.7	173
	380-60	139.7	286	114.7	239
	230-50	240.2	485	198.2	432
	380/415-50	145.4	303	119.9	270
136-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	140.7	920	94.8	685
	575-60	112.4	736	75.7	548
	380-60	170.2	1017	114.7	757
	230-50	*	*	*	*
	380/415-50	178.8	1226	119.9	856
136-WD	208/230-60	311.4	581	209.8	433
	230-60	280.3	581	188.8	433
	460-60	140.7	291	94.8	216
	575-60	112.4	233	75.7	173
	380-60	170.2	321	114.7	239
	230-50	295.3	619	198.2	432
	380/415-50	178.8	387	119.9	270
146-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	140.7	920	115.4	820
	575-60	112.4	736	92.2	656
	380-60	170.2	1017	139.7	906
	230-50	*	*	*	*
	380/415-50	178.8	1226	145.4	960
146-WD	208/230-60	311.4	581	255.5	518
	230-60	280.3	581	230.0	518
	460-60	140.7	291	115.4	259
	575-60	112.4	233	92.2	207
	380-60	170.2	321	139.7	286
	230-50	295.3	619	240.2	485
	380/415-50	178.8	387	145.4	303

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.



COMPRESSOR ELECTRICAL DATA, 30HXA UNITS (cont)

UNIT SIZE 30HXA	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS			
		A1		B1	
		RLA	LRA	RLA	LRA
161-XL	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	157.9	1175	106.6	790
	575-60	126.2	940	85.1	630
	380-60	191.2	1299	129.0	870
	230-50	*	*	*	*
161-WD	380/415-50	201.2	1265	133.4	1045
	208/230-60	349.6	743	235.9	527
	230-60	314.6	743	212.3	527
	460-60	157.9	371	106.6	263
	575-60	126.2	297	85.1	211
	380-60	191.2	410	129.0	290
	230-50	332.3	638	220.3	607
171-XL	380/415-50	201.2	400	133.4	348
	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	129.6	920	157.9	1175
	575-60	103.6	736	126.2	940
	380-60	156.9	1017	191.2	1299
171-WD	230-50	*	*	*	*
	380/415-50	161.7	1226	201.2	1265
	208/230-60	286.9	581	349.6	743
	230-60	258.2	581	314.6	743
	460-60	129.6	291	157.9	371
	575-60	103.6	233	126.2	297
	380-60	156.9	321	191.2	410
186-XL	230-50	267.2	619	332.3	638
	380/415-50	161.7	387	201.2	400
	208/230-60	*	*	*	*
	230-60	*	*	*	*
	460-60	157.9	1175	157.9	1175
	575-60	126.2	940	126.2	940
186-WD	380-60	191.2	1299	191.2	1299
	230-50	*	*	*	*
	380/415-50	201.2	1265	201.2	1265
	208/230-60	349.6	743	349.6	743
	230-60	314.6	743	314.6	743
	460-60	157.9	371	157.9	371
	575-60	126.2	297	126.2	297
186-WD	380-60	191.2	410	191.2	410
	230-50	332.3	638	332.3	638
	380/415-50	201.2	400	201.2	400

LEGEND
 LRA — Locked Rotor Amps
 RLA — Rated Load Amps
 WD — Wye-Delta Start
 XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.

Electrical data (cont)



COMPRESSOR ELECTRICAL DATA, 30HXA UNITS (cont)

UNIT SIZE 30HXA	NAMEPLATE V-Hz (3 Phase)	COMPRESSOR NUMBERS					
		A1		A2		B1	
		RLA	LRA	RLA	LRA	RLA	LRA
206-XL	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	129.6	920	73.1	580	157.9	1175
	575-60	103.6	736	58.5	484	126.2	940
	380-60	156.9	1017	88.5	641	191.2	1299
	230-50	*	*	*	*	*	*
	380/415-50	161.7	1226	92.0	715	201.2	1265
206-WD	208/230-60	286.9	581	162.0	367	337.6	743
	230-60	258.2	581	145.8	367	303.8	743
	460-60	129.6	291	73.1	183	157.9	371
	575-60	103.6	233	58.5	147	126.2	297
	380-60	156.9	321	88.5	203	191.2	410
	230-50	267.2	619	152.0	361	332.3	638
	380/415-50	161.7	387	92.0	226	201.2	400
246-XL	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	157.9	1175	106.6	820	157.9	1175
	575-60	126.2	940	85.1	656	126.2	940
	380-60	191.2	1299	129.0	906	191.2	1299
	230-50	*	*	*	*	*	*
	380/415-50	201.2	1265	133.4	960	201.2	1265
246-WD	208/230-60	337.6	743	235.9	518	337.6	743
	230-60	303.8	743	212.3	518	303.8	743
	460-60	157.9	371	106.6	259	157.9	371
	575-60	126.2	297	85.1	207	126.2	297
	380-60	191.2	410	129.0	286	191.2	410
	230-50	332.3	638	220.3	485	332.3	638
	380/415-50	201.2	400	133.4	303	201.2	400
261-XL	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	157.9	1175	129.6	920	157.9	1175
	575-60	126.2	940	103.6	736	126.2	940
	380-60	191.2	1299	156.9	1017	191.2	1299
	230-50	*	*	*	*	*	*
	380/415-50	201.2	1265	161.7	1226	201.2	1265
261-WD	208/230-60	337.6	743	286.9	581	337.6	743
	230-60	303.8	743	258.2	581	303.8	743
	460-60	157.9	371	129.6	291	157.9	371
	575-60	126.2	297	103.6	233	126.2	297
	380-60	191.2	410	156.9	321	191.2	410
	230-50	332.3	638	267.2	619	332.3	638
	380/415-50	201.2	400	161.7	387	201.2	400
271-XL	208/230-60	*	*	*	*	*	*
	230-60	*	*	*	*	*	*
	460-60	157.9	1175	157.9	1175	157.9	1175
	575-60	126.2	940	126.2	940	126.2	940
	380-60	191.2	1299	191.2	1299	191.2	1299
	230-50	*	*	*	*	*	*
	380/415-50	201.2	1265	201.2	1265	201.2	1265
271-WD	208/230-60	337.6	743	337.6	743	337.6	743
	230-60	303.8	743	303.8	743	303.8	743
	460-60	157.9	371	157.9	371	157.9	371
	575-60	126.2	297	126.2	297	126.2	297
	380-60	191.2	410	191.2	410	191.2	410
	230-50	332.3	638	332.3	638	332.3	638
	380/415-50	201.2	400	201.2	400	201.2	400

LEGEND

- LRA — Locked Rotor Amps
- RLA — Rated Load Amps
- WD — Wye-Delta Start
- XL — Across-the-Line Start

*Units are shipped with wye-delta start as standard. Across-the-line start is not available.

Controls



The standard microprocessor-based control in the 30HX units provides the following functions:

- leaving fluid temperature control (using both entering and leaving fluid sensors)
- 7-day time sequence of both pump and chiller
- temperature reset from return fluid (standard) or from outdoor ambient (accessory), occupied space temperature (accessory), 4 to 20 mA signal (accessory), or via the optional Carrier Comfort Network (CCN)
- automatic compressor lead-lag switching based on compressor accumulated run times and number of cycles
- automatic temperature range across the cooler adjustment
- fully automatic control of the chiller components


A 4-line, 20-character per line display is used to accomplish the following (see figure below):

- set schedules and set points
- identify operating mode
- display current temperatures and pressures being used by the control for internal calculations
- identify abnormal (alarm or alert) conditions

Sequence of operation

The control has a 44 F (6.2 C) leaving fluid temperature (LWT) set point as shipped from the factory. If temperature reset or demand limiting is in effect, this set point may change.

Start-up — The chiller will start when the circulating pump is energized. (If the flow switch is applied, the chiller starts after the flow has been proven.) The compressor starts unloaded.

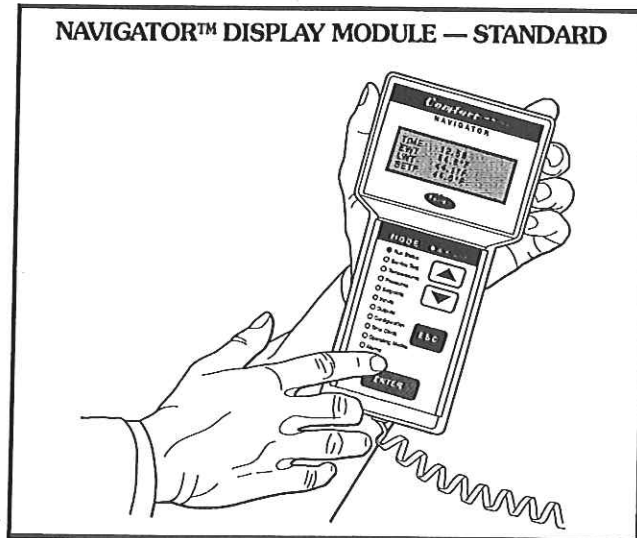

NOTE: Which compressor starts first is determined by the automatic lead/lag feature.

If the entering fluid temperature is 85 F (29 C) or higher, the maximum operating pressure (MOP) feature limits the suction pressure to keep the chiller on line.

Normal operation — The entering fluid temperature sensor monitors changes in entering fluid temperature to anticipate changes in the cooling load. Based on leaving fluid temperature, the control adds or subtracts capacity to maintain a constant leaving fluid temperature.

Dual chiller control — The Dual Chiller Routine is available for the control of two units supplying chilled fluid on a common loop.

In parallel flow applications, an additional leaving fluid temperature thermistor must be installed and connected to the lead chiller.

Transition to off — The chiller unloads once the “time-to-stop” signal has been given. This signal can be either internal or external.

Safeties — The 30HX control as shipped from the factory automatically deenergizes any active compressor that experiences any of the following:

- electrical overload
- thermal overload protection
- high pressure
- low oil pressure
- loss of refrigerant charge
- loss of phase protection
- reverse rotation (control prevents compressor start)
- current imbalance
- ground current
- low chilled fluid temperature

Additional information

Detailed information on controls and operation is available in the Controls, Start-Up, Operation and Troubleshooting guide included with each unit. Packaged Service Training programs are also available. Contact your Carrier representative for more information.

Guide specifications



Water-Cooled and Condenserless HVAC Guide Specifications

Size Range: **75 to 265 Tons (264 to 931 kW)**

Carrier Model Number: **30HXA — Condenserless**
30HXC — Water-Cooled

Part 1 — General

1.01 SYSTEM DESCRIPTION

Microprocessor controlled water-cooled (30HXC) or condenserless (30HXA) liquid chiller utilizing screw compressors and electronic expansion valves.

1.02 QUALITY ASSURANCE

- A. Unit shall be rated in accordance with ARI Standard 550/590-98 (U.S.A.). The 60 Hz 30HXC units shall be ARI certified for performance.
- B. Unit construction shall comply with ASHRAE 15 Safety Code, NEC, and ASME applicable codes (U.S.A. codes).
- C. Unit shall be manufactured at an ISO 9001:2000 registered facility.
- D. 208/230 v, 230 v, 460 v, 575 v, 60 Hz units shall be constructed in accordance with UL or UL Canada standards and shall be tested and listed by ETL or ETL, Canada, as conforming to those standards. Units shall carry the ETL and ETL, Canada, labels.

1.03 DELIVERY, STORAGE, AND HANDLING

- A. Unit controls shall be capable of withstanding 150 F (66 C) storage temperatures in the control compartment.
- B. Unit shall be stored and handled per unit manufacturer's recommendations.

Part 2 — Products

2.01 EQUIPMENT

A. General:

Factory assembled, single-piece, water-cooled (30HXC) or condenserless (30HXA) liquid chiller with dual (2) independent refrigerant circuits. Contained within the unit cabinet shall be all factory wiring, piping, controls, refrigerant charge (HFC-134a) (30HXA units shipped with holding charge only), and special features required prior to field start-up.

B. Compressors:

1. Semi-hermetic twin-screw compressors with internal muffler and check valve.
2. Each compressor shall be equipped with a discharge shutoff valve.

C. Cooler (Evaporator):

1. Shall be tested and stamped in accordance with ASME Code (U.S.A.) for a refrigerant working-side pressure of 220 psig (1408 kPa). Waterside pressure rating shall be 300 psig (2068 kPa). In Canada, maximum waterside pressure shall be 250 psig (1725 kPa), per the Canadian National Registry.

2. Shall be mechanically cleanable shell-and-tube type with removable heads.
3. Tubes shall be internally enhanced, seamless-copper type, and shall be rolled into tube sheets.
4. Shall be equipped with Victaulic fluid connections.
5. Shell shall be insulated with 3/4-in. (19-mm) closed-cell, polyvinyl chloride foam with a maximum K factor of 0.28. Heads may require field insulation.
6. Shall have a cooler drain and vent.
7. Design shall incorporate 2 independent refrigerant circuits.
8. Shall include isolation valves to allow isolation of the refrigerant charge in either the evaporator or the condenser.
9. Shall be equipped with factory-installed thermal dispersion chilled fluid flow switch.

D. Condenser (30HXC units):

1. Shall be tested and stamped in accordance with ASME code (U.S.A.) for a refrigerant working-side pressure of 220 psig (1408 kPa). Waterside pressure rating shall be 300 psig (2068 kPa). In Canada, maximum waterside pressure shall be 250 psig (1725 kPa), per the Canadian National Registry.
2. Shall be mechanically cleanable shell-and-tube type with removable heads.
3. Tubes shall be internally enhanced, seamless-copper type, and shall be rolled into tube sheets.
4. Shall be equipped with Victaulic water connections.
5. Design shall incorporate 2 independent refrigerant circuits.

E. Oil Separator (30HXA Units):

1. Shall be tested and stamped in accordance with ASME Code (U.S.A.) for a refrigerant working-side pressure of 320 psig (2206 kPa).
2. Design shall incorporate 2 independent refrigerant circuits.

F. Refrigeration Components:

Refrigerant circuit components shall include oil separator, high and low side pressure relief devices, discharge and liquid line shutoff valves, filter drier, moisture indicating sight glass, expansion valve, refrigerant economizer (unit sizes 161-271), and complete charge of compressor oil. The 30HXC units shall have a complete operating charge of refrigerant HFC-134a; 30HXA units shall have a holding charge only.



G. Controls, Safeties, and Diagnostics:

1. Controls:

- a. Unit controls shall include the following minimum components:

- 1) Microprocessor with non-volatile memory. Battery backup system shall not be accepted.
- 2) Power and control circuit terminal blocks.
- 3) ON/OFF control switch.
- 4) Replaceable solid-state relay panels.
- 5) Thermistor installed to measure saturated condensing temperature, cooler saturation temperature, compressor return gas temperature, and cooler entering and leaving fluid temperatures.
- 6) Chilled fluid flow switch.

- b. Unit controls shall include the following functions as standard:

- 1) Automatic circuit lead/lag.
- 2) Capacity control based on leaving chilled fluid temperature and compensated by rate of change of return-fluid temperature with temperature setpoint accuracy to 0.1 ° F (0.06° C).
- 3) Limiting the chilled fluid temperature pull-down rate at start-up to an adjustable range of 0.2° F to 2° F (0.11° C to 1.1° C) per minute to prevent excessive demand spikes at start-up.
- 4) Seven-day time schedule.
- 5) Leaving chilled fluid temperature reset from return fluid, outdoor-air temperature, space temperature, or 4 to 20 mA input.
- 6) Demand limit control with 2-stage control (0 to 100% each) or through 4 to 20 mA input (0 to 100%).
- 7) Chilled and condenser water pump start/stop control.
- 8) Dual chiller control for series chiller applications without addition of hardware modules or additional thermistors.
- 9) Dual chiller control for parallel flow applications use one additional sensor.
- 10) Amperage readout per compressor with %MTA per compressor.

- c. The control panel shall include, as standard, a portable hand held display module with a minimum of 4 lines and 20 characters per line, of clear English, Spanish, Portuguese or French language. Display menus shall provide clear language descriptions of all menu items, operating modes, configuration points and alarm diagnostics. Reference to factory codes shall not be accepted. An industrial grade coiled extension cord shall allow the display module to be moved around the chiller. Magnets shall hold the display module to any sheet metal panel to

allow hands-free operation. Display module shall have NEMA 4x housing suitable for use in outdoor environments. Display shall have back light and contrast adjustment for easy viewing in bright sunlight or night conditions. The display module shall have raised surface buttons with positive tactile response.

- d. The chiller controller shall include multiple connection ports for communicating with the local equipment network, the Carrier Comfort Network (CCN) and the ability to access all chiller control functions from any point on the chiller.

- e. The control system shall allow software upgrade without the need for new hardware modules.

2. Safeties:

Unit shall be equipped with thermistors and all necessary components in conjunction with the control system to provide the unit with the following protections:

- a. Loss of refrigerant charge.
- b. Reverse rotation.
- c. Low chilled fluid temperature.
- d. Low oil pressure (each compressor circuit).
- e. Voltage imbalance.
- f. Ground current fault.
- g. Thermal overload.
- h. High pressure.
- i. Electrical overload.
- j. Loss of phase.
- k. Current imbalance.
- l. Loss of flow.

3. Diagnostics:

- a. The display module shall be capable of indicating the safety lockout condition by displaying the information in clear language at the display. Information included for display shall be:

- 1) Compressor lockout.
- 2) Loss of charge.
- 3) Low fluid flow.
- 4) Low oil pressure.
- 5) Cooler freeze protection.
- 6) High or low suction superheat.
- 7) Thermistor malfunction.
- 8) Entering and leaving-fluid temperature.
- 9) Evaporator and condenser pressure.
- 10) Electronic expansion valve positions.
- 11) All set points.
- 12) Time of day.

Guide specifications (cont)



- b. Display module, in conjunction with the microprocessor, must also be capable of displaying the output results of a service test. Service test shall verify operation of every switch, thermistor, and compressor before chiller is started. User shall be able to force each output device.
 - c. Diagnostics shall include the ability to review a list of the 20 most recent alarms with clear language descriptions of the alarm event. Display of alarm codes without the ability for clear language descriptions shall be prohibited.
 - d. An alarm history buffer shall allow the user to store no less than 20 alarm events with clear language descriptions, time and date stamp event entry.
- H. Operating Characteristics:
Unit shall be capable of starting up with 95 F (35 C) entering fluid temperature to the cooler.
- I. Electrical Requirements:
- 1. Unit primary electrical power supply shall enter the unit at a single location (some units have multiple power poles).
 - 2. Unit shall operate on 3-phase power at the voltage shown in the equipment schedule.
 - 3. Control voltage shall be 115-v (60 Hz) or 230-v (50 Hz), single-phase, separate power supply.
 - 4. Unit shall be shipped with factory control and power wiring installed.
- J. Special Features:
Certain standard features are not applicable when the features designated by * are specified. For assistance in amending the specifications, contact your local Carrier Sales office.
- * 1. Wye-Delta Starter:
Unit shall have a factory-installed, Wye-Delta starter to minimize electrical inrush current.
 - 2. Sound Reduction Enclosure:
Unit shall have field-installed sound reduction enclosure which covers the entire unit to muffle compressor noise.
 - 3. Vibration Isolation:
Unit shall be supplied with rubber-in-shear vibration isolators for field installation.
- 4. Control Power Transformer:
Unit shall be supplied with a field-installed transformer that will supply control circuit power from the main unit power supply.
 - 5. Temperature Reset Sensor:
Unit shall reset leaving chilled fluid temperature based on outdoor ambient temperature or space temperature when this sensor is installed.
 - * 6. Brine Option:
Unit shall be factory modified to start and operate at leaving chilled fluid temperatures of between 15 F (-9 C) and 40 F (4.4 C).
 - * 7. Minimum Load Control:
Unit shall be equipped with factory (or field) installed, microprocessor-controlled, minimum load control that shall permit unit operation down to 10% of full capacity.
 - 8. Multi-Chiller Control:
Control shall enable management of multiple parallel chillers (up to 8) or two (2) chillers in series in a single system.
 - 9. Minus-One-Pass Cooler:
Factory-installed option shall reduce pressure drop for high flow applications. Shall also provide same end inlet and outlet for 076-106 sizes and opposite end inlet for 116-271 sizes.
 - 10. Plus-One-Pass Cooler:
Factory-installed option shall enhance low temperature brine performance.
 - 11. Suction Service Valves:
Unit shall be supplied with factory-installed suction service valves.
 - 12. Cooler Head Insulation:
Unit shall be supplied with field-installed cooler insulation that shall cover the cooler heads.
 - 13. Energy Management Module:
A factory or field installed module shall provide the following energy management capabilities: 4 to 20 mA signals for leaving fluid temperature reset, cooling set point reset or demand limit control; 2-point demand limit control (from 0 to 100%) activated by a remote contact closure; and discrete input for "Ice Done" indication for ice storage system interface.

Carrier Corporation • Syracuse, New York 13221

1-04



Carrier

A United Technologies Company

Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.

Book 2
Tab 5c

New

Book 3
Tab 3RC1

Pg 76

Catalog No. 523-076

Printed in U.S.A.

PC 903

Form 30HX-8PD
Replaces: 30HX-7PD